

United States Army
Fort Monmouth, New Jersey

Underground Storage Tank Closure and Site Investigation Report

***Building 104
Main Post-East Area***

NJDEP UST Registration No. 90010-75

January 2001

TABLE OF CONTENTS

EXECUTIVE SUMMARY	iv
1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES	1
1.1 OVERVIEW	1
1.2 SITE DESCRIPTION	2
1.2.1 Geological/Hydrogeological Setting	2
1.3 HEALTH AND SAFETY	4
1.4 REMOVAL OF UNDERGROUND STORAGE TANK	4
1.4.1 General Procedures	4
1.4.2 Underground Storage Tank Excavation and Cleaning	4
1.5 UNDERGROUND STORAGE TANK TRANSPORTATION AND DISPOSAL	5
1.6 MANAGEMENT OF EXCAVATED SOILS	5
2.0 SITE INVESTIGATION ACTIVITIES	6
2.1 OVERVIEW	6
2.2 FIELD SCREENING/MONITORING	6
2.3 SOIL SAMPLING	7
2.4 GROUNDWATER SAMPLING	7
3.0 CONCLUSIONS AND RECOMMENDATIONS	8
3.1 SOIL SAMPLING RESULTS	8
3.2 GROUNDWATER SAMPLING RESULTS	
3.3 CONCLUSIONS AND RECOMMENDATIONS	9

TABLE OF CONTENTS (CONTINUED)

TABLES

Table 1	Summary of Post-Excavation Sampling Activities
Table 2	Post-Excavation Soil Sampling Results
Table 3	Groundwater Sampling Results

FIGURES

Figure 1	Site Location Map
Figure 2	Site Map
Figure 3	Cross Sectional View
Figure 4	Soil Sampling Location Map
Figure 5	Groundwater Sampling Location Map

APPENDICES

Appendix A	NJDEP Standard Reporting Form
Appendix B	Site Assessment Summary
Appendix C	Waste Manifest
Appendix D	UST Disposal Certificate
Appendix E	Soil Analytical Data Package
Appendix F	Groundwater Analytical Data Package
Appendix G	Photographs

EXECUTIVE SUMMARY

UST Closure

On January 27, 1998, a steel underground storage tank (UST) was closed by removal in accordance with New Jersey Department of Environmental Protection (NJDEP) closure procedures at the Main Post-East area of the U.S. Army Fort Monmouth, Fort Monmouth, New Jersey. The UST, NJDEP Registration No. 0090010-75 (Fort Monmouth ID No. 104), was located northeast of Building 104. UST No. 0090010-75 was a 3,000-gallon #2 fuel oil UST. The fill port was located directly above the tank.

Site Assessment

The site assessment was performed by U.S. Army personnel in accordance with the NJDEP *Technical Requirements for Site Remediation* (N.J.A.C. 7:26E) and the NJDEP *Field Sampling Procedures Manual*. The sampling and laboratory analysis conducted during the site assessment were performed in accordance with Section 7:26E-2.1 of the *Technical Requirements for Site Remediation*. Soils surrounding the tank were screened visually and with air monitoring equipment for evidence of contamination. Following removal, the UST was inspected for corrosion holes or punctures. Numerous holes were noted in the UST. Soils at the location of the holes were dark in color and appeared to be contaminated. Approximately 509 cubic yards of potentially contaminated soil were removed from the excavated area and stored at the Fort Monmouth petroleum contaminated soil staging area. Soil samples, which were collected after the removal of the potentially contaminated soil, contained non-detectable levels of TPHC. Groundwater was encountered at 4.0 feet below ground surface and sheen was observed on groundwater.

All post excavation soil samples collected from the UST excavation at Building 104 contained TPHC concentrations below the NJDEP residential direct contact total organic contaminants soil cleanup criteria of 10,000 milligrams per kilogram (mg/kg) (N.J.A.C. 7:26D and revisions dated February 3, 1994). Following receipt of all post-excavation soil sampling results, the excavation was backfilled to grade with a combination of uncontaminated excavated soil and certified clean fill. The excavation site was then restored to its original condition.

In response to the observation of potentially contaminated soil near the shallow water table, five (5) groundwater samples were collected at Building 104. On September 24, 1998, and October 23, 1998, Building 104 was sampled for volatile organic compounds calibrated for xylene plus 15 tentatively identified compounds (VOC's), and semivolatile organic compounds plus 15 tentatively identified compounds (SVOC's). All groundwater analytical results were either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

No further action is proposed in regard to the closure and site assessment of UST No. 90010-75 at Building 104.

1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES

1.1 OVERVIEW

One underground storage tank (UST), New Jersey Department of Environmental Protection (NJDEP) Registration No. 90010-75, was closed at Building 104 at the Main Post-East area of U.S. Army Fort Monmouth, Fort Monmouth, New Jersey on January 27, 1998. Refer to the site location map on Figure 1. This report presents the results of the Department of Public Works' (DPW) implementation of the UST Decommissioning/Closure Plan approved by the NJDEP. The UST was a steel 3,000-gallon tank containing No. 2 fuel oil.

Decommissioning activities for UST No. 90010-75 complied with all applicable Federal, State, and Local laws and ordinances in effect at the date of decommissioning. These laws included but were not limited to N.J.A.C. 7:14B-1 et seq., N.J.A.C. 5:23-1 et seq., and Occupational Safety and Health Administration (OSHA) 1910.146 & 1910.120. All permits including but not limited to the NJDEP approved Decommissioning/Closure Plan were posted onsite for inspection. The decommissioning activities were conducted by DPW personnel who are registered and certified by the NJDEP for performing UST closure activities. Closure of UST No. 90010-75 proceeded under the approval of the NJDEP Bureau of Federal Case Management (NJDEP-BFCM). The Site Assessment Summary form and the UST Subsurface Removal Log form for UST No. 90010-75 are included in Appendices A and B, respectively.

After removal of the potentially contaminated soil, the site was assessed. Based on inspecting the UST, field screening of remaining subsurface soils, and reviewing analytical results of soil samples and groundwater samples, the DPW has concluded that no significant historical discharges are associated with the UST or associated piping.

This UST Closure and Site Investigation Report has been prepared by Versar, to assist the U.S. Army DPW in complying with the NJDEP regulations. The applicable NJDEP regulations at the date of closure were the *Interim Closure Requirements for Underground Storage Tank Systems* (N.J.A.C. 7:14B-1 et seq. October 1990 and revisions dated November 1, 1991).

This report was prepared using information collected at the time of closure. Section 1 of this UST Closure and Site Investigation Report provides a summary of the UST decommissioning activities. Section 2 of this report describes the site investigation activities. Conclusions and recommendations, including the results of the soil sampling and groundwater investigation, are presented in the final section of this report.

1.2 SITE DESCRIPTION

Building 104 is located in the Main Post-East area of the Fort Monmouth Army Base. UST No. 0090010-75 was located northeast of Building 104. A site map is provided on Figure 2.

1.2.1 Geological/Hydrogeological Setting

The following is a description of the geological/hydrogeological setting of the area surrounding Building 104. Included is a description of the regional geology of the area surrounding Fort Monmouth as well as descriptions of the local geology and hydrogeology of the Main Post area.

Regional Geology

Monmouth County lies within the New Jersey Section of the Atlantic Coastal Plain physiographic province. The Main Post, Charles Wood, and the Evans areas are located in what may be referred to as the Outer Coastal Plain subprovince, or the Outer Lowlands.

In general, New Jersey Coastal Plain formations consist of a seaward-dipping wedge of unconsolidated deposits of clay, silt, and gravel. These formations typically strike northeast-southwest with a dip ranging from 10 to 60 feet per mile and were deposited on Precambrian and lower Paleozoic rocks (Zapeczka, 1989). These sediments, predominantly derived from deltaic, shallow marine, and continental shelf environments, date from Cretaceous through the Quaternary Periods. The mineralogy ranges from quartz to glauconite.

The formations record several major transgressive/regressive cycles and contain units which are generally thicker to the southeast and reflect a deeper water environment. More than 20 regional geologic units are present within the sediments of the Coastal Plain. Regressive, upward coarsening deposits are usually aquifers (e.g., Englishtown and Kirkwood Formations, and the Cohansey Sand) while the transgressive deposits act as confining units (e.g., the Merchantville, Marshalltown, and Navesink Formations). The individual thicknesses for these units vary greatly (i.e., from several feet to several hundred feet). The Coastal Plain deposits thicken to the southeast from the Fall Line to greater than 6,500 feet in Cape May County (Brown and Zapeczka, 1990).

Local Geology

Based on the regional geologic map (Jablonski, 1968), the Cretaceous age Red Bank and Tinton Sands outcrop at the Main Post area. The Red Bank sand conformably overlies the Navesink Formation and dips to the southeast at 35 feet per mile. The upper member (Shrewsbury) of the Red Bank sand is a yellowish-gray to reddish brown clayey, medium-to-coarse-grained sand that contains abundant rock fragments, minor mica and glauconite (Jablonski). The lower member (Sandy Hook) is a dark gray to black, medium-to-fine grained sand with abundant clay, mica, and glauconite.

The Tinton sand conformably overlies the Red Bank Sand and ranges from a clayey medium to very coarse grained feldspathic quartz and glauconite sand to a glauconitic coarse sand. The color varies from dark yellowish orange or light brown to moderate brown and from light olive to grayish olive. Glauconite may constitute 60 to 80 percent of the sand fraction in the upper part of the unit (Minard, 1969). The upper part of the Tinton is often highly oxidized and iron oxide encrusted (Minard).

Hydrogeology

The water table aquifer in the Main Post area is identified as part of the "composite confining units," or minor aquifers. The minor aquifers include the Navesink formation, Red Bank Sand, Tinton Sand, Hornerstown Sand, Vincentown Formation, Manasquan Formation, Shark River Formation, Piney Point Formation, and the basal clay of the Kirkwood Formation.

Based on records of wells drilled in the Main Post area, water is typically encountered at depths of 2 to 9 feet below ground surface (bgs). According to Jablonski, wells drilled in the Red Bank and Tinton Sands may produce 2 to 25 gallons per minute (gpm). Some well owners have reported acidic water that requires treatment to remove iron.

Due to the proximity of the Atlantic Ocean to Fort Monmouth, shallow groundwater may be tidally influenced and may flow toward creeks and brooks as the tide goes out, and away from creeks and brooks as the tide comes in. However, an abundance of clay lenses and sand deposits were noted in borings installed throughout Fort Monmouth. Therefore, the direction of shallow groundwater should be determined on a case-by-case basis.

Shallow groundwater is locally influenced within the Main Post area by the following factors:

- tidal influence (based on proximity to the Atlantic Ocean, rivers, and tributaries)
- topography
- nature of the fill material within the Main Post area
- presence of clay and silt lenses in the natural overburden deposits
- local groundwater recharge areas (i.e., streams, lakes)

Due to the fluvial nature of the overburden deposits (i.e., sand and clay lenses), shallow groundwater flow direction is best determined on a case-by-case basis. This is consistent with lithologies observed in borings installed within the Main Post area, which primarily consisted of fine-to-medium grained sands, with occasional lenses or laminations of gravel silt and/or clay.

Building 104 is located approximately 400 feet north of Oceanport Creek, the nearest water body. Based on the Main Post topography, the groundwater flow in the area of Building 104 is anticipated to be to the south.

1.3 HEALTH AND SAFETY

Before, during, and after all decommissioning activities, hazards at the work site which may have posed a threat to the Health and Safety of all personnel who were involved with, or were affected by, the decommissioning of the UST system were minimized. All areas, which posed, or may have been suspected to pose a vapor hazard were monitored by a qualified individual utilizing an organic vapor analyzer (OVA). The individual ascertained if the area was properly vented to render the area safe, as defined by OSHA.

1.4 REMOVAL OF UNDERGROUND STORAGE TANK

1.4.1 General Procedures

- The contractor performing the closure prior to excavation activities identified all underground obstructions (utilities, etc.).
- All activities were carried out with the greatest regard to safety and health and the safeguarding of the environment.
- All excavated soils were visually examined and screened with an OVA for evidence of contamination. Potentially contaminated soils were identified and logged during closure activities.
- Surface materials (i.e., asphalt, concrete, etc.) were excavated and staged separately from all soil and recycled in accordance with all applicable regulations and laws.
- A Sub-Surface Evaluator from the DPW was present during all site assessment activities.

1.4.2 Underground Storage Tank Excavation and Cleaning

Prior to UST decommissioning activities, surficial soil was removed to expose the UST and associated piping. The appurtenant copper piping was found lying in the excavation disconnected from the UST. The UST was then purged to remove vapors prior to cutting and removal of the piping. After removal of the associated piping, a manway was made in the UST to allow for proper cleaning. The UST was completely emptied of all liquids prior to removal from the ground. Approximately 3,000 gallons of liquid from the UST and its associated piping were transported by Lionetti Oil Recovery Company to Lionetti Oil Recovery Company, Inc. facility, a NJDEP-approved petroleum recycling and disposal company located in Old Bridge, New Jersey. Refer to Appendix C for the waste manifest.

The UST was cleaned prior to removal from the excavation in accordance with the NJDEP regulations. After the UST was removed from the excavation, it was staged on polyethylene sheeting and examined for holes. Numerous holes were observed during the inspection by the Sub-Surface Evaluator. Soils at the location of the holes were dark in color and appeared to be contaminated. Approximately 509 cubic yards of potentially contaminated soil were removed from the excavated area and stored at the Fort Monmouth petroleum contaminated soil staging area. Soil screening was also performed along the piping run associated with the UST closure. No contamination was noted anywhere along

the piping length. Groundwater was encountered at 4.0 feet below ground surface and sheen was observed on groundwater. See Figure 3 for a cross-sectional view of the excavated area.

1.5 UNDERGROUND STORAGE TANK TRANSPORTATION AND DISPOSAL

The tank was transported in compliance with all applicable regulations and laws to Mazza and Sons, Inc., Metal Recyclers. Please refer to Appendix D for the UST Disposal Certificate and Appendix G for photographs of the tank.

The UST was labeled prior to transport with the following information:

- Site of origin
- Contact person
- NJDEP UST Facility ID number
- Former contents
- Destination site
- Date

1.6 MANAGEMENT OF EXCAVATED SOILS

Based on OVA air monitoring and TPHC analysis results from the post-excavation soil samples, approximately 509 cubic yards of potentially contaminated soil were removed from the UST excavation. All potentially contaminated soils were stockpiled separately from other excavated material and were placed on and covered with polyethylene sheets. Potentially contaminated soils were transported to the soil staging area. Soils that did not exhibit signs of contamination were used as backfill following the removal of the UST. Groundwater was encountered at 4.0 feet below ground surface and sheen was observed on groundwater.

2.0 SITE INVESTIGATION ACTIVITIES

2.1 OVERVIEW

The Site Investigation was managed and carried out by U.S. Army DPW personnel. All analyses were performed and reported by U.S. Army Fort Monmouth Environmental Laboratory, a NJDEP certified testing laboratory. All sampling was performed under the direct supervision of a NJDEP Certified Sub-Surface Evaluator according to the methods described in the NJDEP *Field Sampling Procedures Manual* (1992). Sampling frequency and parameters analyzed complied with the NJDEP document *Interim Closure Requirements for Underground Storage Tank Systems* (October 1990 and revisions dated November 1, 1991) which was the applicable regulation at the date of the closure. The Fort Monmouth DPW Environmental Office maintains all records of the Site Investigation activities.

The following Parties participated in Closure and Site Investigation Activities:

- Subsurface Evaluator: Charles Appleby
Employer: U.S. Army, Fort Monmouth
Phone Number: (908) 532-0989
NJDEP Certification No.: 2056
- Analytical Laboratory: U.S. Army Fort Monmouth Environmental laboratory
Contact Person: Daniel K. Wright
Phone Number: (908) 532-4359
NJDEP Company Certification No.: 13461
- Hazardous Waste Hauler: Lorco Petroleum Services
Contact Person: Don Taguinot
Phone Number: (908) 721-0900

2.2 FIELD SCREENING/MONITORING

Field screening was performed by a NJDEP Certified Sub-Surface Evaluator using an OVA and visual observations to identify potentially contaminated material. Soil excavated from around the tank exhibited evidence of potential contamination. Approximately 509 cubic yards of potentially petroleum contaminated soil were removed from the excavated area and transported to the Fort Monmouth petroleum contaminated soil holding area. Soils were removed from the excavation until no evidence of contamination remained. Groundwater was encountered at 4.0 feet below ground surface and sheen was observed on groundwater.

2.3 SOIL SAMPLING

On February 10, 1998, following the removal of the UST and associated piping, post-excavation soil samples A, B, C, D, E, F, G, H, I, J, K, L, and DUP G were collected from a total of twelve (12) locations of the UST excavation. Samples A, B, C, D, E, F, G, H, and DUP G were collected along the excavation floor at a depth of 9.0 feet bgs. Sidewall samples H, I, J, K, and L were collected at a depth of 3.5 feet bgs. All samples were analyzed for total petroleum hydrocarbons (TPHC) and total solids.

On October 24, 1996, following the removal of 509 cubic yards of potentially petroleum contaminated soil from the excavated area, post-excavation soil samples A, B, C, D, E, F, G, H, I, J, K, L, M, N, O, and DUP G were collected from a total of fifteen (15) locations of the UST excavation. Samples A, B, C, D, E, F, G, H, and DUP G were collected along the excavation floor at a depth of 9.0 feet bgs. Sidewall samples I, J, K, L, M, N, and O were collected at a depth of 3.5 feet bgs. All samples were analyzed for total petroleum hydrocarbons (TPHC) and total solids.

U.S. Army personnel in accordance with the NJDEP Technical Requirements and the NJDEP Field Sampling Procedures Manual performed the site assessment. A summary of sampling activities including parameters analyzed is provided in Table 1. The post-excavation soil samples were collected using NJDEP *Field Sampling Procedures Manual* (1992) standard sampling procedures. Following soil sampling activities, the samples were chilled and delivered to U.S. Army Fort Monmouth Environmental Laboratory located in Fort Monmouth, New Jersey, for analysis.

2.4 GROUNDWATER SAMPLING

On September 24, 1998, and October 23, 1998, Building 104 was sampled for volatile organic compounds calibrated for xylene plus 15 tentatively identified compounds (VOC's), and semivolatile organic compounds plus 15 tentatively identified compounds (SVOC's). Sampling and analysis were performed in accordance with the NJDEP *Field Sampling Procedures Manual* and the *Technical Requirements For Site Remediation*. Refer to Appendix F for the field sampling documentation.

3.0 CONCLUSIONS AND RECOMMENDATIONS

3.1 SOIL SAMPLING RESULTS

To evaluate soil conditions following removal of the UST and associated piping, post-excavation soil samples were collected on February 10, 1998, and February 18, 1998 from a total of twenty seven (27) locations. All samples were analyzed for TPHC and total solids. The post-excavation sampling results were compared to the NJDEP residential direct contact total organic contaminants soil cleanup criteria of 10,000 mg/kg (N.J.A.C. 7:26D and revisions dated February 3, 1994). A summary of the analytical results and comparison to the NJDEP soil cleanup criteria is provided in Table 2 and the soil sampling locations are shown on Figure 4. The analytical data package is provided in Appendix E.

All post-excavation soil samples collected on February 10, 1998, and February 18, 1998, from the UST excavation and from below piping associated with the UST contained concentrations of TPHC below the NJDEP soil cleanup criteria. Soil samples, which were collected after the removal of the potentially contaminated soil, contained non-detectable levels of TPHC.

3.2 GROUNDWATER SAMPLING RESULTS

The samples collected from Building 104 on September 24, 1998, contained toluene at a concentration of 1.26 ug/l, 2-methylnaphthalene at a concentration of 3.78 ug/l, phenanthrene at a concentration of 1.77 ug/l, and pyrene at a concentration of 1.10 ug/l. No other compounds were detected.

The samples collected from Building 104 on October 23, 1998, contained phenanthrene at a concentration of 1.77 ug/l. No other compounds were detected.

A summary of the analytical results and comparison to the NJDEP groundwater cleanup criteria is provided in Table 3 and the groundwater sampling locations are shown on Figure 5. The analytical data package is provided in Appendix F. The full data package, including quality control, is on file at U.S. Army Fort Monmouth, Fort Monmouth, New Jersey.

Groundwater samples collected on September 24, 1998, and October 23, 1998, were either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

No further action is proposed in regard to the closure and site assessment of UST No. 90010-75 at Building 104.

3.3 CONCLUSIONS AND RECOMMENDATIONS

The analytical results for all post-excavation soil samples collected from the UST closure excavation at Building 104 were below the NJDEP soil cleanup criteria for total organic contaminants.

Based on the post-excavation sampling results, soil with TPHC concentrations exceeding the NJDEP soil cleanup criteria for total organic contaminants of 10,000 mg/kg, do not exist in the former location of the UST or associated piping.

Based on the analytical results of the groundwater samples collected at Building 104 on September 24, 1998, and October 23, 1998, groundwater quality at Building 104 was either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

No further action is proposed in regard to the closure and site assessment of UST No. 90010-75 at Building 104.

7

وتنص

f 7

42-104

7. 2

222

F 1

6. 200

1

6. 25

٤٠

42. 20

12

وہ

52

لہذا

52

١٠٠

41

TABLES

لہذا

50

قر. حـ

51

6. 4

74

۱۲۸

11

ز. کا

[3]

422

63

۱۳۸۵

51

62-9

631

فريق

()

10

TABLE 1

SUMMARY OF POST-EXCAVATION SAMPLING ACTIVITIES
BUILDING 104, MAIN POST-EAST AREA
FORT MONMOUTH, NEW JERSEY

Page 1 of 3

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	NJDEP Method
A	2/10/98	2/11/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
B	2/10/98	2/11/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
C	2/10/98	2/11/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
D	2/10/98	2/11/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
E	2/10/98	2/11/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
F	2/10/98	2/11/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
G	2/10/98	2/11/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
H	2/10/98	2/11/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
**I	2/10/98	2/11/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
J	2/10/98	2/11/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
K	2/10/98	2/11/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
L	2/10/98	2/11/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
DUP G	2/10/98	2/11/98	Soil	Post-Excavation	TPHC	OQA-QAM-025

Note:

* TPHC Total Petroleum Hydrocarbons

** Sample was further remediated and resampled

TABLE 1

SUMMARY OF POST-EXCAVATION SAMPLING ACTIVITIES
BUILDING 104, MAIN POST-EAST AREA
FORT MONMOUTH, NEW JERSEY

Page 2 of 3

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	NJDEP Method
A	2/18/98	2/21/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
B	2/18/98	2/21/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
C	2/18/98	2/21/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
D	2/18/98	2/21/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
E	2/18/98	2/21/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
F	2/18/98	2/21/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
G	2/18/98	2/21/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
H	2/18/98	2/21/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
I	2/18/98	2/21/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
J	2/18/98	2/21/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
K	2/18/98	2/21/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
L	2/18/98	2/21/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
N	2/18/98	2/21/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
O	2/18/98	2/21/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
P	2/18/98	2/21/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
DUP G	2/18/98	2/21/98	Soil	Post-Excavation	TPHC	OQA-QAM-025

Note:

* TPHC Total Petroleum Hydrocarbons

TABLE 1

SUMMARY OF SAMPLING ACTIVITIES
BUILDING 104, MAIN POST-EAST AREA
FORT MONMOUTH, NEW JERSEY

Page 3 of 3

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	Sampling Method**
3914.01	9/24/98	9/28/98	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
3914.02	9/24/98	9/28/98	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
3914.03	9/24/98	9/28/98	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
3914.04	9/24/98	9/28/98	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
3914.05	9/24/98	9/28/98	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
3914.06	9/24/98	9/28/98	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
3914.07	9/24/98	9/28/98	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
3914.08	9/24/98	9/28/98	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
4002.04	10/23/98	10/26/98	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
4002.05	10/23/98	10/26/98	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
4002.06	10/23/98	10/26/98	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
4002.07	10/23/98	10/26/98	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
4002.08	10/23/98	10/26/98	Aqueous	Groundwater	VOCs, SVOCs	PPNDP

Note:

- *VOCs: Volatile Organic Compounds plus 15 tentatively identified compounds
 *SVOCs: Semivolatile organic compounds plus 15 tentatively identified compounds
 **PPNDP: Passively Placed Narrow Diameter Point

TABLE 2

POST-EXCAVATION SOIL SAMPLING RESULTS
 BUILDING 104, MAIN POST-EAST AREA
 FORT MONMOUTH, NEW JERSEY

Page 1 of 4

Sample ID/ Depth	Sample Laboratory ID	Sample Date	Analysis Date	Analytical Parameters	Method Detection Limit (mg/kg)	Compound of Concern	Results (mg/kg) *	NJDEP Soil Cleanup Criteria ** (mg/kg)	Exceeds Cleanup Criteria
A/9.0' =	3335.01	2/10/98	2/11/98	Total Solid	--	--	73.00 %	--	--
				TPHC	210	yes	ND	10,000	No
B/9.0' =	3335.02	2/10/98	2/11/98	Total Solid	--	--	70.44 %	--	--
				TPHC	222	Yes	ND	10,000	No
C/9.0' =	3335.03	2/10/98	2/11/98	Total Solid	--	--	72.21 %	--	--
				TPHC	217	Yes	ND	10,000	No
D/9.0' =	3335.04	2/10/98	2/11/98	Total Solid	--	--	72.53 %	--	--
				TPHC	204	yes	ND	10,000	No
E/9.0' =	3335.05	2/10/98	2/11/98	Total Solid	--	--	73.17 %	--	--
				TPHC	213	Yes	ND	10,000	No
F/9.0' =	3335.06	2/10/98	2/11/98	Total Solid	--	--	71.75 %	--	--
				TPHC	218	Yes	ND	10,000	No
G/9.0' =	3335.07	2/10/98	2/11/98	Total Solid	--	--	71.75 %	--	--
				TPHC	216	yes	ND	10,000	No

Note:

- * Total Solid results are expressed as a percentage.
 ** NJDEP Residential Direct Contact soil cleanup criteria for total organics
 ND Not detected above stated method detection limit
 TPHC Total Petroleum Hydrocarbons

TABLE 2

POST-EXCAVATION SOIL SAMPLING RESULTS
BUILDING 104, MAIN POST-EAST AREA
FORT MONMOUTH, NEW JERSEY

Page 2 of 4

Sample ID/ Depth	Sample Laboratory ID	Sample Date	Analysis Date	Analytical Parameters	Method Detection Limit (mg/kg)	Compound of Concern	Results (mg/kg) *	NJDEP Soil Cleanup Criteria ** (mg/kg)	Exceeds Cleanup Criteria
H/9.0' =	3335.08	2/10/98	2/11/98	Total Solid	--	--	71.00 %	--	--
				TPHC	221	yes	ND	10,000	No
***I/3.5' =	3335.09	2/10/98	2/11/98	Total Solid	--	--	82.87 %	--	--
				TPHC	186	Yes	1275.88	10,000	No
J/3.5' =	3335.10	2/10/98	2/11/98	Total Solid	--	--	83.98 %	--	--
				TPHC	178	Yes	ND	10,000	No
K/3.5' =	3335.11	2/10/98	2/11/98	Total Solid	--	--	79.23 %	--	--
				TPHC	194	yes	ND	10,000	No
L/3.5' =	3335.12	2/10/98	2/11/98	Total Solid	--	--	82.14 %	--	--
				TPHC	181	Yes	ND	10,000	No
DUP G/9.0' =	3335.13	2/10/98	2/11/98	Total Solid	--	--	71.33 %	--	--
				TPHC	216	yes	ND	10,000	No

Note:

- * Total Solid results are expressed as a percentage.
- ** NJDEP Residential Direct Contact soil cleanup criteria for total organics
- *** Sample location was further remediated and resampled
- ND Not detected above stated method detection limit
- TPHC Total Petroleum Hydrocarbons

TABLE 2

POST-EXCAVATION SOIL SAMPLING RESULTS
 BUILDING 104, MAIN POST-EAST AREA
 FORT MONMOUTH, NEW JERSEY

Page 3 of 4

Sample ID/ Depth	Sample Laboratory ID	Sample Date	Analysis Date	Analytical Parameters	Method Detection Limit (mg/kg)	Compound of Concern	Results (mg/kg) *	NJDEP Soil Cleanup Criteria ** (mg/kg)	Exceeds Cleanup Criteria
A/9.0' =	3349.01	2/18/98	2/19/98	Total Solid	--	--	69.71 %	--	--
				TPHC	215	yes	ND	10,000	No
B/9.0' =	3349.02	2/18/98	2/19/98	Total Solid	--	--	86.18 %	--	--
				TPHC	174	Yes	ND	10,000	No
C/9.0' =	3349.03	2/18/98	2/19/98	Total Solid	--	--	77.71 %	--	--
				TPHC	199	Yes	ND	10,000	No
D/9.0' =	3349.04	2/18/98	2/19/98	Total Solid	--	--	72.11 %	--	--
				TPHC	211	yes	ND	10,000	No
E/9.0' =	3349.05	2/18/98	2/19/98	Total Solid	--	--	77.36 %	--	--
				TPHC	193	Yes	ND	10,000	No
F/9.0' =	3349.06	2/18/98	2/19/98	Total Solid	--	--	72.19 %	--	--
				TPHC	210	Yes	ND	10,000	No
G/9.0' =	3349.07	2/18/98	2/19/98	Total Solid	--	--	80.19 %	--	--
				TPHC	193	yes	ND	10,000	No

Note:

- * Total Solid results are expressed as a percentage.
 ** NJDEP Residential Direct Contact soil cleanup criteria for total organics
 ND Not detected above stated method detection limit
 TPHC Total Petroleum Hydrocarbons

TABLE 2

POST-EXCAVATION SOIL SAMPLING RESULTS
 BUILDING 104, MAIN POST-EAST AREA
 FORT MONMOUTH, NEW JERSEY

Page 4 of 4

Sample ID/ Depth	Sample Laboratory ID	Sample Date	Analysis Date	Analytical Parameters	Method Detection Limit (mg/kg)	Compound of Concern	Results (mg/kg) *	NJDEP Soil Cleanup Criteria ** (mg/kg)	Exceeds Cleanup Criteria
H/9.0' =	3349.08	2/18/98	2/19/98	Total Solid	--	--	77.02 %	--	--
				TPHC	198	yes	ND	10,000	No
I/3.5' =	3349.09	2/18/98	2/19/98	Total Solid	--	--	86.34 %	--	--
				TPHC	177	Yes	ND	10,000	No
J/3.5' =	3349.10	2/18/98	2/19/98	Total Solid	--	--	82.07 %	--	--
				TPHC	185	Yes	ND	10,000	No
K/3.5' =	3349.11	2/18/98	2/19/98	Total Solid	--	--	79.83 %	--	--
				TPHC	193	yes	ND	10,000	No
L/3.5' =	3349.12	2/18/98	2/19/98	Total Solid	--	--	79.87 %	--	--
				TPHC	195	Yes	ND	10,000	No
M/3.5' =	3349.13	2/18/98	2/19/98	Total Solid	--	--	81.59 %	--	--
				TPHC	189	Yes	ND	10,000	No
N/3.5' =	3349.14	2/18/98	2/19/98	Total Solid	--	--	81.91 %	--	--
				TPHC	188	yes	ND	10,000	No
O/3.5' =	3349.15	2/18/98	2/19/98	Total Solid	--	--	87.20 %	--	--
				TPHC	172	Yes	ND	10,000	No
DUP G/9.0' =	3349.16	2/18/98	2/19/98	Total Solid	--	--	75.26 %	--	--
				TPHC	206	yes	ND	10,000	No

Note:

- * Total Solid results are expressed as a percentage.
 ** NJDEP Residential Direct Contact soil cleanup criteria for total organics
 ND Not detected above stated method detection limit
 TPHC Total Petroleum Hydrocarbons

TABLE 3

SUMMARY OF ANALYTICAL RESULTS FOR GROUNDWATER
BUILDING NO. 104
FORT MONMOUTH, NEW JERSEY

Sample	Sample Date	Toulene	2-Methyl naphthalene	Phenanthrene	Pyrene
UNITS:		ug/L	ug/L	ug/L	ug/L
NJDEP CRITERIA:		1000	NLE	NLE	200
104-1	09/24/98	1.26	3.78	1.77	ND
104-2	09/24/98	ND	ND	ND	ND
104-3	09/24/98	ND	ND	ND	ND
104-4	09/24/98	ND	ND	ND	ND
104-5	09/24/98	ND	ND	ND	1.10
104-1	10/23/98	ND	ND	2.73	ND
104-2	10/23/98	ND	ND	ND	ND
104-3	10/23/98	ND	ND	ND	ND
104-4	10/23/98	ND	ND	ND	ND
104-5	10/23/98	ND	ND	ND	ND

Abbreviations:

ND: Not Detected.
ug/L: Micrograms per liter.
NLE: No limit established.

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65
66
67
68
69
70
71
72
73
74
75
76
77
78
79
80
81
82
83
84
85
86
87
88
89
90
91
92
93
94
95
96
97
98
99
100

FIGURES

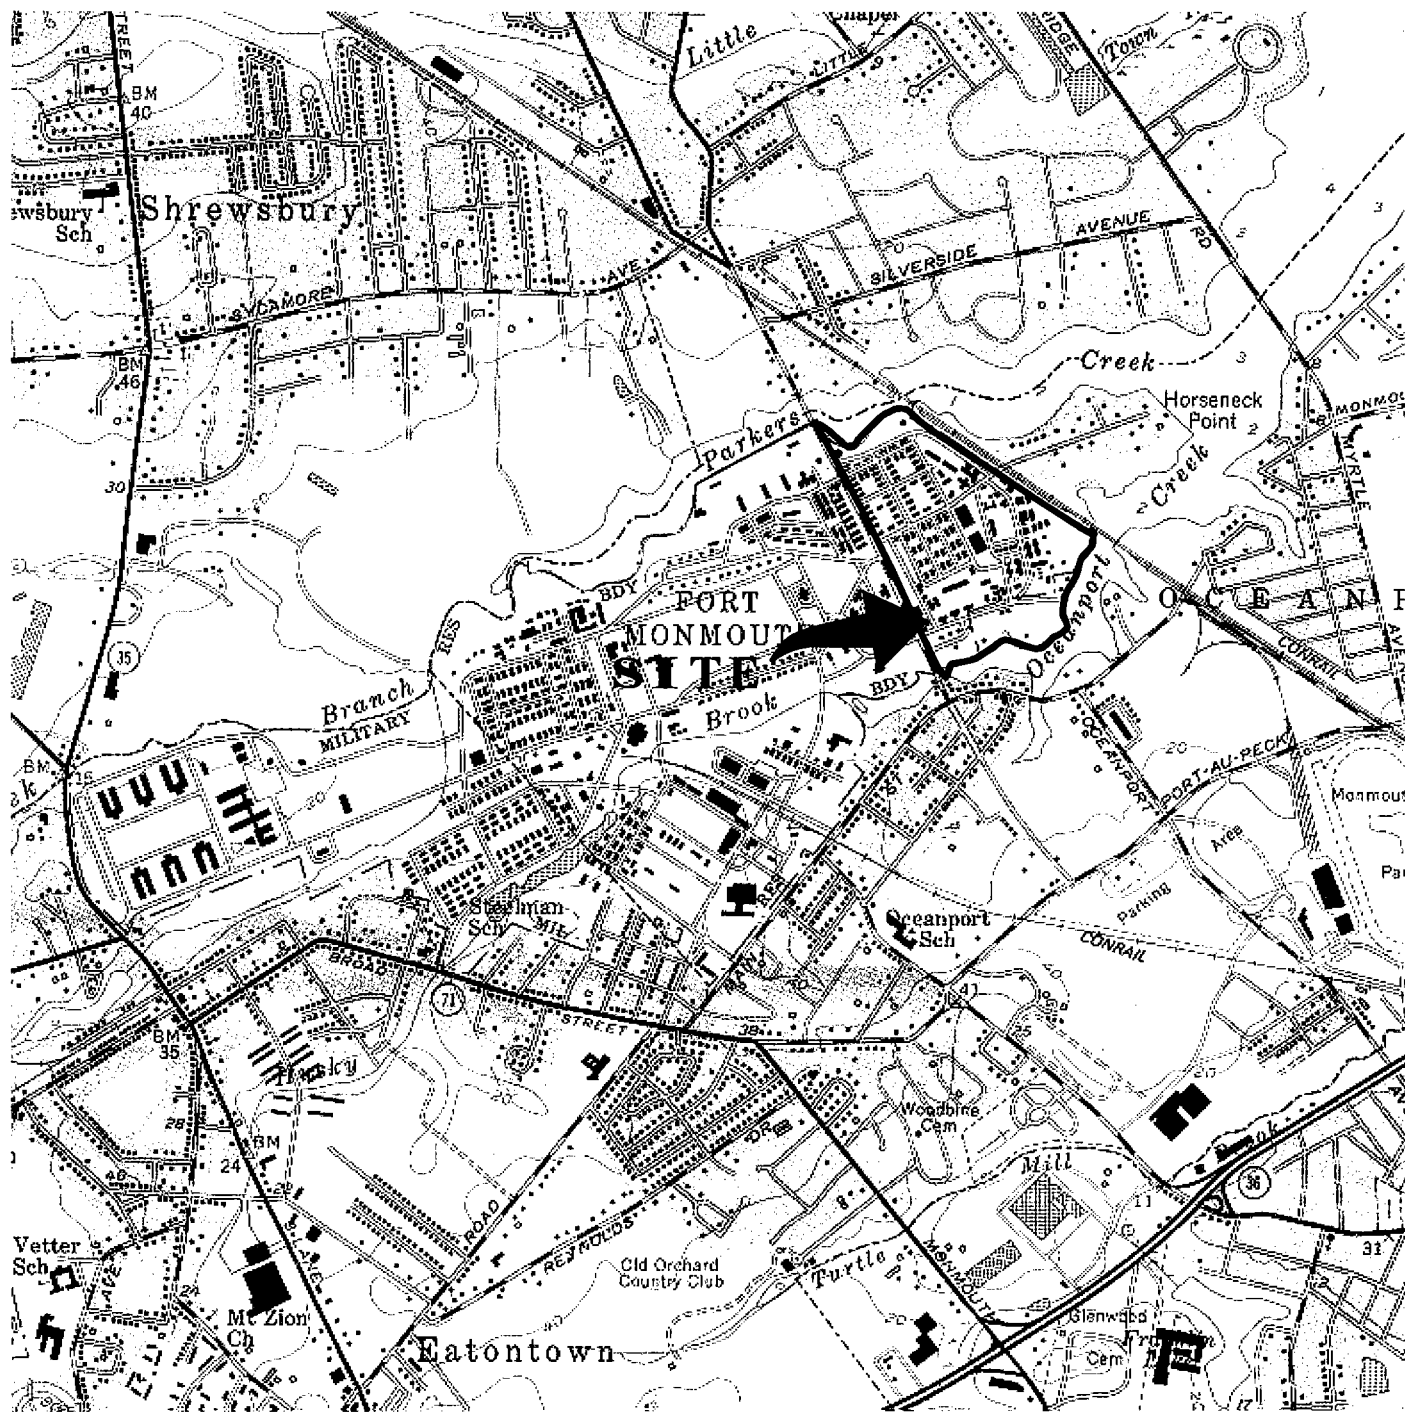


FIGURE 1

LOCATION MAP
Building 104
Main-Post East
Fort Monmouth Army Base
Monmouth County, NJ

VERSAR
 Engineers, Managers, Scientists, & Planners
 Bristol, PA

Scale: 1" = 2000'

Date: Jan. 1998

LONG BRANCH, N. J.

40073-C8-TF-024

1954

PHOTOREVISED 1981

DMA 6164 I SE-SERIES V822

NEW
JERSEY

QUADRANGLE LOCATION

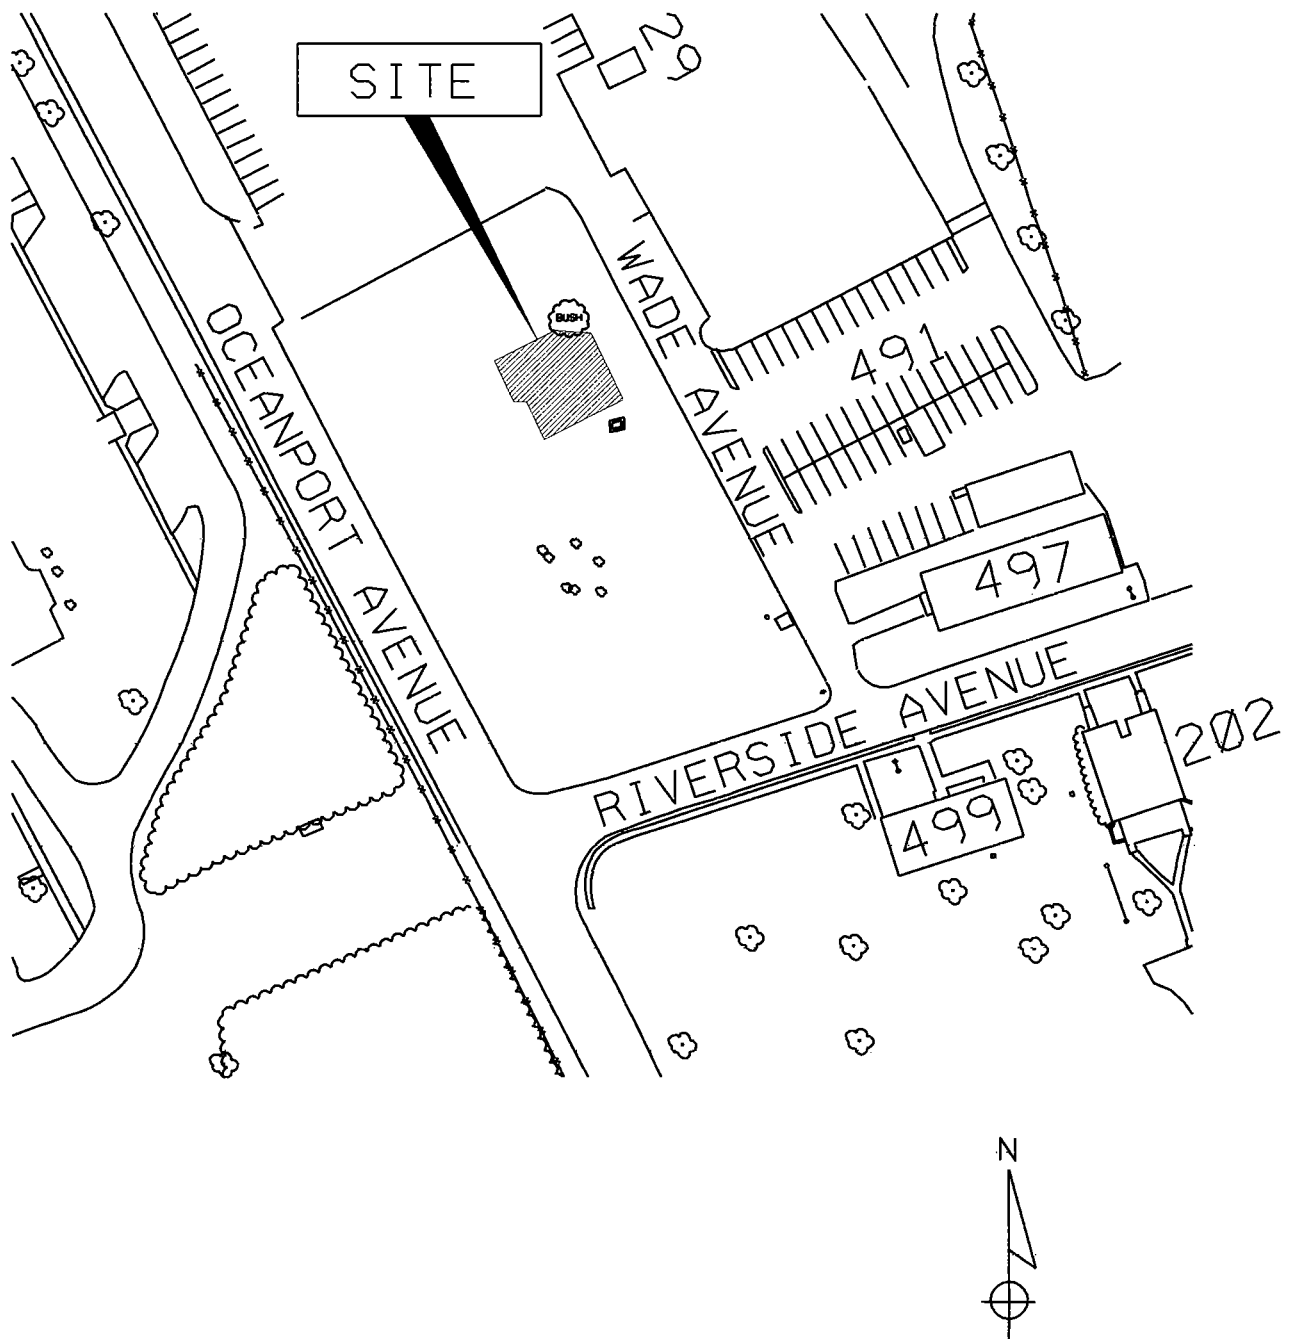
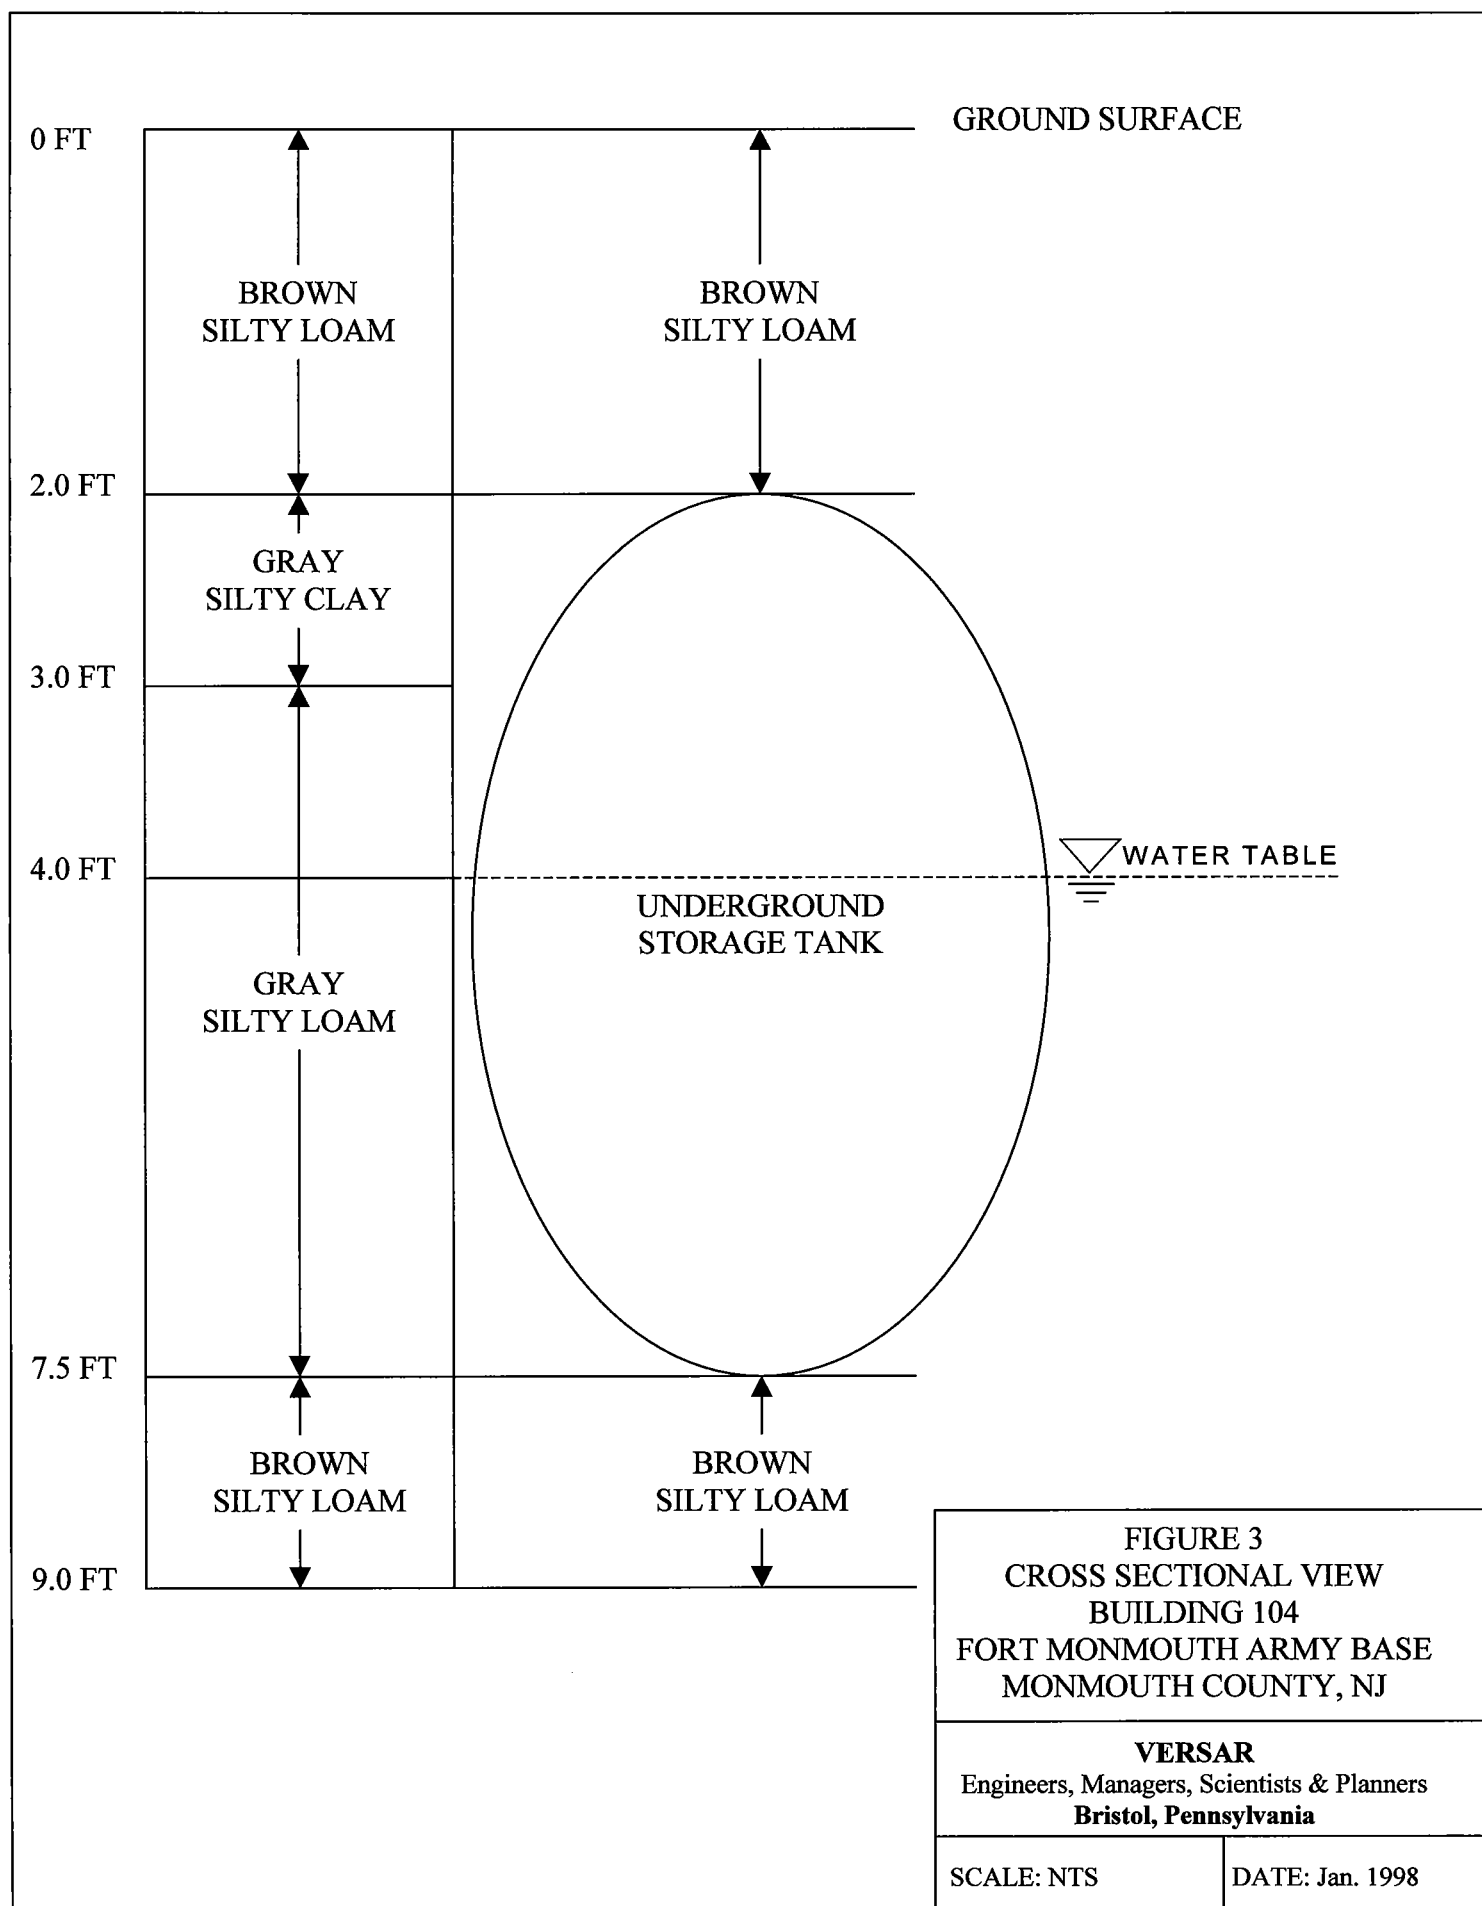


FIGURE 2
 SITE MAP
 BUILDING 104
 FORT MONMOUTH ARMY BASE
 MONMOUTH COUNTY, NJ

VERSAR
 ENGINEERS, SCIENTISTS & PLANNERS
 BRISTOL, PA.

SCALE: 1" = 100'

DATE: JAN 1998




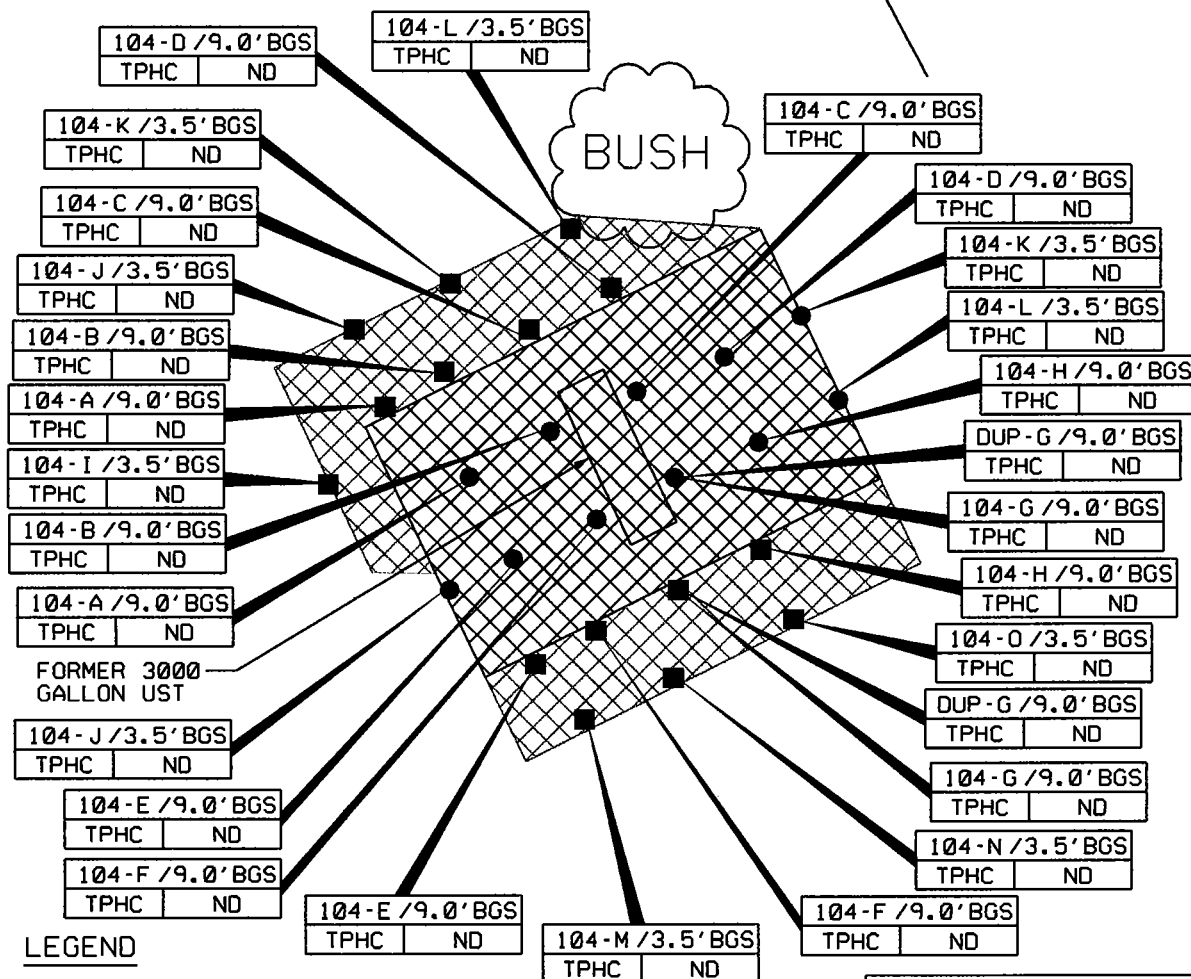


FIGURE 4
SOIL SAMPLING LOCATION MAP
BUILDING 104
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
ENGINEERS, SCIENTISTS & PLANNERS
BRISTOL, PA.

SCALE: 1" = 20'


DATE: JAN 1998

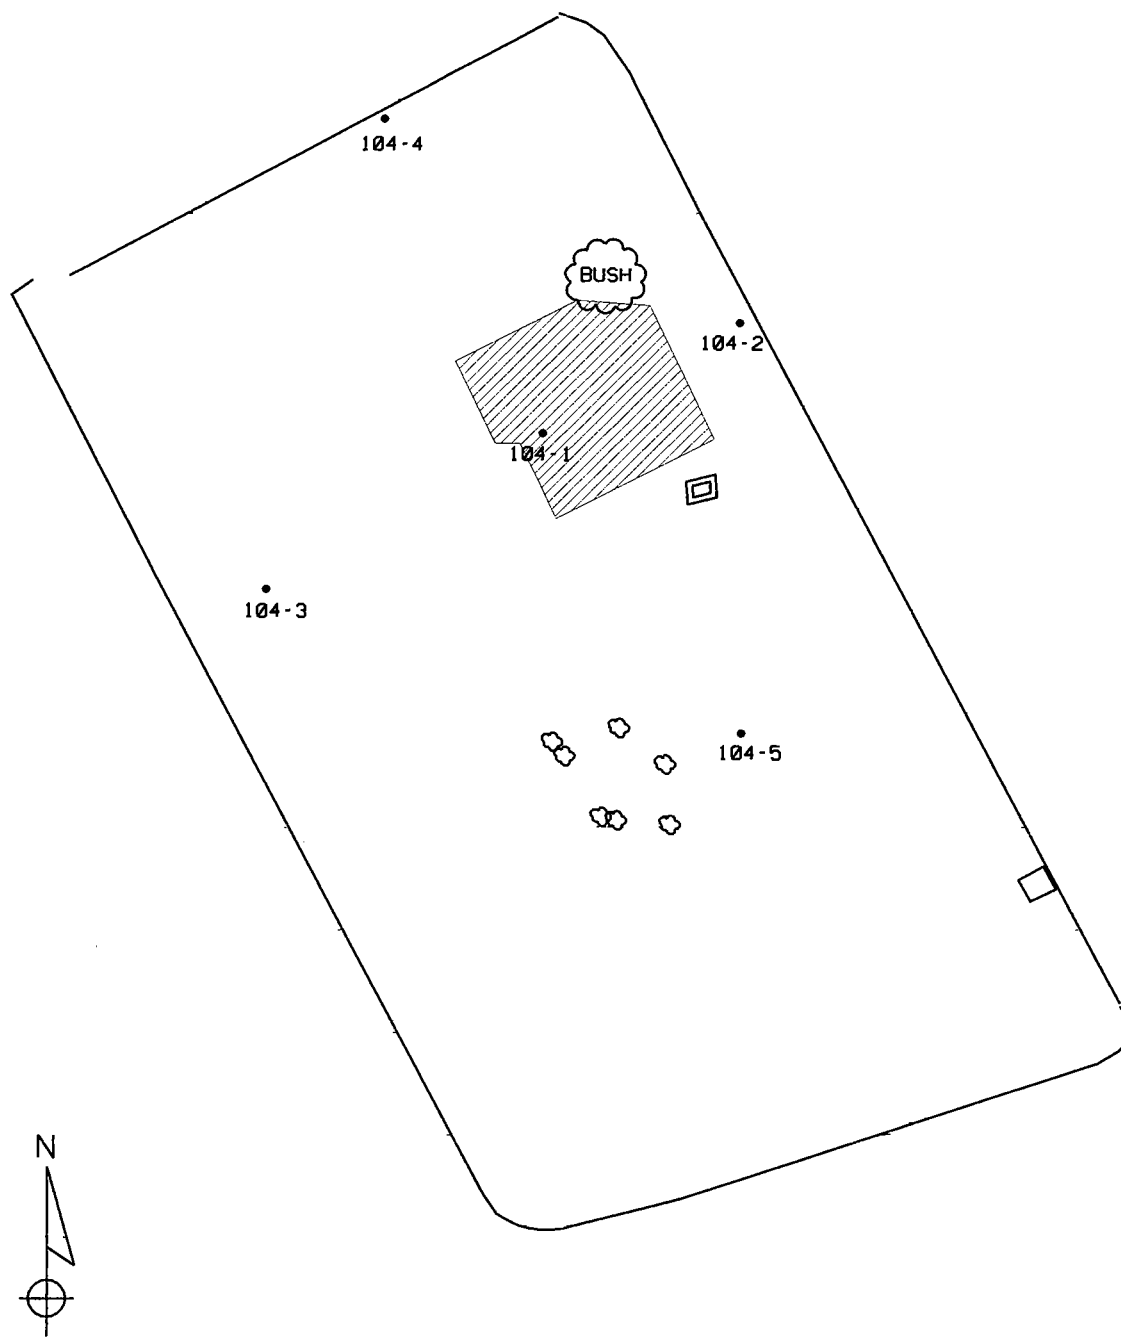

LEGEND



GROUNDWATER SAMPLE LOCATION
(SEPTEMBER 24, 1998 AND OCTOBER 23, 1998)



LIMIT OF EXCAVATION
(FEBRUARY 18, 1998)

NOTES:

1. ND=INDICATES COMPOUND NOT DETECTED
2. NLE= NO LIMIT ESTABLISHED
3. ALL RESULTS IN UG/L
4. BGS = BELOW GROUND SURFACE
5. SEE TABLE 3 FOR GROUNDWATER RESULTS

FIGURE 5
GROUNDWATER SAMPLING MAP
BUILDING 104
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
ENGINEERS, SCIENTISTS & PLANNERS
BRISTOL, PA.

SCALE: 1" = 50'

DATE: JAN 1998

APPENDIX A

NJDEP-STANDARD REPORTING FORM

NEW JERSEY DEPARTMENT OF ENVIRONMENTAL PROTECTION
DIVISION OF RESPONSIBLE PARTY SITE REMEDIATION
BUREAU OF APPLICABILITY AND COMPLIANCE
Registration and Billing Unit
CN 028, Trenton, N.J. 08625-0028
1-609-984-3156

FOR STATE USE ONLY

Check in ☐ Yes ☐ No

STATUS Active Inactive COMCODE

☐ ☐ ☐ ☐ ☐ ☐

UNDERGROUND STORAGE TANK
FACILITY QUESTIONNAIRE

COPY

FACILITY UST # 90010

Bldg. 104

Completion of this Registration Questionnaire will satisfy the registration requirements of the Underground Storage of Hazardous Substances Act, N.J.S.A. 58:10A-21, and the Registration and Billing Regulations N.J.A.C. 7:14B-2.

[Check appropriate box(es)]

- A. ☐ Is this a registration of a proposed or newly installed underground storage tank? (This form must be filed at least 30 days prior to operation)
B. ☒ Is this a registration of an existing underground storage tank not presently registered?
C. ☒ Is this a correction or amendment to an existing facility registration? UST # 90010
D. ☐ There have been no changes to the facility registration since last submittal. UST # _____ (Go to certification page for signatures)

If "C" is checked above, please check the appropriate type of change(s) below

- | | | |
|--|--|--|
| ☐ Facility Name and/or Address Change | ☐ Type of Product(s) Stored | ☐ Financial Responsibility Change |
| ☐ Owner Name and/or Address Change | ☐ Spills, Leaks, Releases | ☐ Substantial Modification(s) |
| ☐ Facility Operator and/or Address Change | ☐ Tank(s) and/or Piping Changes | ☐ Sale or Transfer (Complete Questions 4,5,6 & 13D) |
| ☐ Owner Contact Person Change | ☐ Closure (Complete Question #13) | ☐ Other (please specify) |

SECTION A - GENERAL FACILITY INFORMATION

1. Facility Name _____

2. Facility Location MAIN POST EAST
NUMBER AND STREET

CITY OR MUNICIPALITY

COUNTY STATE ZIP CODE BLOCK LOT
N.J.

3. Facility Operator _____ Contact
PERSON OR TITLE Tele. No. (Area Code) (Extension)
Operator Address _____
#2) _____
NUMBER AND STREET

CITY OR MUNICIPALITY

STATE ZIP CODE

4. Tank Owner _____

5. Tank Owner Address _____
NUMBER AND STREET

CITY OR MUNICIPALITY

STATE ZIP CODE

Contact Person (Tank Owner) _____ Contact
Tele. No. (Area Code) (Extension)

7. EPA ID # _____

11. Is a copy of the facility site plan submitted with this registration pursuant to N.J.A.C. 7:14B-2? ☐ YES ☐ NO

1. Tank Identification Number	TANK NO.	TANK NO.	TANK NO.	TANK NO.	TANK NO.
Bldg. 104	00735				
2. CAS Number (hazardous substances only)	NA				
3. Date Tank Installed (Month/Day/Year)	Mo. Day Year Unknown	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year
4. Tank Size (gallons)	3000				
5. Tank Contents (Mark one "X" for each tank)					
A. Lead gasoline					
B. Unleaded gasoline					
C. Alcohol enriched gasoline					
D. Light diesel fuel (No. 1-D)					
E. Medium diesel fuel (No. 2-D)					
F. Waste Oil					
G. Kerosene (No. 1)					
H. Home heating oil (No. 2)	X				
J. Heating oil (No. 4)					
K. Heavy heating oil (No. 6)					
L. Aviation fuel					
M. Motor oil					
N. Lubricating oil					
P. Sewage					
Q. Sewage sludge					
R. Other hazardous substances (specify)					
S. Hazardous waste (specify ID number)					
T. Mixtures (please specify)					
U. Emergency spill tank (specify substance)					
V. Other petroleum products (please specify)					
W. Other (please specify)					
6. Tank & Piping Construction (Mark one each for both tank & piping)	Tank Piping	Tank Piping	Tank Piping	Tank Piping	Tank Piping
A. Bare Steel	X X				
B. Cathodically protected steel					
C. Fiberglass-coated steel					
D. Fiberglass-reinforced plastic					
E. Internally lined					
F. Other (please specify)					
7. Tank & Piping Structure (Mark one each for both tank & piping)	Tank Piping	Tank Piping	Tank Piping	Tank Piping	Tank Piping
A. Single wall	X X				
B. Double wall					
C. Other (please specify)					
8. Type of Monitoring/Detection System (Mark all that apply for both tank & piping)	Tank Piping	Tank Piping	Tank Piping	Tank Piping	Tank Piping
A. Statistical Inventory Reconciliation					
B. Manual Tank Gauging					
C. Inventory Control					
D. Interstitial					
E. Precision Test					
F. Ground water observation wells					
G. Vapor observation wells					
H. In-tank (automatic) monitoring gauge					

Bldg. 104

Tank Identification Number	TANK NO. 00725	TANK NO. [] [] [] []	TANK NO. [] [] [] []	TANK NO. [] [] [] []	TANK NO. [] [] [] []
8. Type of Monitoring/Detection System	Tank Piping	Tank Piping	Tank Piping	Tank Piping	Tank Piping
K. None	☒ ☒	☐ ☐	☐ ☐	☐ ☐	☐ ☐
L. Other (please specify)					
9. Overfill Protection (tank only) (Mark one X for each tank)					
A. Yes	☐	☐	☐	☐	☐
B. No	☒	☐	☐	☐	☐
10. Spill Containment Around Fill Pipe (Mark one X for each tank)					
A. Yes	☐	☐	☐	☐	☐
B. No	☒	☐	☐	☐	☐
11. Tank Status (Mark one X for each tank)	Tank Piping	Tank Piping	Tank Piping	Tank Piping	Tank Piping
A. In-use	☐ ☐	☐ ☐	☐ ☐	☐ ☐	☐ ☐
B. Empty less than 12 months	☐ ☐	☐ ☐	☐ ☐	☐ ☐	☐ ☐
C. Empty 12 months or more	☐ ☐	☐ ☐	☐ ☐	☐ ☐	☐ ☐
D. Emergency spill tank (sump)	☐ ☐	☐ ☐	☐ ☐	☐ ☐	☐ ☐
E. Emergency backup generator tank	☐ ☐	☐ ☐	☐ ☐	☐ ☐	☐ ☐
F. Abandoned in Place	☐ ☐	☐ ☐	☐ ☐	☐ ☐	☐ ☐
G. Removed	☒ ☒	☐ ☐	☐ ☐	☐ ☐	☐ ☐
H. Other (please specify)					
12. If box 11B, C, or D above has been marked, indicate the estimated date last used (month/day/year)	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year
	[] [] []	[] [] []	[] [] []	[] [] []	[] [] []
13. Closure Information - Tank ID No.	TANK NO. 00725	TANK NO. [] [] [] []	TANK NO. [] [] [] []	TANK NO. [] [] [] []	TANK NO. [] [] [] []
	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year
A. Date abandoned in place	[] [] []	[] [] []	[] [] []	[] [] []	[] [] []
B. Date taken temporarily out of service	[] [] []	[] [] []	[] [] []	[] [] []	[] [] []
C. Date removed	01/27/1998	[] [] []	[] [] []	[] [] []	[] [] []
D. Date of Sale or Transfer	[] [] []	[] [] []	[] [] []	[] [] []	[] [] []
E. TMS # (if applicable)					
F. ISRA # (if applicable)					

SECTION C - FINANCIAL RESPONSIBILITY

Does this facility have a Financial Responsibility Assurance Mechanism as required in 40 CFR 280? ☐ YES ☐ NO
Please list the appropriate financial information below:

Type	Carrier / Issuing Agency
Effective Date	Expiration Date
Policy Number	Amount

SECTION D - MONITORING SYSTEMS

Does this facility have a release detection monitoring system which is in compliance with N.J.A.C. 7:14B-6? ☐ YES ☐ NO
If "No", please be aware that the facility must meet the appropriate deadline. (See "Dates to Know" on Page 4)

SECTION E - RECORDKEEPING/COMPLIANCE

Please answer all the questions in this section on a facility basis. Any one tank not in compliance requires a "NO" answer for the entire facility.

- Does this facility have cathodic protection systems for all steel tanks and piping?
If "Yes", are the systems properly operated and maintained pursuant to N.J.A.C. 7:14B-5? ☐ YES ☐ NO
- Are the performance claims and documentation of monitoring systems maintained by the owner or operator pursuant to N.J.A.C. 7:14B-5? ☐ YES ☐ NO
- Are the proper monitoring, testing, sampling, repair and inventory records kept on-site pursuant to N.J.A.C. 7:14B-5 and 6? ☐ YES ☐ NO
- Is the proper Release Response Plan kept on-site pursuant to N.J.A.C. 7:14B-5? ☐ YES ☐ NO
- Does the facility have spill and over fill protection systems pursuant to N.J.A.C. 7:14B-4? ☐ YES ☐ NO
- Have all Fill Ports been permanently marked as per API #1627? ☐ YES ☐ NO

IMPORTANT INFORMATION

- FEE:** Please make checks payable to: "Treasurer, State of New Jersey". Use of the enclosed return envelope will expedite processing. Registration and Billing Schedule can be found in N.J.A.C. 7:14B.
All Initial Registration fees are \$100 per facility.
- PENALTY:** Failure by owner or operator of a regulated underground storage tank to comply with any requirement of the State UST Act or regulations may result in the penalties set forth in N.J.S.A. 58:10A-10.
- EMERGENCY:** If a discharge or spill occurs, the NJDEP Hotline at (609) 292-7172 must be called IMMEDIATELY - 24 hours a day.
- UPGRADE EXEMPTION:** Residential heating oil underground storage tanks are exempt from all upgrade requirements.

DATES TO KNOW (critical deadlines)

- December 22, 1988 — All new federally regulated tank systems must have cathodic protection and spill/overflow protection.
- September 4, 1990 — All new State-only regulated tank systems must have cathodic protection and spill/overflow protection.
- December 22, 1990 — All federally regulated piping must have begun leak detection.
- February 19, 1993 — All federally regulated tank systems must maintain financial responsibility assurance.
- December 22, 1993 — All federally regulated tank systems must have begun leak detection.
- December 22, 1998 — All regulated tanks shall install cathodic protection and spill/overflow protection.

CERTIFICATIONS

NOTE: IF THE PERSON SIGNING CERTIFICATION NO. 2 IS THE SAME AS THE PERSON SIGNING CERTIFICATION NO. 1, THEN CERTIFICATION NO. 2 NEED NOT BE SIGNED. (If different persons are required to sign No. 1 and No. 2, then they must do so.)

CERTIFICATION NO. 1:

Must be signed by the highest ranking individual at the facility with overall responsibility

"I certify under penalty of law that the information provided in this document is true, accurate and complete to the best of my knowledge, information and belief. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

MR. James Ott

(Typed / Printed Name)

Dir Public Works

(Title)

(Signature)

4/19/98

(Date)

CERTIFICATION NO. 2:

Must be signed as follows:

- For a corporation, by a principal executive officer of at least the level of vice president
- For a partnership or sole proprietorship, by a general partner or the proprietor, respectively
- For a municipality, State, Federal or other public agency, by either a principal executive officer or ranking elected official
- For persons other than indicated above, by the person with legal responsibility for the site

"I certify under penalty of law that I have personally examined and am familiar with the information submitted herein and all attached documents, and that based on my inquiry of those individuals immediately responsible for obtaining the information. I believe that the submitted information is true, accurate and complete. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

(Typed / Printed Name)

(Signature)

(Title)

(Date)

CERTIFICATION NO. 3:

If applicable, must be signed by the individual who is certified to perform services.

"I certify under penalty of law that the information provided in this document is true, accurate and complete to the best of my knowledge, information and belief. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

CHARLES APPLEBY

ENVIRONMENTAL PROTECTION SPEC.

(Typed / Printed Name)

(Title)

D. J. ARMY

(Name of Firm, if applicable)

(Signature)

2056

(Date)

4/18/98

APPENDIX B

SITE ASSESSMENT SUMMARY

Site Remediation Program

UST Site/Remedial Investigation Report Certification Form

A. Facility Name : U.S. Army Fort Monmouth New JerseyFacility Street Address : Directorate of Public Works Building 173Municipality: Oceanport County : MonmouthBlock: _____ Lot(s): _____ Telephone Number : 732-532-6224**B.** Owner (RP)'s Name: _____

Street Address: _____ City : _____

State: _____ Zip: _____ Telephone Number : _____

C. (Check as appropriate)☐ Site Investigation

Report (SIR) \$500 Fee

☐ Remedial Investigation

Report (RIR) \$1000 Fee

☒ NA – Federal Agreement**D.** (Complete all that apply)

- Assigned Case Manager : Ian Curtis, Federal Case Manager
- UST Registration Number : 90010-75 (7 digits)
- Incident Report Number (10 or 12 digits)
- Tank Closure Number : Federal Case Manager

E. Certification by the Subsurface Evaluator:

The attached report conforms to the specific reporting requirements of N.J.A.C. 7:26EYes No

Name: Charles Appleby Signature: See signed subsurface removal log UST Cert. No.: 2056Firm: U.S. Army Fort Monmouth Firm's UST Cert. Number: NA-U.S. ArmyFirm Address: Directorate of Public Works Building 173 City: Fort MonmouthState: NJ Zip: 07703 Telephone Number : 732-532-6224

(NOTE: Certification numbers required only if work was conducted on USTs regulated per N.J.S.A. 58:10A-21 et seq.)

F. Certification by the Responsible Party(ies) of the Facility:

The following certification shall be signed [according to the requirements of N.J.A.C. 7:14B-1.7(b)] as follows:

1. For a Corporation by a person authorized by a resolution of the board of directors to sign the document. A copy of the resolution, certified as a true copy by the secretary of the corporation, shall be submitted along with the certification; or
2. For a partnership or sole proprietorship, by a general partner or the proprietor, respectively; or
3. For a municipality, State, federal or other public agency by either a principal executive officer or ranking elected Official.

"I certify under penalty of law that I have personally examined and am familiar with the information submitted in this application and all attached documents, and that based on my inquiry of those individuals responsible for obtaining the information, I believe that the submitted information is true, accurate, and complete. I am aware that there are significant civil penalties for knowingly submitting false, inaccurate, or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

Name (Print or Type): James Ott Title: Directorate of Public Works

Signature: _____

Company Name: U.S. Army Fort Monmouth Date: _____

APPENDIX C

WASTE MANIFEST

CUSTOMER



RD. 1, BOX 5A - OLD BRIDGE, NJ 08857

**NON-HAZARDOUS
WASTE MANIFEST**

1. Generator's US EPA ID No.

Manifest
Document No.2. Page 1
of 1**NHZ 010388**

3. Generator's Name and Mailing Address

US Army Communications Electronics Command - Main Post
Bldg 173, ATTN: SELFM-PW-EV, Fort Monmouth, N.J. 07703

4. Generator's Phone ()

5. Transporter 1 Company Name

LIONETTI OIL RECOVERY CO INC

6. US EPA ID Number

NJ0000040405

A. Transporter's Phone

908 721-0900

7. Transporter 2 Company Name

8. US EPA ID Number

B. Transporter's Phone

9. Designated Facility Name and Site Address

LIONETTI OIL RECOVERY CO INC DBA LORCO PETROLEUM SVCS
RUNYON&CHEESEBROOK RD
OLD BRIDGE, NJ 08857

10. US EPA ID Number

NJ0000040405

C. Facility's Phone

908 721-0900

11. Waste Shipping Name and Description

12. Containers

No. Type

13.
Total
Quantity14.
Unit
Wt/Vola. PETROLEUM OIL (PETROLEUM OIL)
COMBUSTIBLE LIQUID UN1270 PGIII

001T X 3000 G

b.				
c.				
d.				

D. Additional Descriptions for Materials Listed Above

T, L PETROLEUM OIL 10 %
WATER 90 %

E. Handling Codes for Wastes Listed Above

T04 FILTRATION

15. Special Handling Instructions and Additional Information

24 HR EMERGENCY RESPONSE/(908) 721-0900
DECAL # 87084 ERG # 128 DEXSUL TEST KIT RESULTS MA PDI
MANIFEST USED FOR TRACKING PURPOSES ONLY

16. GENERATOR'S CERTIFICATION: I certify the materials described above on this manifest are not subject to federal regulations for reporting proper disposal of Hazardous Waste.

Printed/Typed Name

Signature

Month Day Year

X Charles A. Army Env. Prot. Eng.

X [Signature]

01/27/98

17. Transporter 1 Acknowledgement of Receipt of Materials

Printed/Typed Name

Signature

Month Day Year

DON TABUINOT

[Signature]

01/27/98

18. Transporter 2 Acknowledgement of Receipt of Materials

Printed/Typed Name

Signature

Month Day Year

19. Discrepancy Indication Space

20. Facility Owner or Operator: Certification of receipt of waste materials covered by this manifest except as noted in Item 19.

Printed/Typed Name

Signature

Month Day Year

GENERATOR'S COPY

APPENDIX D

UST DISPOSAL CERTIFICATE

Customer

Customer

APPENDIX E

SOIL ANALYTICAL DATA PACKAGE


US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

REPORT OF ANALYSIS

Client: U.S. Army
DPW, SELFM-PW-EV
Bldg. 173
Ft. Monmouth, NJ 07703

Project: Total Petroleum Hydrocarbons
98-0001
Bldg. 104
Proposed Credit Union Site

Project # 3335
Date Rec. 02/11/98
Date Compl. 02/19/98
Released by:



Daniel K. Wright
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Cover Sheet	1
Table of Contents	2
Method Summary	3
Conformance/Non-Conformance	4
Chain of Custody	5-6
Results Summary	7
Initial Calibration Summary	8
Continuing Calibration Summary	9-10
Surrogate Results Summary	11
MS/MSD Results Summary	12
Quality Control Spike Summary	13
Raw Sample Data	14-39
Laboratory Deliverable Checklist	40

Method Summary

NJDEP Method OQA-QAM-025-10/97

Gas Chromatographic Determination of Total Petroleum Hydrocarbons in Soil

Fifteen grams (15g)(wet weight) of a soil sample is added to a 125 mL acid cleaned, solvent rinsed, capped Erlenmeyer flask. 15g anhydrous sodium sulfate is added to dry sample. Surrogate standard spiking solution is then added to the flask.

Twenty five milliliters(25mL) Methylene Chloride is added to the flask and it is secured on a gyrotory shaker table. The agitation rate is set to 400rpm and the sample is shaken for 30 minutes. The flask is the removed from the table and the particulate matter is allowed to settle. The extract is transferred to a Teflon capped vial. A second 25mL of Methylene Chloride is added to the flask and shaken for an additional 30 minutes. The flask is again removed and allowed to settle. The extracts are combined in the vial then transferred to a 1mL autosampler vial.

The extract is then injected directly into a GC-FID for analysis. The sample is analyzed for petroleum hydrocarbons covering a range of C8-C42 including pristane and phytane. Total Petroleum Hydrocarbon concentration is determined by integrating between 5 minutes and 22 minutes. The baseline is established by starting the integration after the end of the solvent peak and stopping after the last peak.

The final concentration of Total Petroleum Hydrocarbons is calculated using percent solid, sample weight and concentration.

PHC Conformance/Non-conformance Summary Report

	<u>No</u>	<u>Yes</u>
1. Method Detection Limits provided.	<u>—</u>	<u>✓</u>
2. Method Blank Contamination - If yes, list the sample and the corresponding concentrations in each blank.	<u>✓</u>	<u>—</u>
3. Matrix Spike Results Summary Meet Criteria. (If not met, list the sample and corresponding recovery which falls outside the acceptable range).	<u>—</u>	<u>✓</u>
4. Duplicate Results Summary Meet Criteria. (If not met, list the sample and corresponding recovery which falls outside the acceptable range).	<u>—</u>	<u>✓</u>
5. IR Spectra submitted for standards, blanks, & samples	<u>—</u>	<u>NA</u>
6. Chromatograms submitted for standards, blanks, and samples if GC fingerprinting was conducted.	<u>—</u>	<u>✓</u>
7. Analysis holding time met. (If not met, list number of days exceeded for each sample)	<u>—</u>	<u>✓</u>
Additional Comments:		

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW 846 for Solid Waste Analysis. I have personally examined the information contained in this report, and to the best of my knowledge, I believe that the submitted information is true, accurate, complete, and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.


Daniel K. Wright
Laboratory Manager



Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (908)532-4359 Fax (908)532-3484 EMail:appleby@doim6.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

Customer: <u>DPW-ENV</u>		Project No: <u>98-0001</u>		Analysis Parameters								Comments: *= SAMPLES KEPT BELOW 4°C.			
Phone #:		Location: <u>B.104 (PROPOSED CREDIT UNION SITE, B.497)</u>													
() DERA (X) OMA () Other: _____															
Samplers Name / Company: <u>GARY DIMARTINIS-TVS</u>				Sample #									Remarks / Preservation Method		
Lab Sample I.D.	Sample Location	Date	Time	Type	bottles	TPHC	Pb, Solids	Manganese							
3335. 01	104-A	2-10-98	1354	SOIL	1	X	X	X						ND	EXC. FLOOR @ 9.0' *
02	-B		1358											ND	
03	-C		1405											3	
04	-D		1409											ND	
05	-E		1339											ND	
06	-F		1334											10	
07	-G		1321											2	
08	-H		1316											2	↓
09	-I		1349											ND	SIDE WALL @ 3.5'
10	-J		1344											ND	
11	-K		1308											10	
12	-L		1310											30	↓
13	-DUP		—											—	FIELD DUPLICATE ↓
NOTE: QUA (#AS2114) CALIBRATED W/PS PM CH & ZERO(V) AIR @ 1300 HRS. ON 2/10/98 BY G. DIMARTINIS.															
Relinquished by (signature): <u>[Signature]</u>		Date/Time: <u>2-11-98 1110</u>		Received by (signature): <u>[Signature]</u>		Relinquished by (signature):		Date/Time:		Received by (signature):					
Relinquished by (signature):		Date/Time:		Received by (signature):		Relinquished by (signature):		Date/Time:		Received by (signature):					
Report Type: () Full, (X) Reduced, () Standard, () Screen / non-certified						Remarks: <u>DEDICATED SAMPLING TOOLS USED.</u>									
Turnaround time: () Standard 4 wks, (X) Rush <u>3</u> Days, () ASAP Verbal <u> </u> Hrs.															

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted
2. Table of Contents submitted
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted
4. Document paginated and legible
5. Chain of Custody submitted
6. Samples submitted to lab within 48 hours of sample collection
7. Methodology Summary submitted
8. Laboratory Chronicle and Holding Time Check submitted
9. Results submitted on a dry weight basis
10. Method Detection Limits submitted
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP

Laboratory Manager or Environmental Consultant's Signature

Date 3/23/94

Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

REPORT OF ANALYSIS

Client: U.S. Army
DPW, SELFM-PW-EV
Bldg. 173
Ft. Monmouth, NJ 07703

Project: Total Petroleum Hydrocarbons
98-0001
Bldg. 104
Proposed Credit Union Site(B-497)

Project # 3349
Date Rec. 02/19/98
Date Compl. 02/23/98
Released by:



Daniel K. Wright
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Cover Sheet	1
Table of Contents	2
Method Summary	3
Conformance/Non-Conformance	4
Chain of Custody	5-7
Results Summary	8
Initial Calibration Summary	9
Continuing Calibration Summary	10-12
Surrogate Results Summary	13
MS/MSD Results Summary	14
Quality Control Spike Summary	15
Raw Sample Data	16-47
Laboratory Deliverable Checklist	48

Method Summary

NJDEP Method OQA-QAM-025-10/97

Gas Chromatographic Determination of Total Petroleum Hydrocarbons in Soil

Fifteen grams (15g)(wet weight) of a soil sample is added to a 125 mL acid cleaned, solvent rinsed, capped Erlenmeyer flask. 15g anhydrous sodium sulfate is added to dry sample. Surrogate standard spiking solution is then added to the flask.

Twenty five milliliters(25mL) Methylene Chloride is added to the flask and it is secured on a gyrotory shaker table. The agitation rate is set to 400rpm and the sample is shaken for 30 minutes. The flask is the removed from the table and the particulate matter is allowed to settle. The extract is transferred to a Teflon capped vial. A second 25mL of Methylene Chloride is added to the flask and shaken for an additional 30 minutes. The flask is again removed and allowed to settle. The extracts are combined in the vial then transferred to a 1mL autosampler vial.

The extract is then injected directly into a GC-FID for analysis. The sample is analyzed for petroleum hydrocarbons covering a range of C8-C42 including pristane and phytane. Total Petroleum Hydrocarbon concentration is determined by integrating between 5 minutes and 22 minutes. The baseline is established by starting the integration after the end of the solvent peak and stopping after the last peak.


The final concentration of Total Petroleum Hydrocarbons is calculated using percent solid, sample weight and concentration.

PHC Conformance/Non-conformance Summary Report

	<u>No</u>	<u>Yes</u>
1. Method Detection Limits provided.	—	✓
2. Method Blank Contamination - If yes, list the sample and the corresponding concentrations in each blank.	✓	—
3. Matrix Spike Results Summary Meet Criteria. (If not met, list the sample and corresponding recovery which falls outside the acceptable range).	—	✓
4. Duplicate Results Summary Meet Criteria. (If not met, list the sample and corresponding recovery which falls outside the acceptable range).	—	✓
5. IR Spectra submitted for standards, blanks, & samples	—	NA
6. Chromatograms submitted for standards, blanks, and samples if GC fingerprinting was conducted.	—	✓
7. Analysis holding time met.	—	✓
(If not met, list number of days exceeded for each sample)		
Additional Comments:		

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW 846 for Solid Waste Analysis. I have personally examined the information contained in this report, and to the best of my knowledge, I believe that the submitted information is true, accurate, complete, and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.

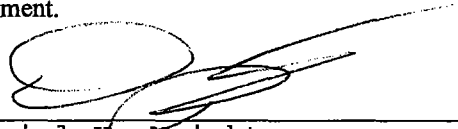

Daniel K. Wright
Laboratory Manager

Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-3484 EMail:appleby@doim6.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

Customer: DPW-ENV				Project No: 98-0001		Analysis Parameters						Comments: *=SAMPLES KEPT BELOW 4°C.			
Phone #:				Location: B. 104 (PROPOSED CREDIT UNION SITE, B.497)		TPHC	Pb	Cd	Mn	Fe	Zn			Cu	OXA
() DERA (X) OMA () Other: _____															
Samplers Name / Company: GARY DiMARTINIS - TUS				Sample #											
Lab Sample I.D.	Sample Location	Date	Time	Type	bottles								Remarks / Preservation Method		
3349 01	104-A	2/18/98	1426	SOIL	1	X	X	X				ND	EXC. FLOOR @ 9.0' *		
02	B		1417									1			
03	C		1409									ND			
04	D		1403									ND			
05	E		1347									ND			
06	F		1341									ND			
07	G		1336									1			
08	H		1330									ND			
09	I		1356									1	SIDE WALL @ 3.5'		
10	J		1421									3			
11	K		1414									1			
12	L		1406									ND			
13	M		1344									5			
14	N	V	1339	V	V	V	V	V				10			
Relinquished by (signature): <i>[Signature]</i>		Date/Time: 2-19-98 1040		Received by (signature): <i>[Signature]</i>		Relinquished by (signature):		Date/Time:		Received by (signature):					
Relinquished by (signature):		Date/Time:		Received by (signature):		Relinquished by (signature):		Date/Time:		Received by (signature):					
Report Type: () Full, (X) Reduced, () Standard, () Screen / non-certified						Remarks: DEDICATED SAMPLING TOOLS USED.									
Turnaround time: () Standard 4 wks, (X) Rush 2 Days, () ASAP Verbal _____ Hrs.															

Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-3484 EMail:appleby@doim6.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

Customer: DPW-ENV		Project No: 98-0001		Analysis Parameters								Comments:		
Phone #:		Location: B104		TPHC	PB SOLIDS	MUNSEL					OUA			
() DERA (X)OMA () Other: _____		(PAGE 2 of 2)												
Samplers Name / Company: GARY DIMARTINIS - TVS				Sample #									Remarks / Preservation Method	
Lab Sample I.D.	Sample Location	Date	Time	Type	bottles									
3349.15	104-0	2/18/98	1333	SOIL	1	X	X	X					2	SIDE WALL @ 3.5' *
10	-DUP	↓	—	↓	↓	↓	↓	↓					—	FIELD Duplicate ↓
<i>NOTE: OUA (#A52114) CALIBRATED w/95ppm CH₄ + ZERO (0) AIR @ 1315 HRS on 2/18/98 by G. DIMARTINIS.</i>														
Relinquished by (signature): <i>[Signature]</i>		Date/Time: 2/19/98 1040		Received by (signature): <i>[Signature]</i>		Relinquished by (signature):		Date/Time:		Received by (signature):				
Relinquished by (signature):		Date/Time:		Received by (signature):		Relinquished by (signature):		Date/Time:		Received by (signature):				
Report Type: () Full, (X) Reduced, () Standard, () Screen / non-certified						Remarks:								
Turnaround time: () Standard 4 wks, (X) Rush 2 Days, () ASAP Verbal _____ Hrs.														

Report of Analysis
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification # 13461


Client : U.S. Army Lab. ID # : 3349
DPW. SELFM-PW-EV Date Rec'd: 19-Feb-98
Bldg. 173 Analysis Start: 21-Feb-98
Ft. Monmouth, NJ 07703 Analysis Complete: 23-Feb-98

Analysis: OQA-QAM-025 UST Reg. #:
Matrix: Soil Closure #:
Analyst: D.DEINHARDT DICAR #:
Ext. Meth: Shake Location #: B.104

Sample	Field ID	Dilution Factor	Weight (g)	% Solid	MDL (mg/kg)	TPHC Result (mg/kg)
3349.01	104-A	1.00	15.70	69.71	215	ND
3349.02	104-B	1.00	15.69	86.18	174	ND
3349.03	104-C	1.00	15.17	77.71	199	ND
3349.04	104-D	1.00	15.46	72.11	211	ND
3349.05	104-E	1.00	15.70	77.36	193	ND
3349.06	104-F	1.00	15.47	72.19	210	ND
3349.07	104-G	1.00	15.21	80.19	193	ND
3349.08	104-H	1.00	15.42	77.02	198	ND
3349.09	104-I	1.00	15.36	86.34	177	ND
3349.10	104-J	1.00	15.44	82.07	185	ND
3349.11	104-K	1.00	15.27	79.83	193	ND
3349.12	104-L	1.00	15.06	79.87	195	ND
3349.13	104-M	1.00	15.21	81.59	189	ND
3349.14	104-N	1.00	15.27	81.91	188	ND
3349.15	104-O	1.00	15.65	87.20	172	ND
3349.16	104-DUP	1.00	15.18	75.26	206	ND
METHOD BLANK	20-Feb-98	1.00	15.00	100.00	157	ND

ND = Not Detected

MDL = Method Detection Limit


Daniel K. Wright
Laboratory Director

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted
2. Table of Contents submitted
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted
4. Document paginated and legible
5. Chain of Custody submitted
6. Samples submitted to lab within 48 hours of sample collection
7. Methodology Summary submitted
8. Laboratory Chronicle and Holding Time Check submitted
9. Results submitted on a dry weight basis
10. Method Detection Limits submitted
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP

✓
✓
✓
✓
✓
✓
✓
✓
✓
✓
✓

Laboratory Manager or Environmental Consultant's Signature

Date 3/23/96

Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance

APPENDIX F

GROUNDWATER ANALYTICAL DATA PACKAGE

FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732)532-6224 FAX: (732)532-3484

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

NJDEP LABORATORY CERTIFICATION # 13461



ANALYTICAL DATA REPORT
Fort Monmouth Environmental Laboratory
ENVIRONMENTAL DIVISION
Fort Monmouth, New Jersey
PROJECT: UST Program

AREA 104

Field Location No. & Location	Laboratory Sample ID#	Matrix	Date and Time Of Collection	Date Received
104 - #1 - 3-4'	3914.01	Aqueous	24-Sept-98 14:25	09/25/98
104 - #2 - 5-6'	3914.02	Aqueous	24-Sept-98 14:45	09/25/98
104 - #2 - 5-6'	3914.03	Aqueous	24-Sept-98 17:30	09/25/98
104 - #3 - 5-6'	3914.04	Aqueous	24-Sept-98 16:00	09/25/98
104 - #3 - 5-6'	3914.05	Aqueous	24-Sept-98 17:59	09/25/98
104 - #4 - 4.5-5.5'	3914.06	Aqueous	24-Sept-98 16:20	09/25/98
104 - #4 - 4.5-5.5'	3914.07	Aqueous	24-Sept-98 16:50	09/25/98
104 - #5 - 4.5-5.5'	3914.08	Aqueous	24-Sept-98 17:20	09/25/98
104 - #5 - 4.5-5.5'	3914.09	Aqueous	24-Sept-98 17:49	09/25/98

ANALYSIS:
FORT MONMOUTH ENVIRONMENTAL LAB.
VOA+15, BN+15

 12/3/98
Daniel Wright/Date
Laboratory Director

ENCLOSURE:
CHAIN OF CUSTODY
FIELD DOCUMENTATION
RESULTS

Table of Contents

<u>Section</u>	<u>Pages</u>
Chain of Custody	1-2
Field Documentation	3-5
Methodology Review	6-7
Conformance/Non-Conformance Summary	8-10
Laboratory Chronicle	11-12
Volatile Organics	13
Analytical Results Summary	14-26
Tune Results Summary	27-28
Method Blank Results Summary	29
Calibration Summary	30-31
Surrogate Recovery Summary	32
MS/MSD Results Summary	33-34
Internal Standard Area & RT Summary	35
Chromatograms	36-47
Base Neutrals	48
Analytical Results Summary	49-60
Tune Results Summary	61-64
Method Blank Results Summary	65
Calibration Summary	66-70
Surrogate Recovery Summary	71
MS/MSD Results Summary	72
Internal Standard Area & RT Summary	73-76
Chromatograms	77-88
Laboratory Deliverables Checklist	89
Laboratory Authentication Statement	90

CHAIN OF CUSTODY

0001

FIELD DOCUMENTATION

0003

Post Remedial Groundwater Sampling at Former Underground Storage Tank Site[#2 fuel oil]

FOR BLDG. # 104

Ground Water Sampling with the use of a Passively Placed Narrow Diameter Point (PPNDP)

Objective:

To collect a representative groundwater sample utilizing a narrow diameter point [PPNDP] This is a small diameter [1-inch OD] screened casing passively placed in a borehole. The casing is of p.v.c. construction.

1. Methods

- A. A solid push - rod (bull point) is used to create a narrow diameter hole to a depth below the water table. A piece of schedule 40 PVC screen with 0.010-inch slots and an end cap is placed to the bottom of the hole. Glues or adhesives are not used for joining the casing. Threaded PVC casing is used. No filter or gravel pack is used.

2. Installation

- A. Using a Geoprobe, five boreholes were advanced with a pre-probe with a diameter slightly larger than the casing. The holes were made to a depth of 10 feet. The water table was at app. 3 - 5 feet below ground surface.
- B. The screened section of PVC was placed into the borehole so the screened section was across the ground water table from 2 - 7 or 4 - 9 feet. Riser casing from 2 - +3 or 4 - +3 feet.

3. Purging

- A. Three volumes of the standing water in the point were purged. The amount of water extracted was app. 0.123 gal. Three to five volumes are purged due to the potential for cross contamination of the screen from upper soil horizons. This was accomplished utilizing a peristaltic pump, and utilizing food grade tubing.

4. Sampling

- A. Sampling methods, sample preservation requirements, sample handling times, decontamination procedure for field equipment, and frequency for field blanks, field duplicates and trip blanks conform to applicable industry methods such as those specified in the NJDEP "Field Sampling Procedures Manual" in effect as of the date on which sampling is performed. Any deviations from the methods in the "Field

Sampling Procedures Manual" pursuant to N.J.A.C. 7:26E-1.6(c) has been approved by the person responsible for conducting the remediation.

All samples were preserved in the field immediately after collection and submitted to the laboratory as soon as possible and no later than 48 hours after sample collection.

The acquisition of samples and water level measurements were performed as recommended and described in the May 1992 edition of NJDEP Field Sampling Procedures Manual.

5. Quality Assurance/Quality Control

A. Decontamination

The associated equipment (bull point, riser pipe, etc.) was decontaminated between borings using the following procedure:

1. Remove all adherent soil material.
2. Wash with a laboratory grade glassware detergent.
3. Rinsed with potable water.
4. Rinse with distilled and deionized ASTM Type II water.


B. Field Blanks

1 Field blank was taken from this site.

- C. Sample bottles: Supplied by Environmental Sampling Supply, Oakland, Calif.
The sample bottles are certified clean and are sealed upon delivery.

- D. P.V.C. Screens: Supplied by Bedrock Enterprises, Forked River N.J.

Geoprobe Operator: Mark Laura
Employer: U.S. Army, Fort Monmouth
Phone Number: [732] 532-8990
NJDEP License #: J-1486

 12-1-98
Mark Laura / Date

METHODOLOGY SUMMARY

Methodology Summary

EPA Method 624

Gas Chromatographic Determination of Volatiles in Water

Surrogates and internal standards are added to a 5 ml aliquot of sample. The sample is then purged and desorbed into a GC/MS system. The organic compounds are separated by the gas chromatograph and detected using the mass spectrometer. Volatiles are identified and quantitated.

EPA Method 3510/8270

Gas Chromatographic Determination of Semi-volatiles in Water

Surrogates are added to a measured volume of sample, usually 1 liter, at a specified pH. The sample is serially extracted with Methylene Chloride using a separatory funnel. The extract concentrated and internal standards are added. The sample is injected into a GC/MS system. Semi-volatiles are identified and quantitated.

CONFORMANCE/ NON-CONFORMANCE SUMMARY

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT

Indicate
Yes, No, N/A

1. Chromatograms labeled/Compounds identified
(Field samples and method blanks) yes
2. Retention times for chromatograms provided yes
3. GC/MS Tune Specifications
 - a. BFB Meet Criteria yes
 - b. DFTPP Meet Criteria yes
4. GC/MS Tuning Frequency – Performed every 24 hours for 600 series and 12 hours for 8000 series yes
5. GC/MS Calibration – Initial Calibration performed before sample analysis and continuing calibration performed within 24 hours of sample analysis for 600 series and 12 hours for 8000 series yes
6. GC/MS Calibration requirements
 - a. Calibration Check Compounds Meet Criteria yes
 - b. System Performance Check Compounds Meet Criteria yes
7. Blank Contamination – If yes, List compounds and concentrations in each blank: NO
 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA
8. Surrogate Recoveries Meet Criteria yes

If not met, list those compounds and their recoveries, which fall outside the acceptable range:

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA

If not met, were the calculations checked and the results qualified as “estimated”? _____
9. Matrix Spike/Matrix Spike Duplicate Recoveries Meet Criteria yes

(If not met, list those compounds and their recoveries, which fall outside the acceptable range)

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT (cont.)

Indicate
Yes, No, N/A

10. Internal Standard Area/Retention Time Shift Meet Criteria
(If not met, list those compounds, which fall outside the acceptable range)

Yes

- a. VOA Fraction _____
b. B/N Fraction _____
c. Acid Fraction NA

11. Extraction Holding Time Met

Yes

If not met, list the number of days exceeded for each sample: _____

12. Analysis Holding Time Met

Yes

If not met, list the number of days exceeded for each sample: _____

Additional Comments:

No Duplicates analyzed for B/D's

Laboratory Manager: _____

Date: 12/3/96

LABORATORY CHRONICLE

Laboratory Chronicle

Lab ID: 3914

Site: Area 104

	Date	Hold Time
Date Sampled	09/24/98	NA
Receipt/Refrigeration	09/25/98	NA
Extractions		
1. Base Neutrals	09/28/98	14 days
Analyses		
1. Volatiles	10/06/98	14 days
2. Base Neutrals	10/01,09/98	40 days

VOLATILE ORGANICS

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

Definition of Qualifiers

MDL : Method Detection Limit

J : Compound identified below detection limit

B : Compound in both sample and blank

D : Results from dilution of sample

U : Compound searched for but not detected

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Nam VB01610.D
 Operator Skelton
 Date Acquired 6 Oct 98 2:18 pm

Sample Name VBLK50
 Field ID VBLK50
 Sample Multiplier 1

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	nle	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ethe			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloroprope			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethan			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

* Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

VBK50

Lab Name: FMETL Project UST
NJDEP# 13461 Case No.: 3914 SDG No Location B.104
Matrix (soil/water) WATER Lab Sample ID: VBK50
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB01610.D
Level: (low/med) LOW Date Received: 09/25/98
% Moisture: not dec. Date Analyzed: 10/06/98
GC Column: HP5MS ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Nam vb01615.d
 Operator Skelton
 Date Acquired 6 Oct 98 6:47 pm

Sample Name 3914.01
 Field ID 104-#1-3-4'
 Sample Multiplier 1

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	nle	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ethe			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene	25.00	166869	1.26 ug/L	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloroprope			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethan			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

* Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

104-#1 3-4"

Lab Name: FMETL Project UST
 NJDEP# 13461 Case No.: 3914 SDG No Location B.104
 Matrix (soil/water) WATER Lab Sample ID: 3914.01
 Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB01615.D
 Level: (low/med) LOW Date Received: 09/25/98
 % Moisture: not dec. Date Analyzed: 10/06/98
 GC Column: HP5MS ID: 0.25 (mm) Dilution Factor: 1.0
 Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 3

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
1. 000099-87-6	Benzene, 1-methyl-4-(1-methylet	36.18	5	JN
2. 000527-84-4	Benzene, 1-methyl-2-(1-methylet	37.16	3	JN
3. 000527-53-7	Benzene, 1,2,3,5-tetramethyl-	37.36	5	JN

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Nam vb01616.d
 Operator Skelton
 Date Acquired 6 Oct 98 7:34 pm

Sample Name 3914.02
 Field ID 104 #2-5-6'
 Sample Multiplier 1

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	nle	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ethe			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloroprope			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethan			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

* Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

0019

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

104-#2 5-6'

Lab Name: FMETL Project UST
NJDEP# 13461 Case No.: 3914 SDG No Location B.104
Matrix (soil/water) WATER Lab Sample ID: 3914.02
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB01616.D
Level: (low/med) LOW Date Received: 09/25/98
% Moisture: not dec. Date Analyzed: 10/06/98
GC Column: HP5MS ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 4

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
1. 006682-71-9	1H-Indene, 2,3-dihydro-4,7-dimet	33.83	5	JN
2. 004175-53-5	1H-Indene, 2,3-dihydro-1,3-dimet	34.96	5	JN
3. 001680-51-9	Naphthalene, 1,2,3,4-tetrahydro-6	35.40	4	JN
4. 002809-64-5	Naphthalene, 1,2,3,4-tetrahydro-5	37.38	3	JN

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Nam vb01617.d
 Operator Skelton
 Date Acquired 6 Oct 98 8:20 pm

Sample Name 3914.04
 Field ID 104-#3-5-6'
 Sample Multiplier 1

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	nle	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ethe			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloroprope			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethan			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

* Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

104-#3 5-6'

Lab Name: FMETL Project UST
NJDEP# 13461 Case No.: 3914 SDG No Location B.104
Matrix (soil/water) WATER Lab Sample ID: 3914.04
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB01617.D
Level: (low/med) LOW Date Received: 09/25/98
% Moisture: not dec. Date Analyzed: 10/06/98
GC Column: HP5MS ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Nam **vb01618.d**
 Operator **Skelton**
 Date Acquired **6 Oct 98 9:01 pm**

Sample Name **3914.06**
 Field ID **104-#4-4.5-5.5'**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	nle	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ethe			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloroprope			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethan			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

* Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

104-#4 4.5-5.5'

Lab Name: FMETL Project UST
NJDEP# 13461 Case No.: 3914 SDG No Location B.104
Matrix (soil/water) WATER Lab Sample ID: 3914.06
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB01618.D
Level: (low/med) LOW Date Received: 09/25/98
% Moisture: not dec. Date Analyzed: 10/06/98
GC Column: HP5MS ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Nam **VB01619.D**
 Operator **Skelton**
 Date Acquired **6 Oct 98 9:45 pm**

Sample Name **3914.08**
 Field ID **104 #5-4.5-5.5'**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	nle	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethan			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ethe			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloroprope			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethan			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

* Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

104-#5 4.5-5.5'

Lab Name: FMETL Project UST
NJDEP# 13461 Case No.: 3914 SDG No Location B.104
Matrix (soil/water) WATER Lab Sample ID: 3914.08
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB01619.D
Level: (low/med) LOW Date Received: 09/25/98
% Moisture: not dec. Date Analyzed: 10/06/98
GC Column: HP5MS ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

BASE NEUTRALS

Semi-Volatile Base Neutral Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **bn00812.d**
 Operator **Skelton**
 Date Acquired **1 Oct 1998 11:46 pm**

Sample Name **SBLK138**
 Misc Info
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
110-86-1	Pyridine			not detected	NLE	2.52 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	2.64 ug/L	
62-53-3	Aniline			not detected	NLE	2.90 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	2.45 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	2.65 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	2.50 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	2.09 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	2.44 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	2.96 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	2.22 ug/L	
67-72-1	Hexachloroethane			not detected	10	2.59 ug/L	
98-95-3	Nitrobenzene			not detected	10	2.45 ug/L	
78-59-1	Isophorone			not detected	100	2.31 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	2.54 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	2.58 ug/L	
91-20-3	Naphthalene			not detected	NLE	3.03 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	2.55 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.64 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	2.49 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.59 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	2.15 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	1.62 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	2.74 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	2.35 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	1.54 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	1.62 ug/L	
83-32-9	Acenaphthene			not detected	400	1.98 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	2.13 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	1.22 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.68 ug/L	
86-73-7	Fluorene			not detected	300	1.93 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.53 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	2.70 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.73 ug/L	
103-33-3	Azobenzene			not detected	NLE	1.92 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	1.54 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.88 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.67 ug/L	
120-12-7	Anthracene			not detected	2000	1.79 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.83 ug/L	
206-44-0	Fluoranthene			not detected	300	1.85 ug/L	
92-87-5	Benzidine			not detected	50	4.11 ug/L	
129-00-0	Pyrene			not detected	200	1.02 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.15 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.57 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	2.28 ug/L	
218-01-9	Chrysene			not detected	20	2.32 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.29 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.30 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.31 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.57 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.36 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	1.22 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	3.12 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	1.13 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6

Qualifiers

E = Value exceeded linear range
 D = Value from dilution
 B = Compound in related blank
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

SBLK138

Lab Name: FMETL Lab Code 13461
Project _____ Case No.: 3914 Location B.104 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: SBLK138
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA00812.D
Level: (low/med) LOW Date Received: 09/25/98
% Moisture: _____ decanted: (Y/N) N Date Extracted: 09/28/98
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 10/01/98
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Base Neutral Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name bna00878.d
 Operator Skelton
 Date Acquired 9 Oct 1998 1:42 am

Sample Name 3914.01
 Misc Info 104-#1-3-4'
 Sample Multiplier 1

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
110-86-1	Pyridine			not detected	NLE	2.52 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	2.64 ug/L	
62-53-3	Aniline			not detected	NLE	2.90 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	2.45 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	2.65 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	2.50 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	2.09 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	2.44 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	2.96 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	2.22 ug/L	
67-72-1	Hexachloroethane			not detected	10	2.59 ug/L	
98-95-3	Nitrobenzene			not detected	10	2.45 ug/L	
78-59-1	Isophorone			not detected	100	2.31 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	2.54 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	2.58 ug/L	
91-20-3	Naphthalene			not detected	NLE	3.03 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	2.55 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.64 ug/L	
91-57-6	2-Methylnaphthalene	12.12	136384	3.78 ug/L	NLE	2.49 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.59 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	2.15 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	1.62 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	2.74 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	2.35 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	1.54 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	1.62 ug/L	
83-32-9	Acenaphthene			not detected	400	1.98 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	2.13 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	1.22 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.68 ug/L	
86-73-7	Fluorene			not detected	300	1.93 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.53 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	2.70 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.73 ug/L	
103-33-3	Azobenzene			not detected	NLE	1.92 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	1.54 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.88 ug/L	
85-01-8	Phenanthrene	18.01	98517	1.77 ug/L	NLE	1.67 ug/L	
120-12-7	Anthracene			not detected	2000	1.79 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.83 ug/L	
206-44-0	Fluoranthene			not detected	300	1.85 ug/L	
92-87-5	Benzidine			not detected	50	4.11 ug/L	
129-00-0	Pyrene			not detected	200	1.02 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.15 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.57 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	2.28 ug/L	
218-01-9	Chrysene			not detected	20	2.32 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.29 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.30 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.31 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.57 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.36 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	1.22 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	3.12 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	1.13 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6

Qualifiers

E = Value exceeded linear range
 D = Value from dilution
 B = Compound in related blank
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

104-#1 3-4'

Lab Name: FMETL Lab Code 13461
Project _____ Case No.: 3914 Location B.104 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 3914.01
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA00878.D
Level: (low/med) LOW Date Received: 09/25/98
% Moisture: _____ decanted: (Y/N) N Date Extracted: 09/28/98
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 10/09/98
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 3 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
1. 000090-12-0	Naphthalene, 1-methyl-	12.36	10	JN
2. 000581-42-0	Naphthalene, 2,6-dimethyl-	13.60	16	JN
3. 000581-40-8	Naphthalene, 2,3-dimethyl-	13.80	19	JN

Semi-Volatile Base Neutral Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name bna00879.d
 Operator Skelton
 Date Acquired 9 Oct 1998 2:27 am

Sample Name 3914.03
 Misc Info 104-#2-5-6'
 Sample Multiplier 1

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
110-86-1	Pyridine			not detected	NLE	2.52 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	2.64 ug/L	
62-53-3	Aniline			not detected	NLE	2.90 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	2.45 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	2.65 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	2.50 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	2.09 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	2.44 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	2.96 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	2.22 ug/L	
67-72-1	Hexachloroethane			not detected	10	2.59 ug/L	
98-95-3	Nitrobenzene			not detected	10	2.45 ug/L	
78-59-1	Isophorone			not detected	100	2.31 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	2.54 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	2.58 ug/L	
91-20-3	Naphthalene			not detected	NLE	3.03 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	2.55 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.64 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	2.49 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.59 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	2.15 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	1.62 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	2.74 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	2.35 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	1.54 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	1.62 ug/L	
83-32-9	Acenaphthene			not detected	400	1.98 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	2.13 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	1.22 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.68 ug/L	
86-73-7	Fluorene			not detected	300	1.93 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.53 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	2.70 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.73 ug/L	
103-33-3	Azobenzene			not detected	NLE	1.92 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	1.54 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.88 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.67 ug/L	
120-12-7	Anthracene			not detected	2000	1.79 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.83 ug/L	
206-44-0	Fluoranthene			not detected	300	1.85 ug/L	
92-87-5	Benztidine			not detected	50	4.11 ug/L	
129-00-0	Pyrene			not detected	200	1.02 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.15 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.57 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	2.28 ug/L	
218-01-9	Chrysene			not detected	20	2.32 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.29 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.30 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.31 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.57 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.36 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	1.22 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	3.12 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	1.13 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6

Qualifiers

E = Value exceeded linear range

D = Value from dilution

B = Compound in related blank

PQL = Practical Quantitation Limit

MDL = Method Detection Limit

NLE = No Limit Established

R.T. = Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

104-#2 5-6'

Lab Name: FMETL Lab Code 13461
Project _____ Case No.: 3914 Location B.104 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 3914.03
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA00879.D
Level: (low/med) LOW Date Received: 09/25/98
% Moisture: _____ decanted: (Y/N) N Date Extracted: 09/28/98
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 10/09/98
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Base Neutral Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name bna00880.d
 Operator Skelton
 Date Acquired 9 Oct 1998 3:12 am

Sample Name 3914.05
 Misc Info 104-#3-S-6'
 Sample Multiplier 1

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
110-86-1	Pyridine			not detected	NLE	2.52 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	2.64 ug/L	
62-53-3	Aniline			not detected	NLE	2.90 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	2.45 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	2.65 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	2.50 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	2.09 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	2.44 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	2.96 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	2.22 ug/L	
67-72-1	Hexachloroethane			not detected	10	2.59 ug/L	
98-95-3	Nitrobenzene			not detected	10	2.45 ug/L	
78-59-1	Isophorone			not detected	100	2.31 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	2.54 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	2.58 ug/L	
91-20-3	Naphthalene			not detected	NLE	3.03 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	2.55 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.64 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	2.49 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.59 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	2.15 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	1.62 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	2.74 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	2.35 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	1.54 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	1.62 ug/L	
83-32-9	Acenaphthene			not detected	400	1.98 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	2.13 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	1.22 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.68 ug/L	
86-73-7	Fluorene			not detected	300	1.93 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.53 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	2.70 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.73 ug/L	
103-33-3	Azobenzene			not detected	NLE	1.92 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	1.54 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.88 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.67 ug/L	
120-12-7	Anthracene			not detected	2000	1.79 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.83 ug/L	
206-44-0	Fluoranthene			not detected	300	1.85 ug/L	
92-87-5	Benzidine			not detected	50	4.11 ug/L	
129-00-0	Pyrene			not detected	200	1.02 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.15 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.57 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	2.28 ug/L	
218-01-9	Chrysene			not detected	20	2.32 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.29 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.30 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.31 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.57 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.36 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	1.22 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	3.12 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	1.13 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6

Qualifiers

E = Value exceeded linear range
 D = Value from dilution
 B = Compound in related blank
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

104-#3 5-6'

Lab Name: FMETL Lab Code 13461
Project _____ Case No.: 3914 Location B.104 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 3914.05
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA00880.D
Level: (low/med) LOW Date Received: 09/25/98
% Moisture: _____ decanted: (Y/N) N Date Extracted: 09/28/98
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 10/09/98
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Base Neutral Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name bna00881.d
 Operator Skelton
 Date Acquired 9 Oct 1998 3:57 am

Sample Name 3914.07
 Misc Info 104-#4-4.5-5.5'
 Sample Multiplier 1

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
110-86-1	Pyridine			not detected	NLE	2.52 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	2.64 ug/L	
62-53-3	Aniline			not detected	NLE	2.90 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	2.45 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	2.65 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	2.50 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	2.09 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	2.44 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	2.96 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	2.22 ug/L	
67-72-1	Hexachloroethane			not detected	10	2.59 ug/L	
98-95-3	Nitrobenzene			not detected	10	2.45 ug/L	
78-59-1	Isophorone			not detected	100	2.31 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	2.54 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	2.58 ug/L	
91-20-3	Naphthalene			not detected	NLE	3.03 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	2.55 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.64 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	2.49 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.59 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	2.15 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	1.62 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	2.74 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	2.35 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	1.54 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	1.62 ug/L	
83-32-9	Acenaphthene			not detected	400	1.98 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	2.13 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	1.22 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.68 ug/L	
86-73-7	Fluorene			not detected	300	1.93 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.53 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	2.70 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.73 ug/L	
103-33-3	Azobenzene			not detected	NLE	1.92 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	1.54 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.88 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.67 ug/L	
120-12-7	Anthracene			not detected	2000	1.79 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.83 ug/L	
206-44-0	Fluoranthene			not detected	300	1.85 ug/L	
92-87-5	Benididine			not detected	50	4.11 ug/L	
129-00-0	Pyrene			not detected	200	1.02 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.15 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.57 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	2.28 ug/L	
218-01-9	Chrysene			not detected	20	2.32 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.29 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.30 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.31 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.57 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.36 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	1.22 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	3.12 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	1.13 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6

Qualifiers

E = Value exceeded linear range
 D = Value from dilution
 B = Compound in related blank
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

0057

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

104-#4 4.5-5.5'

Lab Name: FMETL Lab Code 13461
Project _____ Case No.: 3914 Location B.104 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 3914.07
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA00881.D
Level: (low/med) LOW Date Received: 09/25/98
% Moisture: _____ decanted: (Y/N) N Date Extracted: 09/28/98
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 10/09/98
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Base Neutral Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name bna00882.d
 Operator Skelton
 Date Acquired 9 Oct 1998 4:42 am

Sample Name 3914.09
 Misc Info 104-#5-4.5-5.5'
 Sample Multiplier 1

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
110-86-1	Pyridine			not detected	NLE	2.52 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	2.64 ug/L	
62-53-3	Aniline			not detected	NLE	2.90 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	2.45 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	2.65 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	2.50 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	2.09 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	2.44 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	2.96 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	2.22 ug/L	
67-72-1	Hexachloroethane			not detected	10	2.59 ug/L	
98-95-3	Nitrobenzene			not detected	10	2.45 ug/L	
78-59-1	Isophorone			not detected	100	2.31 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	2.54 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	2.58 ug/L	
91-20-3	Naphthalene			not detected	NLE	3.03 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	2.55 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.64 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	2.49 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.59 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	2.15 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	1.62 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	2.74 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	2.35 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	1.54 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	1.62 ug/L	
83-32-9	Acenaphthene			not detected	400	1.98 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	2.13 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	1.22 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.68 ug/L	
86-73-7	Fluorene			not detected	300	1.93 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.53 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	2.70 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.73 ug/L	
103-33-3	Azobenzene			not detected	NLE	1.92 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	1.54 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.88 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.67 ug/L	
120-12-7	Anthracene			not detected	2000	1.79 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.83 ug/L	
206-44-0	Fluoranthene			not detected	300	1.85 ug/L	
92-87-5	Benztidine			not detected	50	4.11 ug/L	
129-00-0	Pyrene	21.28	76784	1.10 ug/L	200	1.02 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.15 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.57 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	2.28 ug/L	
218-01-9	Chrysene			not detected	20	2.32 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.29 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.30 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.31 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.57 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.36 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	1.22 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	3.12 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	1.13 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6

Qualifiers

E = Value exceeded linear range
 D = Value from dilution
 B = Compound in related blank
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

104-#5 4.5-5.5'

Lab Name: FMETL Lab Code 13461
Project _____ Case No.: 3914 Location B.104 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 3914.09
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA00882.D
Level: (low/med) LOW Date Received: 09/25/98
% Moisture: _____ decanted: (Y/N) N Date Extracted: 09/28/98
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 10/09/98
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted ☒
2. Table of Contents submitted ☒
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted ☒
4. Document paginated and legible ☒
5. Chain of Custody submitted ☒
6. Samples submitted to lab within 48 hours of sample collection ☒
7. Methodology Summary submitted ☒
8. Laboratory Chronicle and Holding Time Check submitted ☒
9. Results submitted on a dry weight basis ☒
10. Method Detection Limits submitted ☒
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP ☒

Laboratory Manager or Environmental Consultant's Signature

Date 12/3/98

Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance.

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.



Daniel K. Wright
Laboratory Manager

FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732)532-6224 FAX: (732)532-3484

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

NJDEP LABORATORY CERTIFICATION # 13461




ANALYTICAL DATA REPORT
Fort Monmouth Environmental Laboratory
ENVIRONMENTAL DIVISION
Fort Monmouth, New Jersey
PROJECT: UST Program

BLDG. 104

Field Location No. & Location	Laboratory Sample ID#	Matrix	Date and Time Of Collection	Date Received
Trip Blank	4002.01	Aqueous	23-Oct-98	10/23/98
Field Blank	4002.02	Aqueous	23-Oct-98 10:50	10/23/98
Bldg. 104 - 1	4002.04	Aqueous	23-Oct-98 13:17	10/23/98
Bldg. 104 - 2	4002.05	Aqueous	23-Oct-98 13:40	10/23/98
Bldg. 104 - 3	4002.06	Aqueous	23-Oct-98 14:40	10/23/98
Bldg. 104 - 4	4002.07	Aqueous	23-Oct-98 14:55	10/23/98
Bldg. 104 - 5	4002.08	Aqueous	23-Oct-98 15:05	10/23/98

ANALYSIS:
FORT MONMOUTH ENVIRONMENTAL LAB.
VOA+15, BN+15


Daniel Wright/Date
Laboratory Director

ENCLOSURE:
CHAIN OF CUSTODY
FIELD DOCUMENTATION
RESULTS

Table of Contents

<u>Section</u>	<u>Pages</u>
Chain of Custody	1-2
Field Documentation	3-5
Methodology Review	6-7
Laboratory Chronicle	8-9
Conformance/Non-Conformance Summary	10-12
Volatile Organics	13
Analytical Results Summary	14-30
Tune Results Summary	31-34
Method Blank Results Summary	35
Calibration Summary	36-39
Surrogate Recovery Summary	40
MS/MSD Results Summary	41
Internal Standard Area & RT Summary	42
Chromatograms	43-58
Base Neutrals	59
Analytical Results Summary	60-80
Tune Results Summary	81-86
Method Blank Results Summary	87
Calibration Summary	88-95
Surrogate Recovery Summary	96
MS/MSD Results Summary	97
Internal Standard Area & RT Summary	98-101
Chromatograms	102-115
Laboratory Deliverables Checklist	116
Laboratory Authentication Statement	117

CHAIN OF CUSTODY

0001



Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-3484 EMail:appleby@doim6.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

Customer: CHAS. APPLEBY / SMC		Project No:		Analysis Parameters								Comments:		
Phone #: 826224		Location: BLDG. 288 BLDG. 104												
() DERA (X) OMA () Other:														
Samplers Name / Company: MARK LAURA - T.V.S. - PWS CO?														
Lab Sample I.D.	Sample Location	Date	Time	Type	bottles	V	B							Remarks / Preservation Method
4002	1 TRIP BLANK	10-23-98	-	AB	2	X								
	2 FIELD BLANK	"	1050	"	"	X	X							HCL
	3 BLDG. 288-6.5'	"	1115	"	3	X	X							HCL / 240C
	4 BLDG. 104-1-	"	1317	"	"	"	"							"
	5 BLDG. 104-2-	"	1340	"	"	"	"							"
	6 BLDG. 104-3-	"	1440	"	"	"	"							"
	7 BLDG. 104-4-	"	1455	"	"	"	"							"
	8 BLDG. 104-5-	"	1505	"	"	"	"							"
	9 FIELD DUP.	"	-	"	"	"	"							
Relinquished by (signature):		Date/Time:		Received by (signature):		Relinquished by (signature):		Date/Time:		Received by (signature):				
Mark Laura		10-23-98 1530		J. Chynoweth										
Relinquished by (signature):		Date/Time:		Received by (signature):		Relinquished by (signature):		Date/Time:		Received by (signature):				
		10/24/98												
Report Type: () Full, (X) Reduced, (X) Standard, () Screen / non-certified						Remarks:								
Turnaround time: (X) Standard 4 wks, () Rush ___ Days, () ASAP Verbal ___ Hrs.														

SAMPLING PROCEDURE SUMMARY

Post Remedial Groundwater Sampling at Former Underground Storage Tank Site[#2 fuel oil]

FOR BLDG. # 104

Ground Water Sampling with the use of a Passively Placed Narrow Diameter Point (PPNDP)

Objective:

To collect a representative groundwater sample utilizing a narrow diameter point [PPNDP] This is a small diameter [1-inch OD] screened casing passively placed in a borehole. The casing is of p.v.c. construction.

1. Methods

- A. A solid push - rod (bull point) is used to create a narrow diameter hole to a depth below the water table. A piece of schedule 40 PVC screen with 0.010-inch slots and an end cap is placed to the bottom of the hole. Glues or adhesives are not used for joining the casing. Threaded PVC casing is used. No filter or gravel pack is used.

2. Installation

- A. Using a Geoprobe, five boreholes were advanced with a pre-probe with a diameter slightly larger than the casing. The holes were made to a depth of 10 feet. The water table was at app. 3 - 5 feet below ground surface.
- B. The screened section of PVC was placed into the borehole so the screened section was across the ground water table from 2 -7 or 4 - 9 feet. Riser casing from 2 - +3 or 4 - +3 feet.

3. Purging

- A. Three volumes of the standing water in the point were purged. The amount of water extracted was app. 0.123 gal. Three to five volumes are purged due to the potential for cross contamination of the screen from upper soil horizons. This was accomplished utilizing a peristaltic pump, and utilizing food grade tubing.

4. Sampling

- A. Sampling methods, sample preservation requirements, sample handling times, decontamination procedure for field equipment, and frequency for field blanks, field duplicates and trip blanks conform to applicable industry methods such as those specified in the NJDEP "Field Sampling Procedures Manual" in effect as of the date on which sampling is performed. Any deviations from the methods in the "Field

Sampling Procedures Manual" pursuant to N.J.A.C. 7:26E-1.6(c) has been approved by the person responsible for conducting the remediation.

All samples were preserved in the field immediately after collection and submitted to the laboratory as soon as possible and no later than 48 hours after sample collection.

The acquisition of samples and water level measurements were performed as recommended and described in the May 1992 edition of NJDEP Field Sampling Procedures Manual.

5. Quality Assurance/Quality Control

A. Decontamination

The associated equipment (bull point, riser pipe, etc.) was decontaminated between borings using the following procedure:

1. Remove all adherent soil material.
2. Wash with a laboratory grade glassware detergent.
3. Rinsed with potable water.
4. Rinse with distilled and deionized ASTM Type II water.

B. Field Blanks

1 Field blank was taken from this site.

C. Sample bottles: Supplied by Environmental Sampling Supply, Oakland, Calif.
The sample bottles are certified clean and are sealed upon delivery.

D. P.V.C. Screens: Supplied by Bedrock Enterprises, Forked River N.J.

Geoprobe Operator: Mark Laura
Employer: U.S. Army, Fort Monmouth
Phone Number: [732] 532-8990
NJDEP License #: J-1486

Mark Laura 12-1-98
Mark Laura / Date

METHODOLOGY REVIEW

Methodology Summary

EPA Method 624

Gas Chromatographic Determination of Volatiles in Water

Surrogates and internal standards are added to a 5 ml aliquot of sample. The sample is then purged and desorbed into a GC/MS system. The organic compounds are separated by the gas chromatograph and detected using the mass spectrometer. Volatiles are identified and quantitated.

EPA Method 3510/8270

Gas Chromatographic Determination of Semi-volatiles in Water

Surrogates are added to a measured volume of sample, usually 1 liter, at a specified pH. The sample is serially extracted with Methylene Chloride using a separatory funnel. The extract concentrated and internal standards are added. The sample is injected into a GC/MS system. Semi-volatiles are identified and quantitated.

LABORATORY CHRONICLE

Laboratory Chronicle

Lab ID: 4002

Site: Bldg. 104

	Date	Hold Time
Date Sampled	10/23/98	NA
Receipt/Refrigeration	10/23/98	NA
Extractions		
1. Base Neutrals	10/27/98	14 days
Analyses		
1. Volatile Organics	10/26,27/98	14 days
2. Base Neutrals	10/31/98, 11/04/98	40 days

CONFORMANCE/ NON-CONFORMANCE SUMMARIES

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT

Indicate
Yes, No, N/A

1. Chromatograms labeled/Compounds identified
(Field samples and method blanks) yes
2. Retention times for chromatograms provided yes
3. GC/MS Tune Specifications
 - a. BFB Meet Criteria yes
 - b. DFTPP Meet Criteria yes
4. GC/MS Tuning Frequency – Performed every 24 hours for 600 series and 12 hours for 8000 series yes
5. GC/MS Calibration – Initial Calibration performed before sample analysis and continuing calibration performed within 24 hours of sample analysis for 600 series and 12 hours for 8000 series yes
6. GC/MS Calibration requirements
 - a. Calibration Check Compounds Meet Criteria yes
 - b. System Performance Check Compounds Meet Criteria yes
7. Blank Contamination – If yes, List compounds and concentrations in each blank: NO
 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA
8. Surrogate Recoveries Meet Criteria yes

If not met, list those compounds and their recoveries, which fall outside the acceptable range:

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA

If not met, were the calculations checked and the results qualified as "estimated"? yes
9. Matrix Spike/Matrix Spike Duplicate Recoveries Meet Criteria
(If not met, list those compounds and their recoveries, which fall outside the acceptable range) _____
 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT (cont.)

Indicate
Yes, No, N/A

10. Internal Standard Area/Retention Time Shift Meet Criteria
(If not met, list those compounds, which fall outside the acceptable range)

yes

- a. VOA Fraction _____
b. B/N Fraction _____
c. Acid Fraction NA _____

11. Extraction Holding Time Met

yes

If not met, list the number of days exceeded for each sample: _____

12. Analysis Holding Time Met

yes

If not met, list the number of days exceeded for each sample: _____

Additional Comments:

Field duplicate collected on this sampling date.
Refer to Bldg 288 6.5

Laboratory Manager: _____

Date: 12-3-98

VOLATILE ORGANICS

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

Definition of Qualifiers

MDL : Method Detection Limit

J : Compound identified below detection limit

B : Compound in both sample and blank

D : Results from dilution of sample

U : Compound searched for but not detected

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Nam **vb01852.d**
 Operator **Skelton**
 Date Acquired **26 Oct 98 11:44 am**

Sample Name **VBLK60**
 Field ID **VBLK60**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	nle	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethan			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ethe			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloroprope			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethan			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

* Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

VBK60

Lab Name: FMETL Project 980932
NJDEP# 13461 Case No.: 4002 SDG No Location UST
Matrix (soil/water) WATER Lab Sample ID: VBK60
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB01852.D
Level: (low/med) LOW Date Received: 10/23/98
% Moisture: not dec. Date Analyzed: 10/26/98
GC Column: HP5MS ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Nam **vb01870.d**
 Operator **Skelton**
 Date Acquired **27 Oct 98 1:47 am**

Sample Name **4002.01**
 Field ID **Trip Blank**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	nle	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethan			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ethe			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloroprope			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethan			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

* Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Trip Blank

Lab Name: FMETL Project 980932
NJDEP# 13461 Case No.: 4002 SDG No Location UST
Matrix (soil/water) WATER Lab Sample ID: 4002.01
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB01870.D
Level: (low/med) LOW Date Received: 10/23/98
% Moisture: not dec. Date Analyzed: 10/27/98
GC Column: HP5MS ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Nam **vb01871.d**
 Operator **Skelton**
 Date Acquired **27 Oct 98 2:33 am**

Sample Name **4002.02**
 Field ID **Field Blank**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	nle	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethan			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ethe			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethan			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

* Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Field Blank

Lab Name: FMETL Project 980932
NJDEP# 13461 Case No.: 4002 SDG No Location UST
Matrix (soil/water) WATER Lab Sample ID: 4002.02
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB01871.D
Level: (low/med) LOW Date Received: 10/23/98
% Moisture: not dec. Date Analyzed: 10/27/98
GC Column: HP5MS ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Nam **vb01873.d**
 Operator **Skelton**
 Date Acquired **27 Oct 98 4:04 am**

Sample Name **4002.04**
 Field ID **Bldg 104 1**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	nle	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethan			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ethe			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethan			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

* Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Bldg104 1

Lab Name: FMETL Project 980932
NJDEP# 13461 Case No.: 4002 SDG No Location UST
Matrix (soil/water) WATER Lab Sample ID: 4002.04
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB01873.D
Level: (low/med) LOW Date Received: 10/23/98
% Moisture: not dec. Date Analyzed: 10/27/98
GC Column: HP5MS ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Nam **vb01874.d**
 Operator **Skelton**
 Date Acquired **27 Oct 98 4:49 am**

Sample Name **4002.05**
 Field ID **Bldg 104 2**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	nle	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethan			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ethe			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethan			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

* Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Bldg104 2

Lab Name: FMETL Project 980932
NJDEP# 13461 Case No.: 4002 SDG No Location UST
Matrix (soil/water) WATER Lab Sample ID: 4002.05
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB01874.D
Level: (low/med) LOW Date Received: 10/23/98
% Moisture: not dec. Date Analyzed: 10/27/98
GC Column: HP5MS ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Nam **vb01875.d**
 Operator **Skelton**
 Date Acquired **27 Oct 98 5:35 am**

Sample Name **4002.06**
 Field ID **Bldg 104 3**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	nle	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethan			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ethe			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethan			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

* Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Bldg104 3

Lab Name: FMETL Project 980932
NJDEP# 13461 Case No.: 4002 SDG No Location UST
Matrix (soil/water) WATER Lab Sample ID: 4002.06
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB01875.D
Level: (low/med) LOW Date Received: 10/23/98
% Moisture: not dec. Date Analyzed: 10/27/98
GC Column: HP5MS ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Nam **vb01876.d**
 Operator **Skelton**
 Date Acquired **27 Oct 98 6:20 am**

Sample Name **4002.07**
 Field ID **Bldg 104 4**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	nle	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethan			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ethe			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethan			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

* Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Bldg104 4

Lab Name: FMETL Project 980932
NJDEP# 13461 Case No.: 4002 SDG No Location UST
Matrix (soil/water) WATER Lab Sample ID: 4002.07
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB01876.D
Level: (low/med) LOW Date Received: 10/23/98
% Moisture: not dec. Date Analyzed: 10/27/98
GC Column: HP5MS ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Nam **vb01877.d**
 Operator **Skelton**
 Date Acquired **27 Oct 98 7:06 am**

Sample Name **4002.08**
 Field ID **Bldg 104 5**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	nle	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethan			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ethe			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloroprope			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethan			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

* Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Bldg104 5

Lab Name: FMETL Project 980932
NJDEP# 13461 Case No.: 4002 SDG No Location UST
Matrix (soil/water) WATER Lab Sample ID: 4002.08
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB01877.D
Level: (low/med) LOW Date Received: 10/23/98
% Moisture: not dec. Date Analyzed: 10/27/98
GC Column: HP5MS ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

BASE NEUTRALS

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **bn01125.d**
 Operator **Skelton**
 Date Acquired **4 Nov 1998 1:02 am**

Sample Name **SBLK153**
 Misc Info **SBLK153 A 981027**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	GW Criteria	MDL	ug/L	Qualifiers
110-86-1	Pyridine			not detected	NLE	2.52	ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	2.64	ug/L	
62-53-3	Aniline			not detected	NLE	2.90	ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	2.45	ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	2.65	ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	2.50	ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	2.09	ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	2.44	ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	2.96	ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	2.22	ug/L	
67-72-1	Hexachloroethane			not detected	10	2.59	ug/L	
98-95-3	Nitrobenzene			not detected	10	2.45	ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	2.54	ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	2.58	ug/L	
91-20-3	Naphthalene			not detected	NLE	3.03	ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	2.55	ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.64	ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	2.49	ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.59	ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	2.15	ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	1.62	ug/L	
131-11-3	Dimethylphthalate			not detected	7000	2.74	ug/L	
208-96-8	Acenaphthylene			not detected	NLE	2.35	ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	1.54	ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	1.62	ug/L	
83-32-9	Acenaphthene			not detected	400	1.98	ug/L	
132-64-9	Dibenzofuran			not detected	NLE	2.13	ug/L	

Semi-Volatile Analysis Report **Page 2**

Data File Name **bna01125.d**
Operator **Skelton**
Date Acquired **4 Nov 1998 1:02 am**

Sample Name **SBLK153**
Misc Info **SBLK153 A 981027**
Sample Multiplier **1**

121-14-2	2,4-Dinitrotoluene			not detected	10	1.22	ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.68	ug/L	
86-73-7	Fluorene			not detected	300	1.93	ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.53	ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	2.70	ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.73	ug/L	
103-33-3	Azobenzene			not detected	NLE	1.92	ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	1.54	ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.88	ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.67	ug/L	
120-12-7	Anthracene			not detected	2000	1.79	ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.83	ug/L	
206-44-0	Fluoranthene			not detected	300	1.85	ug/L	
92-87-5	Benzidine			not detected	50	4.11	ug/L	
129-00-0	Pyrene			not detected	200	1.02	ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.15	ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.57	ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	2.28	ug/L	
218-01-9	Chrysene			not detected	20	2.32	ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.29	ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.30	ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.31	ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.57	ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.36	ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	1.22	ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	3.12	ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	1.13	ug/L	

Qualifiers

E = Value exceeded linear range

D = Value from dilution

B = Compound in related blank

MDL = Method Detection Limit

NLE = No Limit Established

R.T. = Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Sblk153

Lab Name: FMETL Lab Code 13461
Project 980932 Case No.: 4002 Location UST SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: SBLK153
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA01125.D
Level: (low/med) LOW Date Received: 10/23/98
% Moisture: _____ decanted: (Y/N) N Date Extracted: 10/27/98
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 11/04/98
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name bna01070.d
 Operator Skelton
 Date Acquired 31 Oct 1998 12:21 am

Sample Name 4002.02
 Misc Info Field Blank
 Sample Multiplier 1

CAS#	Name	R.T.	Response	Result	GW Criteria	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	2.52 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	2.64 ug/L	
62-53-3	Aniline			not detected	NLE	2.90 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	2.45 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	2.65 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	2.50 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	2.09 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	2.44 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	2.96 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	2.22 ug/L	
67-72-1	Hexachloroethane			not detected	10	2.59 ug/L	
98-95-3	Nitrobenzene			not detected	10	2.45 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	2.54 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	2.58 ug/L	
91-20-3	Naphthalene			not detected	NLE	3.03 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	2.55 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.64 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	2.49 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.59 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	2.15 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	1.62 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	2.74 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	2.35 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	1.54 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	1.62 ug/L	
83-32-9	Acenaphthene			not detected	400	1.98 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	2.13 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **bna01070.d**
 Operator **Skelton**
 Date Acquired **31 Oct 1998 12:21 am**

Sample Name **4002.02**
 Misc Info **Field Blank**
 Sample Multiplier **1**

121-14-2	2,4-Dinitrotoluene			not detected	10	1.22 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.68 ug/L	
86-73-7	Fluorene			not detected	300	1.93 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.53 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	2.70 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.73 ug/L	
103-33-3	Azobenzene			not detected	NLE	1.92 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	1.54 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.88 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.67 ug/L	
120-12-7	Anthracene			not detected	2000	1.79 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.83 ug/L	
206-44-0	Fluoranthene			not detected	300	1.85 ug/L	
92-87-5	Benzidine			not detected	50	4.11 ug/L	
129-00-0	Pyrene			not detected	200	1.02 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.15 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.57 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	2.28 ug/L	
218-01-9	Chrysene			not detected	20	2.32 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate	24.74	987036	25.73 ug/L	30	1.29 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.30 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.31 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.57 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.36 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	1.22 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	3.12 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	1.13 ug/L	

Qualifiers

E = Value exceeded linear range
 D = Value from dilution
 B = Compound in related blank
 MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET FIELD ID
TENTATIVELY IDENTIFIED COMPOUNDS

Field Blank

Lab Name: FMETL Lab Code 13461
 Project 980932 Case No.: 4002 Location UST SDG No.: _____
 Matrix: (soil/water) WATER Lab Sample ID: 4002.02
 Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA01070.D
 Level: (low/med) LOW Date Received: 10/23/98
 % Moisture: _____ decanted: (Y/N) N Date Extracted: 10/27/98
 Concentrated Extract Volume: 1000 (uL) Date Analyzed: 10/31/98
 Injection Volume: 1.0 (uL) Dilution Factor: 1.0
 GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L _____

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **bn01072.d**
 Operator **Skelton**
 Date Acquired **31 Oct 1998 1:45 am**

Sample Name **4002.04**
 Misc Info **Bldg 104 1**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	GW Criteria	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	2.52 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	2.64 ug/L	
62-53-3	Aniline			not detected	NLE	2.90 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	2.45 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	2.65 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	2.50 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	2.09 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	2.44 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	2.96 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	2.22 ug/L	
67-72-1	Hexachloroethane			not detected	10	2.59 ug/L	
98-95-3	Nitrobenzene			not detected	10	2.45 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	2.54 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	2.58 ug/L	
91-20-3	Naphthalene			not detected	NLE	3.03 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	2.55 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.64 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	2.49 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.59 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	2.15 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	1.62 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	2.74 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	2.35 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	1.54 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	1.62 ug/L	
83-32-9	Acenaphthene			not detected	400	1.98 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	2.13 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name bna01072.d
Operator Skelton
Date Acquired 31 Oct 1998 1:45 am

Sample Name 4002.04
Misc Info Bldg 104 1
Sample Multiplier 1

121-14-2	2,4-Dinitrotoluene			not detected	10	1.22	ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.68	ug/L	
86-73-7	Fluorene			not detected	300	1.93	ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.53	ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	2.70	ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.73	ug/L	
103-33-3	Azobenzene			not detected	NLE	1.92	ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	1.54	ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.88	ug/L	
85-01-8	Phenanthrene	17.94	109517	2.73 ug/L	NLE	1.67	ug/L	
120-12-7	Anthracene			not detected	2000	1.79	ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.83	ug/L	
206-44-0	Fluoranthene			not detected	300	1.85	ug/L	
92-87-5	Benzidine			not detected	50	4.11	ug/L	
129-00-0	Pyrene			not detected	200	1.02	ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.15	ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.57	ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	2.28	ug/L	
218-01-9	Chrysene			not detected	20	2.32	ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.29	ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.30	ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.31	ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.57	ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.36	ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	1.22	ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	3.12	ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	1.13	ug/L	

Qualifiers

E = Value exceeded linear range
D = Value from dilution
B = Compound in related blank
MDL = Method Detection Limit
NLE = No Limit Established
R.T. = Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Bldg104 1

Lab Name: FMETL Lab Code 13461
 Project 980932 Case No.: 4002 Location UST SDG No.:
 Matrix: (soil/water) WATER Lab Sample ID: 4002.04
 Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA01072.D
 Level: (low/med) LOW Date Received: 10/23/98
 % Moisture: decanted: (Y/N) N Date Extracted: 10/27/98
 Concentrated Extract Volume: 1000 (uL) Date Analyzed: 10/31/98
 Injection Volume: 1.0 (uL) Dilution Factor: 1.0
 GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 10 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
1. 001127-76-0	Naphthalene, 1-ethyl-	13.39	11	JN
2. 000581-42-0	Naphthalene, 2,6-dimethyl-	13.54	21	JN
3. 000581-40-8	Naphthalene, 2,3-dimethyl-	13.74	25	JN
4. 000571-61-9	Naphthalene, 1,5-dimethyl-	13.77	8	JN
5. 000571-58-4	Naphthalene, 1,4-dimethyl-	13.98	8	JN
6. 000575-37-1	Naphthalene, 1,7-dimethyl-	14.19	8	JN
7. 002131-42-2	Naphthalene, 1,4,6-trimethyl-	15.05	8	JN
8. 000829-26-5	Naphthalene, 2,3,6-trimethyl-	15.11	9	JN
9. 002131-42-2	Naphthalene, 1,4,6-trimethyl-	15.31	8	JN
10.	unknown	17.03	9	J

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **bn01073.d**
 Operator **Skelton**
 Date Acquired **31 Oct 1998 2:27 am**

Sample Name **4002.05**
 Misc Info **Bldg 104 2**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	GW Criteria	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	2.52 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	2.64 ug/L	
62-53-3	Aniline			not detected	NLE	2.90 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	2.45 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	2.65 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	2.50 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	2.09 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	2.44 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	2.96 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	2.22 ug/L	
67-72-1	Hexachloroethane			not detected	10	2.59 ug/L	
98-95-3	Nitrobenzene			not detected	10	2.45 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	2.54 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	2.58 ug/L	
91-20-3	Naphthalene			not detected	NLE	3.03 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	2.55 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.64 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	2.49 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.59 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	2.15 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	1.62 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	2.74 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	2.35 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	1.54 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	1.62 ug/L	
83-32-9	Acenaphthene			not detected	400	1.98 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	2.13 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **bna01073.d**
 Operator **Skelton**
 Date Acquired **31 Oct 1998 2:27 am**

Sample Name **4002.05**
 Misc Info **Bldg 104 2**
 Sample Multiplier **1**

121-14-2	2,4-Dinitrotoluene			not detected	10	1.22	ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.68	ug/L	
86-73-7	Fluorene			not detected	300	1.93	ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.53	ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	2.70	ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.73	ug/L	
103-33-3	Azobenzene			not detected	NLE	1.92	ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	1.54	ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.88	ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.67	ug/L	
120-12-7	Anthracene			not detected	2000	1.79	ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.83	ug/L	
206-44-0	Fluoranthene			not detected	300	1.85	ug/L	
92-87-5	Benzidine			not detected	50	4.11	ug/L	
129-00-0	Pyrene			not detected	200	1.02	ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.15	ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.57	ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	2.28	ug/L	
218-01-9	Chrysene			not detected	20	2.32	ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.29	ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.30	ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.31	ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.57	ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.36	ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	1.22	ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	3.12	ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	1.13	ug/L	

Qualifiers

E = Value exceeded linear range
 D = Value from dilution
 B = Compound in related blank
 MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Bldg104 2

Lab Name: FMETL Lab Code 13461
 Project 980932 Case No.: 4002 Location UST SDG No.:
 Matrix: (soil/water) WATER Lab Sample ID: 4002.05
 Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA01073.D
 Level: (low/med) LOW Date Received: 10/23/98
 % Moisture: decanted: (Y/N) N Date Extracted: 10/27/98
 Concentrated Extract Volume: 1000 (uL) Date Analyzed: 10/31/98
 Injection Volume: 1.0 (uL) Dilution Factor: 1.0
 GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **bna01074.d**
 Operator **Skelton**
 Date Acquired **31 Oct 1998 3:09 am**

Sample Name **4002.06**
 Misc Info **Bldg 104 3**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	GW Criteria	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	2.52 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	2.64 ug/L	
62-53-3	Aniline			not detected	NLE	2.90 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	2.45 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	2.65 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	2.50 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	2.09 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	2.44 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	2.96 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	2.22 ug/L	
67-72-1	Hexachloroethane			not detected	10	2.59 ug/L	
98-95-3	Nitrobenzene			not detected	10	2.45 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	2.54 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	2.58 ug/L	
91-20-3	Naphthalene			not detected	NLE	3.03 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	2.55 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.64 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	2.49 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.59 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	2.15 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	1.62 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	2.74 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	2.35 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	1.54 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	1.62 ug/L	
83-32-9	Acenaphthene			not detected	400	1.98 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	2.13 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name bna01074.d
Operator Skelton
Date Acquired 31 Oct 1998 3:09 am

Sample Name 4002.06
Misc Info Bldg 104 3
Sample Multiplier 1

121-14-2	2,4-Dinitrotoluene			not detected	10	1.22	ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.68	ug/L	
86-73-7	Fluorene			not detected	300	1.93	ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.53	ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	2.70	ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.73	ug/L	
103-33-3	Azobenzene			not detected	NLE	1.92	ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	1.54	ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.88	ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.67	ug/L	
120-12-7	Anthracene			not detected	2000	1.79	ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.83	ug/L	
206-44-0	Fluoranthene			not detected	300	1.85	ug/L	
92-87-5	Benzidine			not detected	50	4.11	ug/L	
129-00-0	Pyrene			not detected	200	1.02	ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.15	ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.57	ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	2.28	ug/L	
218-01-9	Chrysene			not detected	20	2.32	ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.29	ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.30	ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.31	ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.57	ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.36	ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	1.22	ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	3.12	ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	1.13	ug/L	

Qualifiers

E = Value exceeded linear range

D = Value from dilution

B = Compound in related blank

MDL = Method Detection Limit

NLE = No Limit Established

R.T. = Retention Time

0073

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Bldg104 3

Lab Name: FMETL Lab Code 13461
Project 980932 Case No.: 4002 Location UST SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 4002.06
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA01074.D
Level: (low/med) LOW Date Received: 10/23/98
% Moisture: _____ decanted: (Y/N) N Date Extracted: 10/27/98
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 10/31/98
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **bn01075.d**
 Operator **Skelton**
 Date Acquired **31 Oct 1998 3:51 am**

Sample Name **4002.07**
 Misc Info **Bldg 104 4**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	GW Criteria	MDL	ug/L	Qualifiers
110-86-1	Pyridine			not detected	NLE	2.52	ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	2.64	ug/L	
62-53-3	Aniline			not detected	NLE	2.90	ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	2.45	ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	2.65	ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	2.50	ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	2.09	ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	2.44	ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	2.96	ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	2.22	ug/L	
67-72-1	Hexachloroethane			not detected	10	2.59	ug/L	
98-95-3	Nitrobenzene			not detected	10	2.45	ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	2.54	ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	2.58	ug/L	
91-20-3	Naphthalene			not detected	NLE	3.03	ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	2.55	ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.64	ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	2.49	ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.59	ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	2.15	ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	1.62	ug/L	
131-11-3	Dimethylphthalate			not detected	7000	2.74	ug/L	
208-96-8	Acenaphthylene			not detected	NLE	2.35	ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	1.54	ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	1.62	ug/L	
83-32-9	Acenaphthene			not detected	400	1.98	ug/L	
132-64-9	Dibenzofuran			not detected	NLE	2.13	ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name bna01075.d
Operator Skelton
Date Acquired 31 Oct 1998 3:51 am

Sample Name 4002.07
Misc Info Bldg 104 4
Sample Multiplier 1

121-14-2	2,4-Dinitrotoluene			not detected	10	1.22	ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.68	ug/L	
86-73-7	Fluorene			not detected	300	1.93	ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.53	ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	2.70	ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.73	ug/L	
103-33-3	Azobenzene			not detected	NLE	1.92	ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	1.54	ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.88	ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.67	ug/L	
120-12-7	Anthracene			not detected	2000	1.79	ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.83	ug/L	
206-44-0	Fluoranthene			not detected	300	1.85	ug/L	
92-87-5	Benzidine			not detected	50	4.11	ug/L	
129-00-0	Pyrene			not detected	200	1.02	ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.15	ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.57	ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	2.28	ug/L	
218-01-9	Chrysene			not detected	20	2.32	ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.29	ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.30	ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.31	ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.57	ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.36	ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	1.22	ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	3.12	ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	1.13	ug/L	

Qualifiers

E = Value exceeded linear range

D = Value from dilution

B = Compound in related blank

MDL = Method Detection Limit

NLE = No Limit Established

R.T. = Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET FIELD ID
TENTATIVELY IDENTIFIED COMPOUNDS

Bldg104 4

Lab Name: FMETL Lab Code 13461
 Project 980932 Case No.: 4002 Location UST SDG No.: _____
 Matrix: (soil/water) WATER Lab Sample ID: 4002.07
 Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA01075.D
 Level: (low/med) LOW Date Received: 10/23/98
 % Moisture: _____ decanted: (Y/N) N Date Extracted: 10/27/98
 Concentrated Extract Volume: 1000 (uL) Date Analyzed: 10/31/98
 Injection Volume: 1.0 (uL) Dilution Factor: 1.0
 GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **bn01076.d**
 Operator **Skelton**
 Date Acquired **31 Oct 1998 4:32 am**

Sample Name **4002.08**
 Misc Info **Bldg 104 5**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	GW Criteria	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	2.52 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	2.64 ug/L	
62-53-3	Aniline			not detected	NLE	2.90 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	2.45 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	2.65 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	2.50 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	2.09 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	2.44 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	2.96 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	2.22 ug/L	
67-72-1	Hexachloroethane			not detected	10	2.59 ug/L	
98-95-3	Nitrobenzene			not detected	10	2.45 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	2.54 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	2.58 ug/L	
91-20-3	Naphthalene			not detected	NLE	3.03 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	2.55 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.64 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	2.49 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.59 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	2.15 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	1.62 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	2.74 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	2.35 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	1.54 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	1.62 ug/L	
83-32-9	Acenaphthene			not detected	400	1.98 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	2.13 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name bna01076.d
Operator Skelton
Date Acquired 31 Oct 1998 4:32 am

Sample Name 4002.08
Misc Info Bldg 104 5
Sample Multiplier 1

121-14-2	2,4-Dinitrotoluene			not detected	10	1.22	ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.68	ug/L	
86-73-7	Fluorene			not detected	300	1.93	ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.53	ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	2.70	ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.73	ug/L	
103-33-3	Azobenzene			not detected	NLE	1.92	ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	1.54	ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.88	ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.67	ug/L	
120-12-7	Anthracene			not detected	2000	1.79	ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.83	ug/L	
206-44-0	Fluoranthene			not detected	300	1.85	ug/L	
92-87-5	Benzidine			not detected	50	4.11	ug/L	
129-00-0	Pyrene			not detected	200	1.02	ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.15	ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.57	ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	2.28	ug/L	
218-01-9	Chrysene			not detected	20	2.32	ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.29	ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.30	ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.31	ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.57	ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.36	ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	1.22	ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	3.12	ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	1.13	ug/L	

Qualifiers

E = Value exceeded linear range

D = Value from dilution

B = Compound in related blank

MDL = Method Detection Limit

NLE = No Limit Established

R.T. = Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Bldg104 5

Lab Name: FMETL Lab Code 13461
Project 980932 Case No.: 4002 Location UST SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 4002.08
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA01076.D
Level: (low/med) LOW Date Received: 10/23/98
% Moisture: _____ decanted: (Y/N) N Date Extracted: 10/27/98
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 10/31/98
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted
2. Table of Contents submitted
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted
4. Document paginated and legible
5. Chain of Custody submitted
6. Samples submitted to lab within 48 hours of sample collection
7. Methodology Summary submitted
8. Laboratory Chronicle and Holding Time Check submitted
9. Results submitted on a dry weight basis
10. Method Detection Limits submitted
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP

✓
✓
✓
✓
✓
✓
✓
✓
✓
✓
✓

Laboratory Manager or Environmental Consultant's Signature

Date 12/3/93



Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance.

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.



Daniel K. Wright
Laboratory Manager

APPENDIX G

PHOTOGRAPHS



JANUARY 27, 1998
PHOTOGRAPHIC LOG

UST NO. 90010-75

**Building 104
Main Post-East
Fort Monmouth**

VERSAR
Engineers, Managers, Scientists & Planners
Bristol, PA