

United States Army
Fort Monmouth, New Jersey

**Underground Storage Tank
Closure and Site Investigation
Report**

***Building 276
Main Post-East Area***

**NJDEP UST Registration No. 90010-23
Dicar No. 96-06-21-1331-05**

January 2000

**UNDERGROUND STORAGE TANK
CLOSURE AND SITE INVESTIGATION REPORT**

BUILDING 276

**MAIN POST-EAST AREA
NJDEP UST REGISTRATION NO. 90010-23
DICAR NO. 96-06-21-1331-05**

JANUARY 2000

PREPARED FOR:

**UNITED STATES ARMY, FORT MONMOUTH, NEW JERSEY
DIRECTORATE OF PUBLIC WORKS
BUILDING 167
FORT MONMOUTH, NJ 07703**

PREPARED BY:

**VERSAR
1900 FROST ROAD
SUITE 110
BRISTOL, PA 19007**

PROJECT NO. 4435-018

TABLE OF CONTENTS

EXECUTIVE SUMMARY	iv
1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES	1
1.1 OVERVIEW	1
1.2 SITE DESCRIPTION	2
1.2.1 Geological/Hydrogeological Setting	2
1.3 HEALTH AND SAFETY	5
1.4 REMOVAL OF UNDERGROUND STORAGE TANK	5
1.4.1 General Procedures	5
1.4.2 Underground Storage Tank Excavation and Cleaning	5
1.5 UNDERGROUND STORAGE TANK TRANSPORTATION AND DISPOSAL	6
1.6 MANAGEMENT OF EXCAVATED SOILS	6
2.0 SITE INVESTIGATION ACTIVITIES	7
2.1 OVERVIEW	7
2.2 FIELD SCREENING/MONITORING	7
2.3 SOIL SAMPLING	8
2.4 GROUNDWATER SAMPLING	8
3.0 CONCLUSIONS AND RECOMMENDATIONS	9
3.1 SOIL SAMPLING RESULTS	9
3.2 GROUNDWATER SAMPLING RESULTS	
3.3 CONCLUSIONS AND RECOMMENDATIONS	10

TABLE OF CONTENTS (CONTINUED)

TABLES

Table 1	Summary of Post-Excavation Sampling Activities
Table 2	Post-Excavation Soil Sampling Results
Table 3	Groundwater Sampling Results

FIGURES

Figure 1	Site Location Map
Figure 1A	Geological Map
Figure 2	Site Map
Figure 3	Cross Sectional View
Figure 4	Soil Sampling Location Map
Figure 5	Groundwater Sampling Location Map

APPENDICES

Appendix A	NJDEP-BUST Closure Approval Letter
Appendix B	Site Assessment Summary
Appendix C	Waste Manifest
Appendix D	UST Disposal Certificate
Appendix E	Soil Analytical Data Package
Appendix F	Groundwater Analytical Data Package
Appendix G	Photographs
Appendix H	Electronic Data Deliverables

EXECUTIVE SUMMARY

UST Closure

On June 21, 1996, a steel underground storage tank (UST) was closed by removal in accordance with New Jersey Department of Environmental Protection (NJDEP) underground storage tank closure procedures at the Main Post-East area of the U.S. Army Fort Monmouth, Fort Monmouth, New Jersey. The UST, NJDEP Registration No. 90010-23 (Fort Monmouth ID No. 276), was located west of Building 276. UST No. 90010-23 was a 1,000-gallon No. 2 fuel oil UST. The fill port was located directly above the tank.

Site Assessment

The site assessment was performed by U.S. Army personnel in accordance with the NJDEP *Technical Requirements for Site Remediation* (N.J.A.C. 7:26E) and the NJDEP *Field Sampling Procedures Manual*. The sampling and laboratory analysis conducted during the site assessment were performed in accordance with Section 7:26E-2.1 of the *Technical Requirements for Site Remediation*. Soils surrounding the tank were screened visually and with air monitoring equipment for evidence of contamination. Following removal, the UST was inspected for corrosion holes. Numerous holes were noted in the UST. Soils at the location of the holes were dark in color and appeared to be contaminated. Based on the inspection of the UST, Directorate of Public Works (DPW) concluded that a discharge was associated with this UST. The NJDEP hotline was notified and the case was assigned DICAR No. 96-06-21-1331-05. Approximately 480 cubic yards of potentially contaminated soil were removed from the excavated area and stored at the Fort Monmouth petroleum contaminated soil staging area. Soil samples, which were collected after the removal of the potentially contaminated soil, contained non-detectable levels of TPHC. Groundwater was encountered at 6.0 feet below ground surface and no sheen was observed.

All post excavation soil samples collected from the UST excavation at Building 276 contained TPHC concentrations below the NJDEP residential direct contact total organic contaminants soil cleanup criteria of 10,000 milligrams per kilogram (mg/kg) (N.J.A.C. 7:26D and revisions dated February 3, 1994). Following receipt of all post-excavation soil sampling results, the excavation was backfilled to grade with a combination of uncontaminated excavated soil and certified clean fill. The excavation site was then restored to its original condition.

In response to the observation of potentially contaminated soil and the potential of groundwater contamination, two (2) groundwater samples were collected at Building 276. On October 25, 1999, and December 4, 1999, Building 276 was sampled for volatile organic compounds calibrated for xylene plus 15 tentatively identified compounds (VOC's), and semivolatile organic compounds plus 15 tentatively identified compounds (SVOC's). All groundwater analytical results were either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

No further action is proposed in regard to the closure and site assessment of UST No. 90010-23 at Building 276.

1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES

1.1 OVERVIEW

One underground storage tank (UST), New Jersey Department of Environmental Protection (NJDEP) Registration No. 90010-23, was closed at Building 276 at the Main Post-East area of U.S. Army Fort Monmouth, Fort Monmouth, New Jersey on June 21, 1996. Refer to the site location map on Figure 1. This report presents the results of the Department of Public Works' (DPW) implementation of the UST Decommissioning/Closure Plan approved by the NJDEP on September 25, 1995. The UST was a steel 1,000-gallon tank containing No. 2 fuel oil.

Decommissioning activities for UST No. 90010-23 complied with all applicable Federal, State, and Local laws and ordinances in effect at the date of decommissioning. These laws included but were not limited to N.J.A.C. 7:14B-1 et seq., N.J.A.C. 5:23-1 et seq., and Occupational Safety and Health Administration (OSHA) 1910.146 & 1910.120. All permits including but not limited to the NJDEP approved Decommissioning/Closure Plan were posted onsite for inspection. DPW personnel who are registered and certified by the NJDEP for performing UST closure activities conducted the decommissioning activities.

Closure of UST No. 90010-23 proceeded under the approval of the NJDEP Bureau of Underground Storage Tanks (NJDEP-BUST). The NJDEP Closure Approval Letter and signed Site Assessment Summary form for UST No. 90010-23 are included in Appendices A and B, respectively.

After removal of the potentially contaminated soil, the site was assessed. Based on inspecting the UST, field screening of remaining subsurface soils, and reviewing analytical results of soil samples and groundwater samples, the DPW has concluded that no significant historical discharges are associated with the UST or associated piping.

This UST Closure and Site Investigation Report has been prepared by Versar, to assist the U.S. Army DPW in complying with the NJDEP-BUST regulations. The applicable NJDEP-BUST regulations at the date of closure were the *Interim Closure Requirements for Underground Storage Tank Systems* (N.J.A.C. 7:14B-1 et seq. October 1990 and revisions dated November 1, 1991).

This report was prepared using information collected at the time of closure. Section 1 of this UST Closure and Site Investigation Report provides a summary of the UST decommissioning activities. Section 2 of this report describes the site investigation activities. Conclusions and recommendations, including the results of the soil sampling and groundwater investigation, are presented in the final section of this report.

1.2 SITE DESCRIPTION

Building 276 is located in the Main Post-East area of the Fort Monmouth Army Base. UST No. 90010-23 was located west of Building 276 and appurtenant copper piping ran approximately ten (10) feet southeast from the excavation to Building 276. A site map is provided on Figure 2.

1.2.1 Geological/Hydrogeological Setting

The following is a description of the geological/hydrogeological setting of the area surrounding Building 276. Included is a description of the regional geology of the area surrounding Fort Monmouth as well as descriptions of the local geology and hydrogeology of the Main Post area. A geological map is provided on Figure 1A.

Regional Geology

Monmouth County lies within the New Jersey Section of the Atlantic Coastal Plain physiographic province. The Main Post, Charles Wood, and the Evans areas are located in what may be referred to as the Outer Coastal Plain subprovince, or the Outer Lowlands.

In general, New Jersey Coastal Plain formations consist of a seaward-dipping wedge of unconsolidated deposits of clay, silt, and gravel. These formations typically strike northeast-southwest with a dip ranging from 10 to 60 feet per mile and were deposited on Precambrian and lower Paleozoic rocks (Zapecza, 1989). These sediments, predominantly derived from deltaic, shallow marine, and continental shelf environments, date from Cretaceous through the Quaternary Periods. The mineralogy ranges from quartz to glauconite.

The formations record several major transgressive/regressive cycles and contain units which are generally thicker to the southeast and reflect a deeper water environment. More than 20 regional geologic units are present within the sediments of the Coastal Plain. Regressive, upward coarsening deposits are usually aquifers (e.g., Englishtown and Kirkwood Formations, and the Cohansey Sand) while the transgressive deposits act as confining units (e.g., the Merchantville, Marshalltown, and Navesink Formations). The individual thicknesses for these units vary greatly (i.e., from several feet to several hundred feet). The Coastal Plain deposits thicken to the southeast from the Fall Line to greater than 6,500 feet in Cape May County (Brown and Zapecza, 1990).

Local Geology

Based on the regional geologic map (Jablonski, 1968), the Cretaceous age Red Bank and Tinton Sands outcrop at the Main Post area. The Red Bank sand conformably overlies the Navesink Formation and dips to the southeast at 35 feet per mile. The upper member (Shrewsbury) of the Red Bank sand is a yellowish-gray to reddish brown clayey, medium-to-coarse-grained sand that contains abundant rock fragments, minor mica and glauconite (Jablonski). The lower member (Sandy Hook) is a dark gray to black, medium-to-fine

grained sand with abundant clay, mica, and glauconite.

The Tinton sand conformably overlies the Red Bank Sand and ranges from a clayey medium to very coarse grained feldspathic quartz and glauconite sand to a glauconitic coarse sand. The color varies from dark yellowish orange or light brown to moderate brown and from light olive to grayish olive. Glauconite may constitute 60 to 80 percent of the sand fraction in the upper part of the unit (Minard, 1969). The upper part of the Tinton is often highly oxidized and iron oxide encrusted (Minard).

Hydrogeology

The water table aquifer in the Main Post area is identified as part of the "composite confining units," or minor aquifers. The minor aquifers include the Navesink formation, Red Bank Sand, Tinton Sand, Hornerstown Sand, Vincentown Formation, Manasquan Formation, Shark River Formation, Piney Point Formation, and the basal clay of the Kirkwood Formation.

Based on records of wells drilled in the Main Post area, water is typically encountered at depths of 2 to 9 feet below ground surface (bgs). According to Jablonski, wells drilled in the Red Bank and Tinton Sands may produce 2 to 25 gallons per minute (gpm). Some well owners have reported acidic water that requires treatment to remove iron.

Due to the proximity of the Atlantic Ocean to Fort Monmouth, shallow groundwater may be tidally influenced and may flow toward creeks and brooks as the tide goes out, and away from creeks and brooks as the tide comes in. However, an abundance of clay lenses and sand deposits were noted in borings installed throughout Fort Monmouth. Therefore, the direction of shallow groundwater should be determined on a case-by-case basis.

Shallow groundwater is locally influenced within the Main Post area by the following factors:

- tidal influence (based on proximity to the Atlantic Ocean, rivers, and tributaries)
- topography
- nature of the fill material within the Main Post area
- presence of clay and silt lenses in the natural overburden deposits
- local groundwater recharge areas (i.e., streams, lakes)

Due to the fluvial nature of the overburden deposits (i.e., sand and clay lenses), shallow groundwater flow direction is best determined on a case-by-case basis. This is consistent with lithologies observed in borings installed within the Main Post area, which primarily consisted of fine-to-medium grained sands, with occasional lenses or laminations of gravel silt and/or clay.

Building 276 is located approximately 600 feet south of Parkers Creek, the nearest water body. Based on the Main Post topography, the groundwater flow in the area of Building 276 is anticipated to be to the north.

1.3 HEALTH AND SAFETY

Before, during, and after all decommissioning activities, hazards at the work site which may have posed a threat to the Health and Safety of all personnel who were involved with, or were affected by, the decommissioning of the UST system were minimized.

1.4 REMOVAL OF UNDERGROUND STORAGE TANK

1.4.1 General Procedures

- The contractor performing the closure prior to excavation activities identified all underground obstructions (utilities, etc.).
- All activities were carried out with the greatest regard to safety and health and the safeguarding of the environment.
- All excavated soils were visually examined and screened with an OVA for evidence of contamination. Potentially contaminated soils were identified and logged during closure activities.
- Surface materials (i.e., asphalt, concrete, etc.) were excavated and staged separately from all soil and recycled in accordance with all applicable regulations and laws.
- A Sub-Surface Evaluator from the DPW was present during all site assessment activities.

1.4.2 Underground Storage Tank Excavation and Cleaning

Prior to UST decommissioning activities, surficial soil was removed to expose the UST and associated piping. All free product present in the piping was drained into the UST, and the UST was purged to remove vapors prior to cutting and removal of the piping. After removal of the associated piping, a manway was made in the UST to allow for proper cleaning. The UST was completely emptied of all liquids prior to removal from the ground. Approximately 600 gallons of liquid from the UST and its associated piping were transported by Lionetti Oil Recovery Company to Lionetti Oil Recovery Company, Inc. facility, a NJDEP-approved petroleum recycling and disposal company located in Old Bridge, New Jersey. Refer to Appendix C for the waste manifest.

The UST was cleaned prior to removal from the excavation in accordance with the NJDEP-BUST regulations. After the UST was removed from the excavation, it was staged on polyethylene sheeting and examined for holes. Numerous holes were observed during the inspection by the Sub-Surface Evaluator. Soils surrounding the UST were screened visually for evidence of contamination. Potentially contaminated soils were observed. Approximately 480 cubic yards of potentially contaminated soil were removed, respectively from the excavated area. Soil screening was also performed along the piping run associated with the UST closure. No contamination was noted anywhere along the piping length. Groundwater was encountered at 6.0 feet below ground surface and no sheen was observed. See Figure 3 for a cross-sectional view of the excavated area.

1.5 UNDERGROUND STORAGE TANK TRANSPORTATION AND DISPOSAL

The steel tank was transported in compliance with all applicable regulations and laws to Mazza & Sons, Inc., Recycling Division. Refer to Appendix D for the UST disposal certificate and Appendix G for photographs of the UST.

The UST was labeled prior to transport with the following information:

- Site of origin
- Contact person
- NJDEP UST Facility ID number
- Former contents
- Destination site
- Date

1.6 MANAGEMENT OF EXCAVATED SOILS

Based on visual observations, approximately 480 cubic yards of potentially contaminated soil were removed from the UST excavation. All potentially contaminated soils were stockpiled separately from other excavated material and were placed on and covered with polyethylene sheets. Potentially contaminated soils were transported to the soil staging area. Soils that did not exhibit signs of contamination were used as backfill following the removal of the UST. Groundwater was encountered at 6.0 feet below ground surface and no sheen was observed.

2.0 SITE INVESTIGATION ACTIVITIES

2.1 OVERVIEW

The Site Investigation was managed and carried out by U.S. Army DPW personnel. All analyses were performed and reported by U.S. Army Fort Monmouth Environmental Laboratory, a NJDEP-certified testing laboratory. All sampling was performed under the direct supervision of a NJDEP Certified Sub-Surface Evaluator according to the methods described in the NJDEP *Field Sampling Procedures Manual* (1992). Sampling frequency and parameters analyzed complied with the NJDEP-BUST document *Interim Closure Requirements for Underground Storage Tank Systems* (October 1990 and revisions dated November 1, 1991) which was the applicable regulation at the date of the closure. The Fort Monmouth DPW Environmental Office maintains all records of the Site Investigation activities.

The following Parties participated in Closure and Site Investigation Activities:

- Subsurface Evaluator: Eugene Lesinski
Employer: U.S. Army, Fort Monmouth
Phone Number: (908) 532-0989
NJDEP Certification No.: 0014537
- Analytical Laboratory: U.S. Army Fort Monmouth Environmental Laboratory
Contact Person: Daniel K. Wright
Phone Number: (908) 532-4359
NJDEP Company Certification No.: 13461
- Hazardous Waste Hauler: Lorco Petroleum Services
Contact Person: Gary LoBello
Phone Number: (732) 721-0900

2.2 FIELD SCREENING/MONITORING

Field screening was performed by a NJDEP Certified Sub-Surface Evaluator using visual observations to identify potentially contaminated material. Soil excavated from around the tank exhibited evidence of potential contamination. Soils were removed from the excavation until no evidence of contamination remained. Groundwater was encountered at 6.0 feet below ground surface and no sheen was observed.

2.3 SOIL SAMPLING

On June 17, 1998, following the removal of all potentially contaminated soils, post-excavation soil samples 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, and 13 were collected from a total of twelve (12) locations of the UST excavation. Samples 1, 7, 8, and 12 were collected along the excavation floor at a depth of 7.0 feet bgs. Sidewall samples 2, 3, 4, 5, 6, 9, 10, 11, and 13 were collected at a depth of 6.5 feet bgs. All samples were analyzed for TPHC and total solids.

U.S. Army personnel in accordance with the NJDEP Technical Requirements and the NJDEP Field Sampling Procedures Manual performed the site assessment. A summary of sampling activities including parameters analyzed is provided in Table 1. The post-excavation soil samples were collected using NJDEP *Field Sampling Procedures Manual* (1992) standard sampling procedures. Following soil sampling activities, the samples were chilled and delivered to U.S. Army Fort Monmouth Environmental Laboratory located in Fort Monmouth, New Jersey, for analysis.

2.4 GROUNDWATER SAMPLING

On October 25, 1999, and December 4, 1999, Building 276 was sampled for volatile organic compounds calibrated for xylene plus 15 tentatively identified compounds (VOC's), and semivolatile organic compounds plus 15 tentatively identified compounds (SVOC's). Sampling and analysis were performed in accordance with the NJDEP *Field Sampling Procedures Manual* and the *Technical Requirements For Site Remediation*. Refer to Appendix F for the field sampling documentation.

3.0 CONCLUSIONS AND RECOMMENDATIONS

3.1 SOIL SAMPLING RESULTS

To evaluate soil conditions following removal of the UST and associated piping, post-excavation soil samples were collected on June 17, 1998 from a total of twelve (12) locations. All samples were analyzed for TPHC and total solids. The post-excavation sampling results were compared to the NJDEP residential direct contact total organic contaminants soil cleanup criteria of 10,000 mg/kg (N.J.A.C. 7:26D and revisions dated February 3, 1994). A summary of the analytical results and comparison to the NJDEP soil cleanup criteria is provided in Table 2 and the soil sampling locations are shown on Figure 4. The analytical data package is provided in Appendix E.

All post-excavation soil samples collected on June 17, 1998, from the UST excavation and from below piping associated with the UST contained concentrations of TPHC below the NJDEP soil cleanup criteria. Samples contained non-detectable levels of TPHC.

3.2 GROUNDWATER SAMPLING RESULTS

The sample collected from Building 276 on October 25, 1999, contained 2-methylnaphthalene at 1.31 ug/l. No other compounds were detected.

No compounds were detected in the sample collected from Building 276 on December 4, 1999.

A summary of the analytical results and comparison to the NJDEP groundwater cleanup criteria is provided in Table 3 and the groundwater sampling locations are shown on Figure 5. The analytical data package is provided in Appendix F. The full data package, including quality control is on file at U.S. Army Fort Monmouth located in Fort Monmouth, New Jersey.

Groundwater samples collected on October 25, 1999, and on December 4, 1999, were either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

3.3 CONCLUSIONS AND RECOMMENDATIONS

The analytical results for all post-excavation soil samples collected from the UST closure excavation at Building 276 were below the NJDEP soil cleanup criteria for total organic contaminants.

Based on the post-excavation sampling results, soil with TPHC concentrations exceeding the NJDEP soil cleanup criteria for total organic contaminants of 10,000 mg/kg, do not exist in the former location of the UST or associated piping.

Based on the analytical results of the groundwater samples collected at Building 276 on October 25, 1999, and December 4, 1999, groundwater quality at Building 276 was either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

No further action is proposed in regard to the closure and site assessment of UST No. 90010-23 at Building 276.

TABLES

TABLE 1

SUMMARY OF POST-EXCAVATION SAMPLING ACTIVITIES
BUILDING 276, MAIN POST-EAST AREA
FORT MONMOUTH, NEW JERSEY

Page 1 of 2

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	NJDEP Method
1	7/6/94	7/7/94	Soil	Post-Excavation	TPHC	OQA-QAM-025
2	7/6/94	7/7/94	Soil	Post-Excavation	TPHC	OQA-QAM-025
3	7/6/94	7/7/94	Soil	Post-Excavation	TPHC	OQA-QAM-025
4	7/6/94	7/7/94	Soil	Post-Excavation	TPHC	OQA-QAM-025
5	7/6/94	7/7/94	Soil	Post-Excavation	TPHC	OQA-QAM-025
6	7/6/94	7/7/94	Soil	Post-Excavation	TPHC	OQA-QAM-025
7	7/6/94	7/7/94	Soil	Post-Excavation	TPHC	OQA-QAM-025
8	7/6/94	7/7/94	Soil	Post-Excavation	TPHC	OQA-QAM-025
9	7/7/94	7/7/94	Soil	Post-Excavation	TPHC	OQA-QAM-025
10	7/6/94	7/7/94	Soil	Post-Excavation	TPHC	OQA-QAM-025
11	7/6/94	7/7/94	Soil	Post-Excavation	TPHC	OQA-QAM-025
12	7/6/94	7/7/94	Soil	Post-Excavation	TPHC	OQA-QAM-025
13	7/7/94	7/7/94	Soil	Post-Excavation	TPHC	OQA-QAM-025

Note:

* TPHC Total Petroleum Hydrocarbons

TABLE 1

SUMMARY OF SAMPLING ACTIVITIES
BUILDING 276, MAIN POST-EAST AREA
FORT MONMOUTH, NEW JERSEY

Page 2 of 2

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	Sampling Method**
4882.01	10/25/99	10/28/98	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
4882.02	10/25/99	10/28/98	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
4882.03	10/25/99	10/28/98	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
4882.04	10/25/99	10/28/98	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
4982.01	12/4/99	12/9/99	Aqueous	Groundwater	VOCs, SVOCs	PPNDP

Note:

- *VOCs: Volatile Organic Compounds plus 15 tentatively identified compounds
*SVOCs: Semivolatile organic compounds plus 15 tentatively identified compounds
**PPNDP: Passively Placed Narrow Diameter Point

TABLE 2

POST-EXCAVATION SOIL SAMPLING RESULTS
BUILDING 276, MAIN POST-EAST AREA
FORT MONMOUTH, NEW JERSEY

Page 1 of 2

Sample ID/ Depth	Sample Laboratory ID	Sample Date	Analysis Date	Analytical Parameters	Method Detection Limit (mg/kg)	Compound of Concern	Results (mg/kg) *	NJDEP Soil Cleanup Criteria ** (mg/kg)	Exceeds Cleanup Criteria
1/7.0'	3663.01	6/17/98	6/17/98	Total Solid	--	--	80.90 %	--	--
				TPHC	191	yes	ND	10,000	No
2/6.5'	3663.02	6/17/98	6/17/98	Total Solid	--	--	80.20 %	--	--
				TPHC	193	yes	ND	10,000	No
3/6.5'	3663.03	6/17/98	6/17/98	Total Solid	--	--	85.30 %	--	--
				TPHC	177	yes	ND	10,000	No
4/6.5'	3663.04	6/17/98	6/17/98	Total Solid	--	--	86.25 %	--	--
				TPHC	172	yes	ND	10,000	No
5/6.5'	3663.05	6/17/98	6/17/98	Total Solid	--	--	86.02 %	--	--
				TPHC	179	yes	ND	10,000	No
6/6.5'	3663.06	6/17/98	6/17/98	Total Solid	--	--	86.54 %	--	--
				TPHC	172	yes	ND	10,000	No
7/7.0'	3663.07	6/17/98	6/17/98	Total Solid	--	--	79.31 %	--	--
				TPHC	191	yes	ND	10,000	No
8/7.0'	3663.08	6/17/98	6/17/98	Total Solid	--	--	80.91 %	--	--
				TPHC	192	yes	ND	10,000	No
9/6.5'	3663.09	6/17/98	6/17/98	Total Solid	--	--	82.08 %	--	--
				TPHC	187	yes	ND	10,000	No

Note:

- * Total Solid results are expressed as a percentage.
 ** NJDEP Residential Direct Contact soil cleanup criteria for total organics
 ND Not detected above stated method detection limit
 TPHC Total Petroleum Hydrocarbons
 -- Not Applicable

TABLE 2

POST-EXCAVATION SOIL SAMPLING RESULTS
 BUILDING 276, MAIN POST-EAST AREA
 FORT MONMOUTH, NEW JERSEY

Page 2 of 2

Sample ID/ Depth	Sample Laboratory ID	Sample Date	Analysis Date	Analytical Parameters	Method Detection Limit (mg/kg)	Compound of Concern	Results (mg/kg) *	NJDEP Soil Cleanup Criteria ** (mg/kg)	Exceeds Cleanup Criteria
10/6.5'	3663.10	6/17/98	6/17/98	Total Solid	--	--	83.63 %	--	--
				TPHC	187	yes	ND	10,000	No
11/6.5'	3663.11	6/17/98	6/17/98	Total Solid	--	--	83.50 %	--	--
				TPHC	178	yes	ND	10,000	No
12/7.0'	3663.12	6/17/98	6/17/98	Total Solid	--	--	80.47 %	--	--
				TPHC	194	yes	ND	10,000	No
13/6.5'	3663.13	6/17/98	6/17/98	Total Solid	--	--	82.52 %	--	--
				TPHC	188	yes	ND	10,000	No

Note:

- * Total Solid results are expressed as a percentage.
 ** NJDEP Residential Direct Contact soil cleanup criteria for total organics
 ND Not detected above stated method detection limit
 TPHC Total Petroleum Hydrocarbons
 -- Not Applicable

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 10/25/99 Location: 276 Lab Sample ID: 4882.01(Trip Blank)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	Not Detected	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 10/25/99 Location: 276 Lab Sample ID: 4882.01(Trip Blank)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 10/25/99 Location: 276 Lab Sample ID: 4882.02(Field Blank)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	Not Detected	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 10/25/99 Location: 276 Lab Sample ID: 4882.02(Field Blank)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 10/25/99 Location: 276 Lab Sample ID: 4882.03(Dup 276)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	Not Detected	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 10/25/99 Location: 276 Lab Sample ID: 4882.03(Dup 276)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 10/25/99 Location: 276 Lab Sample ID: 4882.04(Bldg 276)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	Not Detected	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 10/25/99 Location: 276 Lab Sample ID: 4882.04(Bldg 276)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 10/25/99Location: 276Lab Sample ID: 4882.02(Field Blank)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	1.83	Not Detected	--	nle	no
62-75-9	N-nitroso-dimethylamine	0.91	Not Detected	--	20	no
62-53-3	Aniline	1.63	Not Detected	--	nle	no
111-44-4	bis(2-Chloroethyl)ether	1.28	Not Detected	--	10	no
541-73-1	1,3-Dichlorobenzene	1.19	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	1.02	Not Detected	--	75	no
100-51-6	Benzyl alcohol	1.02	Not Detected	--	nle	no
95-50-1	1,2-Dichlorobenzene	1.13	Not Detected	--	600	no
108-60-1	bis(2-chloroisopropyl)ether	1.39	Not Detected	--	300	no
621-64-7	n-Nitroso-di-n-propylamine	1.50	Not Detected	--	20	no
67-72-1	Hexachloroethane	0.97	Not Detected	--	10	no
98-95-3	Nitrobenzene	1.01	Not Detected	--	10	no
78-59-1	Isophorone	1.21	Not Detected	--	100	no
111-91-1	bis(2-Chloroethoxy)methane	1.75	Not Detected	--	nle	no
120-82-1	1,2,4-Trichlorobenzene	1.22	Not Detected	--	9	no
91-20-3	Naphthalene	1.27	Not Detected	--	nle	no
106-47-8	4-Chloroaniline	1.09	Not Detected	--	nle	no
87-68-3	Hexachlorobutadiene	0.71	Not Detected	--	1	no
91-57-6	2-Methylnaphthalene	1.08	Not Detected	--	nle	no
77-47-4	Hexachlorocyclopentadiene	1.32	Not Detected	--	50	no
91-58-7	2-Chloronaphthalene	1.01	Not Detected	--	nle	no
88-74-4	2-Nitroaniline	0.79	Not Detected	--	nle	no
131-11-3	Dimethylphthalate	1.52	Not Detected	--	7000	no
208-96-8	Acenaphthylene	0.96	Not Detected	--	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 10/25/99Location: 276Lab Sample ID: 4882.02(Field Blank)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	0.81	Not Detected	--	nle	no
99-09-2	3-Nitroaniline	0.79	Not Detected	--	nle	no
83-32-9	Acenaphthene	1.10	Not Detected	--	400	no
132-64-9	Dibenzofuran	1.00	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	0.87	Not Detected	--	10	no
84-66-2	Diethylphthalate	1.62	Not Detected	--	5000	no
86-73-7	Fluorene	0.99	Not Detected	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	1.10	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	1.05	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.01	Not Detected	--	20	no
103-33-3	Azobenzene	0.67	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	0.76	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	0.94	Not Detected	--	10	no
85-01-8	Phenanthrene	1.23	Not Detected	--	nle	no
120-12-7	Anthracene	1.12	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	1.70	Not Detected	--	900	no
206-44-0	Fluoranthene	1.64	Not Detected	--	300	no
92-87-5	Benzidine	4.18	Not Detected	--	50	no
129-00-0	Pyrene	1.25	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.05	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	1.19	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	1.75	Not Detected	--	60	no
218-01-9	Chrysene	1.38	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	1.74	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.44	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.25	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.29	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	1.05	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	0.83	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	0.64	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	0.84	Not Detected	--	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 10/25/99Location: 276Lab Sample ID: 4882.03(Dup 276)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	1.83	Not Detected	--	nle	no
62-75-9	N-nitroso-dimethylamine	0.91	Not Detected	--	20	no
62-53-3	Aniline	1.63	Not Detected	--	nle	no
111-44-4	bis(2-Chloroethyl)ether	1.28	Not Detected	--	10	no
541-73-1	1,3-Dichlorobenzene	1.19	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	1.02	Not Detected	--	75	no
100-51-6	Benzyl alcohol	1.02	Not Detected	--	nle	no
95-50-1	1,2-Dichlorobenzene	1.13	Not Detected	--	600	no
108-60-1	bis(2-chloroisopropyl)ether	1.39	Not Detected	--	300	no
621-64-7	n-Nitroso-di-n-propylamine	1.50	Not Detected	--	20	no
67-72-1	Hexachloroethane	0.97	Not Detected	--	10	no
98-95-3	Nitrobenzene	1.01	Not Detected	--	10	no
78-59-1	Isophorone	1.21	Not Detected	--	100	no
111-91-1	bis(2-Chloroethoxy)methane	1.75	Not Detected	--	nle	no
120-82-1	1,2,4-Trichlorobenzene	1.22	Not Detected	--	9	no
91-20-3	Naphthalene	1.27	Not Detected	--	nle	no
106-47-8	4-Chloroaniline	1.09	Not Detected	--	nle	no
87-68-3	Hexachlorobutadiene	0.71	Not Detected	--	1	no
91-57-6	2-Methylnaphthalene	1.08	Not Detected	--	nle	no
77-47-4	Hexachlorocyclopentadiene	1.32	Not Detected	--	50	no
91-58-7	2-Chloronaphthalene	1.01	Not Detected	--	nle	no
88-74-4	2-Nitroaniline	0.79	Not Detected	--	nle	no
131-11-3	Dimethylphthalate	1.52	Not Detected	--	7000	no
208-96-8	Acenaphthylene	0.96	Not Detected	--	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER

Date Sampled: 10/25/99 Location: 276 Lab Sample ID: 4882.03(Dup 276)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	0.81	Not Detected	--	nle	no
99-09-2	3-Nitroaniline	0.79	Not Detected	--	nle	no
83-32-9	Acenaphthene	1.10	Not Detected	--	400	no
132-64-9	Dibenzofuran	1.00	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	0.87	Not Detected	--	10	no
84-66-2	Diethylphthalate	1.62	Not Detected	--	5000	no
86-73-7	Fluorene	0.99	Not Detected	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	1.10	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	1.05	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.01	Not Detected	--	20	no
103-33-3	Azobenzene	0.67	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	0.76	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	0.94	Not Detected	--	10	no
85-01-8	Phenanthrene	1.23	Not Detected	--	nle	no
120-12-7	Anthracene	1.12	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	1.70	Not Detected	--	900	no
206-44-0	Fluoranthene	1.64	Not Detected	--	300	no
92-87-5	Benzidine	4.18	Not Detected	--	50	no
129-00-0	Pyrene	1.25	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.05	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	1.19	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	1.75	Not Detected	--	60	no
218-01-9	Chrysene	1.38	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	1.74	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.44	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.25	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.29	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	1.05	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	0.83	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	0.64	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	0.84	Not Detected	--	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 10/25/99 Location: 276 Lab Sample ID: 4882.04(Bldg 276)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	1.83	Not Detected	--	nle	no
62-75-9	N-nitroso-dimethylamine	0.91	Not Detected	--	20	no
62-53-3	Aniline	1.63	Not Detected	--	nle	no
111-44-4	bis(2-Chloroethyl)ether	1.28	Not Detected	--	10	no
541-73-1	1,3-Dichlorobenzene	1.19	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	1.02	Not Detected	--	75	no
100-51-6	Benzyl alcohol	1.02	Not Detected	--	nle	no
95-50-1	1,2-Dichlorobenzene	1.13	Not Detected	--	600	no
108-60-1	bis(2-chloroisopropyl)ether	1.39	Not Detected	--	300	no
621-64-7	n-Nitroso-di-n-propylamine	1.50	Not Detected	--	20	no
67-72-1	Hexachloroethane	0.97	Not Detected	--	10	no
98-95-3	Nitrobenzene	1.01	Not Detected	--	10	no
78-59-1	Isophorone	1.21	Not Detected	--	100	no
111-91-1	bis(2-Chloroethoxy)methane	1.75	Not Detected	--	nle	no
120-82-1	1,2,4-Trichlorobenzene	1.22	Not Detected	--	9	no
91-20-3	Naphthalene	1.27	Not Detected	--	nle	no
106-47-8	4-Chloroaniline	1.09	Not Detected	--	nle	no
87-68-3	Hexachlorobutadiene	0.71	Not Detected	--	1	no
91-57-6	2-Methylnaphthalene	1.08	1.31 ug/L	--	nle	no
77-47-4	Hexachlorocyclopentadiene	1.32	Not Detected	--	50	no
91-58-7	2-Chloronaphthalene	1.01	Not Detected	--	nle	no
88-74-4	2-Nitroaniline	0.79	Not Detected	--	nle	no
131-11-3	Dimethylphthalate	1.52	Not Detected	--	7000	no
208-96-8	Acenaphthylene	0.96	Not Detected	--	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 10/25/99 Location: 276 Lab Sample ID: 4882.04(Bldg 276)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	0.81	Not Detected	--	nle	no
99-09-2	3-Nitroaniline	0.79	Not Detected	--	nle	no
83-32-9	Acenaphthene	1.10	Not Detected	--	400	no
132-64-9	Dibenzofuran	1.00	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	0.87	Not Detected	--	10	no
84-66-2	Diethylphthalate	1.62	Not Detected	--	5000	no
86-73-7	Fluorene	0.99	Not Detected	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	1.10	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	1.05	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.01	Not Detected	--	20	no
103-33-3	Azobenzene	0.67	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	0.76	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	0.94	Not Detected	--	10	no
85-01-8	Phenanthrene	1.23	Not Detected	--	nle	no
120-12-7	Anthracene	1.12	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	1.70	Not Detected	--	900	no
206-44-0	Fluoranthene	1.64	Not Detected	--	300	no
92-87-5	Benzidine	4.18	Not Detected	--	50	no
129-00-0	Pyrene	1.25	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.05	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	1.19	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	1.75	Not Detected	--	60	no
218-01-9	Chrysene	1.38	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	1.74	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.44	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.25	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.29	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	1.05	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	0.83	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	0.64	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	0.84	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/4/99 Location: 276 Lab Sample ID: 4982.01(276-1)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	Not Detected	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/4/99 Location: 276 Lab Sample ID: 4982.01(276-1)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 12/4/99Location: 276Lab Sample ID: 4982.01(Bldg 276-1)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	1.83	Not Detected	--	nle	no
62-75-9	N-nitroso-dimethylamine	0.91	Not Detected	--	20	no
62-53-3	Aniline	1.63	Not Detected	--	nle	no
111-44-4	bis(2-Chloroethyl)ether	1.28	Not Detected	--	10	no
541-73-1	1,3-Dichlorobenzene	1.19	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	1.02	Not Detected	--	75	no
100-51-6	Benzyl alcohol	1.02	Not Detected	--	nle	no
95-50-1	1,2-Dichlorobenzene	1.13	Not Detected	--	600	no
108-60-1	bis(2-chloroisopropyl)ether	1.39	Not Detected	--	300	no
621-64-7	n-Nitroso-di-n-propylamine	1.50	Not Detected	--	20	no
67-72-1	Hexachloroethane	0.97	Not Detected	--	10	no
98-95-3	Nitrobenzene	1.01	Not Detected	--	10	no
78-59-1	Isophorone	1.21	Not Detected	--	100	no
111-91-1	bis(2-Chloroethoxy)methane	1.75	Not Detected	--	nle	no
120-82-1	1,2,4-Trichlorobenzene	1.22	Not Detected	--	9	no
91-20-3	Naphthalene	1.27	Not Detected	--	nle	no
106-47-8	4-Chloroaniline	1.09	Not Detected	--	nle	no
87-68-3	Hexachlorobutadiene	0.71	Not Detected	--	1	no
91-57-6	2-Methylnaphthalene	1.08	Not Detected	--	nle	no
77-47-4	Hexachlorocyclopentadiene	1.32	Not Detected	--	50	no
91-58-7	2-Chloronaphthalene	1.01	Not Detected	--	nle	no
88-74-4	2-Nitroaniline	0.79	Not Detected	--	nle	no
131-11-3	Dimethylphthalate	1.52	Not Detected	--	7000	no
208-96-8	Acenaphthylene	0.96	Not Detected	--	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/4/99 Location: 276 Lab Sample ID: 4982.01(Bldg 276-1)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	0.81	Not Detected	--	nle	no
99-09-2	3-Nitroaniline	0.79	Not Detected	--	nle	no
83-32-9	Acenaphthene	1.10	Not Detected	--	400	no
132-64-9	Dibenzofuran	1.00	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	0.87	Not Detected	--	10	no
84-66-2	Diethylphthalate	1.62	Not Detected	--	5000	no
86-73-7	Fluorene	0.99	Not Detected	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	1.10	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	1.05	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.01	Not Detected	--	20	no
103-33-3	Azobenzene	0.67	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	0.76	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	0.94	Not Detected	--	10	no
85-01-8	Phenanthrene	1.23	Not Detected	--	nle	no
120-12-7	Anthracene	1.12	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	1.70	Not Detected	--	900	no
206-44-0	Fluoranthene	1.64	Not Detected	--	300	no
92-87-5	Benzidine	4.18	Not Detected	--	50	no
129-00-0	Pyrene	1.25	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.05	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	1.19	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	1.75	Not Detected	--	60	no
218-01-9	Chrysene	1.38	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	1.74	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.44	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.25	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.29	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	1.05	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	0.83	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	0.64	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	0.84	Not Detected	--	nle	no

FIGURES

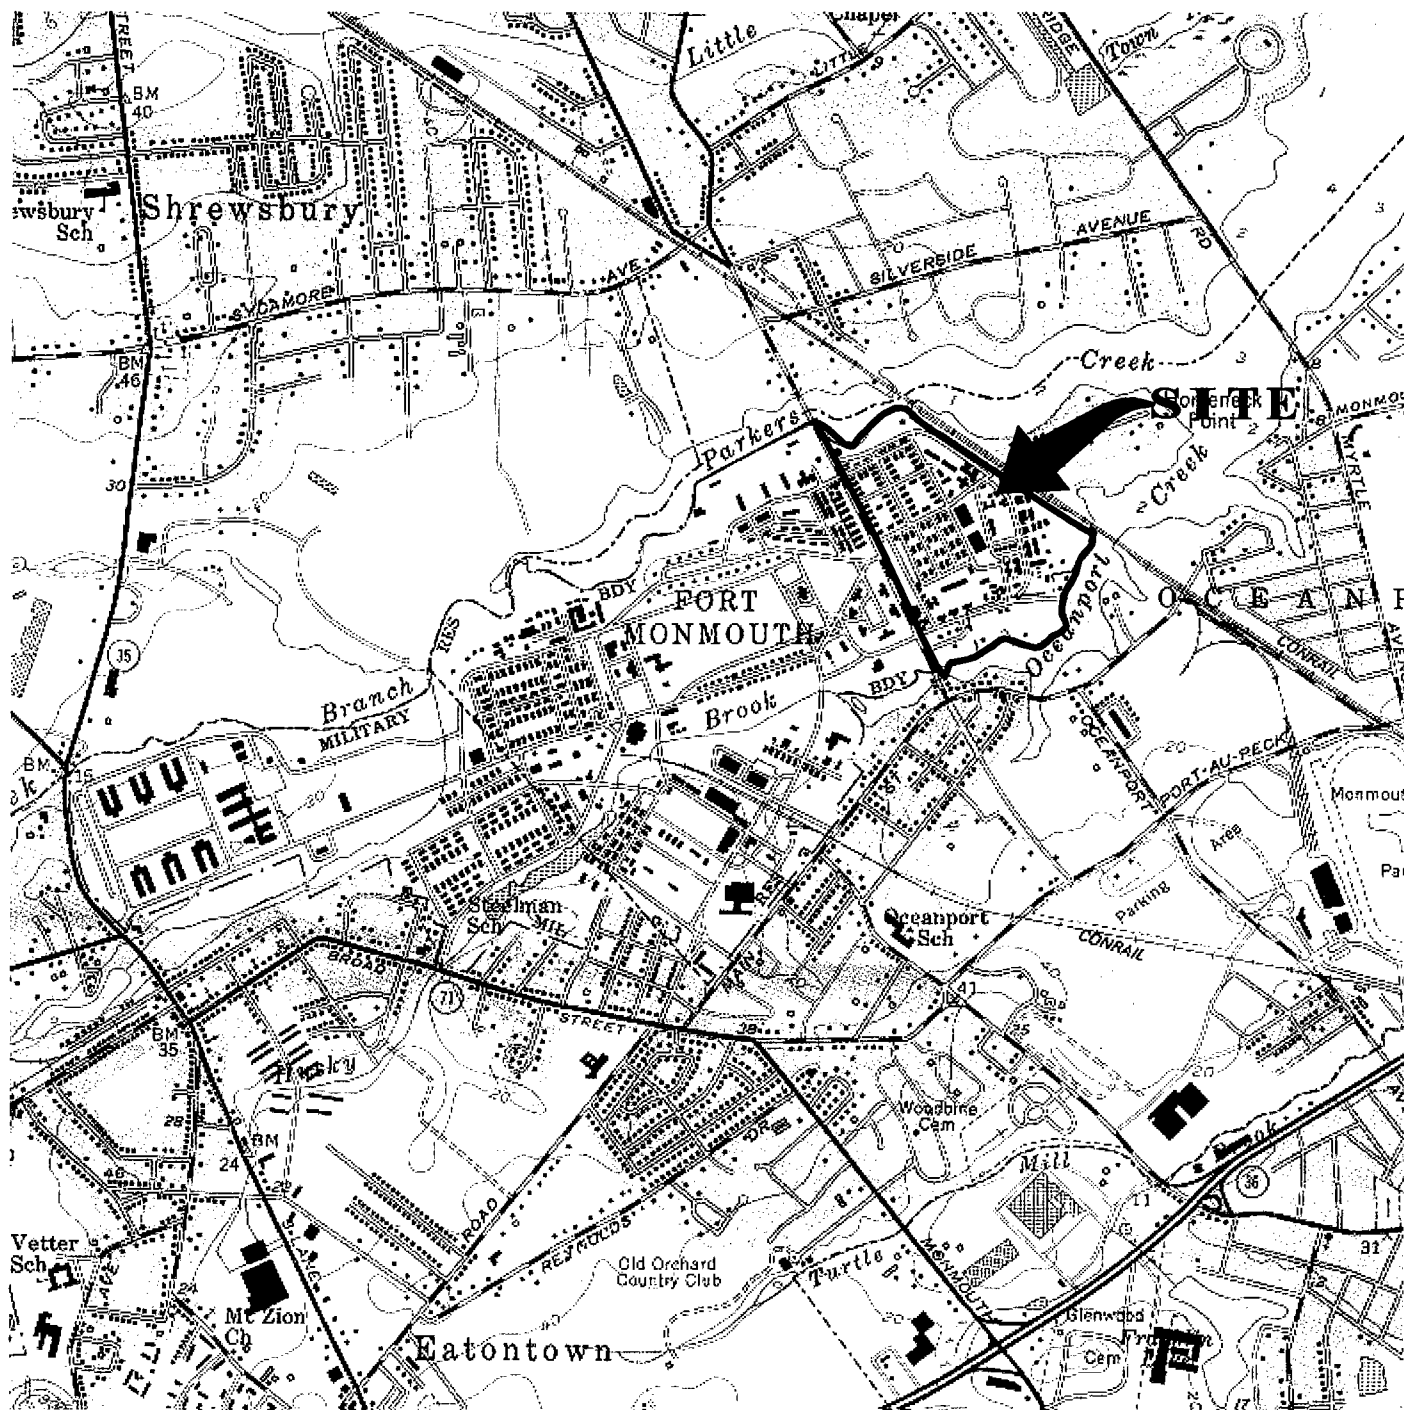


FIGURE 1

LOCATION MAP
Building 276
Main-Post East
Fort Monmouth Army Base
Monmouth County, NJ

VERSAR
Engineers, Managers, Scientists, & Planners
Bristol, PA

Scale: 1" = 2000'

Date: JUNE 1996

LONG BRANCH, N. J.

40073-C8-TF-024

1954

PHOTOREVISED 1981

DMA 6164 I SE-SERIES V822

NEW
JERSEY

QUADRANGLE LOCATION

Geologic Map of New Jersey

SEDIMENTARY ROCKS

CENOZOIC

- Holocene: sand
- Tertiary: sand, silt, clay

MESOZOIC

- Cretaceous: sand, silt, clay
- Jurassic: siltstone, shale, sandstone
- Triassic: siltstone, shale, sandstone

PALEOZOIC

- Devonian: conglomerate, sandstone,
- Silurian: conglomerate, sandstone, shale, limestone
- Ordovician: shale, limestone
- Cambrian: limestone, sandstone

IGNEOUS AND METAMORPHIC ROCKS

MESOZOIC

- Jurassic: basalt
- Jurassic: diabase

PRECAMBRIAN

- marble
- gneiss, granite

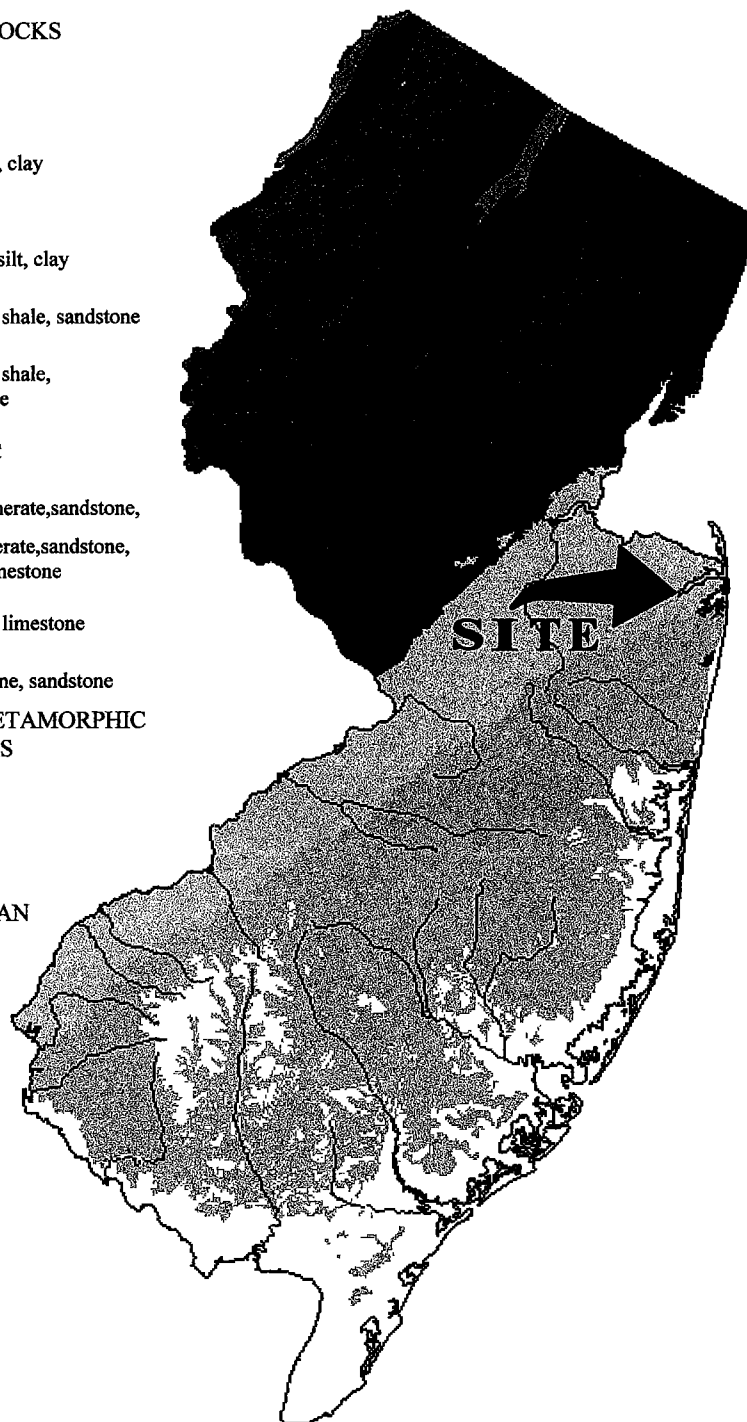


FIGURE 1A
GEOLOGICAL MAP
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
 Engineers, Managers, Scientists & Planners
 Bristol, Pennsylvania

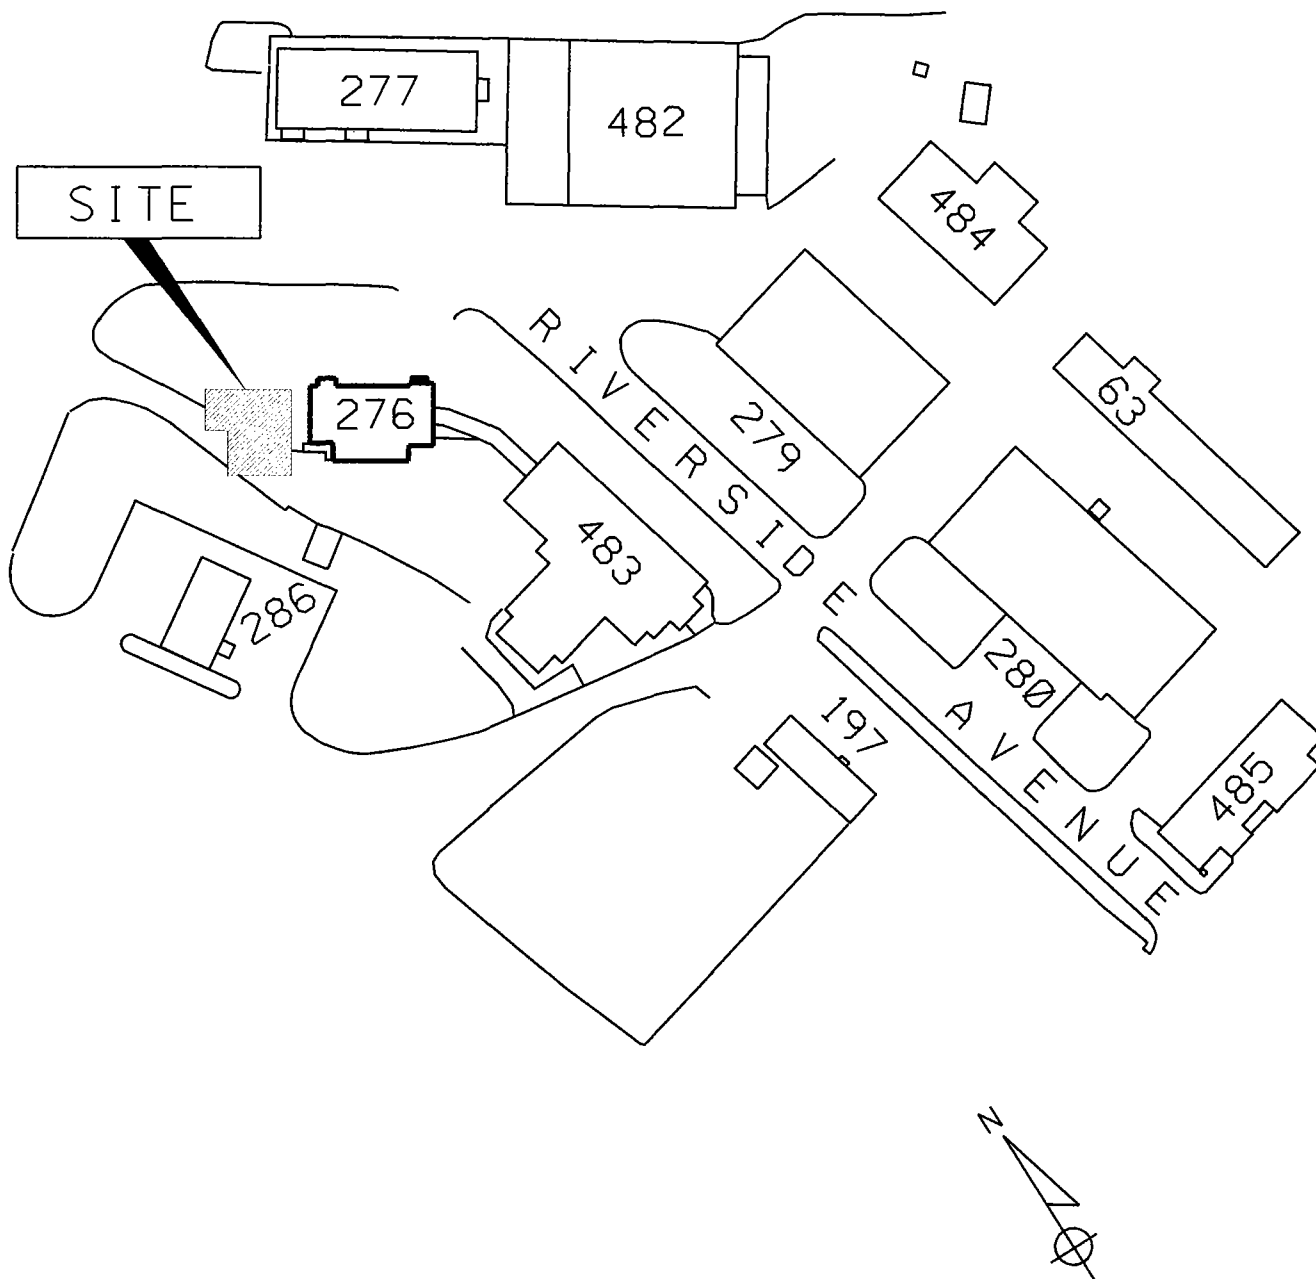


FIGURE 2
SITE MAP
BUILDING 276
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS
BRISTOL, PA.

SCALE: 1"=100'

DATE: JUNE 1996


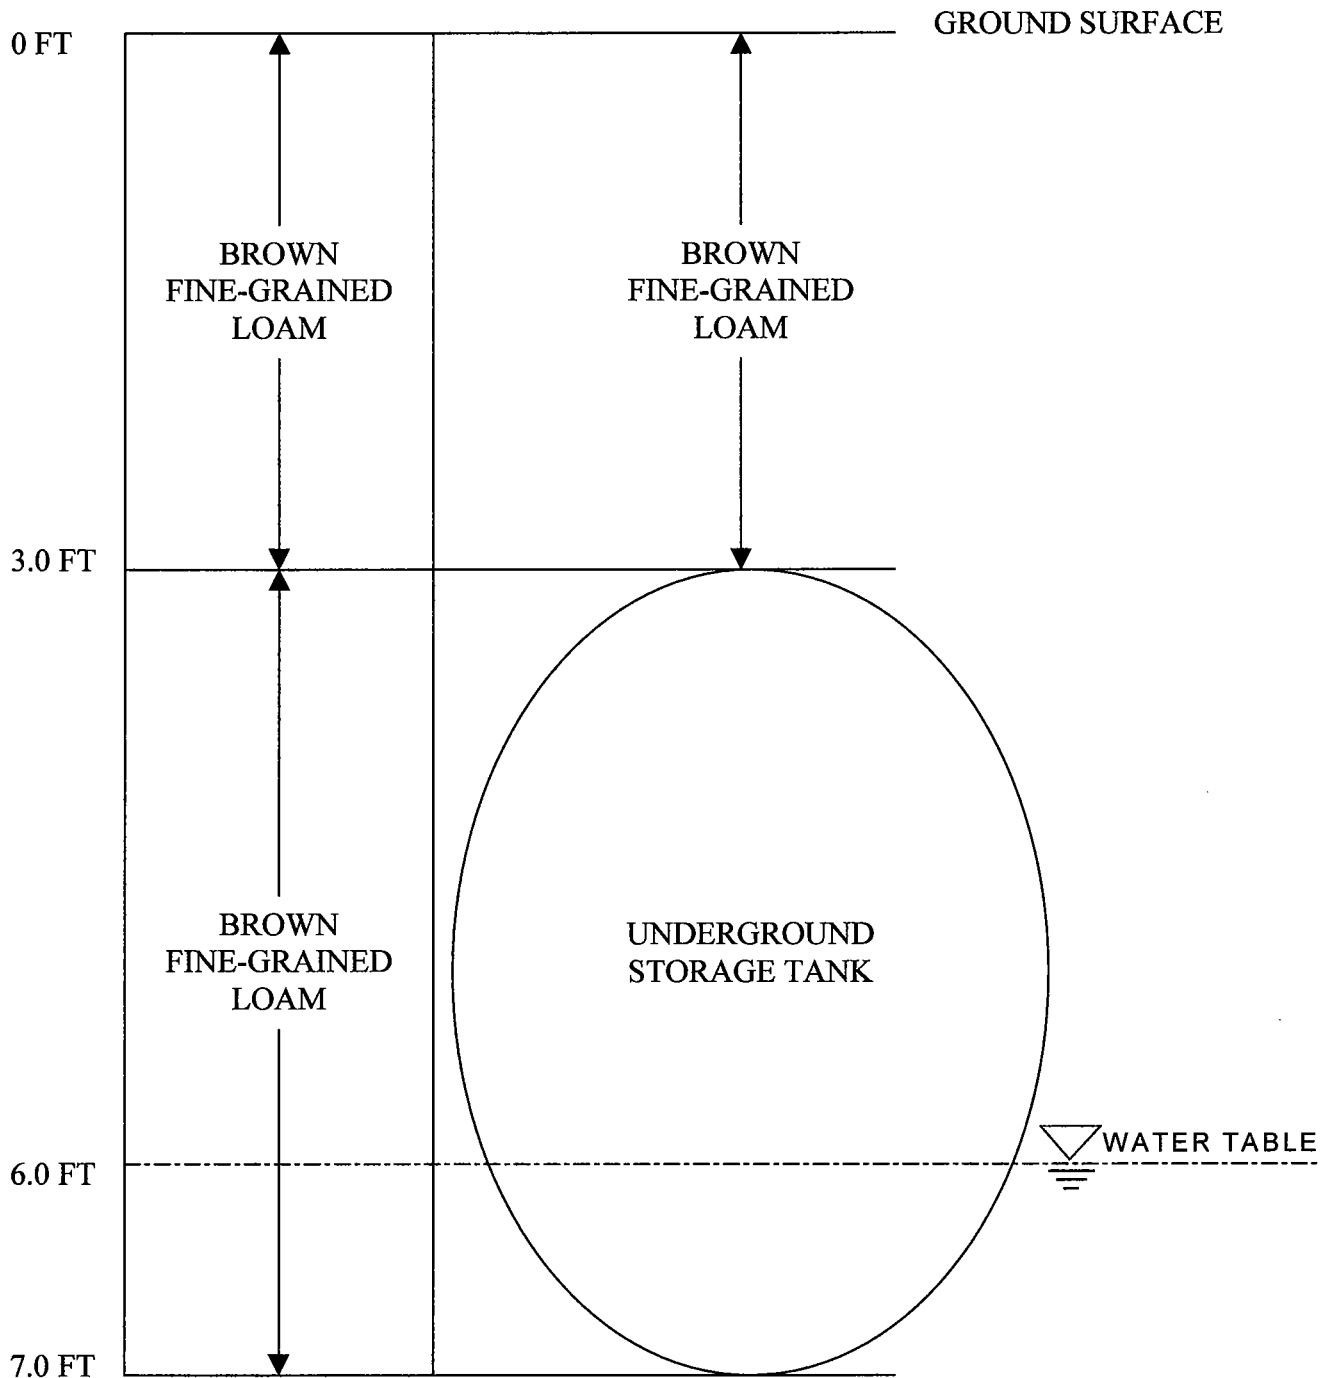



FIGURE 3
CROSS SECTIONAL VIEW
BUILDING 276
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
Engineers, Managers, Scientists & Planners
Bristol, Pennsylvania

SCALE: NTS

DATE: JUNE 1996

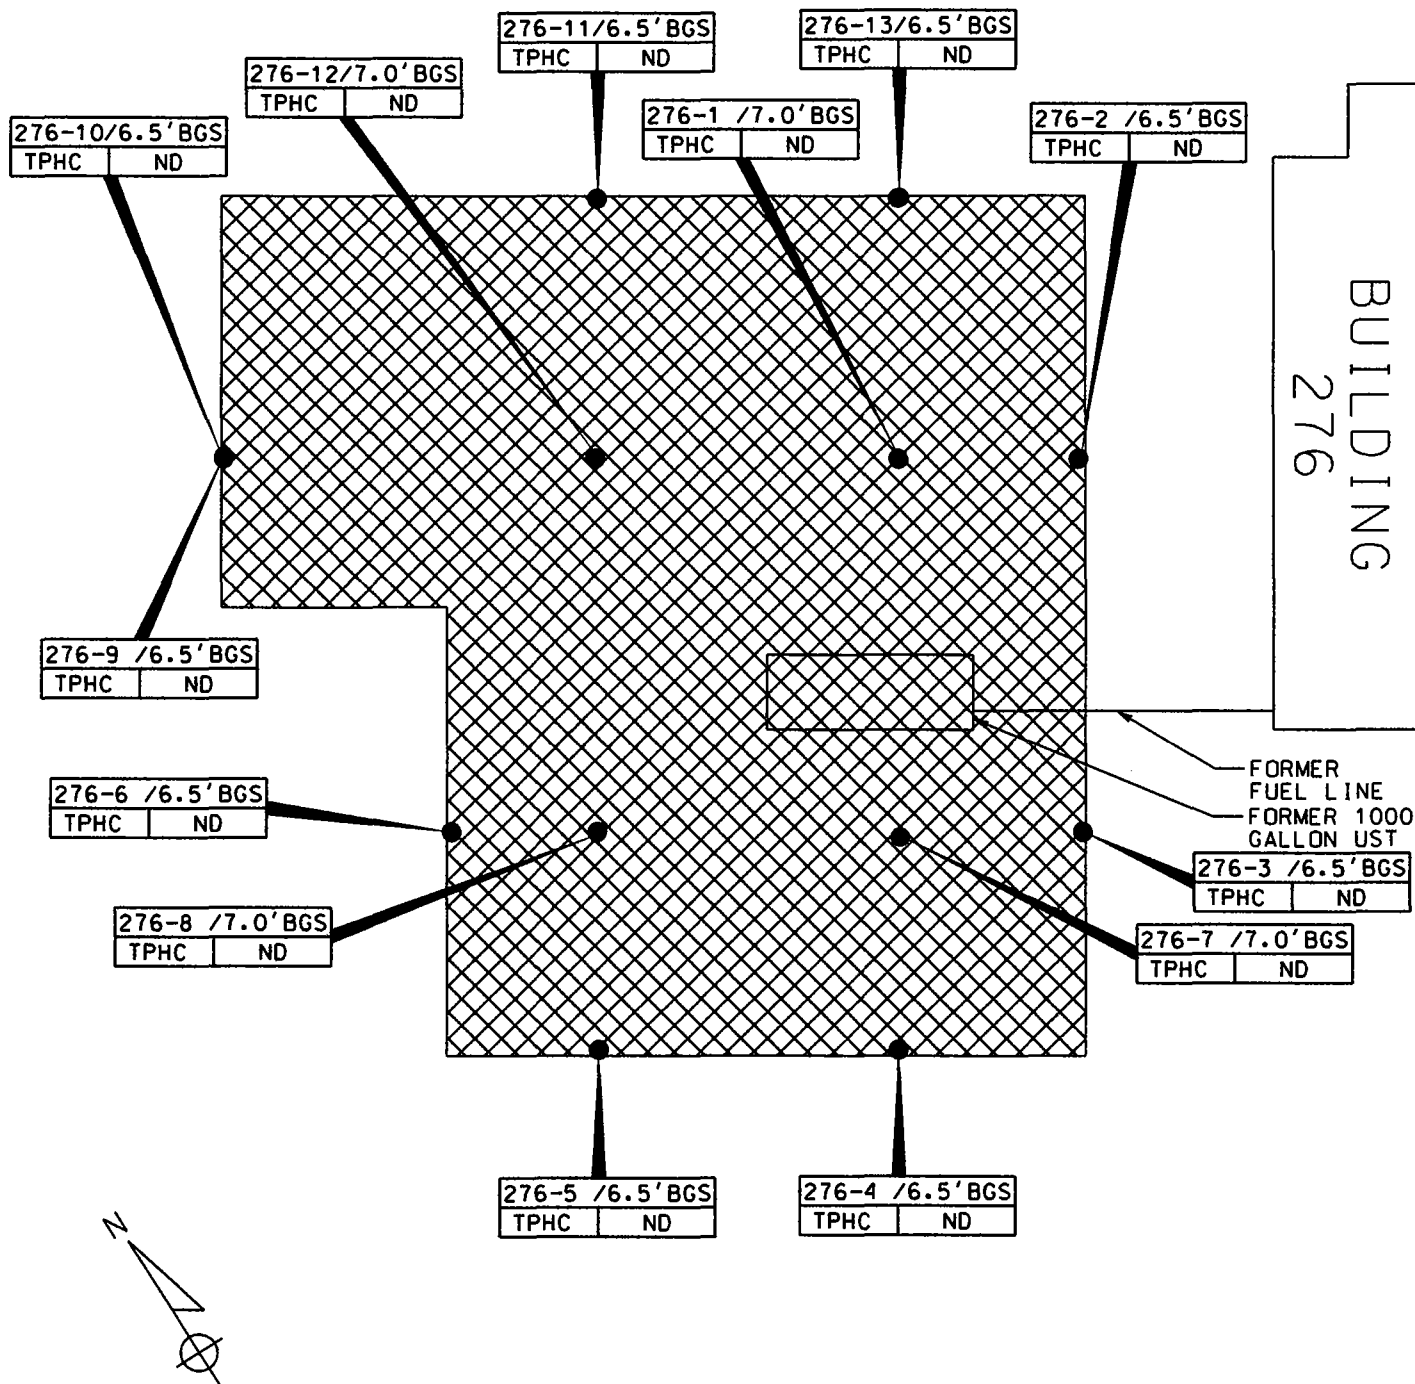


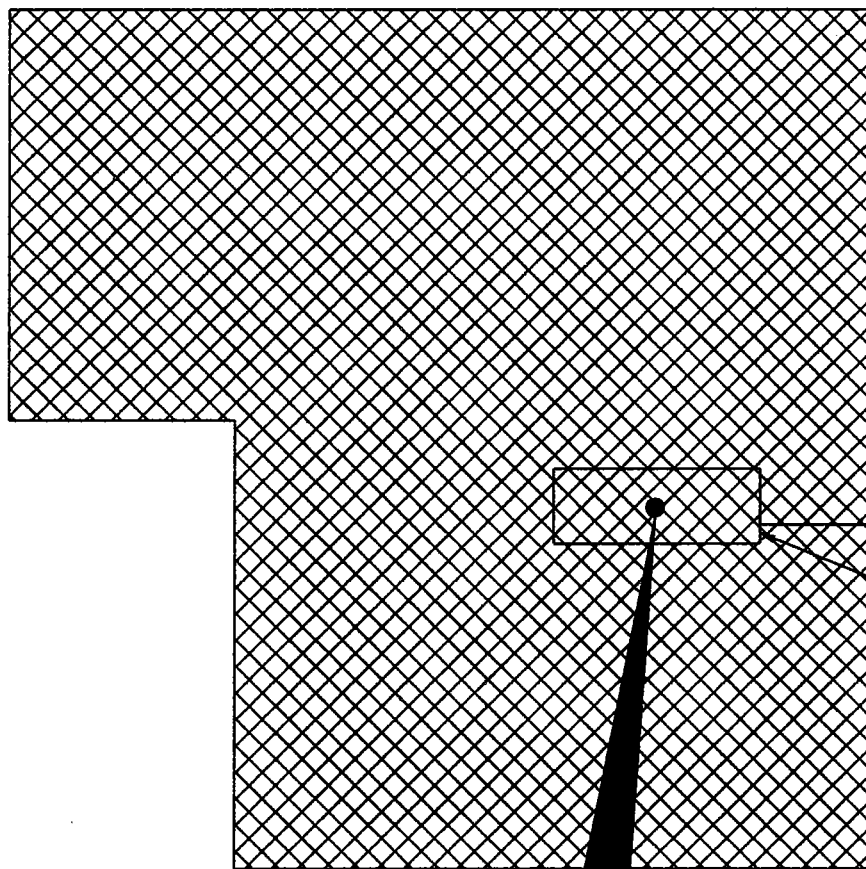

BUILDING
276

FORMER
FUEL LINE
FORMER 1000
GALLON UST

SAMPLING LOCATION: SAMPLING DEPTH: SAMPLING DATE:	HIGHER OF NJDEP GWOS AND POL	BLDG 276 6-11' BGS 10/25/99	BLDG 276 6-11' BGS 12/4/99
VOLATILE ORGANIC COMPOUNDS:		ND	ND
SEMIVOLATILE ORGANIC COMPOUNDS:			
2-METHYLNAPHTHALENE:	NLE	1.31 UG/L	ND



LEGEND

- GROUNDWATER SAMPLE LOCATION
(OCTOBER 25, 1999 AND DECEMBER 4, 1999)
- ▤ LIMIT OF EXCAVATION
(JUNE 17, 1998)

NOTES:

1. ND=INDICATES COMPOUND NOT DETECTED
2. NLE= NO LIMIT ESTABLISHED
3. ALL RESULTS IN UG/L
4. BGS = BELOW GROUND SURFACE

FIGURE 5
GROUNDWATER SAMPLING MAP
BUILDING 276
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS
BRISTOL, PA.

SCALE: 1"=10'

DATE: JUNE 1996

APPENDIX A

NJDEP-BUST CLOSURE APPROVAL LETTER



State of New Jersey

Christine Todd Whitman
Governor

Department of Environmental Protection

Robert C. Shinn, Jr.
Commissioner

Mr. James Ott
SELF-M-EH-EV
Department of the Army
Headquarters CECOM Fort Monmouth
Fort Monmouth, NJ 077703-5000

SEP 25 1995

Dear Mr. Ott:

Re: UST Closure Approval Applications
Fort Monmouth Army Base
Tinton Falls, Monmouth County

The NJDEP has reviewed the Underground Storage Tank Closure Applications listed below and we have determined that the scheduled closures for these Number 2 fuel oil tanks are consistent with NJDEP requirements. This letter shall serve as the closure approval for the following USTs:

AREA	REGISTRATION NO. - SIZE	BLDG NO.	UST NO.	TANK SAMP	LINE SAMP	REMOVAL DATE	REPORT DATE
CW - West	0081515 - 1000	2504	15	4/1	1	9/18/95	1/19/96
CW - East	0090010 - 1000	484	56	4/1	0	10/23/95	2/23/96
CW - West	0081533 - 1000	550	79	4/1	0	10/24/95	2/26/96
CW - West	0081533 - 550	826	134	4/1	2	10/25/95	2/27/96
CW - West	0081533 - 1000	902	144	4/1	0	10/27/95	2/29/96
CW - East	0090010 - 1000	116	9	4/1	1	10/2/95	2/5/96
CW - East	0090010 - 2000	116	10	4/1	0	10/3/95	2/5/96
CW - East	0090010 - 1000	173	19	4/1	3	10/4/95	2/6/96
CW - East	0090010 - 1000	276	23	4/1	2	10/10/95	2/12/96
CW - East	0090010 - 1000	277	24	4/1	0	10/11/95	2/13/96
CW - East	0090010 - 1080	420	36	4/1	2	10/12/95	2/13/96
CW - East	0090010 - 1080	428	42	4/1	3	10/16/95	2/20/96
CW - East	0090010 - 1080	429	43	4/1	3	10/17/95	2/20/96
CW - East	0090010 - 1080	439	48	4/1	2	10/18/95	2/20/96

If you should have any questions or require additional information, please do not hesitate to contact me at (609) 633-1455.

Sincerely,

A handwritten signature in black ink, appearing to read 'IRC', with a stylized flourish extending from the end.

Ian R. Curtis, Case Manager
Bureau of Federal Case Management

cc. Gene Lesinski, FTMMTH

RPCE\BFCM\FTMMTH31.IRC



State of New Jersey
Department of Environmental Protection and Energy
Division of Responsible Party Site Remediation
CN 028
Trenton, NJ 08625-0029
ATTN: UST Program
(609) 984-3156

For State Use Only

Date Rec'd. _____
Auth. _____
Routing _____
UST NO. _____

STANDARD REPORTING FORM
for reporting activities at an UST facility:

- | | |
|--|---|
| ☒ General Facility Information Changes | ☐ Sale or Transfer |
| ☒ Closure (Abandonment or Removal) | ☐ Substantial Modification |
| ☐ Temporary Closure | ☐ Financial Responsibility |
| ☐ Change in Service | ☐ Address Change Only |

Check ONLY One Type of Activity - Complete Form For That Activity

(More than one tank can be listed per activity)

*** NOTE *** ALL NEW tank installations at existing registered facilities must submit a Registration Questionnaire for the new tanks.

Answer questions 1 through 5 and others as applicable.

1. Company name and address (as it appears on registration questionnaire):

U.S. ARMY - FORT MONMOUTH
DPW - BUILDING 173
FORT MONMOUTH NJ 07703
ATTN: EUGENE W. LESINSKI

2. Facility name and location (if different from above):

3. Contact person for this activity:

GENE LESINSKI
Telephone Number: (908) 532-0989

4. The identification number of the affected tank as it appears in Question Number 12 on the Registration Questionnaire:

BLDG 276 23

5. Registration Number (if known):

UST - 0090010

6. For GENERAL FACILITY INFORMATION changes (address, telephone, contact person, etc. - supply NEW information only):

- a. Facility name: _____
b. Facility location: _____
c. Owner's mailing address: _____

NJ _____
d. Block: _____ Lot: _____
e. Contact person (facility operator): _____
f. Contact telephone number: (_____) _____ - _____
g. Other (Specify): _____

(OVER)

7. For CLOSURE (abandonment removal - check all that apply):

a. ☐ Abandonment Date: ____/____/____ Case No: _____

Attach the necessary implementation schedule (3 copies) and all documentation needed for abandonment per N.J.A.C. 7:14B-9.1 (d).

b. ☒ Removal Date: 6/24/96 Case No. 96-6-21-1331-05

Attach the necessary implementation schedule (3 copies).

8. For CHANGES IN HAZARDOUS SUBSTANCES STORED (check all that apply):

a. ☐ Temporary Closure (12 month maximum time - see N.J.A.C. 7:14B-9.1(b)). Remove all hazardous substances; leave tank in place.

b. ☐ Change in service from a regulated substance to a non-regulated substance. Tank must be cleaned and site assessment performed per N.J.A.C. 7:14B-9.1(e).

c. ☐ Changes in service from one regulated hazardous substance to another regulated hazardous substance.

Tank No. _____	Old _____	New _____
Tank No. _____	Old _____	New _____
Tank No. _____	Old _____	New _____

(Attach additional sheets if more space is needed)

9. For TRANSFER OF OWNERSHIP: Effective Date: ____/____/____

a. New Owner (operator) _____

b. New Facility Name _____

NJ

County

c. Closing Attorney _____ Tele: (____) _____

10. For SUBSTANTIAL MODIFICATIONS (to include any retrofitted activity - e.g. the addition of spill/overflow protection, monitoring systems, cathodic protection, etc.):

a. Type of Modification _____ Date: ____/____/____

b. * NOTE * Substantial modifications require a permit under N.J.A.C. 7:14B-10.

11. For changes in FINANCIAL RESPONSIBILITY to (check appropriate changes and attach copies of new information):

a. Policy Type: ☐

d. Company/Carrier: ☐

b. Policy Number: ☐

e. Expiration Date: ☐

c. Other: ☐

(Specify)

NOTE: ALL appropriate and applicable permits, licenses and certificates required by the above activity(ies) from any local, state and/or federal agencies must be obtained separately from this notification.

CERTIFICATION

This registration form shall be signed by the highest ranking individual at the facility with overall responsibility for that facility (N.J.A.C. 7:14B-2.3 (a) 1).

I certify under penalty of law that the information provided in this document is true, accurate and complete. I am aware that there are significant civil and criminal penalties for submitting false, inaccurate or incomplete information, including fines and/or imprisonment.

Signature: James Ott

Name (print or type): JAMES OTT

Title: DIRECTOR - DEPT OF PUBLIC WORKS Date: 1/29/97

APPENDIX B

SITE ASSESSMENT SUMMARY

Site Remediation Program

UST Site/Remedial Investigation Report Certification Form

A. Facility Name : U.S. Army Fort Monmouth New JerseyFacility Street Address : Directorate of Public Works Building 173Municipality: Oceanport County : MonmouthBlock: _____ Lot(s): _____ Telephone Number : 732-532-6224**B. Owner (RP)'s Name:** _____

Street Address: _____ City : _____

State: _____ Zip: _____ Telephone Number : _____

C. (Check as appropriate)

☐ Site Investigation
Report (SIR) \$500 Fee

☐ Remedial Investigation
Report (RIR) \$1000 Fee

☒ NA - Federal
Agreement

D. (Complete all that apply)

- Assigned Case Manager : Ian Curtis, Federal Case Manager
- UST Registration Number : 90010-23 (7 digits)
- Incident Report Number 96 - 06 - 21 - 1331 - 05 (10 or 12 digits)
____ - ____ - ____ - ____ - ____
- Tank Closure Number : Federal Case Manager

E. Certification by the Subsurface Evaluator:

The attached report conforms to the specific reporting requirements of N.J.A.C. 7:26EYes No

Name: Eugene Lesinski Signature: See signed subsurface removal log UST Cert. No.: 14537Firm: U.S. Army Fort Monmouth Firm's UST Cert. Number: NA-U.S. ArmyFirm Address: Directorate of Public Works Building 173 City: Fort MonmouthState: NJ Zip: 07703 Telephone Number : 732-532-6224

(NOTE: Certification numbers required only if work was conducted on USTs regulated per N.J.S.A. 58:10A-21 et seq.)

F. Certification by the Responsible Party(ies) of the Facility:

The following certification shall be signed [according to the requirements of N.J.A.C. 7:14B-1.7(b)] as follows:

1. For a Corporation by a person authorized by a resolution of the board of directors to sign the document. A copy of the resolution, certified as a true copy by the secretary of the corporation, shall be submitted along with the certification; or
2. For a partnership or sole proprietorship, by a general partner or the proprietor, respectively; or
3. For a municipality, State, federal or other public agency by either a principal executive officer or ranking elected Official.

"I certify under penalty of law that I have personally examined and am familiar with the information submitted in this application and all attached documents, and that based on my inquiry of those individuals responsible for obtaining the information, I believe that the submitted information is true, accurate, and complete. I am aware that there are significant civil penalties for knowingly submitting false, inaccurate, or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

Name (Print or Type): James Ott Title: Directorate of Public Works

Signature: _____

Company Name: U.S. Army Fort MonmouthDate: 9/4/00

U ARMY, SELF-M-PW-E
DAILY UST SUBSURFACE REMOVAL LOG

BLDG.#: 276 REG.#: 0090010-23 CLOSURE#: NJDEP LTR
 DATE: 6-21-96 TOA: 0800 TOD: 1330
 GOV. SSE: LESINSKI NJDEP CERT.#: 00145307

REMOVAL CONTRACTOR: SAI Inc.
 CLOSURE SUPERVISOR: De Martini S. NJDEP CERT.#: _____
 WEATHER: Partly Cloudy - 85°F

ACTIVITY	YES / NO
THE SUPERVISOR (CLOSURE CERT.) WAS ON-SITE DURING ALL CLOSURE RELATED ACTIVITIES	Y
THE SSE WAS ON-SITE DURING UST REMOVAL AND SITE SCREENING AND SAMPLING ACTIVITIES	Y
ALL ON-SITE PERSONNEL HAD TRAINING IAW ALL SAFETY REQUIREMENTS (E.G. 29CFR)	Y
A CONFINED ENTRY PERMIT WAS COMPLETED AND POSTED ON-SITE BY THE CONTRACTOR	Y
THE UST WAS PLACED ONTO PLASTIC, SCRAPED OFF, INSPECTED FOR HOLES AND PHOTOGRAPHED	Y
A DISCHARGE WAS REPORTED TO THE NJDEP (609-292-7172), CASE# <u>96-6-21-1331-05</u>	Y
PHOTOS HAVE UST#, BLDG. #, DATE, TIME, NAME OF SSE AND DESCR. WRITTEN ON BACK	Y
GROUNDWATER WAS ENCOUNTERED AT _____ FEET BG, A SHEEN (WAS/WAS NOT) OBSERVED ON GW	N
IF OVA/Hnu WAS USED: WAS IT CAL. AND FOUND TO BE OPERATIONAL (cal. data on COC)	N/A
IF SAMPLES WERE TAKEN: COC, SCALED SITE MAP (VERT. SOIL HORIZONS AND PLOT PLAN)	N/A
ALL SAMPLE COLLECTION ACTIVITIES WERE AS DESCRIBED IN THE NJDEP FSPM, 1992	N/A
ALL SAMPLING WAS BIASED TOWARD HIGHEST OVA/FID RECORDED SITES IAW 7:26E-3.6 <u>et seq.</u>	N/A
ALL PETROL. CONT. SOILS WERE SECURED FROM THE WEATHER BY CLOSE OF BUSINESS TODAY	Y
THE SSE AUTHORIZED BACKFILLING THE EXCAVATION (STONE TO 1" ABOVE GROUNDWATER)	N/A
ADDITIONAL NOTES WERE TAKEN AND ARE RECORDED ON THE BACK OF THIS FORM	N
THE FOLLOWING DOCUMENTS WERE ADDED TO THE PROJECT FOLDER TODAY: (CIRCLE EACH) SCRAP TICKET, CSE PERMIT, <u>ACCIDENT REPORT</u> , HAZ. WASTE MANIFEST, DAILY UST CLOSURE LOG, SCALED SITE MAP (SAMPLING), <u>SRF-CLOSURE</u> , CHAIN OF CUSTODY, SOIL ANALYTICAL RESULTS, CLEAN FILL TICKETS (IN YDS ³), PHOTOGRAPHS (UST), EXCAVATION, <u>SAMPLING POINTS</u>	N

CHECK ALL BOXES. LEAVE NO BLANKS

I certify under penalty of law that tank decommissioning activities were performed in compliance with N.J.A.C. 7:14B-9.2(b)3 and 7:26 et seq. I am aware that there are significant penalties for submitting false, inaccurate, or incomplete information, including fines and/or imprisonment.

SIGNATURE: _____ DATE: 6-21-96

APPENDIX C

WASTE MANIFEST



RD1 Box 5A
Old Bridge, N.J. 08857
(908) 721-0900
Fax (908) 721-0231

PAGE: 1

INVOICE

135755-IN

SALESPERSON

DATE OF INVOICE

MS
JOB SITE

06/21/96

FORT MONMOUTH
BLDG.173
FORT MONMOUTH

NJ 07703

BLDG 276

ACCOUNT NO.

DATE SHIPPED

TERMS

YOUR ORDER NUMBER

NET 10 DAYS

0004754

QUANTITY

DESCRIPTION

UNIT PRICE

AMOUNT

600.000 OILY WATER DISPOSAL - NJ

.650

390.00

NET INVOICE
SALES TAX

390.00
.00

TOTAL

390.00

oh 7/12/96
SERVICE CHARGE OF 1.5%
WILL BE ADDED TO ALL PAST
DUE BALANCES.

Thank You!



RETURN YELLOW COPY
WITH PAYMENT





State of New Jersey
Department of Environmental Protection and
Hazardous Waste Regulation Program
Manifest Section
CN 421, Trenton, NJ 08625-0421

Please type or print in block letters. (Form designed for use on elite (12-pitch) typewriter.)

Form Approved. OMB No. 2050-0039. Expires 9-30-96

UNIFORM HAZARDOUS WASTE MANIFEST		1. Generator's US EPA ID No.	Manifest Document No.	2. Page 1 of 1	Information in the shaded areas is not required by Federal law.
3. Generator's Name and Mailing Address U.S. ARMY COMMUNICATIONS ELECTRONICS COMMAND MAIN POST, C/O JAMES HARRIS BLDG 23 ELF-HW EV		NJ 321003059708850		A. State Manifest Document Number NJA 2608850	
4. Generator's Phone () 609-623-6223		6. US EPA ID Number		B. State Generator's ID (Gen. Site Address) SAME	
5. Transporter 1 Company Name LIONETTI OIL RECOVERY CO., INC.		8. US EPA ID Number		C. State Trans. ID-NUDEPE 56247	
7. Transporter 2 Company Name		10. US EPA ID Number		D. Transporter's Phone () 609-721-0900	
9. Designated Facility Name and Site Address LIONETTI OIL RECOVERY CO., INC. / DBA LOPCO PETROLEUM SVCS. SHUYON & CHESTERMANE ROADS OLD BRIDGE NJ 08857		12. Containers		E. State Trans. ID-NUDEPE	
		14. Unit Wt/Vol		F. Transporter's Phone ()	
		16. Total Quantity		G. State Facility's ID	
		18. Waste No.		H. Facility's Phone () 609-721-0900	
11. US DOT Description (Including Proper Shipping Name, Hazard Class or Division, ID Number and Packing Group) HM		13. Containers		15. Additional Descriptions for Materials Listed Above	
a. PETROLEUM OIL (PETROLEUM OIL) COMBUSTIBLE LIQUID UN 1200 POIII		No. Type		K. Handling Codes for Waste Listed Above	
b.		9911		Y6 X722	
c.				Y6 X722	
d.				Y6 X722	
J. Additional Descriptions for Materials Listed Above		K. Handling Codes for Waste Listed Above			
a. PETROLEUM OIL 20% WATER SOLUBLE		c.		Y04-FILTRATION	
b.		d.		Y04-FILTRATION	
15. Special Handling Instructions and Additional Information NOT EPA REGULATED. REGULATED AS HAZARDOUS WASTE IN NJ 24 HOUR EMERGENCY RESPONSE # (609) 721-0900 DECAL # 73599. EMERG 120 MEXIL TEST KIT RESULTS L1010 PPM HAZARDOUS		1101 BLDG 276			
16. GENERATOR'S CERTIFICATION: I hereby declare that the contents of this consignment are fully and accurately described above by proper shipping name and are classified, packed, marked, and labeled, and are in all respects in proper condition for transport by highway according to applicable international and national government regulations. If I am a large quantity generator, I certify that I have a program in place to reduce the volume and toxicity of waste generated to the degree I have determined to be economically practicable and that I have selected the practicable method of treatment, storage, or disposal currently available to me which minimizes the present and future threat to human health and the environment; OR, if I am a small quantity generator, I have made a good faith effort to minimize my waste generation and select the best waste management method that is available to me and that I can afford.		Printed/Typed Name EUGENE W. LESINSKI		Signature [Signature]	
17. Transporter 1 Acknowledgement of Receipt of Materials		Printed/Typed Name		Signature	
18. Transporter 2 Acknowledgement of Receipt of Materials		Printed/Typed Name		Signature	
19. Discrepancy Indication Space					
20. Facility Owner or Operator: Certification of receipt of hazardous materials covered by this manifest except as noted in Item 19.		Printed/Typed Name		Signature	



RD1 Box 5A
Old Bridge, N.J. 08857
(908) 721-0900
Fax (908) 721-0231

STANDARD
COLLECTION
ORDER FORM

135755

GENERATOR/LOCATION

OFFICE USE ONLY

BILL TO (IF DIFFERENT FROM LOCATION)

NAME FEAT MONITORING
INFORMATION/ATTENTION LINE FEAT MONITORING ACCOUNT APPROVAL CODE
DELIVERY ADDRESS BLDG 173
CITY FEAT MONITORING STATE PA
PHONE NUMBER 908-532-6223 PURCHASE ORDER NUMBER 07705
USA EPA ID NO. (IF APPLICABLE) PA 3010620597 STATE ID NO.

NAME
INFORMATION/ATTENTION LINE
DELIVERY ADDRESS
CITY STATE ZIP
PHONE NUMBER
PURCHASE ORDER NUMBER
MANIFEST NUMBER 7107050

SHIPPING INFORMATION

This is to certify that the below named materials are properly classified, described, packaged, marked and labeled, and are in proper condition for transportation according to the applicable regulations of the Department of Transportation.

NO.	TYPE	QTY.	UNIT	US DOT Description (Including Proper Shipping Name, Hazard Class and ID Number)	SALES REPRESENTATIVE
					<u>WILLIS</u>

SERVICE SECTION

SALES CODE	DESCRIPTION	WASTE CODE	QUANTITY	UNIT PRICE	PRICE	TAX	LINE TOTAL
40500	USED OIL REMOVAL						
40300	ANTI-FREEZE REMOVAL	<u>X712</u>	<u>600</u>	<u>2.6</u>			
40600	USED OIL FILTER REMOVAL						
40501	OILY WATER DISPOSAL						
40502	SLUDGE DISPOSAL						
41001	RCRA WASTE DISPOSAL						
41501	DRUM DISPOSAL						
41504	TANK ENTRY						
40800	PARTS WASHER SERVICE						
41500	TRUCK & OPERATOR						
41511	55 GAL DRUM / 17H						
41503	QAQC ANALYTICAL TESTING						
42001	DEXSIL TEST KIT	TAX					
41509	TRANSPORTATION						
41506	OTHER CHARGES						

CHARGE MY ACCOUNT FOR THIS TRANSACTION UNLESS OTHERWISE INDICATED IN THE PAYMENT SECTION.

INVOICES REFLECTING CHARGES TO CUSTOMER ARE SUBJECT TO AN INTEREST RATE OF THE LESSER OF 1 1/2% PER MONTH (18% PER ANNUM) OR THE MAXIMUM RATE ALLOWED BY LAW ON ANY INVOICES THAT ARE NOT PAID WITHIN 30 DAYS. IN THE EVENT OF DEFAULT, LORCO SHALL BE ENTITLED TO RECOVER COSTS OF COLLECTION, INCLUDING REASONABLE ATTORNEY'S FEES.

GENERATOR WARRANTS AND REPRESENTS THAT THE MATERIALS PROVIDED LORCO HEREUNDER HAVE NOT BEEN MIXED, COMBINED, OR OTHERWISE BLENDED IN ANY QUANTITY WITH MATERIALS CONTAINING POLYCHLORINATED BIPHENYLS (PCB) OR ANY OTHER MATERIAL DEFINED AS HAZARDOUS WASTE UNDER APPLICABLE LAWS, INCLUDING BUT NOT LIMITED TO 40 CFR PART 261. GENERATOR AGREES TO INDEMNIFY AND HOLD LORCO HARMLESS FOR ANY DAMAGES, COSTS, ATTORNEY'S FEES, ETC. ARISING OUT OF OR IN ANY WAY RELATED TO A BREACH OF THE ABOVE WARRANTY BY THE GENERATOR.

Generator certifies that the waste is X722
In accordance the N.J.A.C. 7:26-12.1 et seq, LORCO has the required permits to accept the above described waste.

Print Name EVAN W. LEBNICKI Title
Signature [Signature] Date 6/21/04
GENERATOR/CUSTOMER

SMALL
QUANTITY TOTAL
GENERATOR
CERTIFICATION

I certify that this generator generates less than 100 kilograms of hazardous waste per month, as defined at 40 C.F.R. 261, and does not accumulate more than 1,000 kilograms of such waste during the month.

GENERATOR'S SIGNATURE

LARGE
QUANTITY
GENERATOR
CERTIFICATION

DEXSIL CDT
TEST RESULTS

<1000 PPM

PAYMENT RECEIVED SECTION

CASH ☐	TOTAL RECEIVED
CHECK NUMBER	

CUSTOMER SERVICED
EVERY 30 DAYS

In accordance with 40 CFR 266 § 43(5) LORCO has notified the US EPA of its location and used oil management activities.

Print Name [Signature]
Signature [Signature] Date
LORCO REPRESENTATIVE

APPENDIX D

UST DISPOSAL CERTIFICATE

NO. 292

DATE 5-24-96

Address _____

Weight	Price
--------	-------

Cast Iron

Steel *116.20*

Lt. Iron

Copper #1

Copper #2

Lt. Copper

Brass

Alum Clean

Lead

Stainless

Radiators

Battery

TOTAL AMOUNT:

Price:

1000 GAL #2 OIL

20275 GAL. WASTE AL

TANK OFF TRAILER

AT MOTOR POOL

Ch #3 333/

Customer

[illegible]

3331

DATE _____

7/5/96

$$\begin{array}{r} 55-33 \\ \hline 22 \end{array} \quad \mathbf{34}$$

PAY
TO THE
ORDER OF

PAY TO THE ORDER OF Team Vignelli
One Hundred Sixty

\$ 161.70

DOLLARS  Security logo included. Dollars on page



NatWest Bank N.A.
Jumping Brook Office
3636 Highway 33, Neptune, NJ 07753

1.0090010-23-BUDG³ 276.1000 STEEL

2. 275 GAL WASTE OIL TANK OFF TRAILER FROM MOTOR POOL

3 550 GAL ABOVE GROUND FROM BUDG #1675 - ACSPAC 2700

003331 1021200339 34 11 40981

APPENDIX E

SOIL ANALYTICAL DATA PACKAGE

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

REPORT OF ANALYSIS

Client: U.S. Army
DPW, SELFM-PW-EV
Bldg. 173
Ft. Monmouth, NJ 07703

Project: Total Petroleum Hydrocarbons
98-0932
Bldg. 276
SMC

Project # 3663
Date Rec. 06/17/98
Date Compl. 06/18/98
Released by:

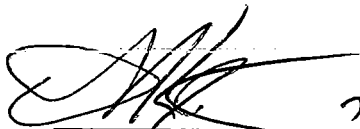

Daniel K. Wright Date: 7-6-98
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Cover Sheet	1
Table of Contents	2
Method Summary	3
Conformance/Non-Conformance	4
Chain of Custody	5
Results Summary	6
Initial Calibration Summary	7
Continuing Calibration Summary	8-11
Surrogate Results Summary	12
MS/MSD Results Summary	13
Quality Control Spike Summary	14
Raw Sample Data	15-40
Laboratory Deliverable Checklist	41

Method Summary

NJDEP Method OQA-QAM-025-10/97

Gas Chromatographic Determination of Total Petroleum Hydrocarbons in Soil

Fifteen grams (15g)(wet weight) of a soil sample is added to a 125 mL acid cleaned, solvent rinsed, capped Erlenmeyer flask. 15g anhydrous sodium sulfate is added to dry sample. Surrogate standard spiking solution is then added to the flask.

Twenty five milliliters(25mL) Methylene Chloride is added to the flask and it is secured on a gyrotory shaker table. The agitation rate is set to 400rpm and the sample is shaken for 30 minutes. The flask is the removed from the table and the particulate matter is allowed to settle. The extract is transferred to a Teflon capped vial. A second 25mL of Methylene Chloride is added to the flask and shaken for an additional 30 minutes. The flask is again removed and allowed to settle. The extracts are combined in the vial then transferred to a 1mL autosampler vial.

The extract is then injected directly into a GC-FID for analysis. The sample is analyzed for petroleum hydrocarbons covering a range of C8-C42 including pristane and phytane. Total Petroleum Hydrocarbon concentration is determined by integrating between 5 minutes and 22 minutes. The baseline is established by starting the integration after the end of the solvent peak and stopping after the last peak.

The final concentration of Total Petroleum Hydrocarbons is calculated using percent solid, sample weight and concentration.

PHC Conformance/Non-conformance Summary Report

No Yes

1. Method Detection Limits provided.

— ☒

2. Method Blank Contamination - If yes, list the sample and the corresponding concentrations in each blank

— ☒

3. Matrix Spike Results Summary Meet Criteria.

(If not met, list the sample and corresponding recovery which falls outside the acceptable range).

— ☒

4. Duplicate Results Summary Meet Criteria.

(If not met, list the sample and corresponding recovery which falls outside the acceptable range).

— ☒

5. IR Spectra submitted for standards, blanks, & samples

— NA —

6. Chromatograms submitted for standards, blanks, and samples if GC fingerprinting was conducted.

— ☒

7. Analysis holding time met.


(If not met, list number of days exceeded for each sample)

— ☒

Additional Comments: _____

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW 846 for Solid Waste Analysis. I have personally examined the information contained in this report, and to the best of my knowledge, I believe that the submitted information is true, accurate, complete, and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.

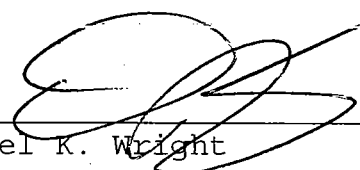

Daniel K. Wright
Laboratory Manager



Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-3484 EMail:appleby@doim6.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

Customer: <u>SMC</u>				Project No: <u>98-0932</u>		Analysis Parameters						Comments: <u>RUSH</u>			
Phone #: <u>610 420 6355</u>				Location: <u>Building 276</u>		TPH H-Na Readings (ppm)									
() DERA (X) OMA () Other: _____															
Samplers Name / Company: <u>David H. Daniels / SMC</u>				Sample #											
Lab Sample I.D.	Sample Location	Date	Time	Type	bottles	Remarks / Preservation Method									
<u>3663 01</u>	<u>276-1 (7')</u>	<u>6.17.98</u>	<u>8:45</u>	<u>50:1</u>	<u>1</u>	<u>ice</u>									
<u>02</u>	<u>276-2 (6.5')</u>		<u>8:50</u>												
<u>03</u>	<u>276-3 (6.5')</u>		<u>8:55</u>												
<u>04</u>	<u>276-4 (6.5')</u>		<u>9:00</u>												
<u>05</u>	<u>276-5 (6.5')</u>		<u>9:05</u>												
<u>06</u>	<u>276-6 (6.5')</u>		<u>9:20</u>												
<u>07</u>	<u>276-7 (7')</u>		<u>12:50</u>												
<u>08</u>	<u>276-8 (7')</u>		<u>12:55</u>												
<u>09</u>	<u>276-9 (6.5')</u>		<u>13:05</u>												
<u>10</u>	<u>276-10 (6.5')</u>		<u>13:10</u>												
<u>11</u>	<u>276-11 (6.5')</u>		<u>13:15</u>												
<u>12</u>	<u>276-12 (7')</u>		<u>13:20</u>												
<u>13</u>	<u>276-13 (6.5')</u>		<u>13:25</u>												
Relinquished by (signature): <u>David H. Daniels</u>		Date/Time: <u>6.17.98 1400</u>		Received by (signature): <u>[Signature]</u>		Relinquished by (signature):		Date/Time:		Received by (signature):					
Relinquished by (signature):		Date/Time:		Received by (signature):		Relinquished by (signature):		Date/Time:		Received by (signature):					
Report Type: () Full, (X) Reduced, () Standard, () Screen / non-certified						Remarks: <u>H-Na Calibration 200 gas = 0.0 ppm</u> <u>calibration gas = 100 ppm at 9.12 setting</u>									
Turnaround time: () Standard 4 wks, (X) Rush Days, (X) ASAP Verbal Hrs.															

Report of Analysis
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification # 13461


Client :	U.S. Army	Lab. ID # :	3663
	DPW. SELF-M-PW-EV	Date Rec'd:	17-Jun-98
	Bldg. 173	Analysis Start:	17-Jun-98
	Ft. Monmouth, NJ 07703	Analysis Complete:	18-Jun-98

Analysis:	OQA-QAM-025	UST Reg. #:	
Matrix:	Soil	Closure #:	
Analyst:	D.DEINHARDT	DICAR #:	
Ext. Meth:	Shake	Location #:	BLDG. 276

Sample	Field ID	Dilution Factor	Weight (g)	% Solid	MDL (mg/kg)	TPHC Result (mg/kg)
3663.01	276-1(7')	1.00	15.18	80.90	191	ND
3663.02	276-2(6.5')	1.00	15.16	80.20	193	ND
3663.03	276-3(6.5')	1.00	15.55	85.30	177	ND
3663.04	276-4(6.5')	1.00	15.81	86.25	172	ND
3663.05	276-5(6.5')	1.00	15.23	86.02	179	ND
3663.06	276-6(6.5')	1.00	15.76	86.54	172	ND
3663.07	276-7(7')	1.00	15.50	79.31	191	ND
3663.08	276-8(7')	1.00	15.14	80.91	192	ND
3663.09	276-9(6.5')	1.00	15.29	82.08	187	ND
3663.10	276-10(6.5')	1.00	15.06	83.63	187	ND
3663.11	276-11(6.5')	1.00	15.80	83.50	178	ND
3663.12	276-12(7')	1.00	15.05	80.47	194	ND
3663.13	276-13(6.5')	1.00	15.11	82.52	188	ND
METHOD BLANK	TBLK 116	1.00	15.00	100.00	157	ND

ND = Not Detected

MDL = Method Detection Limit


 Daniel K. Wright
 Laboratory Director

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

- | | |
|--|-------------------------------------|
| 1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted | ☒ |
| 2. Table of Contents submitted | ☒ |
| 3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted | ☒ |
| 4. Document paginated and legible | ☒ |
| 5. Chain of Custody submitted | ☒ |
| 6. Samples submitted to lab within 48 hours of sample collection | ☒ |
| 7. Methodology Summary submitted | ☒ |
| 8. Laboratory Chronicle and Holding Time Check submitted | ☒ |
| 9. Results submitted on a dry weight basis | ☒ |
| 10. Method Detection Limits submitted | ☒ |
| 11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP | ☒ |

Laboratory Manager or Environmental Consultant's Signature

Date 7/6/98

Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance.

APPENDIX F

GROUNDWATER ANALYTICAL DATA PACKAGE

FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732) 532-6224 FAX: (732) 532-6263

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

CERTIFICATIONS: NJDEP #13461, NYSDOH #11699



ANALYTICAL DATA REPORT Fort Monmouth Environmental Laboratory ENVIRONMENTAL DIVISION Fort Monmouth, New Jersey PROJECT: UST Program

Bldg. 276

Field Sample Location	Laboratory Sample ID#	Matrix	Date and Time of Collection	Date Received
Trip Blank	4882.01	Aqueous	25-Oct-99	10/25/99
Field Blank	4882.02	Aqueous	25-Oct-99 14:20	10/25/99
DUP.	4882.03	Aqueous	25-Oct-99	10/25/99
Bldg. 276	4882.04	Aqueous	25-Oct-99 14:27	10/25/99

ANALYSIS:
FORT MONMOUTH ENVIRONMENTAL LAB
VOA+15, BN+15

ENCLOSURE:
CHAIN OF CUSTODY
RESULTS


 4-7-00
Daniel Wright/Date
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Chain of Custody	1-2
Methodology Summary	3-4
Conformance/Non-Conformance Summary	5-7
Laboratory Chronicle	8-9
Volatile Organics	10-11
Analytical Results Summary	12-21
Tune Results Summary	22-25
Method Blank Results Summary	26
Calibration Summary	27-28
Surrogate Recovery Summary	29
MS/MSD Results Summary	30-31
Internal Standard Area & RT Summary	32
Chromatograms	33-42
Base Neutrals	43
Analytical Results Summary	44-55
Tune Results Summary	56-59
Method Blank Results Summary	60-61
Calibration Summary	62-65
Surrogate Recovery Summary	66
MS/MSD Results Summary	67-70
Internal Standard Area & RT Summary	71-74
Chromatograms	75-84
Laboratory Deliverables Checklist	85
Laboratory Authentication Statement	86

CHAIN OF CUSTODY

000001



Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-6263 EMail:appleby@mail1.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

20000

METHODOLOGY SUMMARY

000003

Methodology Summary

EPA Method 624

Gas Chromatographic Determination of Volatiles in Water

Surrogates and internal standards are added to a 5 ml aliquot of sample. The sample is then purged and desorbed into a GC/MS system. The organic compounds are separated by the gas chromatograph and detected using the mass spectrometer. Volatiles are identified and quantitated.

EPA Method 3510/8270

Gas Chromatographic Determination of Semi-volatiles in Water

Surrogates are added to a measured volume of sample, usually 1 liter, at a specified pH. The sample is serially extracted with Methylene Chloride using a separatory funnel. The extract concentrated and internal standards are added. The sample is injected into a GC/MS system. Semi-volatiles are identified and quantitated.

CONFORMANCE/ NON-CONFORMANCE SUMMARY

000005

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT

Indicate
Yes, No, N/A

1. Chromatograms labeled/Compounds identified
(Field samples and method blanks) yes
2. Retention times for chromatograms provided yes
3. GC/MS Tune Specifications
 - a. BFB Meet Criteria yes
 - b. DFTPP Meet Criteria yes
4. GC/MS Tuning Frequency – Performed every 24 hours for 600 series and 12 hours for 8000 series yes
5. GC/MS Calibration – Initial Calibration performed before sample analysis and continuing calibration performed within 24 hours of sample analysis for 600 series and 12 hours for 8000 series yes
6. GC/MS Calibration requirements
 - a. Calibration Check Compounds Meet Criteria yes
 - b. System Performance Check Compounds Meet Criteria yes
7. Blank Contamination – If yes, List compounds and concentrations in each blank: No
 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction _____
8. Surrogate Recoveries Meet Criteria No

If not met, list those compounds and their recoveries, which fall outside the acceptable range:

 - a. VOA Fraction _____
 - b. B/N Fraction All three low in initial & reanalysis 18 Dup
 - c. Acid Fraction _____

If not met, were the calculations checked and the results qualified as "estimated"?

yes
9. Matrix Spike/Matrix Spike Duplicate Recoveries Meet Criteria
(If not met, list those compounds and their recoveries, which fall outside the acceptable range) yes
 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction _____

000006

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT (cont.)

Indicate
Yes, No, N/A

10. Internal Standard Area/Retention Time Shift Meet Criteria
(If not met, list those compounds, which fall outside the acceptable range)

yes

- a. VOA Fraction _____
b. B/N Fraction _____
c. Acid Fraction _____

11. Extraction Holding Time Met

yes

If not met, list the number of days exceeded for each sample: _____

12. Analysis Holding Time Met

yes

If not met, list the number of days exceeded for each sample: _____

Additional Comments:

Laboratory Manager: _____

Date: 4-7-00

000007

LABORATORY CHRONICLE

000008

Laboratory Chronicle

Lab ID: 4882 Site: Bldg. 276

	Date	Hold Time
Date Sampled	10/25/99	NA
Receipt/Refrigeration	10/ 25/99	NA
Extractions		
1. Base Neutrals	10/28/99	7 Days
Analyses		
1. Volatile Organics	10/28,29/99	14 Days
2. Base Neutrals	11/03/99	40 Days

000009

VOLATILE ORGANICS

000010

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

Definition of Qualifiers

MDL : Method Detection Limit

J : Compound identified below detection limit

B : Compound in both sample and blank

D : Results from dilution of sample

U : Compound searched for but not detected

000011

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001094.D**
 Operator **Skelton**
 Date Acquired **28 Oct 1999 5:09 pm**

Sample Name **Vblk36**
 Field ID **Vblk36**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,1,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

VbIk36

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 4882 Location: 276 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: VbIk36
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001094.D
Level: (low/med) LOW Date Received: 10/25/99
% Moisture: not dec. Date Analyzed: 10/28/99
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001102.D**
 Operator **Skelton**
 Date Acquired **28 Oct 1999 10:27 pm**

Sample Name **4882.01**
 Field ID **Trip Blank**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Trip Blank

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 4882 Location: 276 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 4882.01
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001102.D
Level: (low/med) LOW Date Received: 10/25/99
% Moisture: not dec. Date Analyzed: 10/28/99
GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001103.D**
 Operator **Skelton**
 Date Acquired **28 Oct 1999 11:06 pm**

Sample Name **4882.02**
 Field ID **Field Blank**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers.

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Field Blank

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 4882 Location: 276 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 4882.02
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001103.D
Level: (low/med) LOW Date Received: 10/25/99
% Moisture: not dec. Date Analyzed: 10/28/99
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001104.D**
 Operator **Skelton**
 Date Acquired **28 Oct 1999 11:46 pm**

Sample Name **4882.03**
 Field ID **Dupe**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Dupe

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 4882 Location: 276 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 4882.03
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001104.D
Level: (low/med) LOW Date Received: 10/25/99
% Moisture: not dec. _____ Date Analyzed: 10/28/99
GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001105.D**
 Operator **Skelton**
 Date Acquired **29 Oct 1999 12:25 am**

Sample Name **4882.04**
 Field ID **Bldg276**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Bldg276

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 4882 Location: 276 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 4882.04
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001105.D
Level: (low/med) LOW Date Received: 10/25/99
% Moisture: not dec. _____ Date Analyzed: 10/29/99
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

BASE NEUTRAL

000043

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name **BN04010.D**
Operator **Bhaskar**
Date Acquired **3-Nov-99**

Sample Name **Sblk315**
Misc Info **Sblk315 A 991028**
Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
39638-32-9	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.79 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name BN04010.D
Operator Bhaskar
Date Acquired 3-Nov-99

Sample Name Sblk315
Misc Info Sblk315 A 991028
Sample Multiplier 1

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
D= Value from dilution
B= Compound in Related Blank
PQL= Practical Quantitation Limit

MDL= Method Detection Limit
NLE= No Limit Established
R.T.=Retention Time

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Field ID:

Sblk315

Lab Name: FMETL Lab Code 13461
Project: UST Case No.: 4882 Location: 276 SDG No: _____
Matrix: (soil/water) WATER Lab Sample ID: Sblk315
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BN04010.D
Level: (low/med) LOW Date Received: 10/25/99
% Moisture: _____ decanted: (Y/N) N Date Extracted: 10/28/99
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 11/3/99
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: _____

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **BN04012.D**
 Operator **Bhaskar**
 Date Acquired **3-Nov-99**

Sample Name **4882.02**
 Misc Info **Field Blank**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
39638-32-9	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.79 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BN04012.D**
 Operator **Bhaskar**
 Date Acquired **3-Nov-99**

Sample Name **4882.02**
 Misc Info **Field Blank**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

1F

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET

Field ID:

TENTATIVELY IDENTIFIED COMPOUNDS

Field Blank

Lab Name: FMETL Lab Code 13461
Project: UST Case No.: 4882 Location: 276 SDG No: _____
Matrix: (soil/water) WATER Lab Sample ID: 4882.02
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BN04012.D
Level: (low/med) LOW Date Received: 10/25/99
% Moisture: _____ decanted: (Y/N) N Date Extracted: 10/28/99
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 11/3/99
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: _____

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name **BN04013.D**

Sample Name **4882.03**

Operator **Bhaskar**

Misc Info **Dupe**

Date Acquired **3-Nov-99**

Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
39638-32-9	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.79 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BN04013.D**
 Operator **Bhaskar**
 Date Acquired **3-Nov-99**

Sample Name **4882.03**
 Misc Info **Dupe**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

Page 2 of 2

000051

1F

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Field ID:

Dupe

Lab Name: FMETL Lab Code 13461
Project: UST Case No.: 4882 Location: 276 SDG No:
Matrix: (soil/water) WATER Lab Sample ID: 4882.03
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BN04013.D
Level: (low/med) LOW Date Received: 10/25/99
% Moisture: decanted: (Y/N) N Date Extracted: 10/28/99
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 11/3/99
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH:

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **BN04014.D**
 Operator **Bhaskar**
 Date Acquired **3-Nov-99**

Sample Name **4882.04**
 Misc Info **Bldg. 276**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
39638-32-9	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene	12.19	33702	1.31 ug/L	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.79 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BN04014.D**
 Operator **Bhaskar**
 Date Acquired **3-Nov-99**

Sample Name **4882.04**
 Misc Info **Bldg.276**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benizidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

Page 2 of 2

000054

1F

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Field ID:

Bldg.276

Lab Name: FMETL Lab Code 13461
Project: UST Case No.: 4882 Location: 276 SDG No: _____
Matrix: (soil/water) WATER Lab Sample ID: 4882.04
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BN04014.D
Level: (low/med) LOW Date Received: 10/25/99
% Moisture: _____ decanted: (Y/N) N Date Extracted: 10/28/99
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 11/3/99
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: _____

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

**SEMIVOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
DECAFLUOROTRIPHENYLPHOSPHINE (DFTPP)**

Lab Name: FMETL Lab Code 13461
 Project: UST Case No.: 4882 Location: 276 SDG No: _____
 Lab File ID: BN04004.D DFTPP Injection Date: 11/3/99
 Instrument ID: SVoa#1 DFTPP Injection Time: 10:14

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
51	30.0 - 80.0% of mass 198	42.3
68	Less than 2.0% of mass 69	0.0 (0.0)1
69	Mass 69 Relative abundance	54.2
70	Less than 2.0% of mass 69	0.5 (0.8)1
127	25.0 - 75.0% of mass 198	43.6
197	Less than 1.0% of mass 198	0.0
198	Base Peak, 100% relative abundance	100.0
199	5.0 to 9.0% of mass 198	6.6
275	10.0 - 30.0% of mass 198	15.6
365	Greater than 0.75% of mass 198	2.0
441	Present, but less than mass 443	9.1
442	40.0 - 110.0% of mass 198	59.4
443	15.0 - 24.0% of mass 442	11.7 (19.7)2

1-Value is % mass 69

2-Value is % mass 442

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	Field ID:	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	SSTD050	DAILY CAL	BN04005.D	11/3/99	10:44
02	SSTD120	120 PPM CAL	BN04006.D	11/3/99	11:30
03	SSTD080	80 PPM CAL	BN04007.D	11/3/99	12:15
04	SSTD020	20 PPM CAL	BN04008.D	11/3/99	13:00
05	SSTD010	10 PPM CAL	BN04009.D	11/3/99	13:48
06	SBLK315	SBLK315	BN04010.D	11/3/99	14:38
07	FIELD BLANK	4882.02	BN04012.D	11/3/99	16:09
08	DUPE	4882.03	BN04013.D	11/3/99	16:56
09	BLDG.276	4882.04	BN04014.D	11/3/99	17:42
10	DUPE	4882.03	BN04021.D	11/4/99	7:32

DFTPP

Data File : C:\HPCHEM\1\DATA\991103\BN04004.D

Vial: 99

Acq On : 3 Nov 1999 10:14 am

Operator: Bhaskar

Sample : DFTPP TUNE

Inst : GC/MS Ins

Misc : 50 NG/2UL




Multiplr: 1.00

MS Integration Params: RTEINT.P

GC Integration Params: rteint2.p

Method : C:\HPCHEM\1\METHODS\M62537.M (RTE Integrator)

Title : BNA Calibration

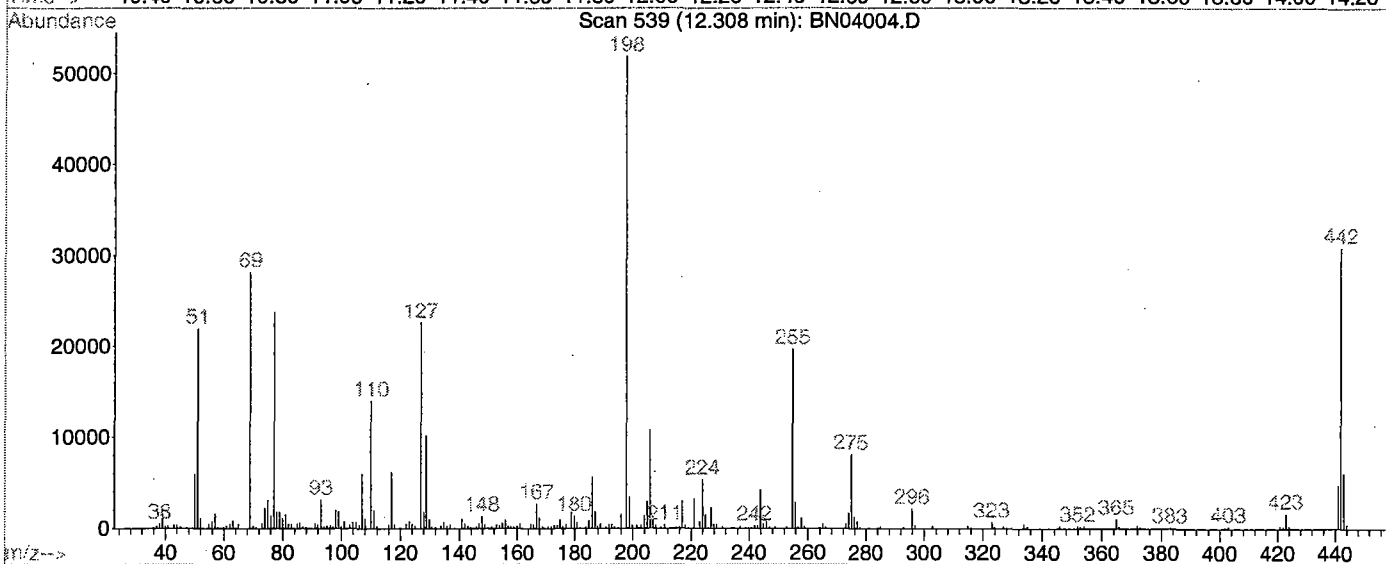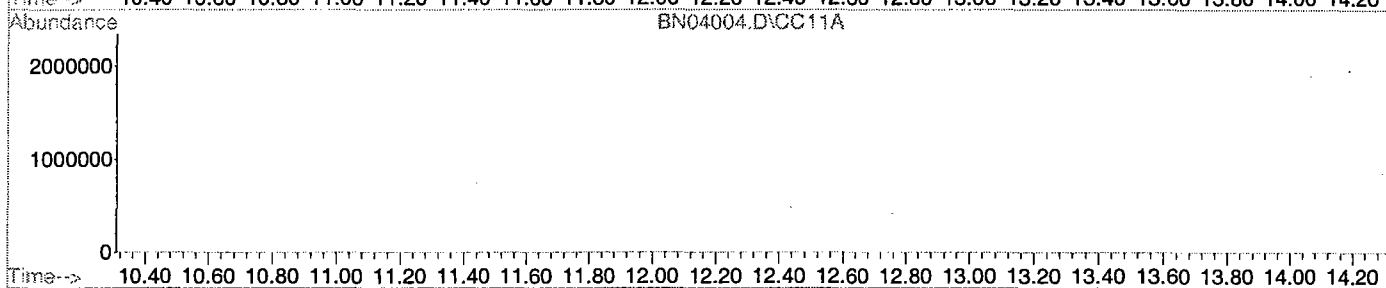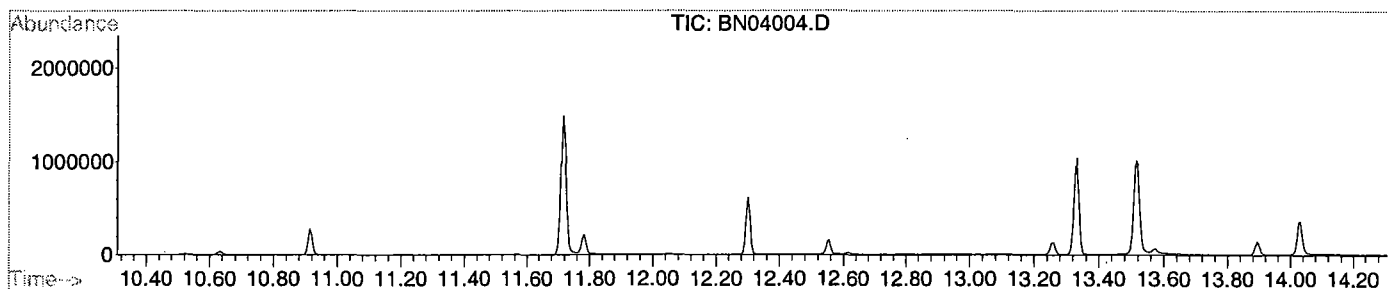

Spectrum Information: Scan 539

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
51	198	30	60	42.3	21944	PASS
68	69	0.00	2	0.0	0	PASS
69	198	0.00	100	54.2	28168	PASS
70	69	0.00	2	0.8	238	PASS
127	198	40	60	43.6	22648	PASS
197	198	0.00	1	0.0	0	PASS
198	198	100	100	100.0	51936	PASS
199	198	5	9	6.6	3426	PASS
275	198	10	30	15.6	8108	PASS
365	198	1	100	2.0	1036	PASS
441	443	1	99	77.9	4735	PASS
442	198	40	100	59.4	30872	PASS
443	442	17	23	19.7	6077	PASS

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

- | | |
|--|-------------------------------------|
| 1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted | ☒ |
| 2. Table of Contents submitted | ☒ |
| 3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted | ☒ |
| 4. Document paginated and legible | ☒ |
| 5. Chain of Custody submitted | ☒ |
| 6. Samples submitted to lab within 48 hours of sample collection | ☒ |
| 7. Methodology Summary submitted | ☒ |
| 8. Laboratory Chronicle and Holding Time Check submitted | ☒ |
| 9. Results submitted on a dry weight basis | ☒ |
| 10. Method Detection Limits submitted | ☒ |
| 11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP | ☒ |

Laboratory Manager or Environmental Consultant's Signature

Date 4/17/00


Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance.

000085

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.



Daniel K. Wright
Laboratory Manager

000086

FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732) 532-6224 FAX: (732) 532-6263

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

CERTIFICATIONS: NJDEP #13461, NYSDOH #11699



ANALYTICAL DATA REPORT Fort Monmouth Environmental Laboratory ENVIRONMENTAL DIVISION Fort Monmouth, New Jersey PROJECT: UST Program

Bldg. 276

Field Sample Location	Laboratory Sample ID#	Matrix	Date and Time of Collection	Date Received
276-1 6-11'	4982.01	Aqueous	04-Dec-99 11:10	12/06/99

ANALYSIS:
FORT MONMOUTH ENVIRONMENTAL LAB
VOA+15, BN+15

ENCLOSURE:
CHAIN OF CUSTODY
RESULTS


 4-8-00
Daniel Wright/Date
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Chain of Custody	1-2
Methodology Summary	3-4
Conformance/Non-Conformance Summary	5-7
Laboratory Chronicle	8-9
Volatile Organics	10-11
Analytical Results Summary	12-15
Tune Results Summary	16-17
Method Blank Results Summary	18
Calibration Summary	19
Surrogate Recovery Summary	20
MS/MSD Results Summary	21-22
Internal Standard Area & RT Summary	23
Chromatograms	24-27
Base Neutrals	28
Analytical Results Summary	29-34
Tune Results Summary	35-40
Method Blank Results Summary	41
Calibration Summary	42-45
Surrogate Recovery Summary	46-47
MS/MSD Results Summary	48-51
Internal Standard Area & RT Summary	52-55
Chromatograms	56-59
Laboratory Deliverables Checklist	60
Laboratory Authentication Statement	61

CHAIN OF CUSTODY

000001



METHODOLOGY SUMMARY

000003

Method Summary

EPA Method 624

Gas Chromatographic Determination of Volatiles in Water

Surrogates and internal standards are added to a 5-ml aliquot of sample. The sample is then purged and desorbed into a GC/MS system. The organic compounds are separated by the gas chromatograph and detected using the mass spectrometer. Volatiles are identified and quantitated.

EPA Method 3510/8270

Gas Chromatographic Determination of Semi-volatiles in Water

Surrogates are added to measured volume of sample, usually 1 liter, at a specified pH. The sample is serially extracted with Methylene chloride using a separatory funnel. The extract concentrated and internal standards are added. The sample is injected into a GC/MS system. Semi-volatiles are identified and quantitated.

000004

CONFORMANCE NON-CONFORMANC SUMMARY

000005

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT

Indicate
Yes, No, N/A

1. Chromatograms Labeled/Compounds Identified
(Field Samples and Method Blanks) yes
2. Retention times for chromatograms provided yes
3. GC/MS Tune Specifications
 - a. BFB Meet Criteria yes
 - b. DFTPP Meet Criteria yes
4. GC/MS Tuning Frequency - Performed every 24 hours for 600 series and 12 hours for 8000 series yes
5. GC/MS Calibration - Initial Calibration performed before sample analysis and continuing calibration performed within 24 hours of sample analysis for 600 series and 12 hours for 8000 series yes
6. GC/MS Calibration Requirements
 - a. Calibration Check Compounds Meet Criteria yes
 - b. System Performance Check Compounds Meet Criteria yes
7. Blank Contamination - If yes, List compounds and concentrations in each blank: NO
 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction _____
8. Surrogate Recoveries Meet Criteria yes

If not met, list those compounds and their recoveries, which fall outside the acceptable range:

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction _____

If not met, were the calculations checked and the results qualified as "estimated"? _____
9. Matrix Spike/Matrix Spike Duplicate Recoveries Meet Criteria yes

(If not met, list those compounds and their recoveries, which fall outside the acceptable range)

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction _____

GC/MS Analysis Conformance/Non-Conformance Summary (cont.)

Indicate
Yes,
No,
N/A

10. Internal Standard Area/Retention Time Shift Meet Criteria
(If not met, list those compounds, which fall outside the acceptable range)

yes

- a. VOA Fraction _____
b. B/N Fraction _____
c. Acid Fraction _____

11. Extraction Holding Time Met

yes

If not met, list number of days exceeded for each sample: _____

12. Analysis Holding Time Met

yes

If not met, list number of days exceeded for each sample: _____

Additional Comments:

Laboratory Manager :



Date:

4-8-00

LABORATORY CHRONICLE

000008

Laboratory Chronicle

Lab ID: 4982

Site: Bldg. 276

	Date	Hold Time
Date Sampled	12/04/99	NA
Receipt/Refrigeration	12/04/99	NA

Extractions

1. Base Neutral	12/06/99	14 days
-----------------	----------	---------

Analyses

1. Volatile Organics	12/06,07/99	14 days
2. Base Neutral	12/07/99	40 days

* Samples collected and refrigerated 12/04/99, Laboratory received the samples on Monday 12/06/99.

000009

VOLATILE ORGANICS

000010

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

Definition of Qualifiers

MDL : Method Detection Limit
J : Compound identified below detection limit
B : Compound in both sample and blank
D : Results from dilution of sample
U : Compound searched for but not detected
E : Compound exceeds calibration limit

000011

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001406.D**
 Operator **Skelton**
 Date Acquired **6 Dec 1999 4:03 pm**

Sample Name **Vblk38**
 Field ID **Vblk38**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Vblk38

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 4982 Location: 276 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: Vblk38
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001406.D
Level: (low/med) LOW Date Received: 12/6/99
% Moisture: not dec. Date Analyzed: 12/6/99
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001423.D**
 Operator **Skelton**
 Date Acquired **7 Dec 1999 3:19 am**

Sample Name **4982.01**
 Field ID **276-1**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6.2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

276-1

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 4982 Location: 276 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 4982.01
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001423.D
Level: (low/med) LOW Date Received: 12/6/99
% Moisture: not dec. Date Analyzed: 12/7/99
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

BASE NEUTRAL

000028

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **BN04072.D**
 Operator **Bhaskar**
 Date Acquired **7-Dec-99**

Sample Name **Sblk325**
 Misc Info **Sblk325 A 991206**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
39638-32-9	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.79 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BN04072.D**

Operator **Bhaskar**

Date Acquired **7-Dec-99**

Sample Name **Sblk325**

Misc Info **Sblk325 A 991206**

Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range

D= Value from dilution

B= Compound in Related Blank

PQL= Practical Quantitation Limit

MDL= Method Detection Limit

NLE= No Limit Established

R.T.=Retention Time

Page 2 of 2

000030

1F

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Field ID:

Sblk325

Lab Name: FMETL Lab Code 13461
Project: 100004 Case No.: 4982 Location: Bld.276 SDG No:
Matrix: (soil/water) WATER Lab Sample ID: Sblk325
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BN04072.D
Level: (low/med) LOW Date Received: 12/6/99
% Moisture: decanted: (Y/N) N Date Extracted: 12/6/99
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 12/7/99
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH:

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **BN04083.D**
 Operator **Bhaskar**
 Date Acquired **7-Dec-99**

Sample Name **4982.01**
 Misc Info **276-1**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
39638-32-9	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.79 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BN04083.D**
 Operator **Bhaskar**
 Date Acquired **7-Dec-99**

Sample Name **4982.01**
 Misc Info **276-1**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

Page 2 of 2

000033

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET

Field ID:

TENTATIVELY IDENTIFIED COMPOUNDS

276-1

Lab Name: FMETL Lab Code 13461
Project: 100004 Case No.: 4982 Location: Bld.276 SDG No:
Matrix: (soil/water) WATER Lab Sample ID: 4982.01
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BN04083.D
Level: (low/med) LOW Date Received: 12/6/99
% Moisture: decanted: (Y/N) N Date Extracted: 12/6/99
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 12/7/99
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH:

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

**SEMIVOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
DECAFLUOROTRIPHENYLPHOSPHINE (DFTPP)**

Lab Name: FMETL Lab Code 13461
 Project 100004 Case No.: 4982 Location Bld.276 SDG No.: _____
 Lab File ID: BNA03321.D DFTPP Injection Date: 10/27/99
 Instrument ID: BNA#2 DFTPP Injection Time: 9:32

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
51	30.0 - 80.0% of mass 198	60.0
68	Less than 2.0% of mass 69	0.0 (0.0)1
69	Mass 69 Relative abundance	56.4
70	Less than 2.0% of mass 69	0.3 (0.6)1
127	25.0 - 75.0% of mass 198	53.8
197	Less than 1.0% of mass 198	0.0
198	Base Peak, 100% relative abundance	100.0
199	5.0 to 9.0% of mass 198	7.1
275	10.0 - 30.0% of mass 198	19.9
365	Greater than 0.75% of mass 198	2.0
441	Present, but less than mass 443	8.7
442	40.0 - 110.0% of mass 198	59.1
443	15.0 - 24.0% of mass 442	12.0 (20.4)2

1-Value is % mass 69

2-Value is % mass 442

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	FIELD ID	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	SSTD050	50 PPM CAL	BNA03325.D	10/27/99	12:40
02	4871.04DUP	4871.04DUP	BNA03332.D	10/27/99	18:28
03	4871.04MS	4871.04MS	BNA03333.D	10/27/99	19:17

Data File : C:\HPCHEM\1\DATA\991027\BNA03321.D

Vial: 99

Acq On : 27 Oct 1999 9:32 am

Operator: Bhaskar

Sample : DFTPP TUNE

Inst : GC BNA 2



Misc : 50NG/2UL

Multiplr: 1.00

MS Integration Params: RTEINT.P

Method : C:\HPCHEM\1\METHODS\M262534.M (RTE Integrator)

Title : BNA Calibration

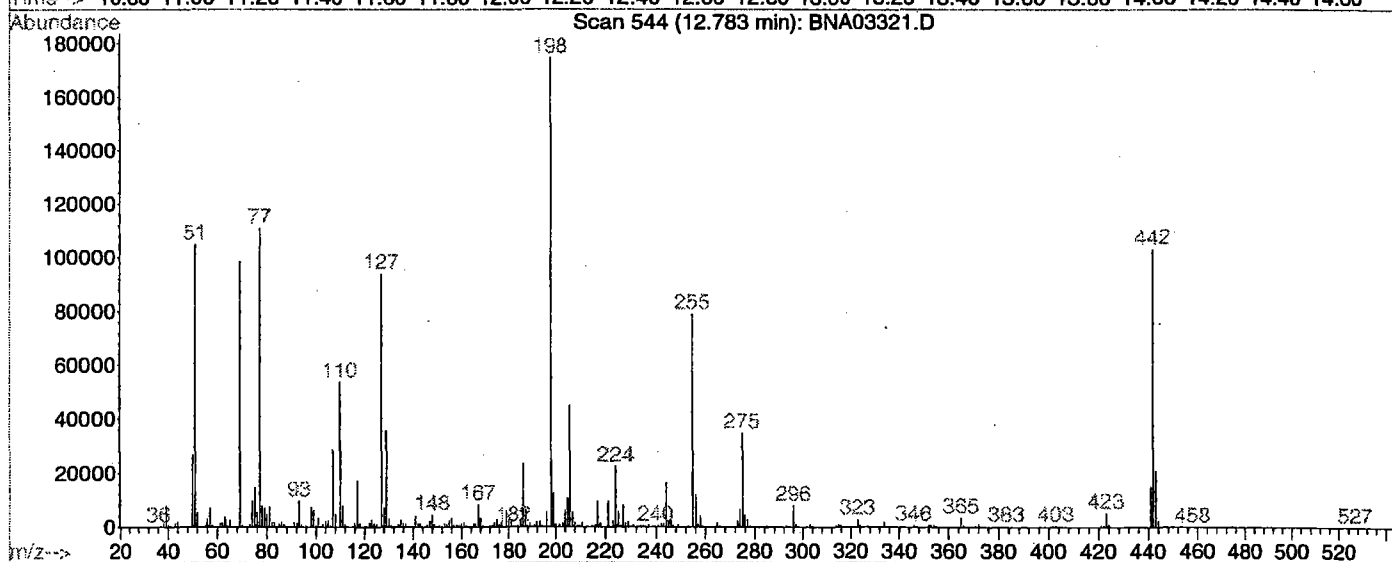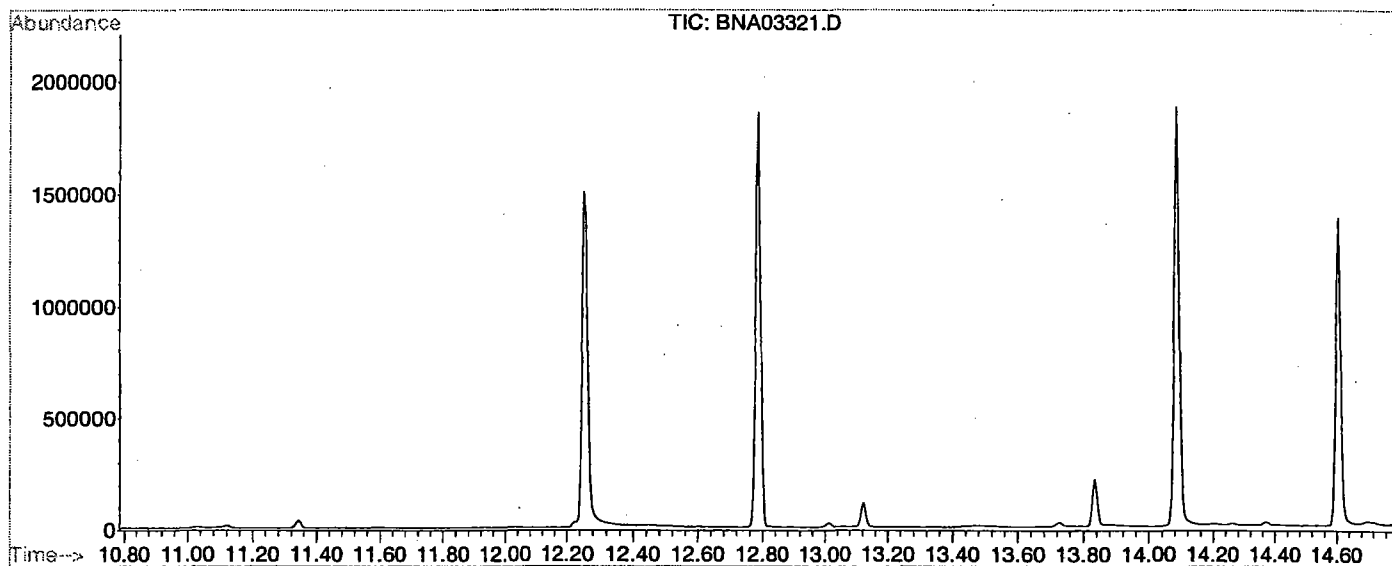

Spectrum Information: Scan 544

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
51	198	30	60	60.0	104832	PASS
68	69	0.00	2	0.0	0	PASS
69	198	0.00	100	56.4	98600	PASS
70	69	0.00	2	0.6	593	PASS
127	198	40	60	53.8	94000	PASS
197	198	0.00	1	0.0	0	PASS
198	198	100	100	100.0	174720	PASS
199	198	5	9	7.1	12479	PASS
275	198	10	30	19.9	34848	PASS
365	198	1	100	2.0	3527	PASS
441	443	1	99	72.0	15134	PASS
442	198	40	100	59.1	103184	PASS
443	442	17	23	20.4	21008	PASS

**SEMIVOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
DECAFLUOROTRIPHENYLPHOSPHINE (DFTPP)**

Lab Name: FMETL Lab Code 13461
 Project: 100004 Case No.: 4982 Location: Bld.276 SDG No: _____
 Lab File ID: BN04064.D DFTPP Injection Date: 11/29/99
 Instrument ID: SVoa#1 DFTPP Injection Time: 13:16

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
51	30.0 - 80.0% of mass 198	48.2
68	Less than 2.0% of mass 69	0.0 (0.0)1
69	Mass 69 Relative abundance	59.4
70	Less than 2.0% of mass 69	0.3 (0.5)1
127	25.0 - 75.0% of mass 198	44.0
197	Less than 1.0% of mass 198	0.0
198	Base Peak, 100% relative abundance	100.0
199	5.0 to 9.0% of mass 198	6.8
275	10.0 - 30.0% of mass 198	15.3
365	Greater than 0.75% of mass 198	1.4
441	Present, but less than mass 443	6.7
442	40.0 - 110.0% of mass 198	41.9
443	15.0 - 24.0% of mass 442	8.2 (19.6)2

1-Value is % mass 69

2-Value is % mass 442

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	Field ID:	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	SSTD120	120 PPM CAL	BN04065.D	11/29/99	13:47
02	SSTD080	80 PPM CAL	BN04066.D	11/29/99	14:37
03	SSTD050	50 PPM CAL	BN04067.D	11/29/99	15:21
04	SSTD020	20 PPM CAL	BN04068.D	11/29/99	16:06
05	SSTD010	10 PPM CAL	BN04069.D	11/29/99	16:52

Data File : C:\HPCHEM\1\DATA\991129\BN04064.D

Vial: 99

Acq On : 29 Nov 1999 1:16 pm

Operator: Bhaskar

Sample : DFTPP TUNE

Inst : GC/MS Ins

Misc : 50 NG/2UL


Multiplr: 1.00

MS Integration Params: RTEINT.P

GC Integration Params: rteint2.p

Method : C:\HPCHEM\1\METHODS\M62538.M (RTE Integrator)

Title : BNA Calibration

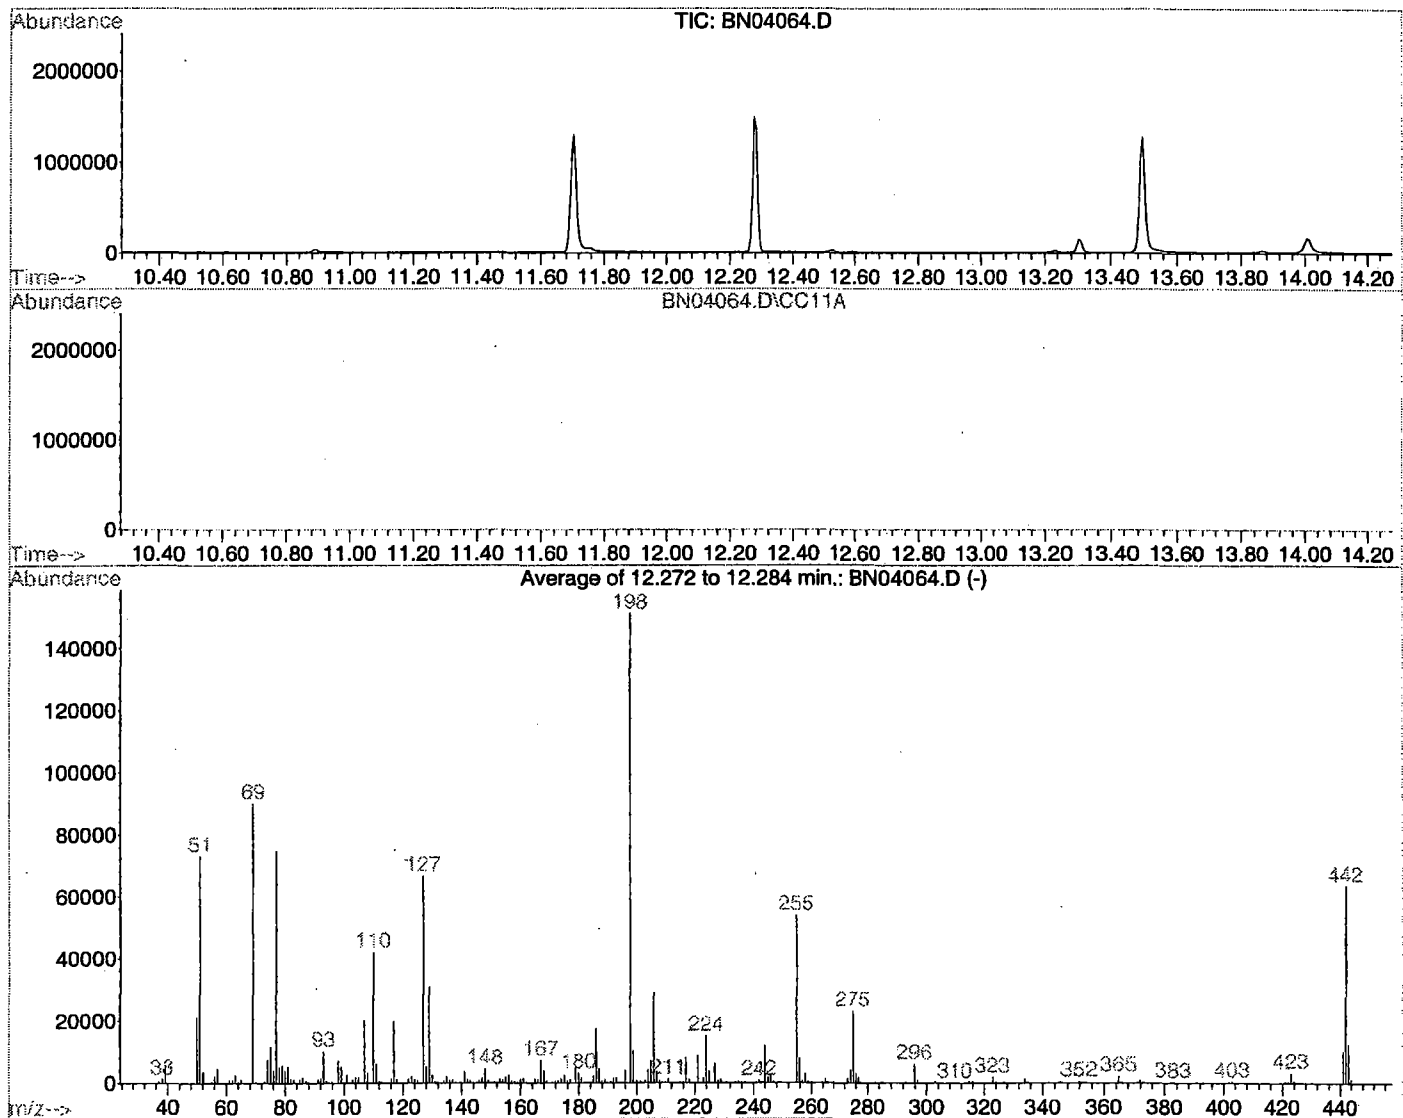

Spectrum Information: Average of 12.272 to 12.284 min.

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
51	198	30	60	48.2	73005	PASS
68	69	0.00	2	0.0	0	PASS
69	198	0.00	100	59.4	90010	PASS
70	69	0.00	2	0.5	426	PASS
127	198	40	60	44.0	66547	PASS
197	198	0.00	1	0.0	0	PASS
198	198	100	100	100.0	151413	PASS
199	198	5	9	6.8	10318	PASS
275	198	10	30	15.3	23106	PASS
365	198	1	100	1.4	2185	PASS
441	443	1	99	81.1	10084	PASS
442	198	40	100	41.9	63450	PASS
443	442	17	23	19.6	12433	PASS

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted ☒
2. Table of Contents submitted ☒
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted ☒
4. Document paginated and legible ☒
5. Chain of Custody submitted ☒
6. Samples submitted to lab within 48 hours of sample collection ☒
7. Methodology Summary submitted ☒
8. Laboratory Chronicle and Holding Time Check submitted ☒
9. Results submitted on a dry weight basis ☒
10. Method Detection Limits submitted ☒
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP ☒

Laboratory Manager or Environmental Consultant's Signature _____

Date 4/8/80


Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance.

000060

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.




Daniel K. Wright
Laboratory Manager

000061

Page 1
Page 2
Page 3
Page 4
Page 5
Page 6
Page 7
Page 8
Page 9
Page 10
Page 11
Page 12
Page 13
Page 14
Page 15
Page 16
Page 17
Page 18
Page 19
Page 20
Page 21
Page 22
Page 23
Page 24
Page 25
Page 26
Page 27
Page 28
Page 29
Page 30
Page 31
Page 32
Page 33
Page 34
Page 35
Page 36
Page 37
Page 38
Page 39
Page 40
Page 41
Page 42
Page 43
Page 44
Page 45
Page 46
Page 47
Page 48
Page 49
Page 50
Page 51
Page 52
Page 53
Page 54
Page 55
Page 56
Page 57
Page 58
Page 59
Page 60
Page 61
Page 62
Page 63
Page 64
Page 65
Page 66
Page 67
Page 68
Page 69
Page 70
Page 71
Page 72
Page 73
Page 74
Page 75
Page 76
Page 77
Page 78
Page 79
Page 80
Page 81
Page 82
Page 83
Page 84
Page 85
Page 86
Page 87
Page 88
Page 89
Page 90
Page 91
Page 92
Page 93
Page 94
Page 95
Page 96
Page 97
Page 98
Page 99
Page 100

APPENDIX G
PHOTOGRAPHS

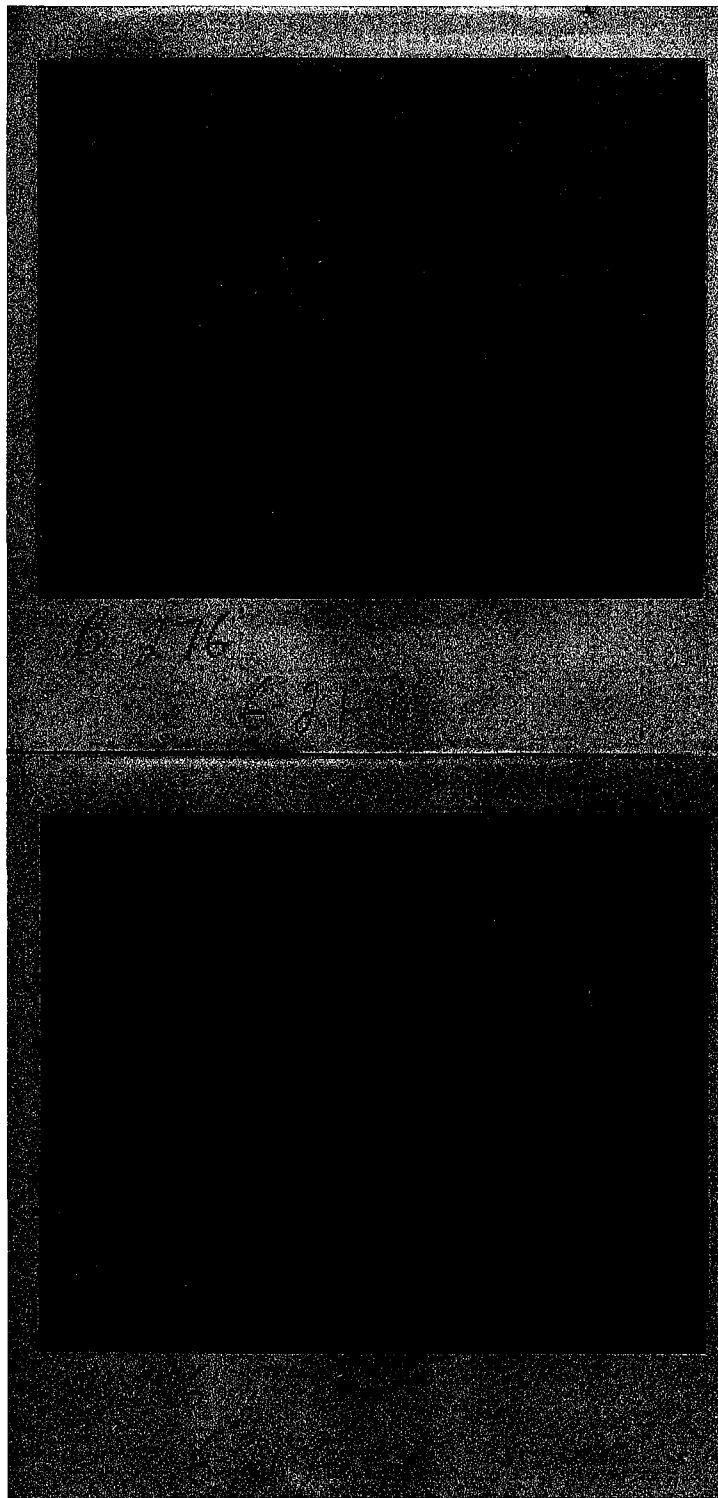

JUNE 21, 1996

PHOTOGRAPHIC LOG


UST NO. 90010-23

**Building 276
Main Post-East
Fort Monmouth**

VERSAR
Engineers, Managers, Scientists & Planners
Bristol, PA

APPENDIX H

ELECTRONIC DATA DELIVERABLES

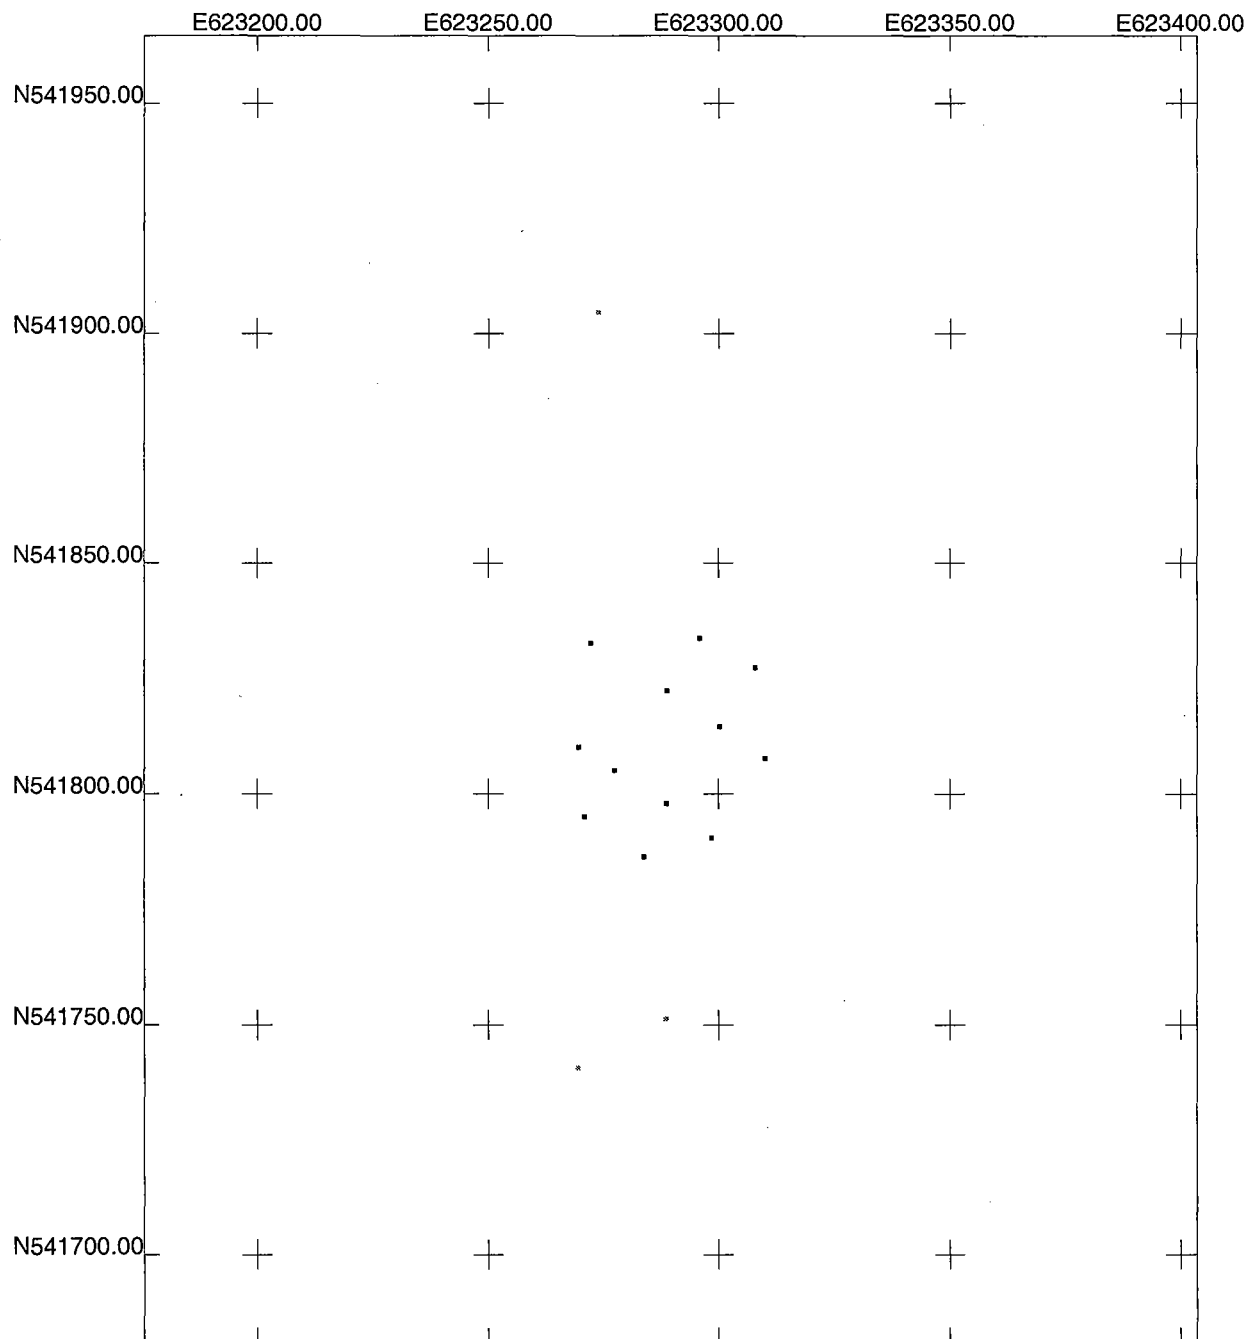

Bldg. 276 UST Sample Location GPS Map

US State Plane 1983
New Jersey (NY East) 2900
NAD 1983 (Conus)



Scale 1:500
0 60.00

US Survey Feet

276 r100214a.ssf
3/20/2000
Pathfinder Office
 Trimble

BLDG. 276 UST SAMPLE LOCATION GPS POSITION & COORDINATES

US STATE PLANE 1983 NJ (NY EAST) 2900 NAD 1983 (CONUS)


(IN US SURVEY FEET)

SAMPLE POINTS

<u>POSITION / DESC.</u>	<u>Y COORD. (NORTHING)</u>	<u>X COORD. (EASTING)</u>
1	541814.778	623300.006
2	541807.797	623309.865
3	541790.601	623298.302
4	541786.413	623283.535
5	541795.274	623270.726
6	541810.333	623269.383
7	541797.934	623288.533
8	541805.227	623277.15
9 and 10	541832.899	623271.963
11	541833.909	623295.616
12	541822.474	623288.606
13	541827.45	623307.802

REFERENCE POINTS

<u>POSITION / DESC.</u>	<u>Y COORD. (NORTHING)</u>	<u>X COORD. (EASTING)</u>
Telephone Pole	541904.719	623273.72
278 CORN	541751.338	623288.379
278 CORN	541740.82	623269.216

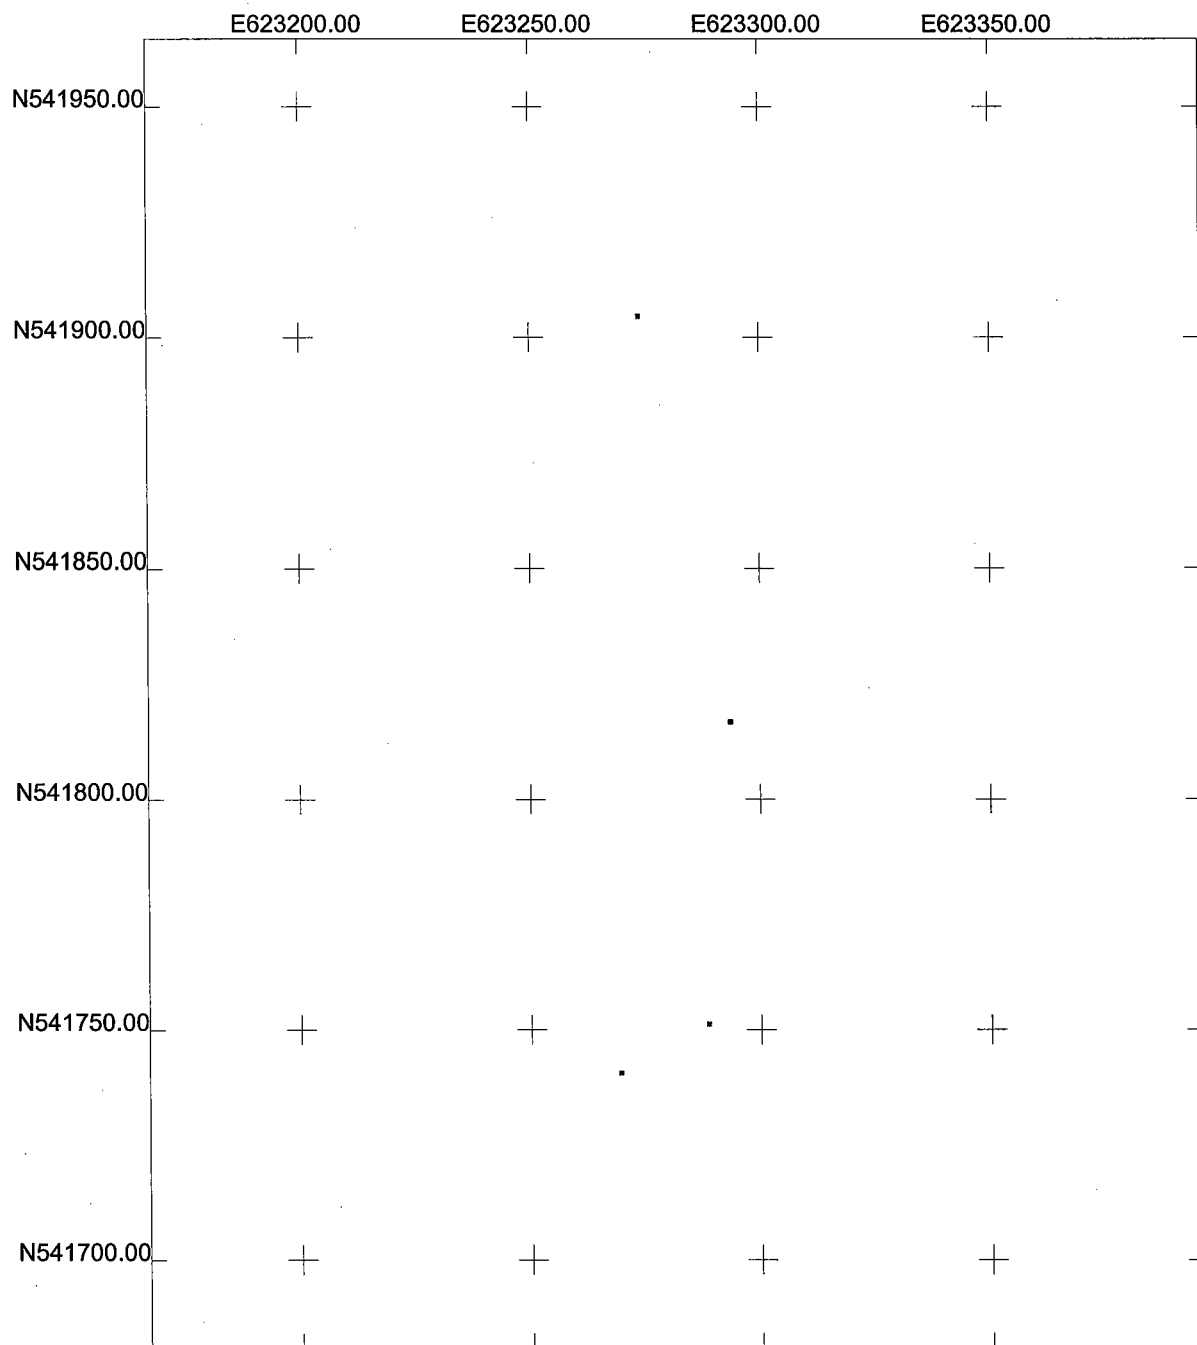

Bldg. 276 UST Ground Water Sample GPS Map

US State Plane 1983
New Jersey (NY East) 2900
NAD 1983 (Conus)



Scale 1:500
0 60.00

US Survey Feet

276 r100214a.ssf
5/12/2000
Pathfinder Office
 Trimble

Bldg. 276 UST Ground Water Sample GPS Positions & Coordinates

US STATE PLANE 1983 NJ (NY EAST) 2900 NAD 1983 (CONUS)

(IN US SURVEY FEET)

SAMPLE POINTS

<u>POSITION / DESC.</u>	<u>Y COORD. (NORTHING)</u>	<u>X COORD. (EASTING)</u>
276 GW	541816.975	623293.404

(GW denotes Ground Water)

REFERENCE POINTS

<u>POSITION / DESC.</u>	<u>Y COORD. (NORTHING)</u>	<u>X COORD. (EASTING)</u>
278 CORNER	541751.338	623288.379
278 CORNER	541740.82	623269.216
Telephone Pole	541904.719	623273.72