

United States Army

Fort Monmouth, New Jersey

**Underground Storage Tank
Closure and Site Investigation
Report**

***Building 678
Main Post-West Area***

**NJDEP UST Registration No. 81533-105
Dicar No. 94-08-29-1141-51**

March 2001

TABLE OF CONTENTS

EXECUTIVE SUMMARY	iv
1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES	1
1.1 OVERVIEW	1
1.2 SITE DESCRIPTION	2
1.2.1 Geological/Hydrogeological Setting	2
1.3 HEALTH AND SAFETY	4
1.4 REMOVAL OF UNDERGROUND STORAGE TANK	4
1.4.1 General Procedures	4
1.4.2 Underground Storage Tank Excavation and Cleaning	4
1.5 UNDERGROUND STORAGE TANK TRANSPORTATION AND DISPOSAL	5
1.6 MANAGEMENT OF EXCAVATED SOILS	5
2.0 SITE INVESTIGATION ACTIVITIES	6
2.1 OVERVIEW	6
2.2 FIELD SCREENING/MONITORING	6
2.3 SOIL SAMPLING	7
2.4 GROUNDWATER SAMPLING	7
3.0 CONCLUSIONS AND RECOMMENDATIONS	8
3.1 SOIL SAMPLING RESULTS	8
3.2 GROUNDWATER SAMPLING RESULTS	
3.3 CONCLUSIONS AND RECOMMENDATIONS	9

TABLE OF CONTENTS (CONTINUED)

TABLES

Table 1	Summary of Post-Excavation Sampling Activities
Table 2	Post-Excavation Soil Sampling Results
Table 3	Groundwater Sampling Results

FIGURES

Figure 1	Site Location Map
Figure 1A	Geological Map
Figure 2	Site Map
Figure 3	Cross Sectional View
Figure 4	Soil Sampling Location Map
Figure 5	Groundwater Sampling Location Map

APPENDICES

Appendix A	NJDEP UST Report Certification Form
Appendix B	Waste Manifest
Appendix C	UST Disposal Certificate
Appendix D	Soil Analytical Data Package
Appendix E	Groundwater Analytical Data Package
Appendix F	Photographs

EXECUTIVE SUMMARY

UST Closure

On August 29, 1994, a steel underground storage tank (UST) was closed by removal in accordance with New Jersey Department of Environmental Protection (NJDEP) underground storage tank closure procedures at the Main Post-West area of the U.S. Army Fort Monmouth, Fort Monmouth, New Jersey. The UST, NJDEP Registration No. 81533-105 (Fort Monmouth ID No. 678), was located southwest of Building 678. UST No. 81533-105 was a 550-gallon #2 fuel oil UST. The fill port was located directly above the tank.

Site Assessment

The site assessment was performed by U.S. Army personnel in accordance with the NJDEP *Technical Requirements for Site Remediation* (N.J.A.C. 7:26E) and the NJDEP *Field Sampling Procedures Manual*. The sampling and laboratory analysis conducted during the site assessment were performed in accordance with Section 7:26E-2.1 of the *Technical Requirements for Site Remediation*. Soils surrounding the tank were screened visually and with air monitoring equipment for evidence of contamination. Following removal, the UST was inspected for corrosion holes. Numerous holes were noted in the UST. Soils at the location of the holes were dark in color and appeared to be contaminated.

Based on the inspection of the excavation, Directorate of Public Works (DPW) concluded that a discharge was associated with this UST. The NJDEP hotline was notified and the case was assigned DICAR No. 94-08-29-1141-51. On August 29, 1994, potentially contaminated soil was removed from the excavation area. In total, approximately 20 cubic yards of potentially contaminated soil were removed from the excavated area and stored at the Fort Monmouth petroleum contaminated soil staging area. Soil samples, which were collected after the removal of the potentially contaminated soil, contained TPHC concentrations ranging from 11.00 mg/kg to 545.00 mg/kg. Groundwater was encountered at 7.0 feet below ground surface and no sheen was observed.

All post excavation soil samples collected from the UST excavation at Building 678 contained TPHC concentrations below the NJDEP residential direct contact total organic contaminants soil cleanup criteria of 10,000 milligrams per kilogram (mg/kg) (N.J.A.C. 7:26D and revisions dated February 3, 1994). Following receipt of all post-excavation soil sampling results, the excavation was backfilled to grade with a combination of uncontaminated excavated soil and certified clean fill. The excavation site was then restored to its original condition.

In response to the observation of potentially contaminated soil near the shallow water table, two (2) groundwater samples were collected at Building 678. On December 4, 2000, and January 17, 2001, Building 678 was sampled for volatile organic compounds calibrated for xylene plus 15 tentatively identified compounds (VOC's), and semivolatile organic compounds plus 15 tentatively identified compounds (SVOC's). All groundwater analytical results were either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

No further action is proposed in regard to the closure and site assessment of UST No. 81533-105 at Building 678.

1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES

1.1 OVERVIEW

One underground storage tank (UST), New Jersey Department of Environmental Protection (NJDEP) Registration No. 81533-105, was closed at Building 678 at the Main Post-West area of U.S. Army Fort Monmouth, Fort Monmouth, New Jersey on August 29, 1994. Refer to the site location map on Figure 1. This report presents the results of the Department of Public Works' (DPW) implementation of the UST Decommissioning/Closure Plan approved by the NJDEP. The UST was a steel 550-gallon tank containing No. 2 fuel oil.

Decommissioning activities for UST No. 81533-105 complied with all applicable Federal, State, and Local laws and ordinances in effect at the date of decommissioning. These laws included but were not limited to N.J.A.C. 7:14B-1 et seq., N.J.A.C. 5:23-1 et seq., and Occupational Safety and Health Administration (OSHA) 1910.146 & 1910.120. All permits including but not limited to the NJDEP approved Decommissioning/Closure Plan were posted onsite for inspection. DPW personnel who are registered and certified by the NJDEP for performing UST closure activities conducted the decommissioning activities. Closure of UST No. 81533-105 proceeded under the approval of the NJDEP Bureau of Federal Case Management (NJDEP-BFCM). The Standard Reporting Form and signed Site Assessment Summary form for UST No. 81533-105 are included in Appendices A and B, respectively.

After removal of the potentially contaminated soil, the site was assessed. Based on inspecting the UST, field screening of remaining subsurface soils, and reviewing analytical results of soil samples and groundwater samples, the DPW has concluded that no significant historical discharges are associated with the UST or associated piping.

This UST Closure and Site Investigation Report has been prepared by Versar, to assist the U.S. Army DPW in complying with the NJDEP regulations. The applicable NJDEP regulations at the date of closure were the *Interim Closure Requirements for Underground Storage Tank Systems* (N.J.A.C. 7:14B-1 et seq. October 1990 and revisions dated November 1, 1991).

This report was prepared using information collected at the time of closure. Section 1 of this UST Closure and Site Investigation Report provides a summary of the UST decommissioning activities. Section 2 of this report describes the site investigation activities. Conclusions and recommendations, including the results of the soil sampling and groundwater investigation, are presented in the final section of this report.

1.2 SITE DESCRIPTION

Building 678 is located in the Main Post-West area of the Fort Monmouth Army Base. UST No. 81533-105 was located southwest of Building 678 and appurtenant copper piping ran approximately five- (5) feet southeast from the excavation to Building 678. A site map is provided on Figure 2.

1.2.1 Geological/Hydrogeological Setting

The following is a description of the geological/hydrogeological setting of the area surrounding Building 678. Included is a description of the regional geology of the area surrounding Fort Monmouth as well as descriptions of the local geology and hydrogeology of the Main Post area. A geological map is provided on Figure 1A.

Regional Geology

Monmouth County lies within the New Jersey Section of the Atlantic Coastal Plain physiographic province. The Main Post, Charles Wood, and the Evans areas are located in what may be referred to as the Outer Coastal Plain subprovince, or the Outer Lowlands.

In general, New Jersey Coastal Plain formations consist of a seaward-dipping wedge of unconsolidated deposits of clay, silt, and gravel. These formations typically strike northeast-southwest with a dip ranging from 10 to 60 feet per mile and were deposited on Precambrian and lower Paleozoic rocks (Zapecza, 1989). These sediments, predominantly derived from deltaic, shallow marine, and continental shelf environments, date from Cretaceous through the Quaternary Periods. The mineralogy ranges from quartz to glauconite.

The formations record several major transgressive/regressive cycles and contain units which are generally thicker to the southeast and reflect a deeper water environment. More than 20 regional geologic units are present within the sediments of the Coastal Plain. Regressive, upward coarsening deposits are usually aquifers (e.g., Englishtown and Kirkwood Formations, and the Cohansey Sand) while the transgressive deposits act as confining units (e.g., the Merchantville, Marshalltown, and Navesink Formations). The individual thicknesses for these units vary greatly (i.e., from several feet to several hundred feet). The Coastal Plain deposits thicken to the southeast from the Fall Line to greater than 6,500 feet in Cape May County (Brown and Zapecza, 1990).

Local Geology

Based on the regional geologic map (Jablonski, 1968), the Cretaceous age Red Bank and Tinton Sands outcrop at the Main Post area. The Red Bank sand conformably overlies the Navesink Formation and dips to the southeast at 35 feet per mile. The upper member (Shrewsbury) of the Red Bank sand is a yellowish-gray to reddish brown clayey, medium-to-coarse-grained sand that contains abundant rock fragments, minor mica and glauconite (Jablonski). The lower member (Sandy Hook) is a dark gray to black, medium-to-fine grained sand with abundant clay, mica, and glauconite.

The Tinton sand conformably overlies the Red Bank Sand and ranges from a clayey

medium to very coarse grained feldspathic quartz and glauconite sand to a glauconitic coarse sand. The color varies from dark yellowish orange or light brown to moderate brown and from light olive to grayish olive. Glauconite may constitute 60 to 80 percent of the sand fraction in the upper part of the unit (Minard, 1969). The upper part of the Tinton is often highly oxidized and iron oxide encrusted (Minard).

Hydrogeology

The water table aquifer in the Main Post area is identified as part of the "composite confining units," or minor aquifers. The minor aquifers include the Navesink formation, Red Bank Sand, Tinton Sand, Hornerstown Sand, Vincentown Formation, Manasquan Formation, Shark River Formation, Piney Point Formation, and the basal clay of the Kirkwood Formation.

Based on records of wells drilled in the Main Post area, water is typically encountered at depths of 2 to 9 feet below ground surface (bgs). According to Jablonski, wells drilled in the Red Bank and Tinton Sands may produce 2 to 25 gallons per minute (gpm). Some well owners have reported acidic water that requires treatment to remove iron.

Due to the proximity of the Atlantic Ocean to Fort Monmouth, shallow groundwater may be tidally influenced and may flow toward creeks and brooks as the tide goes out, and away from creeks and brooks as the tide comes in. However, an abundance of clay lenses and sand deposits were noted in borings installed throughout Fort Monmouth. Therefore, the direction of shallow groundwater should be determined on a case-by-case basis.

Shallow groundwater is locally influenced within the Main Post area by the following factors:

- tidal influence (based on proximity to the Atlantic Ocean, rivers, and tributaries)
- topography
- nature of the fill material within the Main Post area
- presence of clay and silt lenses in the natural overburden deposits
- local groundwater recharge areas (i.e., streams, lakes)

Due to the fluvial nature of the overburden deposits (i.e., sand and clay lenses), shallow groundwater flow direction is best determined on a case-by-case basis. This is consistent with lithologies observed in borings installed within the Main Post area, which primarily consisted of fine-to-medium grained sands, with occasional lenses or laminations of gravel silt and/or clay.

Building 678 is located approximately 1,000 feet south of Parkers Creek, the nearest water body. Based on the Main Post topography, the groundwater flow in the area of Building 678 is anticipated to be to the north.

1.3 HEALTH AND SAFETY

Before, during, and after all decommissioning activities, hazards at the work site which may have posed a threat to the Health and Safety of all personnel who were involved with, or were affected by, the decommissioning of the UST system were minimized.

1.4 REMOVAL OF UNDERGROUND STORAGE TANK

1.4.1 General Procedures

- The contractor performing the closure prior to excavation activities identified all underground obstructions (utilities, etc.).
- All activities were carried out with the greatest regard to safety and health and the safeguarding of the environment.
- All excavated soils were visually examined and screened with an OVA for evidence of contamination. Potentially contaminated soils were identified and logged during closure activities.
- Surface materials (i.e., asphalt, concrete, etc.) were excavated and staged separately from all soil and recycled in accordance with all applicable regulations and laws.
- A Sub-Surface Evaluator from the DPW was present during all site assessment activities.

1.4.2 Underground Storage Tank Excavation and Cleaning

Prior to UST decommissioning activities, surficial soil was removed to expose the UST and associated piping. All free product present in the piping was drained into the UST, and the UST was purged to remove vapors prior to cutting and removal of the piping. After removal of the associated piping, a manway was made in the UST to allow for proper cleaning. The UST was completely emptied of all liquids prior to removal from the ground. Approximately 20 gallons of liquid from the UST and its associated piping were transported by Lionetti Oil Recovery Company to Lionetti Oil Recovery Company, Inc. facility, a NJDEP-approved petroleum recycling and disposal company located in Old Bridge, New Jersey. Refer to Appendix B for the waste manifest.

The UST was cleaned prior to removal from the excavation in accordance with the NJDEP regulations. After the UST was removed from the excavation, it was staged on polyethylene sheeting and examined for holes. Numerous holes were observed during the inspection by the Sub-Surface Evaluator. Soils surrounding the UST were screened visually for evidence of contamination. Stained soil was observed and appeared to be contaminated. Soil samples, which were collected after the removal of the potentially contaminated soil, contained TPHC concentrations ranging from 11.0 mg/kg to 545.00 mg/kg. Groundwater was encountered at 7.0 feet below ground surface and no sheen was observed. See Figure 3 for a cross-sectional view of the excavated area.

1.5 UNDERGROUND STORAGE TANK TRANSPORTATION AND DISPOSAL

The steel tank was transported in compliance with all applicable regulations and laws to Mazza & Sons, Inc., Recycling Division. Refer to Appendix C for the UST disposal certificate and Appendix F for photographs of the UST.

The UST was labeled prior to transport with the following information:

- Site of origin
- Contact person
- NJDEP UST Facility ID number
- Former contents
- Destination site
- Date

1.6 MANAGEMENT OF EXCAVATED SOILS

All potentially contaminated soils were stockpiled separately from other excavated material and were placed on and covered with polyethylene sheets. Potentially contaminated soils were transported to the soil staging area. Soils that did not exhibit signs of contamination were used as backfill following the removal of the UST. Groundwater was encountered at 7.0 feet below ground surface and no sheen was observed.

2.0 SITE INVESTIGATION ACTIVITIES

2.1 OVERVIEW

The Site Investigation was managed and carried out by U.S. Army DPW personnel. All analyses were performed and reported by U.S. Army Fort Monmouth Environmental Laboratory, a NJDEP-certified testing laboratory. All sampling was performed under the direct supervision of a NJDEP Certified Sub-Surface Evaluator according to the methods described in the NJDEP *Field Sampling Procedures Manual* (1992). Sampling frequency and parameters analyzed complied with the NJDEP document *Interim Closure Requirements for Underground Storage Tank Systems* (October 1990 and revisions dated November 1, 1991) which was the applicable regulation at the date of the closure. The Fort Monmouth DPW Environmental Office maintains all records of the Site Investigation activities.

The following Parties participated in Closure and Site Investigation Activities:

- Subsurface Evaluator: Dinker Desai
Employer: U.S. Army, Fort Monmouth
Phone Number: (732) 532-1475
NJDEP Certification No.: 10173
- Analytical Laboratory: U.S. Army Fort Monmouth Environmental Laboratory
Contact Person: Daniel K. Wright
Phone Number: (732) 532-4359
NJDEP Company Certification No.: 13461
- Hazardous Waste Hauler: Lorco Petroleum Services
Contact Person: Bill Burr
Phone Number: (908) 721-0900

2.2 FIELD SCREENING/MONITORING

Field screening was performed by a NJDEP Certified Sub-Surface Evaluator using visual observations to identify potentially contaminated material. Soil excavated from around the tank exhibited evidence of potential contamination. Soils were removed from the excavation until no evidence of contamination remained. Groundwater was encountered at 7.0 feet below ground surface and no sheen was observed.

2.3 SOIL SAMPLING

On August 29, 1994, following the removal of the UST, associated piping, and approximately 20 cubic yards of potentially petroleum contaminated soil, post-excavation soil samples A, B, C, D, E, F (DUP D), and G were collected from a total of six (6) locations within the UST excavation. Samples A, B, C, D, E, and F (DUP D) were collected along the sidewall at a depth of 5.5 feet bgs. Vent line sample G was collected at a depth of 2.0 feet bgs. All samples were analyzed for TPHC and total solids.

U.S. Army personnel in accordance with the NJDEP Technical Requirements and the NJDEP Field Sampling Procedures Manual performed the site assessment. A summary of sampling activities including parameters analyzed is provided in Table 1. The post-excavation soil samples were collected using NJDEP *Field Sampling Procedures Manual* (1992) standard sampling procedures. Following soil sampling activities, the samples were chilled and delivered to U.S. Army Fort Monmouth Environmental Laboratory located in Fort Monmouth, New Jersey, for analysis.

2.4 GROUNDWATER SAMPLING

On December 4, 2000, and January 17, 2001, Building 678 was sampled for volatile organic compounds calibrated for xylene plus 15 tentatively identified compounds (VOC's), and semivolatile organic compounds plus 15 tentatively identified compounds (SVOC's). Sampling and analysis were performed in accordance with the NJDEP *Field Sampling Procedures Manual* and the *Technical Requirements For Site Remediation*.

3.0 CONCLUSIONS AND RECOMMENDATIONS

3.1 SOIL SAMPLING RESULTS

To evaluate soil conditions following removal of the UST and associated piping, post-excavation soil samples were collected on August 29, 1994 from a total of six (6) locations. All samples were analyzed for TPHC and total solids. The post-excavation sampling results were compared to the NJDEP residential direct contact total organic contaminants soil cleanup criteria of 10,000 mg/kg (N.J.A.C. 7:26D and revisions dated February 3, 1994). A summary of the analytical results and comparison to the NJDEP soil cleanup criteria is provided in Table 2 and the soil sampling locations are shown on Figure 4. The analytical data package is provided in Appendix D.

All post-excavation soil samples collected on August 29, 1994, from the UST excavation and from below piping associated with the UST contained concentrations of TPHC below the NJDEP soil cleanup criteria. Soil samples, which were collected after the removal of the potentially contaminated soil, contained TPHC concentrations ranging from 11.00 mg/kg to 545.00 mg/kg.

3.2 GROUNDWATER SAMPLING RESULTS

The sample collected from Building 678 on December 4, 2000, contained 2-methylnaphthalene at a concentration of 4.55 ug/l, acenaphthene at 1.38 ug/l, fluorene at 3.73 ug/l, and phenanthrene at 7.97 ug/l. No other compounds were detected.

The sample collected from Building 678 on January 17, 2001, contained fluorene at a concentration of 4.42 ug/l and phenanthrene at a concentration of 11.06 ug/l. No other compounds were detected.

A summary of the analytical results and comparison to the NJDEP groundwater cleanup criteria is provided in Table 3 and the groundwater sampling locations are shown on Figure 5. The analytical data package is provided in Appendix F. The full data package, including quality control is on file at U.S. Army Fort Monmouth located in Fort Monmouth, New Jersey.

Groundwater samples collected on December 4, 2000, and January 17, 2001, were either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

3.3 CONCLUSIONS AND RECOMMENDATIONS

The analytical results for all post-excavation soil samples collected from the UST closure excavation at Building 678 were below the NJDEP soil cleanup criteria for total organic contaminants.

Based on the post-excavation sampling results, soil with TPHC concentrations exceeding the NJDEP soil cleanup criteria for total organic contaminants of 10,000 mg/kg, do not exist in the former location of the UST or associated piping.

Based on the analytical results of the groundwater samples collected at Building 678 on December 4, 2000, and January 17, 2001, groundwater quality at Building 678 was either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

No further action is proposed in regard to the closure and site assessment of UST No. 81533-105 at Building 678.

TABLES

TABLE 1

SUMMARY OF POST-EXCAVATION SAMPLING ACTIVITIES
BUILDING 678, MAIN POST-WEST AREA
FORT MONMOUTH, NEW JERSEY

Page 1 of 2

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	NJDEP Method
A	8/29/94	8/31/94	Soil	Post-Excavation	TPHC	418.1
B	8/29/94	8/31/94	Soil	Post-Excavation	TPHC	418.1
C	8/29/94	8/31/94	Soil	Post-Excavation	TPHC	418.1
D	8/29/94	8/31/94	Soil	Post-Excavation	TPHC	418.1
E	8/29/94	8/31/94	Soil	Post-Excavation	TPHC	418.1
F (DUP D)	8/29/94	8/31/94	Soil	Post-Excavation	TPHC	418.1
G	8/29/94	8/31/94	Soil	Post-Excavation	TPHC	418.1

Note:

* TPHC Total Petroleum Hydrocarbons

TABLE 1

SUMMARY OF SAMPLING ACTIVITIES
BUILDING 678, MAIN POST-WEST AREA
FORT MONMOUTH, NEW JERSEY

Page 2 of 2

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	Sampling Method**
5892.01	12/4/00	12/4/00	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
220	1/17/01	1/18/01	Aqueous	Groundwater	VOCs, SVOCs	PPNDP

Note:

*VOCs: Volatile Organic Compounds plus 15 tentatively identified compounds

*SVOCs: Semivolatile organic compounds plus 15 tentatively identified compounds

**PPNDP: Passively Placed Narrow Diameter Point

TABLE 2

POST-EXCAVATION SOIL SAMPLING RESULTS
 BUILDING 678, MAIN POST-WEST AREA
 FORT MONMOUTH, NEW JERSEY

Page 1 of 1

Sample ID/ Depth	Sample Laboratory ID	Sample Date	Analysis Date	Analytical Parameters	Method Detection Limit (mg/kg)	Compound of Concern	Results (mg/kg) *	NJDEP Soil Cleanup Criteria ** (mg/kg)	Exceeds Cleanup Criteria
A/5.5'	1627.1	8/29/94	8/31/94	Total Solid	--	--	91 %	--	--
				TPHC	6.6	yes	545.00	10,000	No
B/5.5'	1627.2	8/29/94	8/31/94	Total Solid	--	--	94 %	--	--
				TPHC	6.6	yes	191.00	10,000	No
C/5.5'	1627.3	8/29/94	8/31/94	Total Solid	--	--	90 %	--	--
				TPHC	6.6	yes	11.0	10,000	No
D/5.5'	1627.4	8/29/94	8/31/94	Total Solid	--	--	94 %	--	--
				TPHC	6.6	yes	15.40	10,000	No
E/5.5'	1627.5	8/29/94	8/31/94	Total Solid	--	--	92 %	--	--
				TPHC	6.6	yes	80.60	10,000	No
F/5.5'	1627.4	8/29/94	8/31/94	Total Solid	--	--	94 %	--	--
				TPHC	6.6	yes	64.20	10,000	No
G/2.0'	1627.5	8/29/94	8/31/94	Total Solid	--	--	95 %	--	--
				TPHC	6.6	yes	82.80	10,000	No

* Total Solid results are expressed as a percentage.

** NJDEP Residential Direct Contact soil cleanup criteria for total organics

ND Not detected above stated method detection limit

TPHC Total Petroleum Hydrocarbons

-- Not Applicable

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 12/4/00Location: 678Lab Sample ID: 5892.01(678)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	Not Detected	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 12/4/00Location: 678Lab Sample ID: 5892.01(678)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 12/4/00Location: 678Lab Sample ID: 5892.01(678)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	1.54	Not Detected	--	nle	no
62-75-9	N-nitroso-dimethylamine	0.69	Not Detected	--	20	no
62-53-3	Aniline	1.85	Not Detected	--	nle	no
111-44-4	bis(2-Chloroethyl)ether	0.63	Not Detected	--	10	no
541-73-1	1,3-Dichlorobenzene	0.62	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.58	Not Detected	--	75	no
100-51-6	Benzyl alcohol	0.62	Not Detected	--	nle	no
95-50-1	1,2-Dichlorobenzene	0.65	Not Detected	--	600	no
108-60-1	bis(2-chloroisopropyl)ether	0.57	Not Detected	--	300	no
621-64-7	n-Nitroso-di-n-propylamine	0.64	Not Detected	--	20	no
67-72-1	Hexachloroethane	0.34	Not Detected	--	10	no
98-95-3	Nitrobenzene	0.51	Not Detected	--	10	no
78-59-1	Isophorone	0.45	Not Detected	--	100	no
111-91-1	bis(2-Chloroethoxy)methane	0.48	Not Detected	--	nle	no
120-82-1	1,2,4-Trichlorobenzene	0.54	Not Detected	--	9	no
91-20-3	Naphthalene	0.72	Not Detected	--	nle	no
106-47-8	4-Chloroaniline	1.78	Not Detected	--	nle	no
87-68-3	Hexachlorobutadiene	0.43	Not Detected	--	1	no
91-57-6	2-Methylnaphthalene	0.55	4.55 ug/L	--	nle	no
77-47-4	Hexachlorocyclopentadiene	0.76	Not Detected	--	50	no
91-58-7	2-Chloronaphthalene	0.53	Not Detected	--	nle	no
88-74-4	2-Nitroaniline	0.79	Not Detected	--	nle	no
131-11-3	Dimethylphthalate	1.04	Not Detected	--	7000	no
208-96-8	Acenaphthylene	0.70	Not Detected	--	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 12/4/00Location: 678Lab Sample ID: 5892.01(678)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	0.92	Not Detected	--	nle	no
99-09-2	3-Nitroaniline	1.93	Not Detected	--	nle	no
83-32-9	Acenaphthene	0.62	1.38 ug/L	--	400	no
132-64-9	Dibenzofuran	0.73	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	1.41	Not Detected	--	10	no
84-66-2	Diethylphthalate	1.54	Not Detected	--	5000	no
86-73-7	Fluorene	0.98	3.73 ug/L	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	0.86	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	2.96	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.44	Not Detected	--	20	no
103-33-3	Azobenzene	1.00	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	1.28	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	1.08	Not Detected	--	10	no
85-01-8	Phenanthrene	1.73	7.97 ug/L	--	nle	no
120-12-7	Anthracene	1.85	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	2.49	Not Detected	--	900	no
206-44-0	Fluoranthene	1.48	Not Detected	--	300	no
92-87-5	Benzidine	2.15	Not Detected	--	50	no
129-00-0	Pyrene	1.53	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.24	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	2.68	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	1.60	Not Detected	--	60	no
218-01-9	Chrysene	1.14	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	1.34	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.44	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.32	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.15	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	2.43	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	2.24	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	1.94	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	2.04	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER

Date Sampled: 1/17/01 Location: 678 Lab Sample ID: 220(678)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	Not Detected	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 1/17/01Location: 678Lab Sample ID: 220(678)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 1/17/01Location: 678Lab Sample ID: 220(678)



CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	1.54	Not Detected	--	nle	no
62-75-9	N-nitroso-dimethylamine	0.69	Not Detected	--	20	no
62-53-3	Aniline	1.85	Not Detected	--	nle	no
111-44-4	bis(2-Chloroethyl)ether	0.63	Not Detected	--	10	no
541-73-1	1,3-Dichlorobenzene	0.62	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.58	Not Detected	--	75	no
100-51-6	Benzyl alcohol	0.62	Not Detected	--	nle	no
95-50-1	1,2-Dichlorobenzene	0.65	Not Detected	--	600	no
108-60-1	bis(2-chloroisopropyl)ether	0.57	Not Detected	--	300	no
621-64-7	n-Nitroso-di-n-propylamine	0.64	Not Detected	--	20	no
67-72-1	Hexachloroethane	0.34	Not Detected	--	10	no
98-95-3	Nitrobenzene	0.51	Not Detected	--	10	no
78-59-1	Isophorone	0.45	Not Detected	--	100	no
111-91-1	bis(2-Chloroethoxy)methane	0.48	Not Detected	--	nle	no
120-82-1	1,2,4-Trichlorobenzene	0.54	Not Detected	--	9	no
91-20-3	Naphthalene	0.72	Not Detected	--	nle	no
106-47-8	4-Chloroaniline	1.78	Not Detected	--	nle	no
87-68-3	Hexachlorobutadiene	0.43	Not Detected	--	1	no
91-57-6	2-Methylnaphthalene	0.55	Not Detected	--	nle	no
77-47-4	Hexachlorocyclopentadiene	0.76	Not Detected	--	50	no
91-58-7	2-Chloronaphthalene	0.53	Not Detected	--	nle	no
88-74-4	2-Nitroaniline	0.79	Not Detected	--	nle	no
131-11-3	Dimethylphthalate	1.04	Not Detected	--	7000	no
208-96-8	Acenaphthylene	0.70	Not Detected	--	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 1/17/01Location: 678Lab Sample ID: 220(678)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	0.92	Not Detected	--	nle	no
99-09-2	3-Nitroaniline	1.93	Not Detected	--	nle	no
83-32-9	Acenaphthene	0.62	Not Detected	--	400	no
132-64-9	Dibenzofuran	0.73	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	1.41	Not Detected	--	10	no
84-66-2	Diethylphthalate	1.54	Not Detected	--	5000	no
86-73-7	Fluorene	0.98	4.42 ug/L	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	0.86	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	2.96	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.44	Not Detected	--	20	no
103-33-3	Azobenzene	1.00	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	1.28	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	1.08	Not Detected	--	10	no
85-01-8	Phenanthrene	1.73	11.06 ug/L	--	nle	no
120-12-7	Anthracene	1.85	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	2.49	Not Detected	--	900	no
206-44-0	Fluoranthene	1.48	Not Detected	--	300	no
92-87-5	Benzidine	2.15	Not Detected	--	50	no
129-00-0	Pyrene	1.53	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.24	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	2.68	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	1.60	Not Detected	--	60	no
218-01-9	Chrysene	1.14	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	1.34	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.44	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.32	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.15	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	2.43	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	2.24	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	1.94	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	2.04	Not Detected	--	nle	no

FIGURES

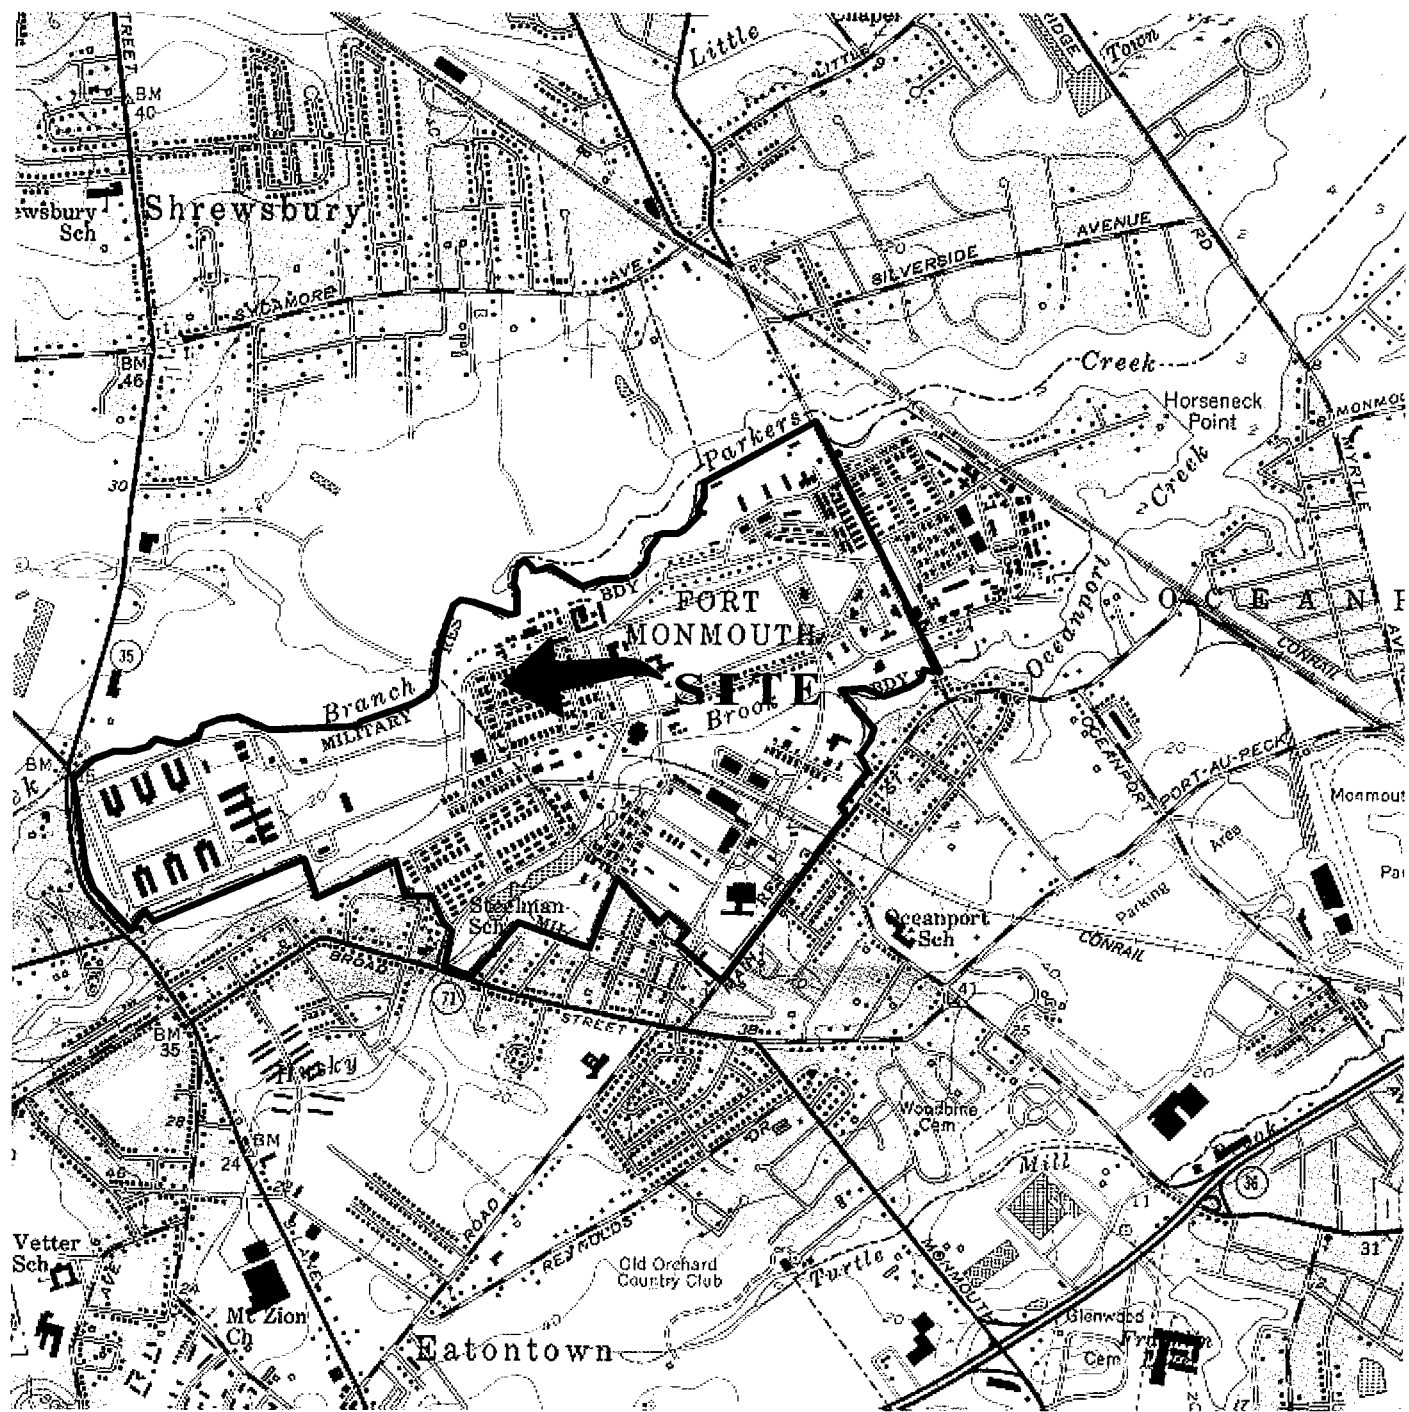

LONG BRANCH, N. J.

40073-C8-TF-024

1954

PHOTOREVISED 1981

DMA 6164 I SE-SERIES V822

NEW
JERSEY

QUADRANGLE LOCATION

FIGURE 1

LOCATION MAP
Building 678
Main-Post West
Fort Monmouth Army Base
Monmouth County, NJ

VERSAR
Engineers, Managers, Scientists, & Planners
Bristol, PA

Scale: 1" = 2000'

Date: August 1994

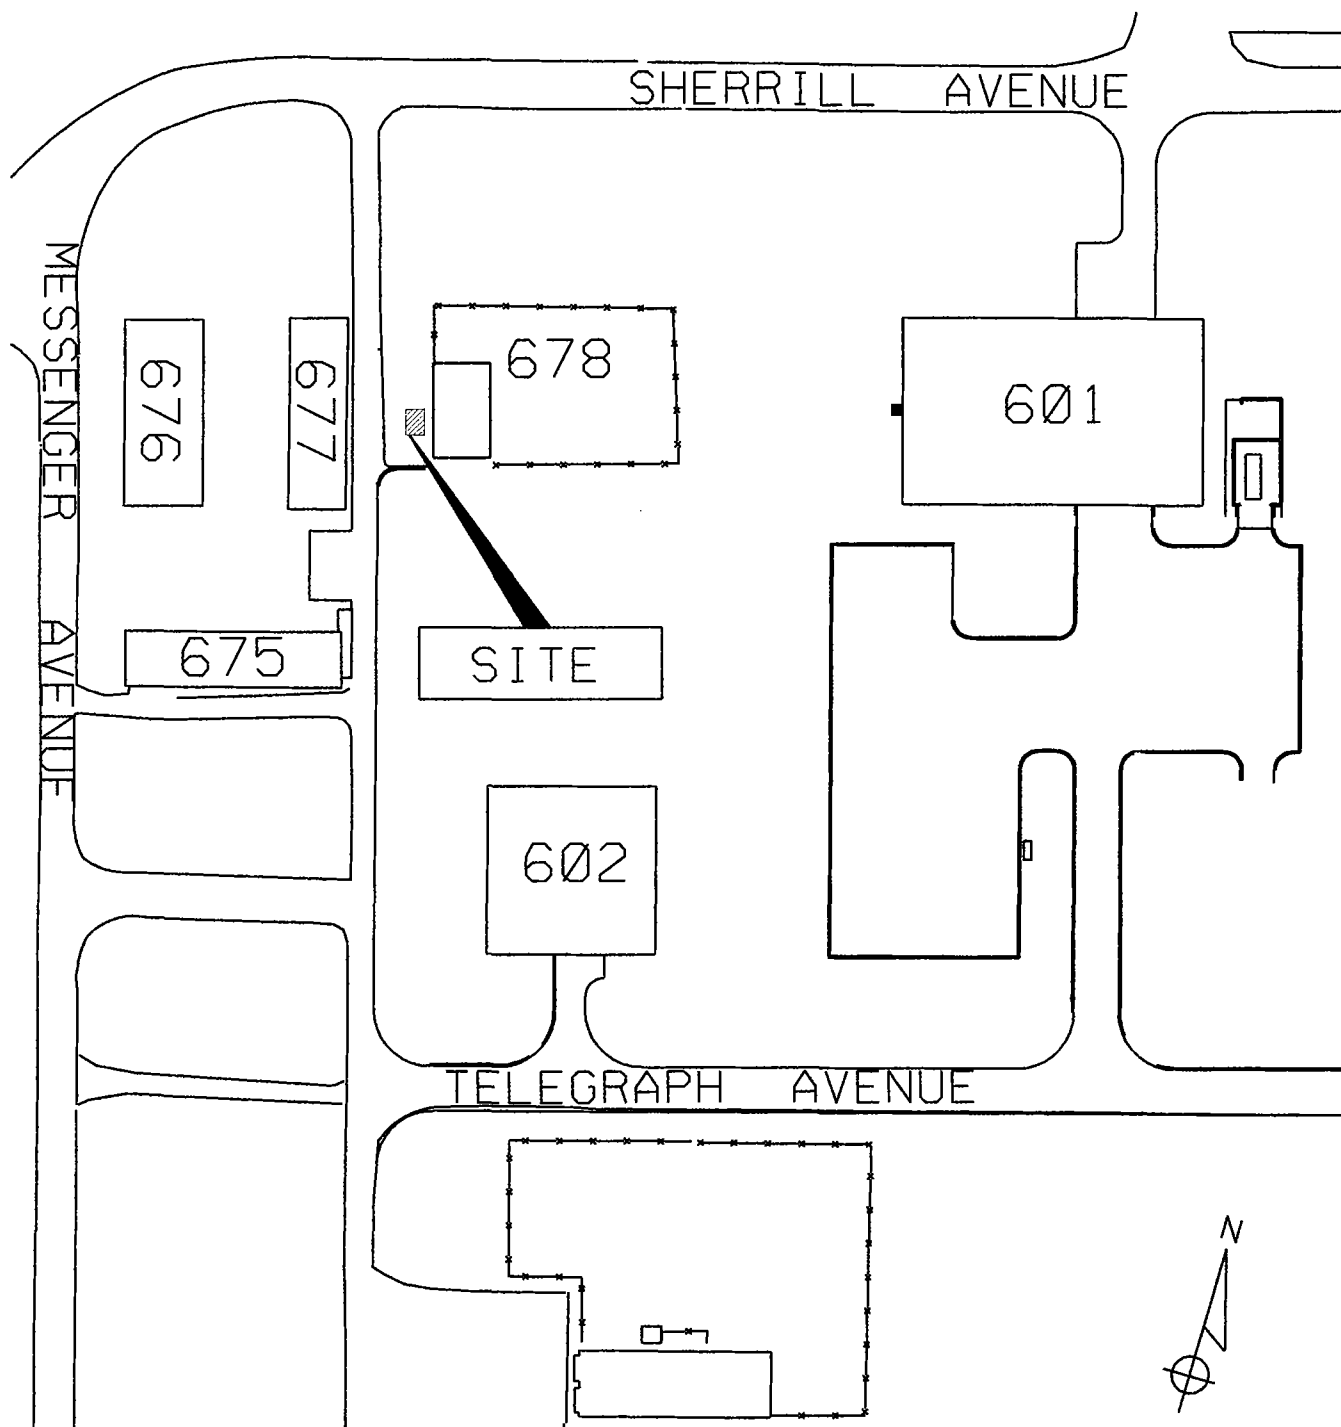


FIGURE 2
 SITE MAP
 BUILDING 678
 FORT MONMOUTH ARMY BASE
 MONMOUTH COUNTY, NJ

VERSAR
 ENGINEERS, SCIENTISTS & PLANNERS
 BRISTOL, PA.

SCALE: 1"=100'

DATE: AUGUST 1994


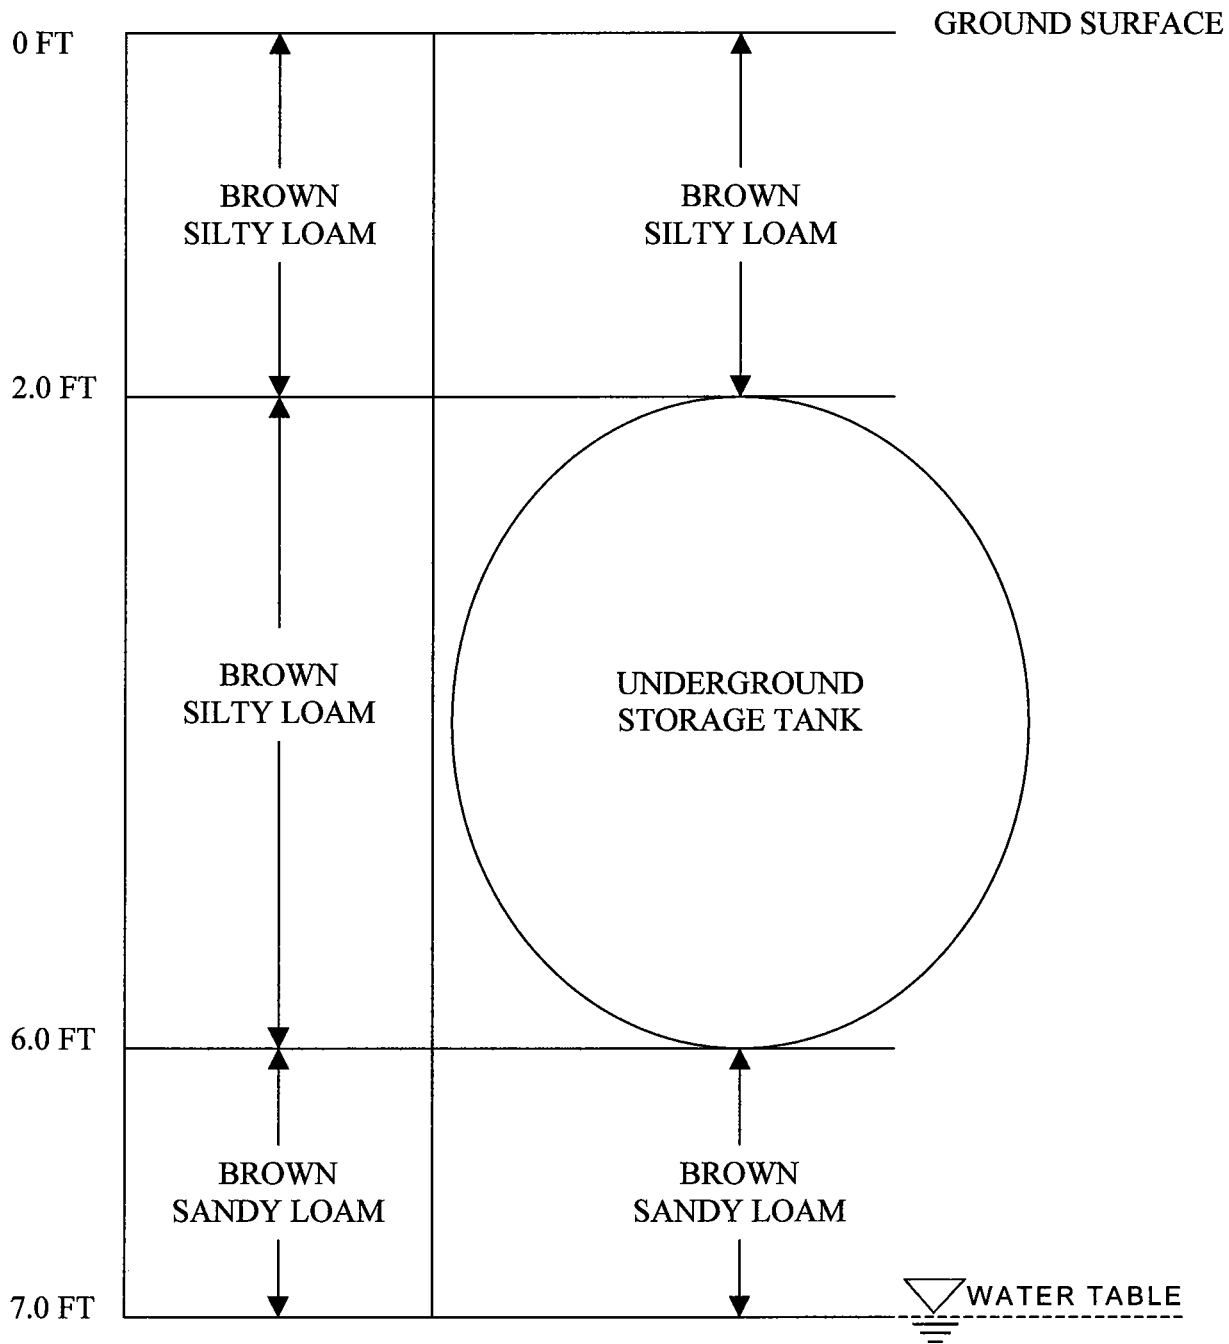


FIGURE 3
CROSS SECTIONAL VIEW
BUILDING 678
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
Engineers, Managers, Scientists & Planners
Bristol, Pennsylvania

SCALE: NTS

DATE: August 1994

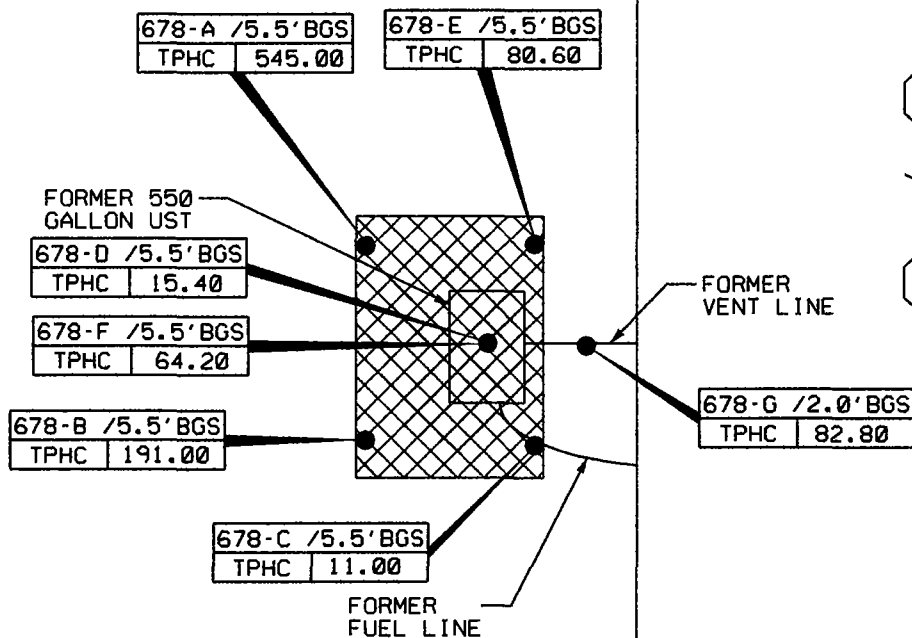

LEGEND

- SOIL SAMPLE LOCATION (AUGUST 29, 1994)
- ▨ LIMIT OF EXCAVATION (AUGUST 29, 1994)

NOTES:

1. ALL RESULTS IN MG/KG.
2. SEE TABLE 2 FOR NJDEP SOIL CLEANUP CRITERIA
3. BGS = BELOW GROUND SURFACE

FIGURE 4
SOIL SAMPLING LOCATION MAP
BUILDING 678
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS
BRISTOL, PA.

SCALE: 1"=10'

DATE: AUGUST 1994

SAMPLING LOCATION: SAMPLING DEPTH: SAMPLING DATE:	HIGHER OF NJDEP GWQS AND POL	BLDG 678 6.2' BGS 12/4/00	BLDG 678 6.2' BGS 1/17/01
VOLATILE ORGANIC COMPOUNDS:		ND	ND
SEMIVOLATILE ORGANIC COMPOUNDS:			
2-METHYLNAPHTHALENE:	NLE	4.55	ND
ACENAPHTHENE:	400	1.38	ND
FLUORENE:	300	3.73	4.42
PHENANTHRENE:	NLE	7.97	11.06

FORMER 550
GALLON UST

FORMER
VENT LINE

FORMER
FUEL LINE



B
U
I
L
D
I
N
G
6
7
8

LEGEND



GROUNDWATER SAMPLE LOCATION
(DECEMBER 4, 2000 AND JANUARY 17, 2001)



LIMIT OF EXCAVATION
(AUGUST 29, 1994)

NOTES:

1. ND-INDICATES COMPOUND NOT DETECTED
2. NLE- NO LIMIT ESTABLISHED
3. ALL RESULTS IN UG/L
4. BGS - BELOW GROUND SURFACE

FIGURE 5
GROUNDWATER SAMPLING MAP
BUILDING 678
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS
BRISTOL, PA.

SCALE: 1"=10'

DATE: AUGUST 1994

APPENDIX A

NJDEP UST Certification Form

Site Remediation Program

UST Site/Remedial Investigation Report Certification Form

A. Facility Name : U.S. Army Fort Monmouth New JerseyFacility Street Address : Directorate of Public Works Building 173Municipality: Oceanport County : MonmouthBlock: _____ Lot(s): _____ Telephone Number : 732-532-6224**B. Owner (RP)'s Name:** _____

Street Address: _____ City : _____

State: _____ Zip: _____ Telephone Number : _____

C. (Check as appropriate)☐ Site Investigation

Report (SIR) \$500 Fee

☐ Remedial Investigation

Report (RIR) \$1000 Fee

☒ NA – Federal Agreement**D. (Complete all that apply)**• Assigned Case Manager : Ian Curtis, Federal Case Manager• UST Registration Number : 81533-105 (7 digits)• Incident Report Number 94 - 08 - 29 - 1141 - 51 (10 or 12 digits)• Tank Closure Number : Federal Case Manager**E. Certification by the Subsurface Evaluator:**

The attached report conforms to the specific reporting requirements of N.J.A.C. 7:26E Yes No

Name: Dinker Desai Signature: _____ UST Cert. No.: 10173Firm: U.S. Army Fort Monmouth Firm's UST Cert. Number: NA-U.S. ArmyFirm Address: Directorate of Public Works Building 173 City: Fort MonmouthState: NJ Zip: 07703 Telephone Number : 732-532-6224

(NOTE: Certification numbers required only if work was conducted on USTs regulated per N.J.S.A. 58:10A-21 et seq.)

F. Certification by the Responsible Party(ies) of the Facility:

The following certification shall be signed [according to the requirements of N.J.A.C. 7:14B-1.7(b)] as follows:

1. For a Corporation by a person authorized by a resolution of the board of directors to sign the document. A copy of the resolution, certified as a true copy by the secretary of the corporation, shall be submitted along with the certification; or
2. For a partnership or sole proprietorship, by a general partner or the proprietor, respectively; or
3. For a municipality, State, federal or other public agency by either a principal executive officer or ranking elected Official.

"I certify under penalty of law that I have personally examined and am familiar with the information submitted in this application and all attached documents, and that based on my inquiry of those individuals responsible for obtaining the information, I believe that the submitted information is true, accurate, and complete. I am aware that there are significant civil penalties for knowingly submitting false, inaccurate, or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

Name (Print or Type): James Ott Title: Directorate of Public Works

Signature: _____

Company Name: U.S. Army Fort Monmouth Date: _____

APPENDIX B
Waste Manifest

Waste Manifest

Not Available

APPENDIX C

UST Disposal Certificates

Port Monmouth
Tinton Falls, NJ
Tank #s: UST #s
621-0081533-94 ✓
625-0081533-96 ✓
678-0081533-105

MAZZA & SONS, INC.

Metal Recyclers
Auto and Truck
3230 Shafto Rd.
Tinton Falls, NJ
(908) 922-9292

NO. _____

DATE 30 Aug 94

Customer's Name Cate Tire 103 Godwin Ave Midland Park NJ

Address _____

Make of Autos _____

Tires B12

Tank 621 - 0081533-94


Price 625 - 0081533-96

678 - 0081533-105

38440 LB 6

35260 LB 6

3180

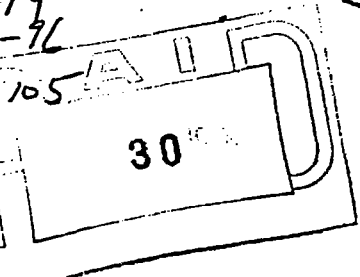

	Weight	Price
Cast Iron		
Steel	63.60	
Lt. Iron		
Copper #1		
Copper #2		
Lt. Copper		
Brass		
Alum Clean		
Lead		
Stainless		
Radiators		
Battery		
TOTAL AMOUNT:		

Weigher _____ Customer Donelli

APPENDIX D

Soil Analytical Package

U.S. ARMY FORT MONMOUTH

P.O. #: *W3-7 7142*

Chain of Custody

Project #: <i>94-8-29-1141-51</i>		Sampler: <i>George/Clark - Dineen</i>		Date / Time: <i>8/29 1-45</i>		Analysis Parameters				Start:			
Customer: <i>Dineen, Dana</i>		Site Name: <i>1306 678</i>				TPH % Solids MWI OWA				Finish:			
Phone: <i>Y 21475</i>		USRY # <i>081533-105</i>								Preservation Method			
Lab Sample ID Number	Date/Time	Customer Sample Location/ID Number	Sample Matrix	# of Bottles	Remarks								
<i>1627.1</i>	<i>8/29 2-01</i>	<i>Site A Sidewell</i>	<i>Soil</i>	<i>1</i>	☒	☒	☒	☐	☐	☐	☐	<i>NO</i>	<i>Sample < 4°C</i>
<i>.2</i>	<i>" 2-04</i>	<i>Site B "</i>	<i>"</i>	<i>1</i>	☒	☒	☒	☐	☐	☐	☐	<i>3</i>	
<i>.3</i>	<i>" 2-17</i>	<i>Site C "</i>	<i>"</i>	<i>1</i>	☒	☒	☒	☐	☐	☐	☐	<i>ND</i>	
<i>.4</i>	<i>" 2-13</i>	<i>Site D "</i>	<i>"</i>	<i>1</i>	☒	☒	☒	☐	☐	☐	☐	<i>5</i>	<i>Calibrated</i>
<i>.5</i>	<i>" 2-08</i>	<i>Site E "</i>	<i>"</i>	<i>1</i>	☒	☒	☒	☐	☐	☐	☐	<i>ND</i>	<i>OK</i>
<i>.6</i>	<i>" 2-13</i>	<i>Site F (DUP of D)</i>	<i>"</i>	<i>1</i>	☒	☒	☒	☐	☐	☐	☐	<i>5</i>	<i>Zero rev</i>
<i>✓ .7</i>	<i>" 1-55</i>	<i>Site G "</i>	<i>"</i>	<i>1</i>	☒	☒	☒	☐	☐	☐	☐	<i>ND</i>	<i>Sample 95</i>
													<i>Random 75</i>
													<i>8/29</i>
Relinquished By (signature)		Date / Time		Received By (signature)		Shipped By:							
<i>[Signature]</i>		<i>8/29/94 1425</i>		<i>Sarah J. Hubbard</i>		<i>8/29/94 1425</i>							
Relinquished By (signature)		Date / Time		Received for Lab by (signature):				Date / Time					
<i>[Signature]</i>		<i>8/29/94 1425</i>		<i>Sarah J. Hubbard</i>				<i>8/29/94 1425</i>					
Note: A drawing depicting sample location should be attached or drawn on the reverse side of this chain of custody.													

Report of Analysis
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEPE Certification # 13461

Client: U.S. Army
DPW, SELFM-PW-EV
Bldg. 167
Ft. Monmouth, NJ 07703

Lab. ID #: 1627.1-.7
Sample Rec'd: 08/29/94
Analysis Start: 08/31/94
Analysis Comp: 08/31/94

Analysis: 418.1 (TPH)
Matrix: Soil
Analyst: S. Hubbard
Ext. Meth: Sonc.


NJDEPE UST Reg. #: 0081533-105
Closure #:
DICAR #:
Location #: Bldg. 678

Lab ID.	Description	%Solid	Result (mg/Kg)	MDL
1627.1	Site A, Sidewall OVA= ND	91	545.	6.6
1627.2	Site B, Sidewall OVA= 3.	94	191.	6.6
1627.3	Site C, Sidewall OVA= ND	90	11.0	6.6
1627.4	Site D, Sidewall OVA= 5.	94	15.4	6.6
1627.5	Site E, Sidewall OVA= ND	92	80.6	6.6
1627.6	Site F, DUPE OF D OVA= 5.	94	64.2	6.6
1627.7	Site G, OVA= ND	95	82.8	6.6
M. Bl.	Method Blank	100	ND	3.3

Notes: ND = Not Detected, MDL = Method Detection Limit

* = Silica Gel Added, NA = Not Applicable

BATHC dup= 109% BATCH s= 117% BATCH sd= 122% RPD= 4.0%



Brian K. McKee
Laboratory Director

Analysis: Munsel

PHC Conformance/Non-conformance Summary Report

No Yes

1. Blank Contamination - If yes, list the sample and the corresponding concentrations in each blank

✓

2. Matrix Spike/Matrix Sp Dup. Recoveries Meet Criteria (If not met, list the sample and corresponding recovery which falls outside the acceptable range)

✓

3. IR Spectra submitted for standards, blanks, & samples

✓

4. Chromatograms submitted for standards, blanks, and samples if GC fingerprinting was conducted.

N/A

5. Extraction holding time met. (If not met, list number of days exceeded for each sample)

✓

6. Analysis holding time met. (If not met, list number of days exceeded for each sample)

✓

Comments:

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW 846 for Solid Waste Analysis. I have personally examined the information contained in this report, and to the best of my knowledge, I believe that the submitted information is true, accurate, complete, and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.

Project #1627


Brian K. McKee
Laboratory Manager

APPENDIX E

Groundwater Analytical Package

FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732) 532-6224 FAX: (732) 532-6263

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

CERTIFICATIONS: NJDEP #13461, NYSDOH #11699



ANALYTICAL DATA REPORT
Fort Monmouth Environmental Laboratory
ENVIRONMENTAL DIVISION
Fort Monmouth, New Jersey
PROJECT: UST Monitoring
Program

Bldg. 678

Field Sample Location	Laboratory Sample ID#	Matrix	Date and Time of Collection	Date Received
678-GW	5892.01	Aqueous	04-Dec-00 12:05	12/04/00
F. D.	5892.02	Aqueous	04-Dec-00	12/04/00

ANALYSIS:
FORT MONMOUTH ENVIRONMENTAL LAB
VOA+15, BN+15

ENCLOSURE:
CHAIN OF CUSTODY
RESULTS


Daniel Wright/Date
Laboratory Director

12-13-00

Table of Contents

<u>Section</u>	<u>Pages</u>
Chain of Custody	1-2
Methodology Review	3-4
Laboratory Chronicle	5-6
Conformance/Non-Conformance Summary	7-9
Volatile Organics	10
Analytical Results Summary	11-37
Tune Results Summary	38-46
Method Blank Results Summary	47-48
Surrogate Recovery Summary	49
MS/MSD Results Summary	50
Internal Standard Area & RT Summary	51-52
Chromatograms	53-70
Base Neutrals	71
Analytical Results Summary	72-92
Tune Results Summary	93-100
Method Blank Results Summary	101
Surrogate Recovery Summary	102
MS/MSD Results Summary	103
Internal Standard Area & RT Summary	104-106
Chromatograms	106-119
Laboratory Deliverables Checklist	120
Laboratory Authentication Statement	121

CHAIN OF CUSTODY

NJDEP Certification #13461

[illegible]

METHOD SUMMARY

Methodology Summary

EPA Method 624

Gas Chromatographic Determination of Volatiles in Water

Surrogates and internal standards are added to a 5-ml aliquot of sample. The sample is then purged and desorbed into a GC/MS system. The organic compounds are separated by the gas chromatograph and detected using the mass spectrometer. Volatiles are identified and quantitated.

EPA Method 3510/8270

Gas Chromatographic Determination of Semi-volatiles in Water

Surrogates are added to a measured volume of sample, usually 1 liter, at a specified pH. The sample is serially extracted with Methylene Chloride using a separatory funnel. The extract is concentrated and internal standards are added. The sample is injected into a GC/MS system. Semi-volatiles are identified and quantitated.

LABORATORY CHRONICLE

Laboratory Chronicle

Lab ID: 5892

Site: Bldg. 678

	Date	Hold Time
Date Sampled	12/04/00	NA
Receipt/Refrigeration	12/04/00	NA
Extractions		
1. BN	12/05/00	7 days
Analyses		
1. Volatile Organics	12/04, 05/00	14 days
2. BN	12/06,07/00	40 days

CONFORMANCE/ NON- CONFORMANCE SUMMARY

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT

Indicate
Yes, No, N/A

1. Chromatograms labeled/Compounds identified
(Field samples and method blanks) yes
2. Retention times for chromatograms provided yes
3. GC/MS Tune Specifications
 - a. BFB Meet Criteria yes
 - b. DFTPP Meet Criteria yes
4. GC/MS Tuning Frequency – Performed every 24 hours for 600 series and 12 hours for 8000 series yes
5. GC/MS Calibration – Initial Calibration performed before sample analysis and continuing calibration performed within 24 hours of sample analysis for 600 series and 12 hours for 8000 series yes
6. GC/MS Calibration requirements
 - a. Calibration Check Compounds Meet Criteria yes
 - b. System Performance Check Compounds Meet Criteria yes
7. Blank Contamination – If yes, List compounds and concentrations in each blank: NO
 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA
8. Surrogate Recoveries Meet Criteria yes

If not met, list those compounds and their recoveries, which fall outside the acceptable range:

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA

If not met, were the calculations checked and the results qualified as “estimated”?

9. Matrix Spike/Matrix Spike Duplicate Recoveries Meet Criteria yes

(If not met, list those compounds and their recoveries, which fall outside the acceptable range)

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT (cont.)

Indicate
Yes, No, N/A

10. Internal Standard Area/Retention Time Shift Meet Criteria
(If not met, list those compounds, which fall outside the acceptable range)

yes

- a. VOA Fraction _____
b. B/N Fraction _____
c. Acid Fraction NA

11. Extraction Holding Time Met

yes

If not met, list the number of days exceeded for each sample: _____

12. Analysis Holding Time Met

yes

If not met, list the number of days exceeded for each sample: _____

Additional Comments:

Laboratory Manager: _____

Date: 12-13-00

VOLATILE ORGANICS

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VB008932.D**
 Operator **Skelton**
 Date Acquired **4 Dec 2000 1:05 pm**

Sample Name **Vblk262**
 Field ID **Vblk262**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-34-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
156-59-2	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
71-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
124-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
00-00-0	m+p-Xylenes			not detected	nle	1.14 ug/L	
95-47-6	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

Vblk262

Lab Name: FMETL Project: 01-0004
NJDEP#: 13461 Case No.: 5892 Location: 678 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: Vblk262
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB008932.D
Level: (low/med) LOW Date Received: 12/4/00
% Moisture: not dec. _____ Date Analyzed: 12/4/00
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VB008961.D**
 Operator **Skelton**
 Date Acquired **5 Dec 2000 8:44 am**

Sample Name **5892.01**
 Field ID **678-GW**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-34-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
156-59-2	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
71-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
124-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
00-00-0	m+p-Xylenes			not detected	nle	1.14 ug/L	
95-47-6	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

678-GW

Lab Name: FMETL Project: 01-0004
NJDEP#: 13461 Case No.: 5892 Location: 678 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 5892.01
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB008961.D
Level: (low/med) LOW Date Received: 12/4/00
% Moisture: not dec. _____ Date Analyzed: 12/5/00
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VB008962.D**
 Operator **Skelton**
 Date Acquired **5 Dec 2000 9:23 am**

Sample Name **5892.02**
 Field ID **Field Dup**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-34-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
156-59-2	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
71-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
124-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
00-00-0	m+p-Xylenes			not detected	nle	1.14 ug/L	
95-47-6	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

Field Dup

Lab Name: FMETL Project: 01-0004
NJDEP#: 13461 Case No.: 5892 Location: 678 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 5892.02
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB008962.D
Level: (low/med) LOW Date Received: 12/4/00
% Moisture: not dec. Date Analyzed: 12/5/00
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

BASE NEUTRALS

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **BN04715.D**
 Operator **Bhaskar**
 Date Acquired **6-Dec-00**

Sample Name **Sblk444**
 Misc Info **Sblk444 A 001205**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.54 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.69 ug/L	
62-53-3	Aniline			not detected	NLE	1.85 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	0.63 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.62 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.58 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	0.62 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.65 ug/L	
39638-32-9	bis(2-chloroisopropyl)ether			not detected	300	0.57 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.64 ug/L	
67-72-1	Hexachloroethane			not detected	10	0.34 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.51 ug/L	
78-59-1	Isophorone			not detected	100	0.45 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	0.48 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	0.54 ug/L	
91-20-3	Naphthalene			not detected	NLE	0.72 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.78 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.43 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	0.55 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	0.76 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	0.53 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.79 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.04 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.70 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.92 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	1.93 ug/L	
83-32-9	Acenaphthene			not detected	400	0.62 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	0.73 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	1.41 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.54 ug/L	
86-73-7	Fluorene			not detected	300	0.98 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	0.86 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	2.96 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.44 ug/L	
103-33-3	Azobenzene			not detected	NLE	1.00 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	1.28 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.08 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.73 ug/L	
120-12-7	Anthracene			not detected	2000	1.85 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	2.49 ug/L	
206-44-0	Fluoranthene			not detected	300	1.48 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BN04715.D**
 Operator **Bhaskar**
 Date Acquired **6-Dec-00**

Sample Name **Sblk444**
 Misc Info **Sblk444 A 001205**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	2.15 ug/L	
129-00-0	Pyrene			not detected	200	1.53 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.24 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	2.68 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.60 ug/L	
218-01-9	Chrysene			not detected	20	1.14 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.34 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.32 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.15 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	2.43 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	2.24 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	1.94 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	2.04 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

1F

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Field ID:

Sblk444

Lab Name: FMETL Lab Code 13461
Project: 01-0004 Case No.: 5892 Location: Bl.678 SDG No: _____
Matrix: (soil/water) WATER Lab Sample ID: Sblk444
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BN04715.D
Level: (low/med) LOW Date Received: 12/4/00
% Moisture: _____ decanted: (Y/N) N Date Extracted: 12/5/00
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 12/6/00
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: _____

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **BN04732.D**
 Operator **Bhaskar**
 Date Acquired **7-Dec-00**

Sample Name **5892.01**
 Misc Info **678-GW**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.54 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.69 ug/L	
62-53-3	Aniline			not detected	NLE	1.85 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	0.63 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.62 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.58 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	0.62 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.65 ug/L	
39638-32-9	bis(2-chloroisopropyl)ether			not detected	300	0.57 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.64 ug/L	
67-72-1	Hexachloroethane			not detected	10	0.34 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.51 ug/L	
78-59-1	Isophorone			not detected	100	0.45 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	0.48 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	0.54 ug/L	
91-20-3	Naphthalene			not detected	NLE	0.72 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.78 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.43 ug/L	
91-57-6	2-Methylnaphthalene	16.27	77473	4.55 ug/L	NLE	0.55 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	0.76 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	0.53 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.79 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.04 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.70 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.92 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	1.93 ug/L	
83-32-9	Acenaphthene	19.33	17681	1.38 ug/L	400	0.62 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	0.73 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	1.41 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.54 ug/L	
86-73-7	Fluorene	20.69	50270	3.73 ug/L	300	0.98 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	0.86 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	2.96 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.44 ug/L	
103-33-3	Azobenzene			not detected	NLE	1.00 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	1.28 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.08 ug/L	
85-01-8	Phenanthrene	23.14	151749	7.97 ug/L	NLE	1.73 ug/L	
120-12-7	Anthracene			not detected	2000	1.85 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	2.49 ug/L	
206-44-0	Fluoranthene			not detected	300	1.48 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BN04732.D**
 Operator **Bhaskar**
 Date Acquired **7-Dec-00**

Sample Name **5892.01**
 Misc Info **678-GW**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	2.15 ug/L	
129-00-0	Pyrene			not detected	200	1.53 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.24 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	2.68 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.60 ug/L	
218-01-9	Chrysene			not detected	20	1.14 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.34 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.32 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.15 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	2.43 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	2.24 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	1.94 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	2.04 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Field ID:

678-GW

Lab Name: FMETL Lab Code 13461

Project: 01-0004 Case No.: 5892 Location: Bl.678 SDG No: _____

Matrix: (soil/water) WATER Lab Sample ID: 5892.01

Sample wt/vol: 1000 (g/ml) ML Lab File ID: BN04732.D

Level: (low/med) LOW Date Received: 12/4/00

% Moisture: _____ decanted: (Y/N) N Date Extracted: 12/5/00

Concentrated Extract Volume: 1000 (uL) Date Analyzed: 12/7/00

Injection Volume: 1.0 (uL) Dilution Factor: 1.0

GPC Cleanup: (Y/N) N pH: _____

CONCENTRATION UNITS:

Number TICs found: 15 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
1. 017301-23-4	Undecane, 2,6-dimethyl-	14.26	23	JN
2. 062108-25-2	Decane, 2,6,7-trimethyl-	15.44	41	JN
3. 074645-98-0	Dodecane, 2,7,10-trimethyl-	17.26	46	JN
4. 000629-59-4	Tetradecane	17.66	17	JN
5. 000571-61-9	Naphthalene, 1,5-dimethyl-	18.10	29	JN
6. 000581-40-8	Naphthalene, 2,3-dimethyl-	18.31	27	JN
7. 000581-42-0	Naphthalene, 2,6-dimethyl-	18.37	33	JN
8. 017312-62-8	Decane, 5-propyl-	18.55	44	JN
9. 002245-38-7	Naphthalene, 1,6,7-trimethyl-	19.80	30	JN
10. 002245-38-7	Naphthalene, 1,6,7-trimethyl-	19.90	19	JN
11.	unknown	19.97	18	J
12. 002131-42-2	Naphthalene, 1,4,6-trimethyl-	20.10	17	JN
13.	unknown	21.01	45	J
14. 001921-70-6	Pentadecane, 2,6,10,14-tetramethyl-	21.69	120	JN
15. 000638-36-8	Hexadecane, 2,6,10,14-tetramethyl-	22.86	50	JN

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **BN04733.D**
 Operator **Bhaskar**
 Date Acquired **7-Dec-00**

Sample Name **5892.02**
 Misc Info **Field Dupe**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.54 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.69 ug/L	
62-53-3	Aniline			not detected	NLE	1.85 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	0.63 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.62 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.58 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	0.62 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.65 ug/L	
39638-32-9	bis(2-chloroisopropyl)ether			not detected	300	0.57 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.64 ug/L	
67-72-1	Hexachloroethane			not detected	10	0.34 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.51 ug/L	
78-59-1	Isophorone			not detected	100	0.45 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	0.48 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	0.54 ug/L	
91-20-3	Naphthalene			not detected	NLE	0.72 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.78 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.43 ug/L	
91-57-6	2-Methylnaphthalene	16.27	105175	6.28 ug/L	NLE	0.55 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	0.76 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	0.53 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.79 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.04 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.70 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.92 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	1.93 ug/L	
83-32-9	Acenaphthene	19.33	20081	1.62 ug/L	400	0.62 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	0.73 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	1.41 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.54 ug/L	
86-73-7	Fluorene	20.69	56812	4.37 ug/L	300	0.98 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	0.86 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	2.96 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.44 ug/L	
103-33-3	Azobenzene			not detected	NLE	1.00 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	1.28 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.08 ug/L	
85-01-8	Phenanthrene	23.14	164914	8.73 ug/L	NLE	1.73 ug/L	
120-12-7	Anthracene			not detected	2000	1.85 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	2.49 ug/L	
206-44-0	Fluoranthene			not detected	300	1.48 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BN04733.D**
 Operator **Bhaskar**
 Date Acquired **7-Dec-00**

Sample Name **5892.02**
 Misc Info **Field Dupe**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	2.15 ug/L	
129-00-0	Pyrene			not detected	200	1.53 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.24 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	2.68 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.60 ug/L	
218-01-9	Chrysene			not detected	20	1.14 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.34 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.32 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.15 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	2.43 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	2.24 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	1.94 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	2.04 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Field ID:

Dupe

Lab Name: FMETL Lab Code 13461

Project: 01-0004 Case No.: 5892 Location: Bl.678 SDG No: _____

Matrix: (soil/water) WATER Lab Sample ID: 5892.02

Sample wt/vol: 1000 (g/ml) ML Lab File ID: BN04733.D

Level: (low/med) LOW Date Received: 12/4/00

% Moisture: _____ decanted: (Y/N) N Date Extracted: 12/5/00

Concentrated Extract Volume: 1000 (uL) Date Analyzed: 12/7/00

Injection Volume: 1.0 (uL) Dilution Factor: 1.0

GPC Cleanup: (Y/N) N pH: _____

CONCENTRATION UNITS:

Number TICs found: 15 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
1. 002958-76-1	Naphthalene, decahydro-2-methyl	12.67	14	JN
2. 017301-23-4	Undecane, 2,6-dimethyl-	14.27	26	JN
3. 062108-25-2	Decane, 2,6,7-trimethyl-	15.44	46	JN
4. 074645-98-0	Dodecane, 2,7,10-trimethyl-	17.27	36	JN
5. 000629-59-4	Tetradecane	17.66	14	JN
6. 000575-37-1	Naphthalene, 1,7-dimethyl-	18.11	22	JN
7. 000581-40-8	Naphthalene, 2,3-dimethyl-	18.32	20	JN
8. 000575-37-1	Naphthalene, 1,7-dimethyl-	18.38	26	JN
9. 054833-48-6	Heptadecane, 2,6,10,15-tetramet	18.55	34	JN
10. 002245-38-7	Naphthalene, 1,6,7-trimethyl-	19.81	23	JN
11. 000829-26-5	Naphthalene, 2,3,6-trimethyl-	19.90	12	JN
12.	unknown	21.01	35	J
13. 001921-70-6	Pentadecane, 2,6,10,14-tetramet	21.69	120	JN
14. 055000-52-7	Hexadecane, 2,6,10-trimethyl-	22.86	55	JN
15. 017312-53-7	Decane, 3,6-dimethyl-	23.73	13	JN

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

- | | |
|--|-------------------------------------|
| 1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted | ☒ |
| 2. Table of Contents submitted | ☒ |
| 3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted | ☒ |
| 4. Document paginated and legible | ☒ |
| 5. Chain of Custody submitted | ☒ |
| 6. Samples submitted to lab within 48 hours of sample collection | ☒ |
| 7. Methodology Summary submitted | ☒ |
| 8. Laboratory Chronicle and Holding Time Check submitted | ☒ |
| 9. Results submitted on a dry weight basis | ☒ |
| 10. Method Detection Limits submitted | ☒ |
| 11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP | ☒ |

Laboratory Manager or Environmental Consultant's Signature _____
Date 12/13/00

Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance.

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.

A handwritten signature in black ink, appearing to read 'D.K. Wright', is written over a horizontal line.

Daniel K. Wright
Laboratory Manager

FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732) 532-6224 FAX: (732) 532-6263

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

CERTIFICATIONS: NJDEP #13461, NYSDOH #11699



ANALYTICAL DATA REPORT Fort Monmouth Environmental Laboratory ENVIRONMENTAL DIVISION Fort Monmouth, New Jersey PROJECT:IJO# 01-0001

Bldg. 678

Field Sample Location	Laboratory Sample ID#	Matrix	Date and Time Of Collection	Date Received
Bldg. 678 6.2'	220	Aqueous	17-Jan-01 10:00	01/17/01

ANALYSIS:
FORT MONMOUTH ENVIRONMENTAL LAB
VOA+15, BN+15

ENCLOSURE:
CHAIN OF CUSTODY
RESULTS

 2-7-01
Daniel Wright/Date
Laboratory Director

Table of Contents

Section	Pages
Chain of Custody	1-2
Methodology Summary	3-4
Conformance/Non-Conformance Summary	5-7
Laboratory Chronicle	8-9
Volatile Organics	10-11
Analytical Results Summary	12-15
Tune Results Summary	16-21
Method Blank Results Summary	22
Surrogate Recovery Summary	23
MS/MSD Results Summary	24-25
Internal Standard Area & RT Summary	26
Chromatograms	27-30
Base Neutrals	31
Analytical Results Summary	32-37
Tune Results Summary	38-47
Method Blank Results Summary	48
Surrogate Recovery Summary	49
MS/MSD Results Summary	50-51
Internal Standard Area & RT Summary	52-55
Chromatograms	56-59
Laboratory Deliverables Checklist	60
Laboratory Authentication Statement	61

CHAIN OF CUSTODY

000001

METHODOLOGY SUMMARY

000003

Method Summary

EPA Method 624

Gas Chromatographic Determination of Volatiles in Water

Surrogates and internal standards are added to a 5-ml aliquot of sample. The sample is then purged and desorbed into a GC/MS system. The organic compounds are separated by the gas chromatograph and detected using the mass spectrometer. Volatiles are identified and quantitated.

EPA Method 3510/8270

Gas Chromatographic Determination of Semi-volatiles in Water

Surrogates are added to measured volume of sample, usually 1 liter, at a specified pH. The sample is serially extracted with Methylene chloride using a separatory funnel. The extract concentrated and internal standards are added. The sample is injected into a GC/MS system. Semi-volatiles are identified and quantitated.

CONFORMANCE/NON- CONFORMANCE SUMMARY

000005

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT

Indicate
Yes, No, N/A

1. Chromatograms labeled/Compounds identified
(Field samples and method blanks) yes
2. Retention times for chromatograms provided yes
3. GC/MS Tune Specifications
 - a. BFB Meet Criteria yes
 - b. DFTPP Meet Criteria yes
4. GC/MS Tuning Frequency – Performed every 24 hours for 600 series and 12 hours for 8000 series yes
5. GC/MS Calibration – Initial Calibration performed before sample analysis and continuing calibration performed within 24 hours of sample analysis for 600 series and 12 hours for 8000 series yes
6. GC/MS Calibration requirements
 - a. Calibration Check Compounds Meet Criteria yes
 - b. System Performance Check Compounds Meet Criteria yes
7. Blank Contamination – If yes, List compounds and concentrations in each blank: NO
 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA
8. Surrogate Recoveries Meet Criteria NO

If not met, list those compounds and their recoveries, which fall outside the acceptable range:

 - a. VOA Fraction _____
 - b. B/N Fraction Nitrobenzene-d5 20%
 - c. Acid Fraction NA

If not met, were the calculations checked and the results qualified as "estimated"?

yes
9. Matrix Spike/Matrix Spike Duplicate Recoveries Meet Criteria
(If not met, list those compounds and their recoveries, which fall outside the acceptable range) yes
 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA

000006

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT (cont.)

Indicate
Yes, No, N/A

10. Internal Standard Area/Retention Time Shift Meet Criteria
(If not met, list those compounds, which fall outside the acceptable range)

yes

a. VOA Fraction _____
b. B/N Fraction _____
c. Acid Fraction NA

11. Extraction Holding Time Met

yes

If not met, list the number of days exceeded for each sample: _____

12. Analysis Holding Time Met

yes

If not met, list the number of days exceeded for each sample: _____

Additional Comments:

Laboratory Manager: _____

Date: 2-7-01

000007

LABORATORY CHRONICLE

000008

Laboratory Chronicle

Lab ID: 220

Site: Bldg. 678

	Date	Hold Time
Date Sampled	01/17/01	NA
Receipt/Refrigeration	01/17/01	NA

Extractions

1. BN	01/18/01	7 days
-------	----------	--------

Analyses

1. Volatile Organics	01/19/01	14 days
2. BN	01/24,25/01	40 days

000009

VOLATILE ORGANICS

000010

**US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEP CERTIFICATION # 13461**

Definition of Qualifiers

MDL	:	Method Detection Limit
J	:	Compound identified below detection limit
B	:	Compound found in blank
D	:	Results are from a dilution of the sample
U	:	Compound searched for but not detected
E	:	Compound exceeds calibration limit
PQL	:	Practical Quantitation Limit
NLE	:	No limit established
RT	:	Retention time

000011

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification Number #13461

Data File **VC004743.D**
 Operator **Skelton**
 Date Acquired **19-Jan-01**

Sample Name **MB**
 Field ID **MB**
 Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-34-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
156594	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C., 7:9-6 2-Sept 97

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

MB 010119

Lab Name: FMETL NJDEP#: 13461
Project: 010001 Case No.: 220 Location: 678 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: MB
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC004743.D
Level: (low/med) LOW Date Received: 1/17/01
% Moisture: not dec. Date Analyzed: 1/19/01
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification Number #13461

Data File **VC004753.D**
 Operator **Skelton**
 Date Acquired **19-Jan-01**

Sample Name **220**
 Field ID **Bldg678**
 Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-34-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
156594	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C., 7-9-6 2-Sept 97

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Bldg678

Lab Name: FMETL NJDEP#: 13461
Project: 010001 Case No.: 220 Location: 678 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 220
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC004753.D
Level: (low/med) LOW Date Received: 1/17/01
% Moisture: not dec. Date Analyzed: 1/19/01
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

BASE NEUTRALS

000031

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **BNA04856.D**
 Operator **Bhaskar**
 Date Acquired **24-Jan-01**

Sample Name **MB-250**
 Misc Info **MB-010118**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.54 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.69 ug/L	
62-53-3	Aniline			not detected	NLE	1.85 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	0.63 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.62 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.58 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	0.62 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.65 ug/L	
39638-32-9	bis(2-chloroisopropyl)ether			not detected	300	0.57 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.64 ug/L	
67-72-1	Hexachloroethane			not detected	10	0.34 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.51 ug/L	
78-59-1	Isophorone			not detected	100	0.45 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	0.48 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	0.54 ug/L	
91-20-3	Naphthalene			not detected	NLE	0.72 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.78 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.43 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	0.55 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	0.76 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	0.53 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	1.04 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.04 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.70 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.92 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	1.93 ug/L	
83-32-9	Acenaphthene			not detected	400	0.62 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	0.73 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	1.41 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.54 ug/L	
86-73-7	Fluorene			not detected	300	0.98 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	0.86 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	2.96 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.44 ug/L	
103-33-3	Azobenzene			not detected	NLE	1.00 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	1.28 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.08 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.73 ug/L	
120-12-7	Anthracene			not detected	2000	1.85 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	2.49 ug/L	
206-44-0	Fluoranthene			not detected	300	1.48 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BNA04856.D**
 Operator **Bhaskar**
 Date Acquired **24-Jan-01**

Sample Name **MB-250**
 Misc Info **MB-010118**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	2.15 ug/L	
129-00-0	Pyrene			not detected	200	1.53 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.24 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	2.68 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.60 ug/L	
218-01-9	Chrysene			not detected	20	1.14 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.34 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.32 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.15 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	2.43 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	2.24 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	1.94 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	2.04 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

1F

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Field Id:

MB-250

Lab Name: FMETL Lab Code 13461
Project: 01-0001 Case No.: 220 Location: Bl.678 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: MB-250
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA04856.D
Level: (low/med) LOW Date Received: 1/17/01
% Moisture: decanted: (Y/N) N Date Extracted: 1/18/01
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 1/24/01
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH:

CONCENTRATION UNITS:

Number TICs found: 2 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
1.	unknown	7.11	15	J
2.	unknown	33.96	140	J

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **BNA04870.D**
 Operator **Bhaskar**
 Date Acquired **25-Jan-01**

Sample Name **220**
 Misc Info **Bldg.678**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.54 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.69 ug/L	
62-53-3	Aniline			not detected	NLE	1.85 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	0.63 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.62 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.58 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	0.62 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.65 ug/L	
39638-32-9	bis(2-chloroisopropyl)ether			not detected	300	0.57 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.64 ug/L	
67-72-1	Hexachloroethane			not detected	10	0.34 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.51 ug/L	
78-59-1	Isophorone			not detected	100	0.45 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	0.48 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	0.54 ug/L	
91-20-3	Naphthalene			not detected	NLE	0.72 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.78 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.43 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	0.55 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	0.76 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	0.53 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	1.04 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.04 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.70 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.92 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	1.93 ug/L	
83-32-9	Acenaphthene			not detected	400	0.62 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	0.73 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	1.41 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.54 ug/L	
86-73-7	Fluorene	19.05	153561	4.42 ug/L	300	0.98 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	0.86 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	2.96 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.44 ug/L	
103-33-3	Azobenzene			not detected	NLE	1.00 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	1.28 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.08 ug/L	
85-01-8	Phenanthrene	21.42	512464	11.06 ug/L	NLE	1.73 ug/L	
120-12-7	Anthracene			not detected	2000	1.85 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	2.49 ug/L	
206-44-0	Fluoranthene			not detected	300	1.48 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BNA04870.D**

Operator **Bhaskar**

Date Acquired **25-Jan-01**

Sample Name **220**

Misc Info **Bldg.678**

Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	2.15 ug/L	
129-00-0	Pyrene			not detected	200	1.53 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.24 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	2.68 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.60 ug/L	
218-01-9	Chrysene			not detected	20	1.14 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.34 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.32 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.15 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	2.43 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	2.24 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	1.94 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	2.04 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range

D= Value from dilution

B= Compound in Related Blank

PQL= Practical Quantitation Limit

MDL= Method Detection Limit

NLE= No Limit Established

R.T.=Retention Time

Page 2 of 2

000036

1F

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Field Id:

Bldg.678

Lab Name: FMETL Lab Code 13461

Project: 01-0001 Case No.: 220 Location: Bl.678 SDG No.: _____

Matrix: (soil/water) WATER Lab Sample ID: 220

Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA04870.D

Level: (low/med) LOW Date Received: 1/17/01

% Moisture: _____ decanted: (Y/N) N Date Extracted: 1/18/01

Concentrated Extract Volume: 1000 (uL) Date Analyzed: 1/25/01

Injection Volume: 1.0 (uL) Dilution Factor: 1.0

GPC Cleanup: (Y/N) N pH: _____

CONCENTRATION UNITS:

Number TICs found: 15 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
1.	unknown	12.52	47	J
2. 017301-28-9	Undecane, 3,6-dimethyl-	13.60	80	JN
3.	unknown	14.47	140	J
4. 000629-50-5	Tridecane	14.89	55	JN
5. 003891-98-3	Dodecane, 2,6,10-trimethyl-	15.94	120	JN
6. 000571-61-9	Naphthalene, 1,5-dimethyl-	16.69	48	JN
7. 000581-40-8	Naphthalene, 2,3-dimethyl-	16.88	44	JN
8.	unknown	16.94	91	J
9. 006117-97-1	Dodecane, 4-methyl-	17.07	170	JN
10.	unknown	17.43	43	J
11. 002131-42-2	Naphthalene, 1,4,6-trimethyl-	17.97	53	JN
12. 000829-26-5	Naphthalene, 2,3,6-trimethyl-	18.22	69	JN
13.	unknown	19.35	130	J
14. 001921-70-6	Pentadecane, 2,6,10,14-tetramet	20.01	300	JN
15. 000629-99-2	Pentacosane	21.15	110	JN

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

- | | |
|--|-------------------------------------|
| 1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted | ☒ |
| 2. Table of Contents submitted | ☒ |
| 3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted | ☒ |
| 4. Document paginated and legible | ☒ |
| 5. Chain of Custody submitted | ☒ |
| 6. Samples submitted to lab within 48 hours of sample collection | ☒ |
| 7. Methodology Summary submitted | ☒ |
| 8. Laboratory Chronicle and Holding Time Check submitted | ☒ |
| 9. Results submitted on a dry weight basis | ☒ |
| 10. Method Detection Limits submitted | ☒ |
| 11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP | ☒ |

Laboratory Manager or Environmental Consultant's Signature _____
Date 2/7/01

Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP Methods for further guidance.

000060

Laboratory Authentication Statement


I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.




Daniel K. Wright
Laboratory Manager

APPENDIX F

Photographs

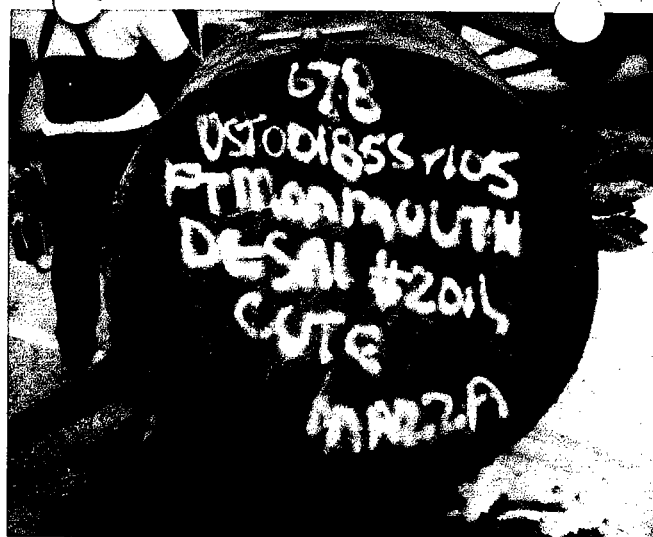

UST 008.1533-105
BLD 678 550 #2 oil

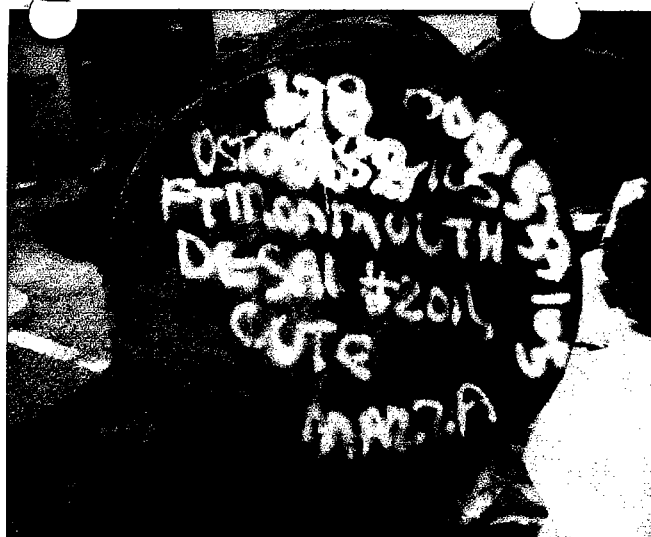

678-UST 0081533-105
550 pt1 - #2 oil

AUGUST 29, 1994
PHOTOGRAPHIC LOG
UST NO. 81533-105

Building 678
Main Post-West
Fort Monmouth

VERSAR
Engineers, Managers, Scientists & Planners
Bristol, PA