

United States Army
Fort Monmouth, New Jersey

**Underground Storage Tank
Closure and Site Investigation
Report**

***Building 752
Main Post-West Area***

**NJDEP UST Registration No. 81533-202
DICAR No. 98-04-03-1315-37**

January 2000

**UNDERGROUND STORAGE TANK
CLOSURE AND SITE INVESTIGATION REPORT**

BUILDING 752

**MAIN POST-WEST AREA
NJDEP UST REGISTRATION NO. 81533-202**

JANUARY 2000

PREPARED FOR:

**UNITED STATES ARMY, FORT MONMOUTH, NEW JERSEY
DIRECTORATE OF PUBLIC WORKS
BUILDING 167
FORT MONMOUTH, NJ 07703**

PREPARED BY:

**VERSAR
1900 FROST ROAD
SUITE 110
BRISTOL, PA 19007**

PROJECT NO. 4435-018

TABLE OF CONTENTS

EXECUTIVE SUMMARY	iv
1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES	1
1.1 OVERVIEW	1
1.2 SITE DESCRIPTION	2
1.2.1 Geological/Hydrogeological Setting	2
1.3 HEALTH AND SAFETY	4
1.4 REMOVAL OF UNDERGROUND STORAGE TANK	4
1.4.1 General Procedures	4
1.4.2 Underground Storage Tank Excavation and Cleaning	4
1.5 UNDERGROUND STORAGE TANK TRANSPORTATION AND DISPOSAL	5
1.6 MANAGEMENT OF EXCAVATED SOILS	5
2.0 SITE INVESTIGATION ACTIVITIES	6
2.1 OVERVIEW	6
2.2 FIELD SCREENING/MONITORING	6
2.3 SOIL SAMPLING	7
2.4 GROUNDWATER SAMPLING	7
3.0 CONCLUSIONS AND RECOMMENDATIONS	8
3.1 SOIL SAMPLING RESULTS	8
3.2 GROUNDWATER SAMPLING RESULTS	
3.3 CONCLUSIONS AND RECOMMENDATIONS	9

TABLE OF CONTENTS (CONTINUED)

TABLES

Table 1	Summary of Post-Excavation Sampling Activities
Table 2	Post-Excavation Soil Sampling Results
Table 3	Groundwater Sampling Results

FIGURES

Figure 1	Site Location Map
Figure 1A	Geological Map
Figure 2	Site Map
Figure 3	Cross Sectional View
Figure 4	Soil Sampling Location Map
Figure 5	Groundwater Sampling Location Map

APPENDICES

Appendix A	NJDEP Standard Reporting Form
Appendix B	Site Assessment Summary
Appendix C	Waste Manifest
Appendix D	UST Disposal Certificate
Appendix E	Soil Analytical Data Package
Appendix F	Groundwater Analytical Data Package
Appendix G	Photographs
Appendix H	Electronic Data Deliverables

EXECUTIVE SUMMARY

UST Closure

On April 2, 1998, a steel underground storage tank (UST) was closed by removal in accordance with New Jersey Department of Environmental Protection (NJDEP) closure procedures at the Main Post-West area of the U.S. Army Fort Monmouth, Fort Monmouth, New Jersey. The UST, NJDEP Registration No. 0081533-202 (Fort Monmouth ID No. 752), was located northeast of Building 752. UST No. 0081533-202 was a 275-gallon diesel UST.

Site Assessment

The site assessment was performed by U.S. Army personnel in accordance with the NJDEP *Technical Requirements for Site Remediation* (N.J.A.C. 7:26E) and the NJDEP *Field Sampling Procedures Manual*. The sampling and laboratory analysis conducted during the site assessment were performed in accordance with Section 7:26E-2.1 of the *Technical Requirements for Site Remediation*. Soils surrounding the tank were screened visually and with air monitoring equipment for evidence of contamination. Following removal, the UST was inspected for corrosion holes. Numerous holes were noted in the UST. Soils at the location of the holes were dark in color and appeared to be contaminated. Based on the inspection of the UST, Directorate of Public Works (DPW) concluded that a discharge was associated with this UST. The NJDEP hotline was notified and the case was assigned DICAR No. 98-04-03-1315-37. Approximately 25 cubic yards of potentially contaminated soil were removed from the excavated area and stored at the Fort Monmouth petroleum contaminated soil staging area. Soil samples, which were collected after the removal of the potentially contaminated soil, contained TPHC concentrations ranging from non-detect to 976.61 mg/kg. Groundwater was encountered at 7.5 feet below ground surface and sheen was observed on groundwater.

All post excavation soil samples collected from the UST excavation at Building 752 contained TPHC concentrations below the NJDEP residential direct contact total organic contaminants soil cleanup criteria of 10,000 milligrams per kilogram (mg/kg) (N.J.A.C. 7:26D and revisions dated February 3, 1994). Following receipt of all post-excavation soil sampling results, the excavation was backfilled to grade with a combination of uncontaminated excavated soil and certified clean fill. The excavation site was then restored to its original condition.

In response to the observation of sheen on groundwater, two (2) groundwater samples were collected at Building 752. On November 11, 1999, and December 22, 1999, Building 752 was sampled for volatile organic compounds calibrated for xylene plus 15 tentatively identified compounds (VOC's), and semivolatile organic compounds plus 15 tentatively identified compounds (SVOC's). All groundwater analytical results were either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

No further action is proposed in regard to the closure and site assessment of UST No. 81533-202 at Building 752.

1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES

1.1 OVERVIEW

One underground storage tank (UST), New Jersey Department of Environmental Protection (NJDEP) Registration No. 81533-202, was closed at Building 752 at the Main Post-West area of U.S. Army Fort Monmouth, Fort Monmouth, New Jersey on April 2, 1998. Refer to the site location map on Figure 1. This report presents the results of the Department of Public Works' (DPW) implementation of the UST Decommissioning/Closure Plan approved by the NJDEP. The UST was a steel 275-gallon tank containing diesel.

Decommissioning activities for UST No. 81533-202 complied with all applicable Federal, State, and Local laws and ordinances in effect at the date of decommissioning. These laws included but were not limited to N.J.A.C. 7:14B-1 et seq., N.J.A.C. 5:23-1 et seq., and Occupational Safety and Health Administration (OSHA) 1910.146 & 1910.120. All permits including but not limited to the NJDEP approved Decommissioning/Closure Plan were posted onsite for inspection. The decommissioning activities were conducted by SMC Environmental Services Group personnel who are registered and certified by the NJDEP for performing UST closure activities. Closure of UST No. 81533-202 proceeded under the approval of the NJDEP Bureau of Federal Case Management (NJDEP-BFCM). The Standard Reporting Form and signed Site Assessment Summary form for UST No. 81533-202 are included in Appendices A and B, respectively.

After removal of the potentially contaminated soil, the site was assessed. Based on inspecting the UST, field screening of remaining subsurface soils, and reviewing analytical results of soil samples and groundwater samples, the DPW has concluded that no significant historical discharges are associated with the UST or associated piping.

This UST Closure and Site Investigation Report has been prepared by Versar, to assist the U.S. Army DPW in complying with the NJDEP regulations. The applicable NJDEP regulations at the date of closure were the *Interim Closure Requirements for Underground Storage Tank Systems* (N.J.A.C. 7:14B-1 et seq. October 1990 and revisions dated November 1, 1991).

This report was prepared using information collected at the time of closure. Section 1 of this UST Closure and Site Investigation Report provides a summary of the UST decommissioning activities. Section 2 of this report describes the site investigation activities. Conclusions and recommendations, including the results of the soil sampling and groundwater investigation, are presented in the final section of this report.

1.2 SITE DESCRIPTION

Building 752 is located in the Main Post-West area of the Fort Monmouth Army Base. UST No. 0081533-202 was located northeast of Building 752 and appurtenant copper piping ran approximately four (4) feet southwest from the excavation to the emergency generator building. The vent line ran approximately twelve (12) feet southwest from the excavation to Building 752. A site map is provided on Figure 2.

1.2.1 Geological/Hydrogeological Setting

The following is a description of the geological/hydrogeological setting of the area surrounding Building 752. Included is a description of the regional geology of the area surrounding Fort Monmouth as well as descriptions of the local geology and hydrogeology of the Main Post area. A geological map is provided on Figure 1A.

Regional Geology

Monmouth County lies within the New Jersey Section of the Atlantic Coastal Plain physiographic province. The Main Post, Charles Wood, and the Evans areas are located in what may be referred to as the Outer Coastal Plain subprovince, or the Outer Lowlands.

In general, New Jersey Coastal Plain formations consist of a seaward-dipping wedge of unconsolidated deposits of clay, silt, and gravel. These formations typically strike northeast-southwest with a dip ranging from 10 to 60 feet per mile and were deposited on Precambrian and lower Paleozoic rocks (Zapecza, 1989). These sediments, predominantly derived from deltaic, shallow marine, and continental shelf environments, date from Cretaceous through the Quaternary Periods. The mineralogy ranges from quartz to glauconite.

The formations record several major transgressive/regressive cycles and contain units which are generally thicker to the southeast and reflect a deeper water environment. More than 20 regional geologic units are present within the sediments of the Coastal Plain. Regressive, upward coarsening deposits are usually aquifers (e.g., Englishtown and Kirkwood Formations, and the Cohansey Sand) while the transgressive deposits act as confining units (e.g., the Merchantville, Marshalltown, and Navesink Formations). The individual thicknesses for these units vary greatly (i.e., from several feet to several hundred feet). The Coastal Plain deposits thicken to the southeast from the Fall Line to greater than 6,500 feet in Cape May County (Brown and Zapecza, 1990).

Local Geology

Based on the regional geologic map (Jablonski, 1968), the Cretaceous age Red Bank and Tinton Sands outcrop at the Main Post area. The Red Bank sand conformably overlies the Navesink Formation and dips to the southeast at 35 feet per mile. The upper member (Shrewsbury) of the Red Bank sand is a yellowish-gray to reddish brown clayey, medium-to-coarse-grained sand that contains abundant rock fragments, minor mica and glauconite (Jablonski). The lower member (Sandy Hook) is a dark gray to black, medium-to-fine

grained sand with abundant clay, mica, and glauconite.

The Tinton sand conformably overlies the Red Bank Sand and ranges from a clayey medium to very coarse grained feldspathic quartz and glauconite sand to a glauconitic coarse sand. The color varies from dark yellowish orange or light brown to moderate brown and from light olive to grayish olive. Glauconite may constitute 60 to 80 percent of the sand fraction in the upper part of the unit (Minard, 1969). The upper part of the Tinton is often highly oxidized and iron oxide encrusted (Minard).

Hydrogeology

The water table aquifer in the Main Post area is identified as part of the "composite confining units," or minor aquifers. The minor aquifers include the Navesink formation, Red Bank Sand, Tinton Sand, Hornerstown Sand, Vincentown Formation, Manasquan Formation, Shark River Formation, Piney Point Formation, and the basal clay of the Kirkwood Formation.

Based on records of wells drilled in the Main Post area, water is typically encountered at depths of 2 to 9 feet below ground surface (bgs). According to Jablonski, wells drilled in the Red Bank and Tinton Sands may produce 2 to 25 gallons per minute (gpm). Some well owners have reported acidic water that requires treatment to remove iron.

Due to the proximity of the Atlantic Ocean to Fort Monmouth, shallow groundwater may be tidally influenced and may flow toward creeks and brooks as the tide goes out, and away from creeks and brooks as the tide comes in. However, an abundance of clay lenses and sand deposits were noted in borings installed throughout Fort Monmouth. Therefore, the direction of shallow groundwater should be determined on a case-by-case basis.

Shallow groundwater is locally influenced within the Main Post area by the following factors:

- tidal influence (based on proximity to the Atlantic Ocean, rivers, and tributaries)
- topography
- nature of the fill material within the Main Post area
- presence of clay and silt lenses in the natural overburden deposits
- local groundwater recharge areas (i.e., streams, lakes)

Due to the fluvial nature of the overburden deposits (i.e., sand and clay lenses), shallow groundwater flow direction is best determined on a case-by-case basis. This is consistent with lithologies observed in borings installed within the Main Post area, which primarily consisted of fine-to-medium grained sands, with occasional lenses or laminations of gravel silt and/or clay.

Building 752 is located approximately 100 feet northwest of Husky Brook, the nearest water body. Based on the Main Post topography, the groundwater flow in the area of Building 752 is anticipated to be to the southeast.

1.3 HEALTH AND SAFETY

Before, during, and after all decommissioning activities, hazards at the work site which may have posed a threat to the Health and Safety of all personnel who were involved with, or were affected by, the decommissioning of the UST system were minimized. All areas, which posed, or may have been suspected to pose a vapor hazard were monitored by a qualified individual utilizing an organic vapor analyzer (OVA). The individual ascertained if the area was properly vented to render the area safe, as defined by OSHA.

1.4 REMOVAL OF UNDERGROUND STORAGE TANK

1.4.1 General Procedures

- The contractor performing the closure prior to excavation activities identified all underground obstructions (utilities, etc.).
- All activities were carried out with the greatest regard to safety and health and the safeguarding of the environment.
- All excavated soils were visually examined and screened with an OVA for evidence of contamination. Potentially contaminated soils were identified and logged during closure activities.
- Surface materials (i.e., asphalt, concrete, etc.) were excavated and staged separately from all soil and recycled in accordance with all applicable regulations and laws.
- A Sub-Surface Evaluator from the DPW was present during all site assessment activities.

1.4.2 Underground Storage Tank Excavation and Cleaning

Prior to UST decommissioning activities, surficial soil was removed to expose the UST and associated piping. All free product present in the piping was drained into the UST, and the UST was purged to remove vapors prior to cutting and removal of the piping. After removal of the associated piping, a manway was made in the UST to allow for proper cleaning. The UST was completely emptied of all liquids prior to removal from the ground. Approximately 70 gallons of liquid from the UST and its associated piping were transported by Lionetti Oil Recovery Co. Inc to the Lionetti Oil Recovery Co. Inc. facility, a NJDEP-approved petroleum recycling and disposal company located in Old Bridge, New Jersey. Refer to Appendix C for the waste manifest.

The UST was cleaned prior to removal from the excavation in accordance with the NJDEP regulations. After the UST was removed from the excavation, it was staged on polyethylene sheeting and examined for holes. Numerous holes were observed during the inspection by the Sub-Surface Evaluator. Soils surrounding the UST were screened visually and with an OVA for evidence of contamination. Soils were stained and appeared to be contaminated. Approximately 25 cubic yards of potentially contaminated soil were removed from the excavated area and transported to the Main Post petroleum contaminated soil holding area. Soil screening was also performed along the piping associated with the UST. No contamination was noted anywhere along the piping length. Soil samples, which were collected after the removal of the potentially contaminated soil, contained TPHC concentrations ranging from non-detect to 976.61 mg/kg. Groundwater was encountered at 7.5 feet below ground surface and sheen was observed on groundwater. See Figure 3 for a cross-sectional view of the excavated area.

1.5 UNDERGROUND STORAGE TANK TRANSPORTATION AND DISPOSAL

The tank was transported in compliance with all applicable regulations and laws to Red Bank Recycling Auto Wreckers, Inc. Please refer to Appendix D for the UST Disposal Certificate and Appendix G for photographs of the tank.

The UST was labeled prior to transport with the following information:

- Site of origin
- Contact person
- NJDEP UST Facility ID number
- Former contents
- Destination site
- Date

1.6 MANAGEMENT OF EXCAVATED SOILS

Based on OVA air monitoring and TPHC analysis results from the post-excavation soil samples, approximately 25 cubic yards of potentially contaminated soil were removed from the UST excavation. All potentially contaminated soils were stockpiled separately from other excavated material and were placed on and covered with polyethylene sheets. Potentially contaminated soils were transported to the soil staging area. Soils that did not exhibit signs of contamination were used as backfill following the removal of the UST. Groundwater was encountered at 7.5 feet below ground surface and sheen was observed on groundwater.

2.0 SITE INVESTIGATION ACTIVITIES

2.1 OVERVIEW

The Site Investigation was managed and carried out by U.S. Army DPW personnel. All analyses were performed and reported by U.S. Army Fort Monmouth Environmental Laboratory, a NJDEP-certified testing laboratory. All sampling was performed under the direct supervision of a NJDEP Certified Sub-Surface Evaluator according to the methods described in the NJDEP *Field Sampling Procedures Manual* (1992). Sampling frequency and parameters analyzed complied with the NJDEP document *Interim Closure Requirements for Underground Storage Tank Systems* (October 1990 and revisions dated November 1, 1991) which was the applicable regulation at the date of the closure. The Fort Monmouth DPW Environmental Office maintains all records of the Site Investigation activities.

The following Parties participated in Closure and Site Investigation Activities:

- Subsurface Evaluator: David H. Daniels
Employer: SMC Environmental Services Group
Phone Number: (215) 788-7844
NJDEP Certification No.: 10279
- Project Manager: Dinker Desai
Employer: U.S. Army, Fort Monmouth
Phone Number: (730) 532-6224
NJDEP Certification No.: 10173
- Analytical Laboratory: U.S. Army Fort Monmouth Environmental laboratory
Contact Person: Daniel K. Wright
Phone Number: (908) 532-4359
NJDEP Company Certification No.: 13461
- Hazardous Waste Hauler: Lorco Petroleum Services
Contact Person: Gary LoBello
Phone Number: (732) 721-0900

2.2 FIELD SCREENING/MONITORING

Field screening was performed by a NJDEP Certified Sub-Surface Evaluator using an OVA and visual observations to identify potentially contaminated material. Approximately 25 cubic yards of potentially petroleum contaminated soil were removed from the excavated area and transported to the Fort Monmouth petroleum contaminated soil holding area. Soils were removed from the excavation until no evidence of contamination remained. Groundwater was encountered at 7.5 feet below ground surface and sheen was observed on groundwater.

2.3 SOIL SAMPLING

On April 3, 1998, following the removal of the UST and associated piping, post-excavation soil samples B, S, E, N, W, V, PP and DUP E2 were collected from a total of seven (7) locations of the UST excavation. Excavation floor sample B was collected at a depth of 7.5 feet bgs. Sidewall samples S, E, N, W, and DUP E were collected at a depth of 6.0 feet bgs. Piping sample PP and vent line sample V were collected at a depth of 2.0 feet bgs. All samples were analyzed for total petroleum hydrocarbons (TPHC) and total solids.

On August 28, 1998, following the removal of potentially contaminated soil from the west end of the excavated area, post-excavation soil samples B2, W2, and W3 were collected from a total of three (3) locations of the UST excavation. Excavation floor sample B2 was collected at a depth of 7.5 feet bgs. Sidewall samples W2 and W3 were collected at a depth of 6.0 feet bgs. All samples were analyzed for total petroleum hydrocarbons (TPHC) and total solids.

SMC Environmental Services Group personnel in accordance with the NJDEP Technical Requirements and the NJDEP Field Sampling Procedures Manual performed the site assessment. A summary of sampling activities including parameters analyzed is provided in Table 1. The post-excavation soil samples were collected using NJDEP *Field Sampling Procedures Manual* (1992) standard sampling procedures. Following soil sampling activities, the samples were chilled and delivered to U.S. Army Fort Monmouth Environmental Laboratory located in Fort Monmouth, New Jersey, for analysis.

2.4 GROUNDWATER SAMPLING

On November 6, 1999, and December 22, 1999, Building 752 was sampled for volatile organic compounds calibrated for xylene plus 15 tentatively identified compounds (VOC's), and semivolatile organic compounds plus 15 tentatively identified compounds (SVOC's). Sampling and analysis were performed in accordance with the NJDEP *Field Sampling Procedures Manual* and the *Technical Requirements For Site Remediation*. Refer to Appendix F for the field sampling documentation.

3.0 CONCLUSIONS AND RECOMMENDATIONS

3.1 SOIL SAMPLING RESULTS

To evaluate soil conditions following removal of the UST and associated piping, post-excavation soil samples were collected on April 3, 1998, and August 25, 1998 from a total of ten (10) locations. All samples were analyzed for TPHC and total solids. The post-excavation sampling results were compared to the NJDEP residential direct contact total organic contaminants soil cleanup criteria of 10,000 mg/kg (N.J.A.C. 7:26D and revisions dated February 3, 1994). A summary of the analytical results and comparison to the NJDEP soil cleanup criteria is provided in Table 2 and the soil sampling locations are shown on Figure 4. The analytical data package is provided in Appendix E.

All post-excavation soil samples collected on April 3, 1998, and August 25, 1998, from the UST excavation and from below piping associated with the UST contained concentrations of TPHC below the NJDEP soil cleanup criteria. Soil samples, which were collected after the removal of the potentially contaminated soil, contained TPHC concentrations ranging from non-detect to 976.61 mg/kg.

3.2 GROUNDWATER SAMPLING RESULTS

No compounds were detected in the sample collected from Building 752 on November 6, 1999, and December 22, 1999.

A summary of the analytical results and comparison to the NJDEP groundwater cleanup criteria is provided in Table 3 and the groundwater sampling locations are shown on Figure 5. The analytical data package is provided in Appendix F. The full data package, including quality control, is on file at U.S. Army Fort Monmouth, Fort Monmouth, New Jersey.

Groundwater samples collected on November 6, 1999, and December 22, 1999, were either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

3.3 CONCLUSIONS AND RECOMMENDATIONS

The analytical results for all post-excavation soil samples collected from the UST closure excavation at Building 752 were below the NJDEP soil cleanup criteria for total organic contaminants.

Based on the post-excavation sampling results, soil with TPHC concentrations exceeding the NJDEP soil cleanup criteria for total organic contaminants of 10,000 mg/kg, do not exist in the former location of the UST or associated piping.

Based on the analytical results of the groundwater samples collected at Building 752 on November 6, 1999, and December 22, 1999, groundwater quality at Building 752 was either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

No further action is proposed in regard to the closure and site assessment of UST No. 81533-202 at Building 752.

TABLES

TABLE 1

SUMMARY OF POST-EXCAVATION SAMPLING ACTIVITIES
BUILDING 752, MAIN POST-WEST AREA
FORT MONMOUTH, NEW JERSEY

Page 1 of 3

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	NJDEP Method
B	4/3/98	4/3/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
S	4/3/98	4/3/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
E2	4/3/98	4/3/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
E	4/3/98	4/3/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
N	4/3/98	4/3/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
**W	4/3/98	4/3/98	Soil	Post-excavation	TPHC	OQA-QAM-025
V	4/3/98	4/3/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
PP	4/3/98	4/3/98	Soil	Post-excavation	TPHC	OQA-QAM-025

Note:

- * TPHC Total Petroleum Hydrocarbons
 ** Sample further remediated and resampled

TABLE 1

SUMMARY OF POST-EXCAVATION SAMPLING ACTIVITIES
BUILDING 752, MAIN POST-WEST AREA
FORT MONMOUTH, NEW JERSEY

Page 2 of 3

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	NJDEP Method
B2	8/25/98	8/25/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
W2	8/25/98	8/25/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
W3	8/25/98	8/25/98	Soil	Post-Excavation	TPHC	OQA-QAM-025

Note:

* TPHC Total Petroleum Hydrocarbons

TABLE 1

SUMMARY OF SAMPLING ACTIVITIES
BUILDING 752, MAIN POST-WEST AREA
FORT MONMOUTH, NEW JERSEY

Page 3 of 3

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	Sampling Method**
4924.01	11/6/99	11/9/99	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
5042.01	12/22/99	12/29/99	Aqueous	Groundwater	VOCs, SVOCs	PPNDP

Note:

- *VOCs: Volatile Organic Compounds plus 15 tentatively identified compounds
*SVOCs: Semivolatile organic compounds plus 15 tentatively identified compounds
**PPNDP: Passively Placed Narrow Diameter Point

TABLE 2

POST-EXCAVATION SOIL SAMPLING RESULTS
BUILDING 752, MAIN POST-WEST AREA
FORT MONMOUTH, NEW JERSEY

Page 1 of 2

Sample ID/ Depth	Sample Laboratory ID	Sample Date	Analysis Date	Analytical Parameters	Method Detection Limit (mg/kg)	Compound of Concern	Results (mg/kg) *	NJDEP Soil Cleanup Criteria ** (mg/kg)	Exceeds Cleanup Criteria
B/7.5=	3454.01	4/3/98	4/3/98	Total Solid	--	--	74.64 %	--	--
				TPHC	198	yes	ND	10,000	No
S/6.0=	3454.02	4/3/98	4/3/98	Total Solid	--	--	71.73 %	--	--
				TPHC	209	Yes	976.61	10,000	No
E2/6.0=	3454.03	4/3/98	4/3/98	Total Solid	--	--	77.38 %	--	--
				TPHC	194	Yes	194.58	10,000	No
E/6.0=	3454.04	4/3/98	4/3/98	Total Solid	--	--	80.45 %	--	--
				TPHC	189	yes	ND	10,000	No
N/6.0=	3454.05	4/3/98	4/3/98	Total Solid	--	--	82.41 %	--	--
				TPHC	185	yes	501.58	10,000	No
***W/6.0=	3454.06	4/3/98	4/3/98	Total Solid	--	--	83.00 %	--	--
				TPHC	187	yes	19977.71	10,000	YES
V/2.0=	3454.07	4/3/98	4/3/98	Total Solid	--	--	84.43 %	--	--
				TPHC	177	yes	212.07	10,000	No
PP/2.0=	3454.08	4/3/98	4/3/98	Total Solid	--	--	82.06 %	--	--
				TPHC	185	yes	200.09	10,000	No

Note:

- * Total Solid results are expressed as a percentage.
 ** NJDEP Residential Direct Contact soil cleanup criteria for total organics
 *** Sample further remediated and resampled
 ND Not detected above stated method detection limit
 TPHC Total Petroleum Hydrocarbons

TABLE 2

POST-EXCAVATION SOIL SAMPLING RESULTS
 BUILDING 752, MAIN POST-WEST AREA
 FORT MONMOUTH, NEW JERSEY

Page 2 of 2

Sample ID/ Depth	Sample Laboratory ID	Sample Date	Analysis Date	Analytical Parameters	Method Detection Limit (mg/kg)	Compound of Concern	Results (mg/kg) *	NJDEP Soil Cleanup Criteria ** (mg/kg)	Exceeds Cleanup Criteria
B2/7.5=	3826.01	8/25/98	8/25/98	Total Solid TPHC	-- 193	-- yes	80.62 % ND	-- 10,000	-- No
W2/6.0=	3826.02	8/25/98	8/25/98	Total Solid TPHC	-- 192	-- Yes	79.98 % ND	-- 10,000	-- No
W3/6.0=	3826.03	8/25/98	8/25/98	Total Solid TPHC	-- 186	-- Yes	82.95 % ND	-- 10,000	-- No

Note:

* Total Solid results are expressed as a percentage.

** NJDEP Residential Direct Contact soil cleanup criteria for total organics

ND Not detected above stated method detection limit

TPHC Total Petroleum Hydrocarbons

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 11/6/99 Location: 752 Lab Sample ID: 4924.01(752-1)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	Not Detected	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 11/6/99 Location: 752 Lab Sample ID: 4924.01(752-1)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 11/6/99Location: 752Lab Sample ID: 4924.01(752-1)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	1.83	Not Detected	--	nle	no
62-75-9	N-nitroso-dimethylamine	0.91	Not Detected	--	20	no
62-53-3	Aniline	1.63	Not Detected	--	nle	no
111-44-4	bis(2-Chloroethyl)ether	1.28	Not Detected	--	10	no
541-73-1	1,3-Dichlorobenzene	1.19	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	1.02	Not Detected	--	75	no
100-51-6	Benzyl alcohol	1.02	Not Detected	--	nle	no
95-50-1	1,2-Dichlorobenzene	1.13	Not Detected	--	600	no
108-60-1	bis(2-chloroisopropyl)ether	1.39	Not Detected	--	300	no
621-64-7	n-Nitroso-di-n-propylamine	1.50	Not Detected	--	20	no
67-72-1	Hexachloroethane	0.97	Not Detected	--	10	no
98-95-3	Nitrobenzene	1.01	Not Detected	--	10	no
78-59-1	Isophorone	1.21	Not Detected	--	100	no
111-91-1	bis(2-Chloroethoxy)methane	1.75	Not Detected	--	nle	no
120-82-1	1,2,4-Trichlorobenzene	1.22	Not Detected	--	9	no
91-20-3	Naphthalene	1.27	Not Detected	--	nle	no
106-47-8	4-Chloroaniline	1.09	Not Detected	--	nle	no
87-68-3	Hexachlorobutadiene	0.71	Not Detected	--	1	no
91-57-6	2-Methylnaphthalene	1.08	Not Detected	--	nle	no
77-47-4	Hexachlorocyclopentadiene	1.32	Not Detected	--	50	no
91-58-7	2-Chloronaphthalene	1.01	Not Detected	--	nle	no
88-74-4	2-Nitroaniline	0.79	Not Detected	--	nle	no
131-11-3	Dimethylphthalate	1.52	Not Detected	--	7000	no
208-96-8	Acenaphthylene	0.96	Not Detected	--	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 11/6/99Location: 752Lab Sample ID: 4924.01(752-1)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	0.81	Not Detected	--	nle	no
99-09-2	3-Nitroaniline	0.79	Not Detected	--	nle	no
83-32-9	Acenaphthene	1.10	Not Detected	--	400	no
132-64-9	Dibenzofuran	1.00	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	0.87	Not Detected	--	10	no
84-66-2	Diethylphthalate	1.62	Not Detected	--	5000	no
86-73-7	Fluorene	0.99	Not Detected	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	1.10	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	1.05	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.01	Not Detected	--	20	no
103-33-3	Azobenzene	0.67	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	0.76	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	0.94	Not Detected	--	10	no
85-01-8	Phenanthrene	1.23	Not Detected	--	nle	no
120-12-7	Anthracene	1.12	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	1.70	Not Detected	--	900	no
206-44-0	Fluoranthene	1.64	Not Detected	--	300	no
92-87-5	Benidine	4.18	Not Detected	--	50	no
129-00-0	Pyrene	1.25	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.05	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	1.19	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	1.75	Not Detected	--	60	no
218-01-9	Chrysene	1.38	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	1.74	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.44	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.25	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.29	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	1.05	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	0.83	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	0.64	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	0.84	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/22/99 Location: 752 Lab Sample ID: 5042.01(Bldg 752)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	Not Detected	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/22/99 Location: 752 Lab Sample ID: 5042.01(Bldg 752)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 12/22/99Location: 752Lab Sample ID: 5042.01(Bldg 752)



CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	1.83	Not Detected	--	nle	no
62-75-9	N-nitroso-dimethylamine	0.91	Not Detected	--	20	no
62-53-3	Aniline	1.63	Not Detected	--	nle	no
111-44-4	bis(2-Chloroethyl)ether	1.28	Not Detected	--	10	no
541-73-1	1,3-Dichlorobenzene	1.19	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	1.02	Not Detected	--	75	no
100-51-6	Benzyl alcohol	1.02	Not Detected	--	nle	no
95-50-1	1,2-Dichlorobenzene	1.13	Not Detected	--	600	no
108-60-1	bis(2-chloroisopropyl)ether	1.39	Not Detected	--	300	no
621-64-7	n-Nitroso-di-n-propylamine	1.50	Not Detected	--	20	no
67-72-1	Hexachloroethane	0.97	Not Detected	--	10	no
98-95-3	Nitrobenzene	1.01	Not Detected	--	10	no
78-59-1	Isophorone	1.21	Not Detected	--	100	no
111-91-1	bis(2-Chloroethoxy)methane	1.75	Not Detected	--	nle	no
120-82-1	1,2,4-Trichlorobenzene	1.22	Not Detected	--	9	no
91-20-3	Naphthalene	1.27	Not Detected	--	nle	no
106-47-8	4-Chloroaniline	1.09	Not Detected	--	nle	no
87-68-3	Hexachlorobutadiene	0.71	Not Detected	--	1	no
91-57-6	2-Methylnaphthalene	1.08	Not Detected	--	nle	no
77-47-4	Hexachlorocyclopentadiene	1.32	Not Detected	--	50	no
91-58-7	2-Chloronaphthalene	1.01	Not Detected	--	nle	no
88-74-4	2-Nitroaniline	0.79	Not Detected	--	nle	no
131-11-3	Dimethylphthalate	1.52	Not Detected	--	7000	no
208-96-8	Acenaphthylene	0.96	Not Detected	--	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 12/22/99Location: 752Lab Sample ID: 5042.01(Bldg 752)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	0.81	Not Detected	--	nle	no
99-09-2	3-Nitroaniline	0.79	Not Detected	--	nle	no
83-32-9	Acenaphthene	1.10	Not Detected	--	400	no
132-64-9	Dibenzofuran	1.00	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	0.87	Not Detected	--	10	no
84-66-2	Diethylphthalate	1.62	Not Detected	--	5000	no
86-73-7	Fluorene	0.99	Not Detected	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	1.10	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	1.05	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.01	Not Detected	--	20	no
103-33-3	Azobenzene	0.67	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	0.76	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	0.94	Not Detected	--	10	no
85-01-8	Phenanthrene	1.23	Not Detected	--	nle	no
120-12-7	Anthracene	1.12	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	1.70	Not Detected	--	900	no
206-44-0	Fluoranthene	1.64	Not Detected	--	300	no
92-87-5	Benzidine	4.18	Not Detected	--	50	no
129-00-0	Pyrene	1.25	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.05	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	1.19	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	1.75	Not Detected	--	60	no
218-01-9	Chrysene	1.38	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	1.74	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.44	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.25	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.29	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	1.05	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	0.83	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	0.64	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	0.84	Not Detected	--	nle	no

FIGURES

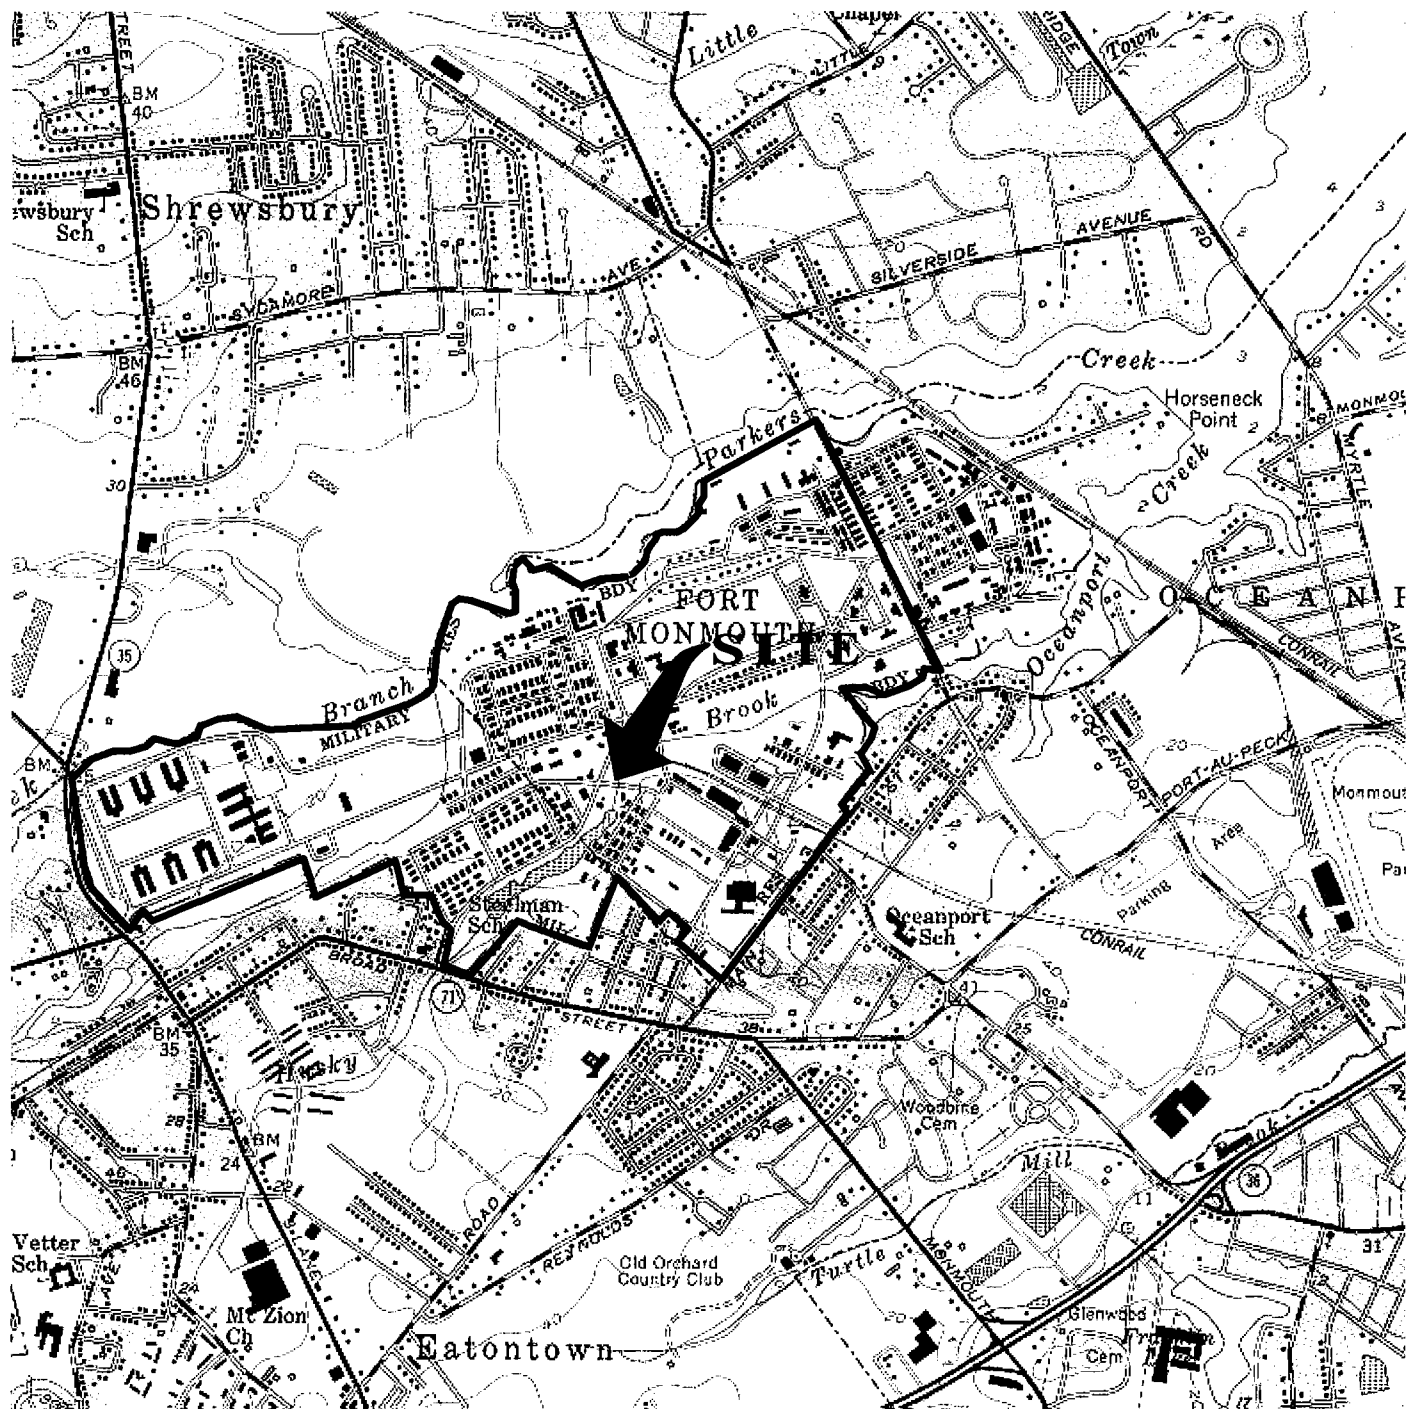

LONG BRANCH, N. J.

40073-C8-TF-024

1954

PHOTOREVISED 1981

DMA 6164 I SE-SERIES V822



QUADRANGLE LOCATION

FIGURE 1

LOCATION MAP

Building 752

Main-Post West

Fort Monmouth Army Base

Monmouth County, NJ

VERSAR

Engineers, Managers, Scientists, & Planners
Bristol, PA

Scale: 1" = 2000'

Date: APRIL 1998

Mapped, edited and published by the Geological Survey

Geologic Map of New Jersey

SEDIMENTARY ROCKS

CENOZOIC

- Holocene: sand
- Tertiary: sand, silt, clay

MESOZOIC

- Cretaceous: sand, silt, clay
- Jurassic: siltstone, shale, sandstone
- Triassic: siltstone, shale, sandstone

PALEOZOIC

- Devonian: conglomerate, sandstone,
- Silurian: conglomerate, sandstone, shale, limestone
- Ordovician: shale, limestone
- Cambrian: limestone, sandstone

IGNEOUS AND METAMORPHIC ROCKS

MESOZOIC

- Jurassic: basalt
- Jurassic: diabase

PRECAMBRIAN

- marble
- gneiss, granite

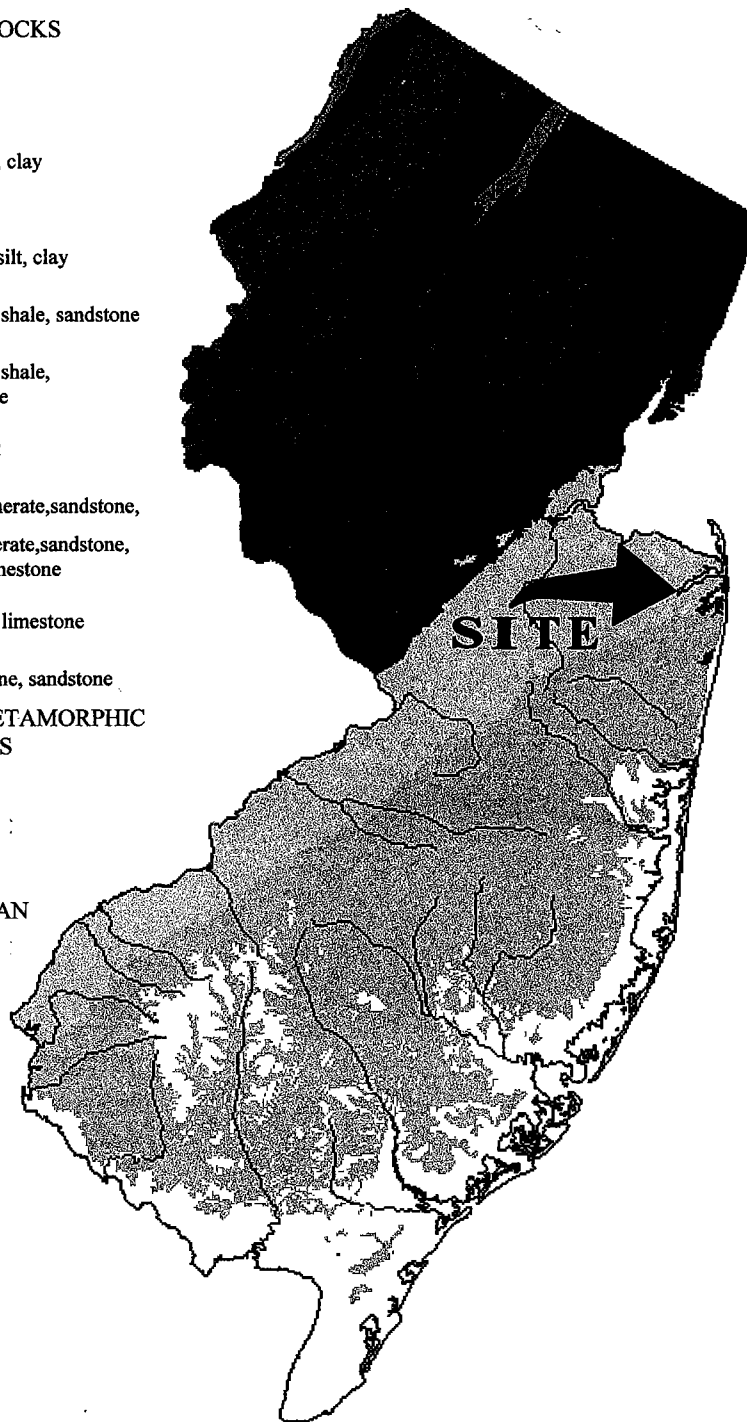


FIGURE 1A
GEOLOGICAL MAP
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
 Engineers, Managers, Scientists & Planners
 Bristol, Pennsylvania

SITE

562

752

811

NICODEMUS
AVENUE



FIGURE 2
SITE MAP
BUILDING 752
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS
BRISTOL, PA.

SCALE: 1"=100'

DATE: APRIL 1998


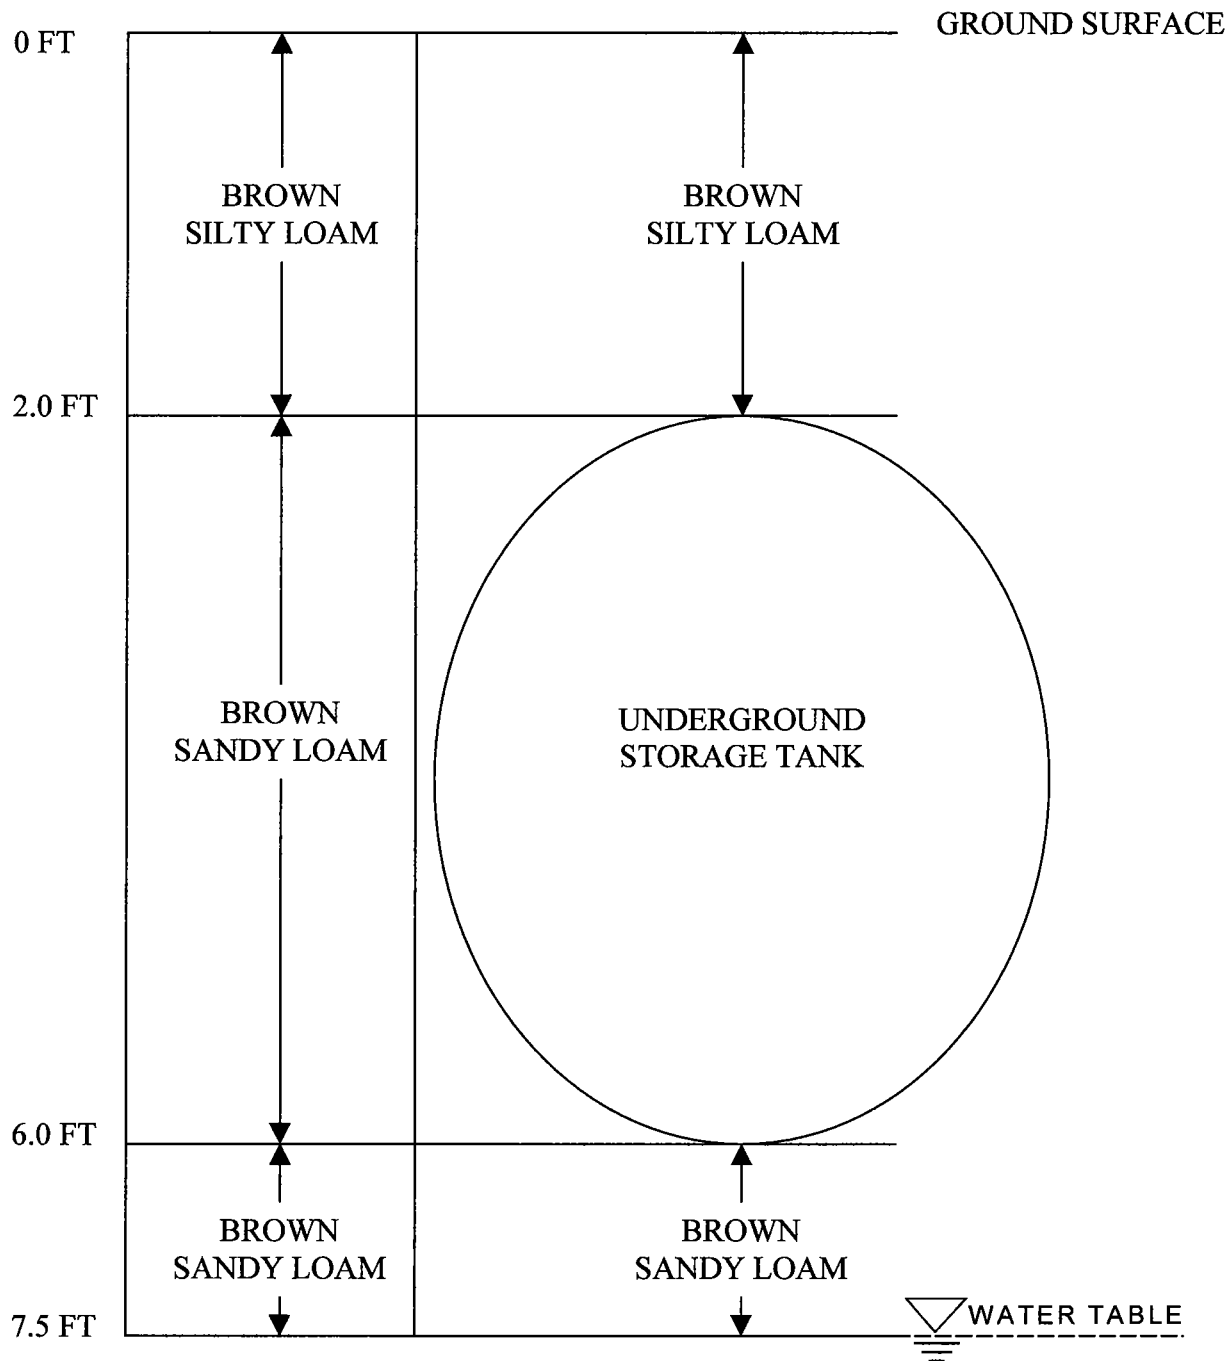


FIGURE 3
CROSS SECTIONAL VIEW
BUILDING 752
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
Engineers, Managers, Scientists & Planners
Bristol, Pennsylvania

SCALE: NTS

DATE: APRIL 1998

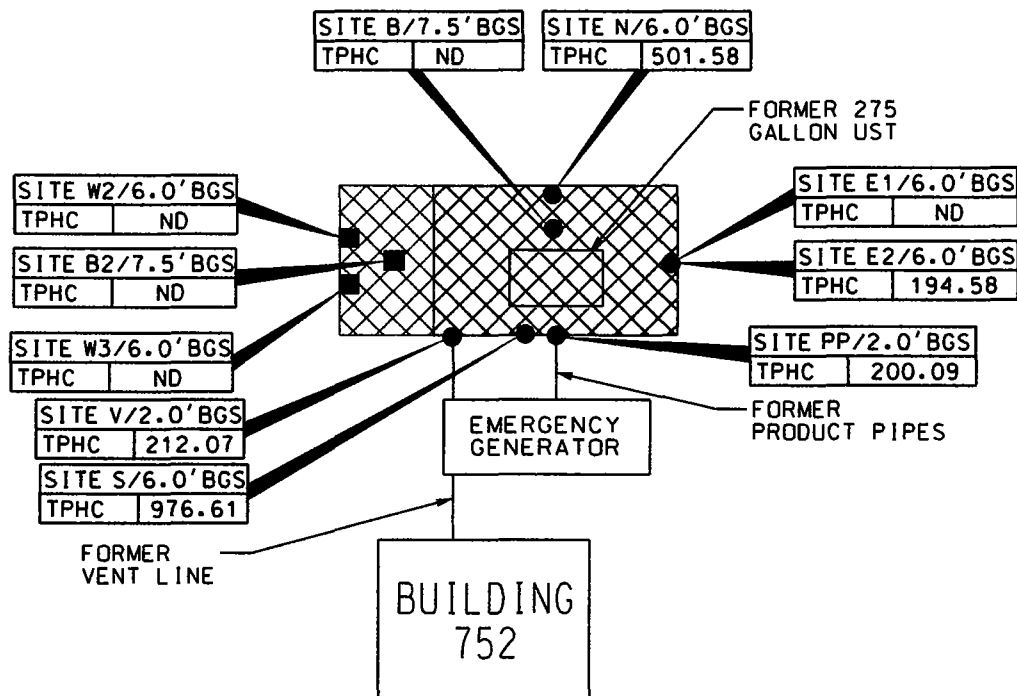

LEGEND

- SOIL SAMPLE LOCATION (APRIL 3, 1998)
- SOIL SAMPLE LOCATION (AUGUST 25, 1998)
- ▨ LIMIT OF EXCAVATION (APRIL 3, 1998)
- ▨ LIMIT OF EXCAVATION (AUGUST 25, 1998)

NOTES:

1. ALL RESULTS IN MG/KG.
2. SEE TABLE 2 FOR NJDEP SOIL CLEANUP CRITERIA
3. BGS = BELOW GROUND SURFACE


FIGURE 4
SOIL SAMPLING LOCATION MAP
BUILDING 752
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS
BRISTOL, PA.

SCALE: 1"=10'

DATE: APRIL 1998

SAMPLING LOCATION: SAMPLING DEPTH: SAMPLING DATE:	HIGHER OF NJDEP GWQS AND POL	BLDG 752 11/6/99	BLDG 752 12/22/99
VOLATILE ORGANIC COMPOUNDS:		ND	ND
SEMIVOLATILE ORGANIC COMPOUNDS:		ND	ND

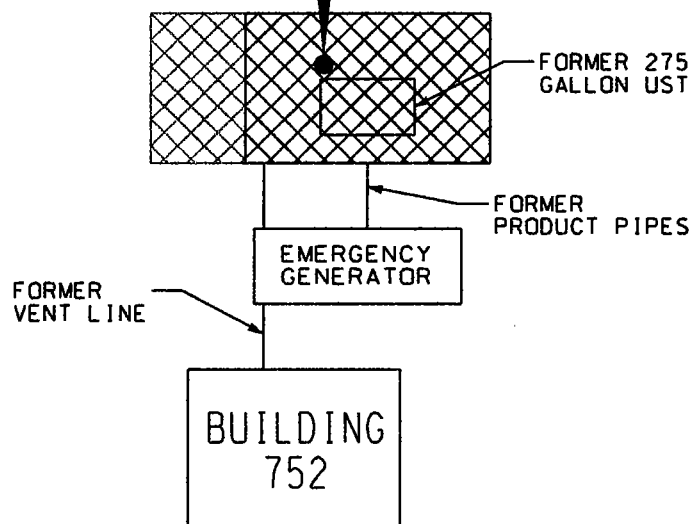

LEGEND

- GROUNDWATER SAMPLE LOCATION
(NOVEMBER 6, 1999 AND DECEMBER 22, 1999)
- ▨ LIMIT OF EXCAVATION
(APRIL 3, 1998)
- ▨ LIMIT OF EXCAVATION
(AUGUST 25, 1998)

NOTES:

1. ND=INDICATES COMPOUND NOT DETECTED
2. NLE= NO LIMIT ESTABLISHED
3. ALL RESULTS IN UG/L
4. BGS = BELOW GROUND SURFACE

FIGURE 5
GROUNDWATER SAMPLING MAP
BUILDING 752
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS
BRISTOL, PA.

SCALE: 1"=10'

DATE: APRIL 1998

APPENDIX A

NJDEP-STANDARD REPORTING FORM

<u>STATUS</u>	<u>COMCODE</u>
<u>Active Inactive</u>	
☐ ☐	

8. Total number of regulated underground storage tanks at facility

--	--	--	--

 (Complete Section B for each tank)

10. Facility Type: A ☐ State B ☐ Commercial/Industrial C ☐ County/Municipal Federal D ☐ Charitable / Public School Residence E ☐ F ☐ Other Farm (as defined in N.J.S.A. 54:4-23.1 et seq.) G ☐ H

11. Is a copy of the facility site plan submitted with this registration pursuant to N.J.A.C. 7:14B-2? ☐ YES ☐ NO

SECTION B - SPECIFIC TANK INFORMATION

ALL underground tanks, including those taken out of operation (UNLESS THE TANK WAS REMOVED FROM THE GROUND PRIOR TO 9/3/86) must be registered. Report all tank/piping status changes unless previously submitted.

1. Tank Identification Number	TANK NO.			TANK NO.			TANK NO.			TANK NO.			TANK NO.		
2. CAS Number (hazardous substances only)															
3. Date Tank Installed (Month/Day/Year)	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year
4. Tank Size (gallons)															
5. Tank Contents (Mark one "X" for each tank)															
A. Leaded gasoline															
B. Unleaded gasoline															
C. Alcohol enriched gasoline															
D. Light diesel fuel (No. 1-D)															
E. Medium diesel fuel (No. 2-D)															
F. Waste Oil															
G. Kerosene (No. 1)															
H. Home heating oil (No. 2)															
J. Heating oil (No. 4)															
K. Heavy heating oil (No. 6)															
L. Aviation fuel															
M. Motor oil															
N. Lubricating oil															
P. Sewage															
Q. Sewage sludge															
R. Other hazardous substances (specify)															
S. Hazardous waste (specify ID number)															
T. Mixtures (please specify)															
U. Emergency spill tank (specify substance)															
V. Other petroleum products (please specify)															
W. Other (please specify)															
6. Tank & Piping Construction (Mark one each for both tank & piping)	Tank	Piping		Tank	Piping		Tank	Piping		Tank	Piping		Tank	Piping	
A. Bare Steel															
B. Cathodically protected steel															
C. Fiberglass-coated steel															
D. Fiberglass-reinforced plastic															
E. Internally lined															
F. Other (please specify)															
7. Tank & Piping Structure (Mark one each for both tank & piping)	Tank	Piping		Tank	Piping		Tank	Piping		Tank	Piping		Tank	Piping	
A. Single wall															
B. Double wall															
C. Other (please specify)															
8. Type of Monitoring/Detection System (Mark all that apply for both tank & piping)	Tank	Piping		Tank	Piping		Tank	Piping		Tank	Piping		Tank	Piping	
A. Statistical Inventory Reconciliation															
B. Manual Tank Gauging															
C. Inventory Control															
D. Interstitial															
E. Precision Test															
F. Ground water observation wells															
G. Vapor observation wells															
H. In-tank (automatic) monitoring gauge															
J. Periodic Tank Test															

Tank Identification Number	TANK NO.	TANK NO.	TANK NO.	TANK NO.	TANK NO.							
8. Type of Monitoring/Detection System	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping		
K. None	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐		
L. Other (please specify)												
9. Overfill Protection (tank only)												
(Mark one X for each tank)												
A. Yes	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐		
B. No	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐		
10. Spill Containment Around Fill Pipe												
(Mark one X for each tank)												
A. Yes	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐		
B. No	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐		
11. Tank Status (Mark one X for each tank)	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping		
A. In-use	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐		
B. Empty less than 12 months	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐		
C. Empty 12 months or more	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐		
D. Emergency spill tank (sump)	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐		
E. Emergency backup generator tank	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐		
F. Abandoned in Place	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐		
G. Removed	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐		
H. Other (please specify)												
12. If box 11B, C, or D above has been marked, indicate the estimated date last used (month/day/year)	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year
13. Closure Information - Tank ID No.	TANK NO.	TANK NO.	TANK NO.	TANK NO.	TANK NO.							
	0202											
	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year
A. Date abandoned in place												
B. Date taken temporarily out of service												
C. Date removed	04	02	1998									
D. Date of Sale or Transfer												
E. TMS # (if applicable)												
F. ISRA # (if applicable)												

SECTION C - FINANCIAL RESPONSIBILITY

Does this facility have a Financial Responsibility Assurance Mechanism as required in 40 CFR 280? ☐ YES ☐ NO
Please list the appropriate financial information below:

Type	Carrier / Issuing Agency
Effective Date	Expiration Date
Policy Number	Amount

SECTION D - MONITORING SYSTEMS

Does this facility have a release detection monitoring system which is in compliance with N.J.A.C. 7:14B-6? ☐ YES ☐ NO
If "No", please be aware that the facility must meet the appropriate deadline. (See "Dates to Know" on Page 4)

SECTION E - RECORDKEEPING/COMPLIANCE

Please answer all the questions in this section on a facility basis. Any one tank not in compliance requires a "NO" answer for the entire facility.

- Does this facility have cathodic protection systems for all steel tanks and piping?
If "Yes", are the systems properly operated and maintained pursuant to N.J.A.C. 7:14B-5? ☐ YES ☐ NO
- Are the performance claims and documentation of monitoring systems maintained by the owner or operator pursuant to N.J.A.C. 7:14B-5? ☐ YES ☐ NO
- Are the proper monitoring, testing, sampling, repair and inventory records kept on-site pursuant to N.J.A.C. 7:14B-5 and 6? ☐ YES ☐ NO
- Is the proper Release Response Plan kept on-site pursuant to N.J.A.C. 7:14B-5? ☐ YES ☐ NO
- Does the facility have spill and over fill protection systems pursuant to N.J.A.C. 7:14B-4? ☐ YES ☐ NO
- Have all Fill Ports been permanently marked as per API #1637 pursuant to N.J.A.C. 7:14B-5? ☐ YES ☐ NO

IMPORTANT INFORMATION

FEE: Please make checks payable to: "Treasurer, State of New Jersey". Use of the enclosed return envelope will expedite processing. Registration and Billing Schedule can be found in N.J.A.C. 7:14B.
All Initial Registration fees are \$100 per facility.

PENALTY: Failure by owner or operator of a regulated underground storage tank to comply with any requirement of the State UST Act or regulations may result in the penalties set forth in N.J.S.A. 58:10A-10.

EMERGENCY: If a discharge or spill occurs, the NJDEP Hotline at (609) 292-7172 must be called IMMEDIATELY - 24 hours a day.

UPGRADE EXEMPTION: Residential heating oil underground storage tanks are exempt from all upgrade requirements.

DATES TO KNOW (critical deadlines)

December 22, 1988 — All new federally regulated tank systems must have cathodic protection and spill/overfill protection.
September 4, 1990 — All new State-only regulated tank systems must have cathodic protection and spill/overfill protection.
December 22, 1990 — All federally regulated piping must have begun leak detection.
February 19, 1993 — All federally regulated tank systems must maintain financial responsibility assurance.
December 22, 1993 — All federally regulated tank systems must have begun leak detection.
December 22, 1998 — All regulated tanks shall install cathodic protection and spill/overfill protection.

CERTIFICATIONS

NOTE: IF THE PERSON SIGNING CERTIFICATION NO. 2 IS THE SAME AS THE PERSON SIGNING CERTIFICATION NO. 1, THEN CERTIFICATION NO. 2 NEED NOT BE SIGNED. (If different persons are required to sign No. 1 and No. 2, then they must do so.)

CERTIFICATION NO. 1:

Must be signed by the highest ranking individual at the facility with overall responsibility

"I certify under penalty of law that the information provided in this document is true, accurate and complete to the best of my knowledge, information and belief. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

James Ott

(Typed / Printed Name)

Director

(Title)

JAMES OTT

DIRECTOR, PUBLIC WORKS

(Signature)

4/15/90

(Date)

CERTIFICATION NO. 2:

Must be signed as follows:

- For a corporation, by a principal executive officer of at least the level of vice president
- For a partnership or sole proprietorship, by a general partner or the proprietor, respectively
- For a municipality, State, Federal or other public agency, by either a principal executive officer or ranking elected official
- For persons other than indicated above, by the person with legal responsibility for the site

"I certify under penalty of law that I have personally examined and am familiar with the information submitted herein and all attached documents, and that based on my inquiry of those individuals immediately responsible for obtaining the information. I believe that the submitted information is true, accurate and complete. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

(Typed / Printed Name)

(Signature)

(Title)

(Date)

CERTIFICATION NO. 3:

If applicable, must be signed by the individual who is certified to perform services.

"I certify under penalty of law that the information provided in this document is true, accurate and complete to the best of my knowledge, information and belief. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

David H. Daniels

(Typed / Printed Name)

(Title)

SM Environmental Services Group

(Name of Firm, if applicable)

David H. Daniels

(Signature)

4.2.98

(Date)

10279

(N.J. Certification Number)

APPENDIX B

SITE ASSESSMENT SUMMARY

Site Remediation Program

UST Site/Remedial Investigation Report Certification Form

A. Facility Name : U.S. Army Fort Monmouth New JerseyFacility Street Address : Directorate of Public Works Building 173Municipality: Oceanport County : MonmouthBlock: _____ Lot(s): _____ Telephone Number : 732-532-6224**B. Owner (RP)'s Name:** _____

Street Address: _____ City : _____

State: _____ Zip: _____ Telephone Number : _____

C. (Check as appropriate)


- ☐ Site Investigation
 Report (SIR) \$500 Fee
- ☐ Remedial Investigation
 Report (RIR) \$1000 Fee

☒ NA – Federal Agreement**D. (Complete all that apply)**

- Assigned Case Manager : Ian Curtis, Federal Case Manager
- UST Registration Number : 81533-202 (7 digits)
- Incident Report Number 98 – 04 – 03 – 1315 – 37 (10 or 12 digits)
- Tank Closure Number : Federal Case Manager

E. Certification by the Subsurface Evaluator:

The attached report conforms to the specific reporting requirements of N.J.A.C. 7:26EYes No

Name: Dinker Desai Signature:  UST Cert. No.: 10173Firm: U.S. Army Fort Monmouth Firm's UST Cert. Number: NA-U.S. ArmyFirm Address: Directorate of Public Works Building 173 City: Fort MonmouthState: NJ Zip: 07703 Telephone Number : 732-532-6224


(NOTE: Certification numbers required only if work was conducted on USTs regulated per N.J.S.A. 58:10A-21 et seq.)

F. Certification by the Responsible Party(ies) of the Facility:

The following certification shall be signed [according to the requirements of N.J.A.C. 7:14B-1.7(b)] as follows:

- For a Corporation by a person authorized by a resolution of the board of directors to sign the document. A copy of the resolution, certified as a true copy by the secretary of the corporation, shall be submitted along with the certification; or
- For a partnership or sole proprietorship, by a general partner or the proprietor, respectively; or
- For a municipality, State, federal or other public agency by either a principal executive officer or ranking elected Official.

"I certify under penalty of law that I have personally examined and am familiar with the information submitted in this application and all attached documents, and that based on my inquiry of those individuals responsible for obtaining the information, I believe that the submitted information is true, accurate, and complete. I am aware that there are significant civil penalties for knowingly submitting false, inaccurate, or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

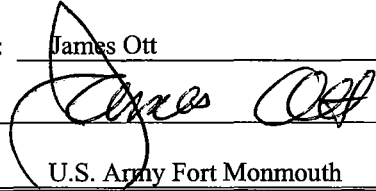Name (Print or Type): James Ott Title: Directorate of Public WorksSignature: Company Name: U.S. Army Fort MonmouthDate: 9/14/00

APPENDIX C

WASTE MANIFEST

CUSTOMER

**NON-HAZARDOUS
WASTE MANIFEST**

1. Generator's US EPA ID No.

NJ3210030324

Manifest
Document No.

2. Page 1
of 1

NHZ 009956

3. Generator's Name and Mailing Address

U.S. ARMY COMMUNICATIONS ELECTRONICS COMMAND
210 JOSEPH FALLON BLVD 173 ATTN SELF M - PW - EV
FT MONMOUTH NJ 07703

4. Generator's Phone

(732) 532-6223

5. Transporter 1 Company Name

6. US EPA ID Number

A. Transporter's Phone

7. Transporter 2 Company Name

8. US EPA ID Number

B. Transporter's Phone

9. Designated Facility Name and Site Address

10. US EPA ID Number

C. Facility's Phone

ENVIRONMENTAL SERVICES INC
OLD BRIDGE NJ 08857

088 384-0000

11. Waste Shipping Name and Description

12. Containers
No. Type

13. Total
Quantity

14. Unit
Wt/Vol

a. **ARMY COMMUNICATIONS ELECTRONICS COMMAND**
ENVIRONMENTAL SERVICES INC

XX 330

b.				
c.				
d.				

D. Additional Descriptions for Materials Listed Above

UNTESTED 10

E. Handling Codes for Wastes Listed Above

FOR INFORMATION

15. Special Handling Instructions and Additional Information

TEST 187063 FOR ARMY COMMUNICATIONS ELECTRONICS COMMAND
UNTESTED FOR INFORMATION PURPOSES ONLY
N/A

16. GENERATOR'S CERTIFICATION: I certify the materials described above on this manifest are not subject to federal regulations for reporting proper disposal of Hazardous Waste.

Printed/Typed Name

Joseph M. Fallon

Signature

Joseph M. Fallon Month **14** Day **12** Year **1988**

17. Transporter 1 Acknowledgement of Receipt of Materials

Printed/Typed Name

GARY LOBELLE

Signature

GARY LOBELLE

Month **14** Day **12** Year **1988**

18. Transporter 2 Acknowledgement of Receipt of Materials

Printed/Typed Name

Signature

Month Day Year

19. Discrepancy Indication Space

20. Facility Owner or Operator: Certification of receipt of waste materials covered by this manifest except as noted in Item 19.

Printed/Typed Name

Signature

Month Day Year

GENERATOR'S COPY

APPENDIX D

UST DISPOSAL CERTIFICATE



Reorder From:
The Drawing Board
P.O. Box 2944 • Hartford, CT 06104-2944
Call Toll Free: 1-800-527-6539

REORDER ITEM # BLN74

STRAIGHT BILL OF LADING
ORIGINAL - NOT NEGOTIABLE

Shipper No. 002

Carrier No. _____

Date _____

SMC ENVIRONMENTAL SERVICES GROUP

(Name of Carrier)

To: Red Bank Recycling	From: Fort Monmouth (U.S. Army)
Street: 64 Central Ave	Street: Building 752
Destination: Red Bank NJ	Origin: Oceanport, N.J.
Zip Code: 07701	

No. Shipping Unit	Unit	Kind of Packaging, Description of Articles, Special Marks and Symbols	Weight (Subject to Correction)	RATE	CHARGES
①		For SERAP only 1 - 275 Gallon U.S.T. Skid "Clean"			
		TANK # 81533-202 Building # 752			

REMIT C.O.D. TO: ADDRESS	COD Amt: \$	C.O.D. FFE: PREPAID ☐ \$ COLLECT ☐ TOTAL CHARGES: \$
NOTE - Where the rate is dependent on value, shippers are required to state specifically in writing the agreed or declared value of the property. The agreed or declared value of the property is hereby specifically stated by the shipper to be not exceeding:	This is to certify that the above named material is the property classified, described, packed and marked and insured, and is in proper condition for transportation according to the applicable regulations of the Department of Transportation.	Subject to Section 7 of the conditions, this document is to be delivered to the consignee without recourse on the carrier's, the carrier shall assume the following statement: The carrier shall not make delivery of the shipment without payment of freight and all other lawful charges.
Signature _____	Signature _____	Signature _____

RECEIVED, subject to the classifications and tariffs in effect on the date of the issue of this Bill of Lading, the property described above is apparent good order, except as noted (contents and condition of contents of packages unknown, received, consigned, and destined as indicated above which said carrier (the word carrier being understood throughout this contract as meaning any person or corporation in possession of the property under the contract) agrees to carry to its usual place of delivery at said destination, if on its route, otherwise to deliver to another carrier on the route to said destination. It is mutually agreed as to each carrier of all or any of, said property over all or any portion of said route to destination and as to each party at any time interested in all or any of said property, that every service to be performed hereunder shall be subject to all the bill of lading terms and conditions in the governing classification and the said terms and conditions are hereby agreed to by the shipper and accepted for himself and his assigns.

SHIPPER Fort Monmouth (U.S. Army)	CARRIER SMC ENVIRONMENTAL SERVICES GROUP
PER _____	PER Mark C. Smith
	DATE 5/1/98

*Mark with "X" to designate Hazardous Materials defined in Title 49 of the Code of Federal Regulations.

Reorder Item #BLN74 The Drawing Board, P.O. Box 2944, Hartford, CT 06104-2944
©EGL, 1992, Printed in U.S.A.

FROM JMT ENVIRON. TECH 610 759 6149

1995 8:52PM

908-747-7784
908-747-7779

Red Bank Recycling Auto Wreckers, Inc.
64 Central Avenue, Red Bank, New Jersey 07701

Date 5/1 19 78

M

Yellow Dump Truck

	AMOUNT	CWT	TOTAL
☒ LIGHT IRON	5.60		5.60
NO. 1 STEEL			
NO. 2 STEEL			
D. M. B.			
CAST IRON			
COPPER			
BRASS			
ALUMINUM			
RADIATORS			
BATTERIES			
3 500 TANKS SCRAP			
CARS			

I am the owner of said vehicle(s) and I release it to Red Bank Recycling Auto Wreckers, Inc.

Signature of Owner

Mark C. Smith

APPENDIX E

SOIL ANALYTICAL DATA PACKAGE

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

REPORT OF ANALYSIS

Client: U.S. Army
DPW, SELFM-PW-EV
Bldg. 173
Ft. Monmouth, NJ 07703

Project: Total Petroleum Hydrocarbons
98-0779
Bldg. 752
Tetra Tech - BRAC

Project # 3454
Date Rec. 04/03/98
Date Compl. 04/04/98
Released by:



Daniel K. Wright
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Cover Sheet	1
Table of Contents	2
Method Summary	3
Conformance/Non-Conformance	4
Chain of Custody	5
Results Summary	6
Initial Calibration Summary	7
Continuing Calibration Summary	8-9
Surrogate Results Summary	10
MS/MSD Results Summary	11
Quality Control Spike Summary	12
Raw Sample Data	13-28
Laboratory Deliverable Checklist	29

Method Summary

NJDEP Method OQA-QAM-025-10/97

Gas Chromatographic Determination of Total Petroleum Hydrocarbons in Soil

Fifteen grams (15g)(wet weight) of a soil sample is added to a 125 mL acid cleaned, solvent rinsed, capped Erlenmeyer flask. 15g anhydrous sodium sulfate is added to dry sample. Surrogate standard spiking solution is then added to the flask.

Twenty five milliliters(25mL) Methylene Chloride is added to the flask and it is secured on a gyrotory shaker table. The agitation rate is set to 400rpm and the sample is shaken for 30 minutes. The flask is the removed from the table and the particulate matter is allowed to settle. The extract is transferred to a Teflon capped vial. A second 25mL of Methylene Chloride is added to the flask and shaken for an additional 30 minutes. The flask is again removed and allowed to settle. The extracts are combined in the vial then transferred to a 1mL autosampler vial.

The extract is then injected directly into a GC-FID for analysis. The sample is analyzed for petroleum hydrocarbons covering a range of C8-C42 including pristane and phytane. Total Petroleum Hydrocarbon concentration is determined by integrating between 5 minutes and 22 minutes. The baseline is established by starting the integration after the end of the solvent peak and stopping after the last peak.

The final concentration of Total Petroleum Hydrocarbons is calculated using percent solid, sample weight and concentration.

PHC Conformance/Non-conformance Summary Report

	<u>No</u>	<u>Yes</u>
1. Method Detection Limits provided.	<u> </u>	<u> </u> ✓
2. Method Blank Contamination - If yes, list the sample and the corresponding concentrations in each blank. _____ _____	✓ <u> </u>	<u> </u>
3. Matrix Spike Results Summary Meet Criteria. (If not met, list the sample and corresponding recovery which falls outside the acceptable range). _____ _____	<u> </u>	✓ <u> </u>
4. Duplicate Results Summary Meet Criteria. (If not met, list the sample and corresponding recovery which falls outside the acceptable range). _____ _____	<u> </u>	✓ <u> </u>
5. IR Spectra submitted for standards, blanks, & samples	<u> </u>	<u> </u> NA <u> </u>
6. Chromatograms submitted for standards, blanks, and samples if GC fingerprinting was conducted.	<u> </u>	<u> </u> ✓ <u> </u>
7. Analysis holding time met. (If not met, list number of days exceeded for each sample) _____ _____	<u> </u>	✓ <u> </u>
Additional Comments: _____ _____ _____		

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW 846 for Solid Waste Analysis. I have personally examined the information contained in this report, and to the best of my knowledge, I believe that the submitted information is true, accurate, complete, and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.

Daniel K. Wright
Laboratory Manager

4



Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-3484 EMail:appleby@doim6.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record


Report of Analysis
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification # 13461

Client : U.S. Army **Lab. ID # :** 3454
 DPW. SELFM-PW-EV **Date Rec'd:** 03-Apr-98
 Bldg. 173 **Analysis Start:** 03-Apr-98
 Ft. Monmouth, NJ 07703 **Analysis Complete:** 04-Apr-98

Analysis: OQA-QAM-025 **UST Reg. #:**
Matrix: Soil **Closure #:**
Analyst: D.DEINHARDT **DICAR #:**
Ext. Meth: Shake **Location #:** 752

Sample	Field ID	Dilution Factor	Weight (g)	% Solid	MDL (mg/kg)	TPHC Result (mg/kg)
3454.01	752-B-7.5	1.00	15.87	74.64	198	ND
3454.02	752-S-6	1.00	15.71	71.73	209	976.61
3454.03	752-E2-6	1.00	15.69	77.38	194	194.58
3454.04	752-E-6	1.00	15.45	80.45	189	ND
3454.05	752-N-6	1.00	15.45	82.41	185	501.58
3454.06	752-W-6	2.00	15.18	83.00	187	19977.71
3454.07	752-V-2	1.00	15.76	84.43	177	212.07
3454.08	752-PP-2	1.00	15.49	82.06	185	200.09
METHOD BLANK	3-Apr-98	1.00	15.00	100.00	157	ND

ND = Not Detected
 MDL = Method Detection Limit


 Daniel K. Wright
 Laboratory Director

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted
2. Table of Contents submitted
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted
4. Document paginated and legible
5. Chain of Custody submitted
6. Samples submitted to lab within 48 hours of sample collection
7. Methodology Summary submitted
8. Laboratory Chronicle and Holding Time Check submitted
9. Results submitted on a dry weight basis
10. Method Detection Limits submitted
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP

✓
✓
✓
✓
✓
✓
✓
✓
✓
✓
✓

Laboratory Manager or Environmental Consultant's Signature

Date 9/15/98

Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

REPORT OF ANALYSIS

Client: U.S. Army
DPW, SELFM-PW-EV
Bldg. 173
Ft. Monmouth, NJ 07703

Project: Total Petroleum Hydrocarbons
98-0932
Bldg. 752
SMC

Project # 3826
Date Rec. 08/25/98
Date Compl. 08/26/98
Released by:


Daniel K. Wright Date: 10/5/98
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Cover Sheet	1
Table of Contents	2
Method Summary	3
Conformance/Non-Conformance	4
Laboratory Authentication Statement	4
Chain of Custody	5
Results Summary	6
Initial Calibration Summary	7 7
Continuing Calibration Summary	13-16 8-11
Surrogate Results Summary	17 12
MS/MSD Results Summary	18 13
Blank Spike Summary	19 14
Raw Sample Data	19A-25 15-22
Laboratory Deliverable Checklist	26 23

Method Summary

NJDEP Method OQA-QAM-025-10/97

Gas Chromatographic Determination of Total Petroleum Hydrocarbons in Soil

Fifteen grams (15g)(wet weight) of a soil sample is added to a 125 mL acid cleaned, solvent rinsed, capped Erlenmeyer flask. 15g anhydrous sodium sulfate is added to dry sample. Surrogate standard spiking solution is then added to the flask.

Twenty five milliliters(25mL) Methylene Chloride is added to the flask and it is secured on a gyrotory shaker table. The agitation rate is set to 400rpm and the sample is shaken for 30 minutes. The flask is the removed from the table and the particulate matter is allowed to settle. The extract is transferred to a Teflon capped vial. A second 25mL of Methylene Chloride is added to the flask and shaken for an additional 30 minutes. The flask is again removed and allowed to settle. The extracts are combined in the vial then transferred to a 1mL autosampler vial.

The extract is then injected directly into a GC-FID for analysis. The sample is analyzed for petroleum hydrocarbons covering a range of C8-C42 including pristane and phytane. Total Petroleum Hydrocarbon concentration is determined by integrating between 5 minutes and 22 minutes. The baseline is established by starting the integration after the end of the solvent peak and stopping after the last peak.


The final concentration of Total Petroleum Hydrocarbons is calculated using percent solid, sample weight and concentration.

PHC Conformance/Non-conformance Summary Report


	No	Yes
1. Method Detection Limits provided.	—	✓
2. Method Blank Contamination - If yes, list the sample and the corresponding concentrations in each blank	✓	—
3. Matrix Spike Results Summary Meet Criteria. (If not met, list the sample and corresponding recovery which falls outside the acceptable range).	—	✓
4. Duplicate Results Summary Meet Criteria. (If not met, list the sample and corresponding recovery which falls outside the acceptable range).	—	✓
5. IR Spectra submitted for standards, blanks, & samples	—	NA —
6. Chromatograms submitted for standards, blanks, and samples if GC fingerprinting was conducted.	—	✓
7. Analysis holding time met. (If not met, list number of days exceeded for each sample)	—	✓
Additional Comments:		

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW 846 for Solid Waste Analysis. I have personally examined the information contained in this report, and to the best of my knowledge, I believe that the submitted information is true, accurate, complete, and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.

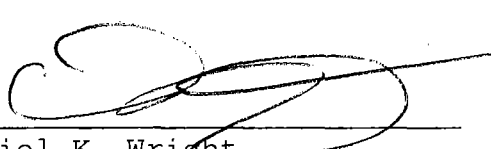

Daniel K. Wright
Laboratory Manager

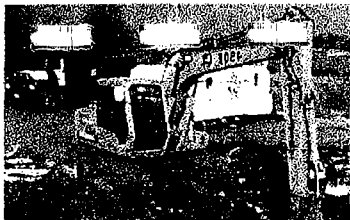

Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-3484 EMail:appleby@doim6.mourmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

[illegible]

Report of Analysis
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification # 13461

Client :	U.S. Army	Lab. ID # :	3826
	DPW. SELFM-PW-EV	Date Rec'd:	25-Aug-98
	Bldg. 173	Analysis Start:	25-Aug-98
	Ft. Monmouth, NJ 07703	Analysis Complete:	26-Aug-98

Analysis:	OQA-QAM-025	UST Reg. #:	
Matrix:	Soil	Closure #:	
Analyst:	D.DEINHARDT	DICAR #:	
Inst. ID.	GC TPHC INST. #1	Injection Volume	1 ul
Column Type	RTX 5	Column ID	0.32 um
Ext. Meth:	Shake	Location #:	BLDG. 752

Sample	Field ID	Dilution Factor	Weight (g)	% Solid	MDL (mg/kg)	TPHC Result (mg/kg)
3826.01	752-B2(7.5')	1.00	15.11	80.62	193	ND
3826.02	752-W2(6')	1.00	15.27	79.98	192	ND
3826.03	752-W3(6')	1.00	15.27	82.95	186	ND
METHOD BLANK	TBLK 153	1.00	15.00	100.00	157	ND

ND = Not Detected

MDL = Method Detection Limit


 Daniel K. Wright
 Laboratory Director

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted ☒
2. Table of Contents submitted ☒
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted ☒
4. Document paginated and legible ☒
5. Chain of Custody submitted ☒
6. Samples submitted to lab within 48 hours of sample collection ☒
7. Methodology Summary submitted ☒
8. Laboratory Chronicle and Holding Time Check submitted ☒
9. Results submitted on a dry weight basis ☒
10. Method Detection Limits submitted ☒
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP ☒

Laboratory Manager or Environmental Consultant's Signature

Date 10/6/98

Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance.

APPENDIX F

GROUNDWATER ANALYTICAL DATA PACKAGE

FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732) 532-6224 FAX: (732) 532-6263

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

CERTIFICATIONS: NJDEP #13461, NYSDOH #11699



ANALYTICAL DATA REPORT
Fort Monmouth Environmental Laboratory
ENVIRONMENTAL DIVISION
Fort Monmouth, New Jersey
PROJECT: UST Program

Bldg. 752

Field Sample Location	Laboratory Sample ID#	Matrix	Date and Time of Collection	Date Received
752-1	4924.01	Aqueous	06-Nov-99 12:45	11/08/99

ANALYSIS:
FORT MONMOUTH ENVIRONMENTAL LAB
VOA+15, BN+15

ENCLOSURE:
CHAIN OF CUSTODY
RESULTS

 4-7-00
Daniel Wright/Date
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Chain of Custody	1-2
Methodology Summary	3-4
Conformance/Non-Conformance Summary	5-7
Laboratory Chronicle	8-9
Volatile Organics	10-11
Analytical Results Summary	12-15
Tune Results Summary	16-17
Method Blank Results Summary	18
Calibration Summary	19
Surrogate Recovery Summary	20
MS/MSD Results Summary	21-22
Internal Standard Area & RT Summary	23
Chromatograms	24-27
Base Neutrals	28
Analytical Results Summary	29-34
Tune Results Summary	35-38
Method Blank Results Summary	39
Calibration Summary	40-43
Surrogate Recovery Summary	44
MS/MSD Results Summary	45-48
Internal Standard Area & RT Summary	49-52
Chromatograms	53-56
Laboratory Deliverables Checklist	57
Laboratory Authentication Statement	58

CHAIN OF CUSTODY

000001



Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-6263 EMail:appleby@mail1.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

[illegible]

METHOD SUMMARY

000003

Methodology Summary

EPA Method 624

Gas Chromatographic Determination of Volatiles in Water

Surrogates and internal standards are added to a 5 ml aliquot of sample. The sample is then purged and desorbed into a GC/MS system. The organic compounds are separated by the gas chromatograph and detected using the mass spectrometer. Volatiles are identified and quantitated.

EPA Method 3510/8270

Gas Chromatographic Determination of Semi-volatiles in Water

Surrogates are added to a measured volume of sample, usually 1 liter, at a specified pH. The sample is serially extracted with Methylene Chloride using a separatory funnel. The extract concentrated and internal standards are added. The sample is injected into a GC/MS system. Semi-volatiles are identified and quantitated.

CONFORMANCE/NON- CONFORMANCE SUMMARY

000005

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT

Indicate
Yes, No, N/A

1. Chromatograms labeled/Compounds identified
(Field samples and method blanks) Yes
2. Retention times for chromatograms provided Yes
3. GC/MS Tune Specifications
 - a. BFB Meet Criteria Yes
 - b. DFTPP Meet Criteria Yes
4. GC/MS Tuning Frequency – Performed every 24 hours for 600 series and 12 hours for 8000 series Yes
5. GC/MS Calibration – Initial Calibration performed before sample analysis and continuing calibration performed within 24 hours of sample analysis for 600 series and 12 hours for 8000 series Yes
6. GC/MS Calibration requirements
 - a. Calibration Check Compounds Meet Criteria Yes
 - b. System Performance Check Compounds Meet Criteria Yes
7. Blank Contamination – If yes, List compounds and concentrations in each blank: NO
 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction _____
8. Surrogate Recoveries Meet Criteria Yes

If not met, list those compounds and their recoveries, which fall outside the acceptable range:

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction _____

If not met, were the calculations checked and the results qualified as "estimated"?

9. Matrix Spike/Matrix Spike Duplicate Recoveries Meet Criteria Yes

(If not met, list those compounds and their recoveries, which fall outside the acceptable range)

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction _____

000006

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT (cont.)

Indicate
Yes, No, N/A

10. Internal Standard Area/Retention Time Shift Meet Criteria
(If not met, list those compounds, which fall outside the acceptable range)

Yes

- a. VOA Fraction _____
b. B/N Fraction _____
c. Acid Fraction _____

11. Extraction Holding Time Met

Yes

If not met, list the number of days exceeded for each sample: _____

12. Analysis Holding Time Met

Yes

If not met, list the number of days exceeded for each sample: _____

Additional Comments:

Laboratory Manager: _____

Date: 4-7-00

000007

LABORATORY CHRONICLE

000008

Laboratory Chronicle

Lab ID: 4924

Site: Bldg. 752

	Date	Hold Time
Date Sampled	11/06/99	NA
Receipt/Refrigeration	11/06/99	NA

Extractions

1. Base Neutral	11/09/99	14 days
-----------------	----------	---------

Analyses

1. Volatile Organics	11/10,11/99	14 days
2. Base Neutral	11/12/99	40 Day

*Samples collected and refrigerated on 11/06/99, Laboratory received the samples Monday 11/08/99.

000009

VOLATILE ORGANICS

000010

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

Definition of Qualifiers

MDL : Method Detection Limit
J : Compound identified below detection limit
B : Compound in both sample and blank
D : Results from dilution of sample
U : Compound searched for but not detected
E : Compound exceeds calibration limit

000011

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001257.D**
 Operator **Skelton**
 Date Acquired **10 Nov 1999 2:43 pm**

Sample Name **Vblk37**
 Field ID **Vblk37**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6.2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Vblk37

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 4923 Location: 811 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: Vblk37
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001257.D
Level: (low/med) LOW Date Received: 11/8/99
% Moisture: not dec. Date Analyzed: 11/10/99
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001279.D**
 Operator **Skelton**
 Date Acquired **11 Nov 1999 5:44 am**

Sample Name **4924.01**
 Field ID **752-1**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

752-1

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 4924 Location: 752 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 4924.01
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001279.D
Level: (low/med) LOW Date Received: 11/8/99
% Moisture: not dec. Date Analyzed: 11/11/99
GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

BASE NEUTRALS

000028

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name BNA03358.D

Operator Bhaskar

Date Acquired 12-Nov-99

Sample Name Sblk318

Misc Info Sblk318 A 991109

Sample Multiplier 1

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BNA03358.D**
 Operator **Bhaskar**
 Date Acquired **12-Nov-99**

Sample Name **Sblk318**
 Misc Info **Sblk318 A 991109**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Sblk318

Lab Name: FMETL Lab Code 13461
 Project UST Case No.: 4924 Location 752 SDG No.:
 Matrix: (soil/water) WATER Lab Sample ID: Sblk318
 Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03358.D
 Level: (low/med) LOW Date Received: 11/8/99
 % Moisture: decanted: (Y/N) N Date Extracted: 11/9/99
 Concentrated Extract Volume: 1000 (uL) Date Analyzed: 11/12/99
 Injection Volume: 1.0 (uL) Dilution Factor: 1.0
 GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **BNA03368.D**
 Operator **Bhaskar**
 Date Acquired **12-Nov-99**

Sample Name **4924.01**
 Misc Info **752-1**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name BNA03368.D

Operator Bhaskar

Date Acquired 12-Nov-99

Sample Name 4924.01

Misc Info 752-1

Sample Multiplier 1

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range

D= Value from dilution

B= Compound in Related Blank

PQL= Practical Quantitation Limit

MDL= Method Detection Limit

NLE= No Limit Established

R.T.=Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

752-1

Lab Name: FMETL Lab Code 13461
Project UST Case No.: 4924 Location 752 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 4924.01
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03368.D
Level: (low/med) LOW Date Received: 11/8/99
% Moisture: decanted: (Y/N) N Date Extracted: 11/9/99
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 11/12/99
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 2 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
1.	unknown	7.23	7	J
2. 000095-16-9	Benzothiazole	14.24	9	JN

**SEMIVOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
DECAFLUOROTRIPHENYLPHOSPHINE (DFTPP)**

Lab Name: FMETL Lab Code 13461
 Project UST Case No.: 4924 Location 752 SDG No.: _____
 Lab File ID: BNA03321.D DFTPP Injection Date: 10/27/99
 Instrument ID: BNA#2 DFTPP Injection Time: 9:32

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
51	30.0 - 80.0% of mass 198	60.0
68	Less than 2.0% of mass 69	0.0 (0.0)1
69	Mass 69 Relative abundance	56.4
70	Less than 2.0% of mass 69	0.3 (0.6)1
127	25.0 - 75.0% of mass 198	53.8
197	Less than 1.0% of mass 198	0.0
198	Base Peak, 100% relative abundance	100.0
199	5.0 to 9.0% of mass 198	7.1
275	10.0 - 30.0% of mass 198	19.9
365	Greater than 0.75% of mass 198	2.0
441	Present, but less than mass 443	8.7
442	40.0 - 110.0% of mass 198	59.1
443	15.0 - 24.0% of mass 442	12.0 (20.4)2

1-Value is % mass 69

2-Value is % mass 442

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	FIELD ID	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	SSTD120	120 PPM CAL	BNA03323.D	10/27/99	10:55
02	SSTD080	80 PPM CAL	BNA03324.D	10/27/99	11:50
03	SSTD050	50 PPM CAL	BNA03325.D	10/27/99	12:40
04	SSTD010	10 PPM CAL	BNA03326.D	10/27/99	13:31
05	SSTD020	20 PPM CAL	BNA03327.D	10/27/99	14:20
06	4871.04DUP	4871.04DUP	BNA03332.D	10/27/99	18:28
07	4871.04MS	4871.04MS	BNA03333.D	10/27/99	19:17

Data File : C:\HPCHEM\1\DATA\991027\BNA03321.D

Vial: 99

Acq On : 27 Oct 1999 9:32 am

Operator: Bhaskar

Sample : DFTPP TUNE

Inst : GC BNA 2



Misc : 50NG/2UL

Multiplr: 1.00

MS Integration Params: RTEINT.P

Method : C:\HPCHEM\1\METHODS\M262534.M (RTE Integrator)

Title : BNA Calibration

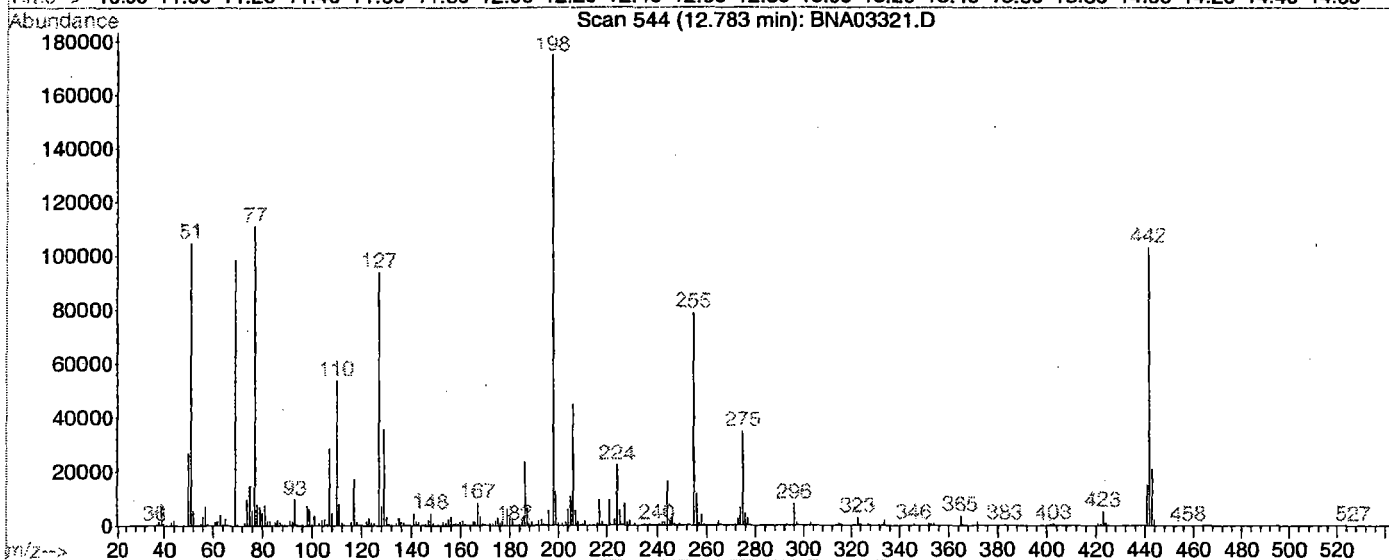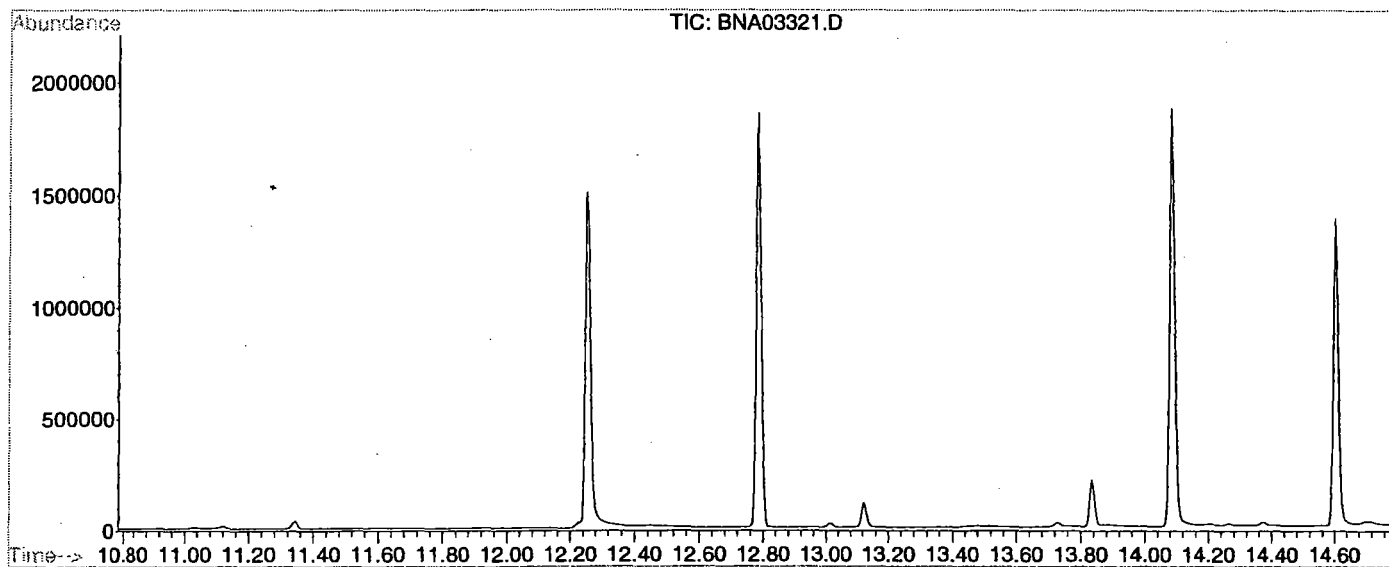

Spectrum Information: Scan 544

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
51	198	30	60	60.0	104832	PASS
68	69	0.00	2	0.0	0	PASS
69	198	0.00	100	56.4	98600	PASS
70	69	0.00	2	0.6	593	PASS
127	198	40	60	53.8	94000	PASS
197	198	0.00	1	0.0	0	PASS
198	198	100	100	100.0	174720	PASS
199	198	5	9	7.1	12479	PASS
275	198	10	30	19.9	34848	PASS
365	198	1	100	2.0	3527	PASS
441	443	1	99	72.0	15134	PASS
442	198	40	100	59.1	103184	PASS
443	442	17	23	20.4	21008	PASS

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.


It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted
2. Table of Contents submitted
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted
4. Document paginated and legible
5. Chain of Custody submitted
6. Samples submitted to lab within 48 hours of sample collection
7. Methodology Summary submitted
8. Laboratory Chronicle and Holding Time Check submitted
9. Results submitted on a dry weight basis
10. Method Detection Limits submitted
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP

✓
✓
✓
✓
✓
✓
✓
✓
✓
✓
✓

Laboratory Manager or Environmental Consultant's Signature

Date 4/7/00

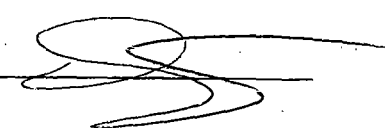


Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance.

000057

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.



**Daniel K. Wright
Laboratory Manager**

000058

FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732) 532-6224 FAX: (732) 532-6263

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

CERTIFICATIONS: NJDEP #13461, NYSDOH #11699



ANALYTICAL DATA REPORT Fort Monmouth Environmental Laboratory ENVIRONMENTAL DIVISION Fort Monmouth, New Jersey PROJECT: UST Program

Bldg. 752

Field Sample Location	Laboratory Sample ID#	Matrix	Date and Time of Collection	Date Received
Bldg. 752	5042.01	Aqueous	22-Dec-99 09:00	12/22/99
Trip Blank	5042.02	Aqueous	22-Dec-99	12/22/99
Field Blank	5042.03	Aqueous	22-Dec-99 08:50	12/22/99

ANALYSIS:
FORT MONMOUTH ENVIRONMENTAL LAB
VOA+15, BN+15

ENCLOSURE:
CHAIN OF CUSTODY
RESULTS

 5-8-00
Daniel Wright/Date
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Chain of Custody	1-2
Methodology Summary	3-4
Conformance/Non-Conformance Summary	5-7
Laboratory Chronicle	8-9
Volatile Organics	10-11
Analytical Results Summary	12-19
Tune Results Summary	20-23
Method Blank Results Summary	24
Calibration Summary	25-26
Surrogate Recovery Summary	27
MS/MSD Results Summary	28-29
Internal Standard Area & RT Summary	30
Chromatograms	31-38
Base Neutrals	39
Analytical Results Summary	40-48
Tune Results Summary	49-52
Method Blank Results Summary	53
Calibration Summary	54-57
Surrogate Recovery Summary	58
MS/MSD Results Summary	59-62
Internal Standard Area & RT Summary	63-66
Chromatograms	67-72
Laboratory Deliverables Checklist	73
Laboratory Authentication Statement	74

CHAIN OF CUSTODY

000001



Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-6263 EMail:appleby@mail1.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

[illegible]

METHODOLOGY SUMMARY

000003

Method Summary

EPA Method 624

Gas Chromatographic Determination of Volatiles in Water

Surrogates and internal standards are added to a 5-ml aliquot of sample. The sample is then purged and desorbed into a GC/MS system. The organic compounds are separated by the gas chromatograph and detected using the mass spectrometer. Volatiles are identified and quantitated.

EPA Method 3510/8270

Gas Chromatographic Determination of Semi-volatiles in Water

Surrogates are added to measured volume of sample, usually 1 liter, at a specified pH. The sample is serially extracted with Methylene chloride using a separatory funnel. The extract concentrated and internal standards are added. The sample is injected into a GC/MS system. Semi-volatiles are identified and quantitated.

CONFORMANCE NON-CONFORMANC SUMMARY

000005

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT

Indicate
Yes, No, N/A

1. Chromatograms labeled/Compounds identified
(Field samples and method blanks) yes
2. Retention times for chromatograms provided yes
3. GC/MS Tune Specifications
 - a. BFB Meet Criteria yes
 - b. DFTPP Meet Criteria yes
4. GC/MS Tuning Frequency – Performed every 24 hours for 600 series and 12 hours for 8000 series yes
5. GC/MS Calibration – Initial Calibration performed before sample analysis and continuing calibration performed within 24 hours of sample analysis for 600 series and 12 hours for 8000 series yes
6. GC/MS Calibration requirements
 - a. Calibration Check Compounds Meet Criteria yes
 - b. System Performance Check Compounds Meet Criteria yes
7. Blank Contamination – If yes, List compounds and concentrations in each blank: NO
 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA
8. Surrogate Recoveries Meet Criteria NO

If not met, list those compounds and their recoveries, which fall outside the acceptable range:

 - a. VOA Fraction _____
 - b. B/N Fraction Nitrobenzene-d5 low MS+MS Terphenyl-d14 low 5042.01
 - c. Acid Fraction NA

If not met, were the calculations checked and the results qualified as "estimated"? _____
9. Matrix Spike/Matrix Spike Duplicate Recoveries Meet Criteria yes

(If not met, list those compounds and their recoveries, which fall outside the acceptable range)

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA

000006

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT (cont.)

Indicate
Yes, No, N/A

10. Internal Standard Area/Retention Time Shift Meet Criteria
(If not met, list those compounds, which fall outside the acceptable range)

yes

- a. VOA Fraction _____
b. B/N Fraction _____
c. Acid Fraction NA _____

11. Extraction Holding Time Met

yes

If not met, list the number of days exceeded for each sample: _____

12. Analysis Holding Time Met

yes

If not met, list the number of days exceeded for each sample: _____

Additional Comments:

Laboratory Manager: _____

Date: 5-8-00

000007

LABORATORY CHRONICLE

000008

Laboratory Chronicle

Lab ID: 5042

Site: Bldg. 752

	Date	Hold Time
Date Sampled	12/22/99	NA
Receipt/Refrigeration	12/22/99	NA
Extractions		
1. Base Neutral	12/29/99	14 days
Analyses		
1. Volatile Organics	12/30/99	14 days
2. Base Neutral	01/04/00	40 days

000003

VOLATILE ORGANICS

000010

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

Definition of Qualifiers

MDL : Method Detection Limit
J : Compound identified below detection limit
B : Compound in both sample and blank
D : Results from dilution of sample
U : Compound searched for but not detected
E : Compound exceeds calibration limit

000011

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VB005223.D**
 Operator **Skelton**
 Date Acquired **30 Dec 1999 1:59 am**

Sample Name **Vblk159**
 Field ID **Vblk159**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-34-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
156-59-4	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7-9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

VbIk159

Lab Name: FMETL Project: 100004
NJDEP#: 13461 Case No.: 5042 Location: 752 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: VbIk159
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB005223.D
Level: (low/med) LOW Date Received: 12/22/99
% Moisture: not dec. Date Analyzed: 12/30/99
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VB005254.D**
 Operator **Skelton**
 Date Acquired **30 Dec 1999 10:39 pm**

Sample Name **5042.02**
 Field ID **Trip Blank**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-34-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
156-59-4	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

Trip Blank

Lab Name: FMETL Project: 100004
NJDEP#: 13461 Case No.: 5042 Location: 752 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 5042.02
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB005254.D
Level: (low/med) LOW Date Received: 12/22/99
% Moisture: not dec. Date Analyzed: 12/30/99
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VB005255.D**
 Operator **Skelton**
 Date Acquired **30 Dec 1999 11:18 pm**

Sample Name **5042.03**
 Field ID **Field Blank**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-34-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
156-59-4	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

Field Blank

Lab Name: FMETL Project: 100004
NJDEP#: 13461 Case No.: 5042 Location: 752 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 5042.03
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB005255.D
Level: (low/med) LOW Date Received: 12/22/99
% Moisture: not dec. Date Analyzed: 12/30/99
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VB005253.D**
 Operator **Skelton**
 Date Acquired **30 Dec 1999 10:00 pm**

Sample Name **5042.01**
 Field ID **Bldg752**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-34-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
156-59-4	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

Bldg752

Lab Name: FMETL Project: 100004
NJDEP#: 13461 Case No.: 5042 Location: 752 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 5042.01
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB005253.D
Level: (low/med) LOW Date Received: 12/22/99
% Moisture: not dec. Date Analyzed: 12/30/99
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

**VOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
BROMOFLUOROBENZENE (BFB)**

Lab Name: FMETL Project: 100004
 NJDEP#: 13461 Case No.: 5042 Location: 752 SDG No.:
 Lab File ID: VB005199.D BFB Injection Date: 12/29/99
 Instrument ID: GCMS#2 BFB Injection Time: 10:02
 GC Column: RTX502.2 ID: 0.25 (mm) Heated Purge: (Y/N) N

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
50	8.0 - 40.0% of mass 95	23.1
75	30.0 - 66.0% of mass 95	52.0
95	Base peak, 100% relative abundance	100.0
96	5.0 - 9.0% of mass 95	7.0
173	Less than 2.0% of mass 174	0.0 (0.0)1
174	50.0 - 120.0% of mass 95	59.4
175	4.0 - 9.0% of mass 174	4.7 (7.9)1
176	93.0 - 101.0% of mass 174	57.8 (97.3)1
177	5.0 - 9.0% of mass 176	4.2 (7.2)2


1-Value is % mass 174

2-Value is % mass 176

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	Lab ID.	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	VSTD020	VSTD020	VB005200.D	12/29/99	10:33
02	VSTD010	VSTD010	VB005201.D	12/29/99	11:26
03	VSTD100	VSTD100	VB005202.D	12/29/99	12:06
04	VSTD050	VSTD050	VB005203.D	12/29/99	12:45
05	VSTD005	VSTD005	VB005204.D	12/29/99	13:24

Data File : C:\HPCHEM\1\DATA\DEC99\991229\VB005199.D Vial: 1
 Acq On : 29 Dec 1999 10:02 am Operator: Skelton
 Sample : BFB Tune Inst : GC VOA 2
 Misc : BFB Tune Multiplr: 1.00
 MS Integration Params: RTEINT.P
 Method : C:\HPCHEM\1\METHODS\M262445.M (RTE Integrator)
 Title : Volatile Organics by GC/MS Method 624/8260/TCLP

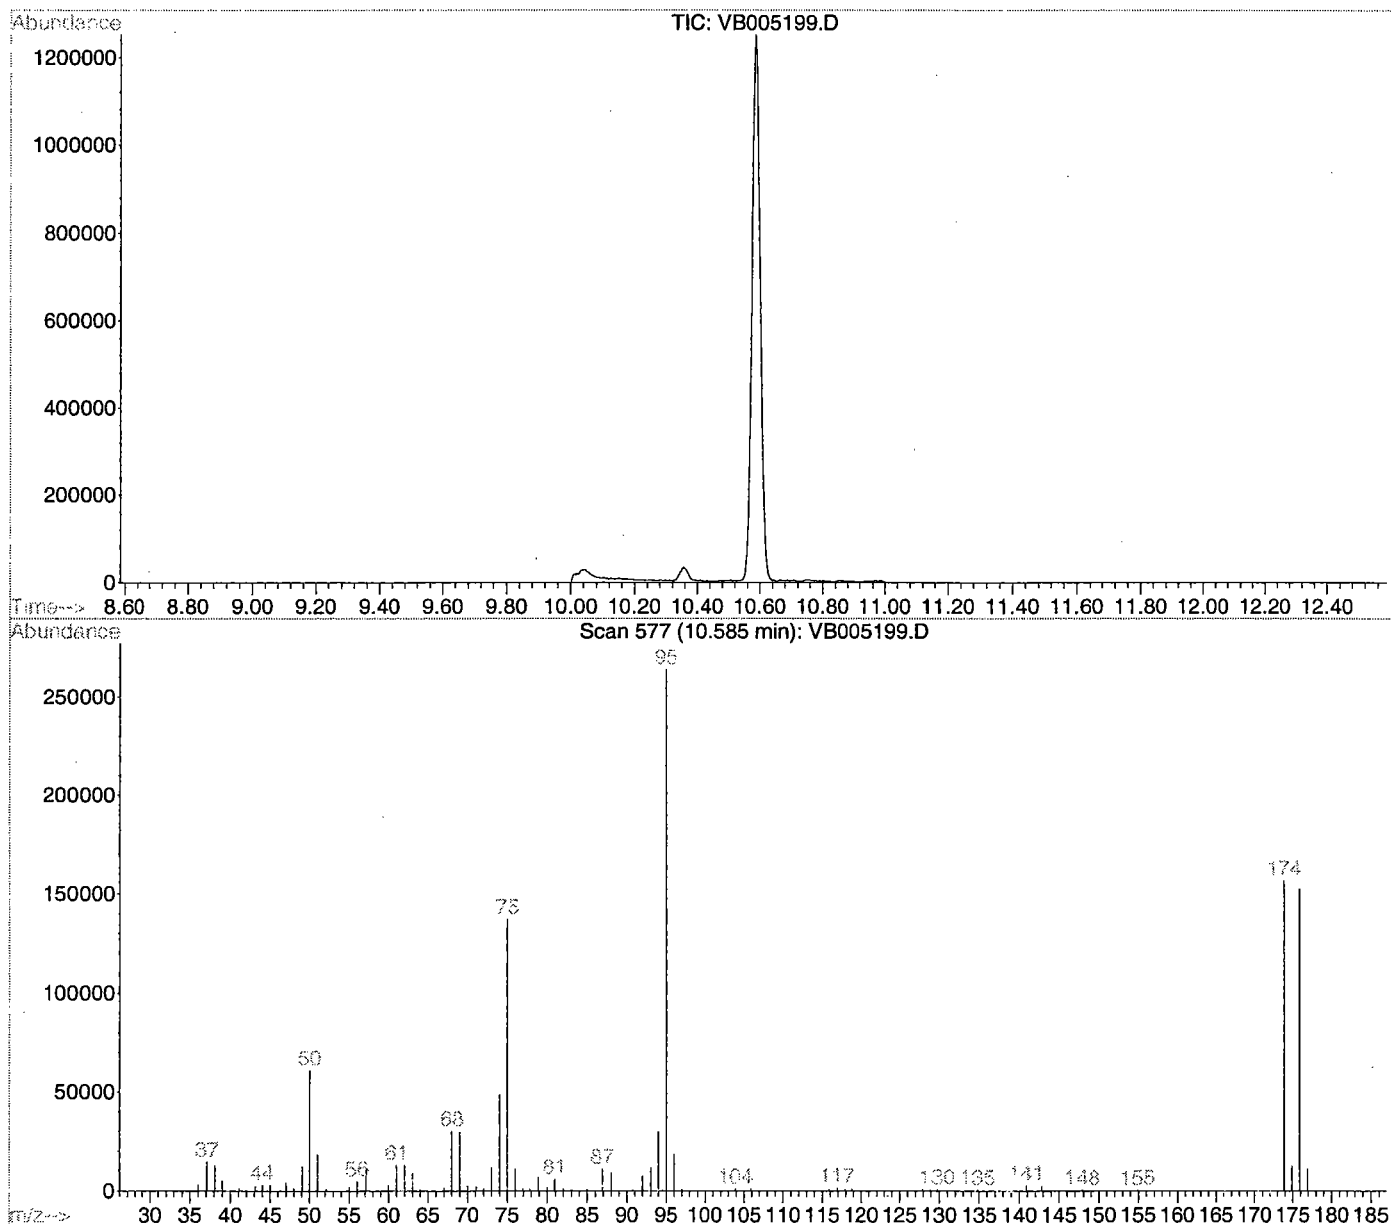

Spectrum Information: Scan 577

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
50	95	15	40	23.1	61064	PASS
75	95	30	60	52.0	137344	PASS
95	95	100	100	100.0	264128	PASS
96	95	5	9	7.0	18400	PASS
173	174	0.00	2	0.0	0	PASS
174	95	50	100	59.4	156864	PASS
175	174	5	9	7.9	12416	PASS
176	174	95	101	97.3	152704	PASS
177	176	5	9	7.2	10974	PASS

BASE NEUTRAL

000039

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name BNA03495.D

Operator Bhaskar

Date Acquired 4-Jan-00

Sample Name Sblk331

Misc Info Sblk331 A 991229

Sample Multiplier 1

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

000040

Semi-Volatile Analysis Report

Page 2

Data File Name **BNA03495.D**
 Operator **Bhaskar**
 Date Acquired **4-Jan-00**

Sample Name **Sblk331**
 Misc Info **Sblk331 A 991229**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

Page 2 of 2

000041

1F

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Sblk331

Lab Name: FMETL Lab Code 13461
Project 100004 Case No.: 5042 Location Bld.752 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: Sblk331
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03495.D
Level: (low/med) LOW Date Received: 12/22/99
% Moisture: decanted: (Y/N) N Date Extracted: 12/29/99
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 1/4/00
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 1 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
1.	unknown	10.15	57	J

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name BNA03498.D

Operator Bhaskar

Date Acquired 4-Jan-00

Sample Name 5042.03

Misc Info Field Blank

Sample Multiplier 1

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BNA03498.D**

Operator **Bhaskar**

Date Acquired **4-Jan-00**

Sample Name **5042.03**

Misc Info **Field Blank**

Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range

D= Value from dilution

B= Compound in Related Blank

PQL= Practical Quantitation Limit

MDL= Method Detection Limit

NLE= No Limit Established

R.T.=Retention Time

Page 2 of 2

000044

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Field Blank

Lab Name: FMETL Lab Code 13461
Project 100004 Case No.: 5042 Location Bld.752 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 5042.03
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03498.D
Level: (low/med) LOW Date Received: 12/22/99
% Moisture: decanted: (Y/N) N Date Extracted: 12/29/99
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 1/4/00
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **BNA03497.D**
 Operator **Bhaskar**
 Date Acquired **4-Jan-00**

Sample Name **5042.01**
 Misc Info **Bldg.752**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BNA03497.D**
 Operator **Bhaskar**
 Date Acquired **4-Jan-00**

Sample Name **5042.01**
 Misc Info **Bldg.752**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benizidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

1F

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Bldg.752

Lab Name: FMETL Lab Code 13461
Project 100004 Case No.: 5042 Location Bld.752 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 5042.01
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03497.D
Level: (low/med) LOW Date Received: 12/22/99
% Moisture: decanted: (Y/N) N Date Extracted: 12/29/99
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 1/4/00
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

**SEMIVOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
DECAFLUOROTRIPHENYLPHOSPHINE (DFTPP)**

Lab Name: FMETL Lab Code 13461
 Project 100004 Case No.: 5042 Location Bld.752 SDG No.:
 Lab File ID: BNA03470.D DFTPP Injection Date: 12/22/99
 Instrument ID: BNA#2 DFTPP Injection Time: 9:53

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
51	30.0 - 80.0% of mass 198	45.5
68	Less than 2.0% of mass 69	0.0 (0.0)1
69	Mass 69 Relative abundance	43.9
70	Less than 2.0% of mass 69	0.2 (0.5)1
127	25.0 - 75.0% of mass 198	50.1
197	Less than 1.0% of mass 198	0.0
198	Base Peak, 100% relative abundance	100.0
199	5.0 to 9.0% of mass 198	6.4
275	10.0 - 30.0% of mass 198	22.5
365	Greater than 0.75% of mass 198	2.5
441	Present, but less than mass 443	13.5
442	40.0 - 110.0% of mass 198	89.7
443	15.0 - 24.0% of mass 442	17.5 (19.5)2

1-Value is % mass 69

2-Value is % mass 442

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	FIELD ID	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	SSTD120	120 PPM CAL	BNA03471.D	12/22/99	10:20
02	SSTD080	80 PPM CAL	BNA03472.D	12/22/99	11:07
03	SSTD050	50 PPM CAL	BNA03473.D	12/22/99	11:55
04	SSTD020	20 PPM CAL	BNA03474.D	12/22/99	12:42
05	SSTD010	10 PPM CAL	BNA03475.D	12/22/99	13:30
06	5024.03MS	5024.03MS	BNA03478.D	12/22/99	15:58
07	5024.03DUP	5024.03DUP	BNA03479.D	12/22/99	16:46

Data File : C:\HPCHEM\1\DATA\991222\BNA03470.D

Vial: 99

Acq On : 22 Dec 1999 9:53 am

Operator: Bhaskar

Sample : DFTPP TUNE...

Inst : GC BNA 2



Misc : 50 NG/2UL

Multiplr: 1.00

MS Integration Params: RTEINT.P

Method : C:\HPCHEM\1\METHODS\M262535.M (RTE Integrator)

Title : BNA Calibration

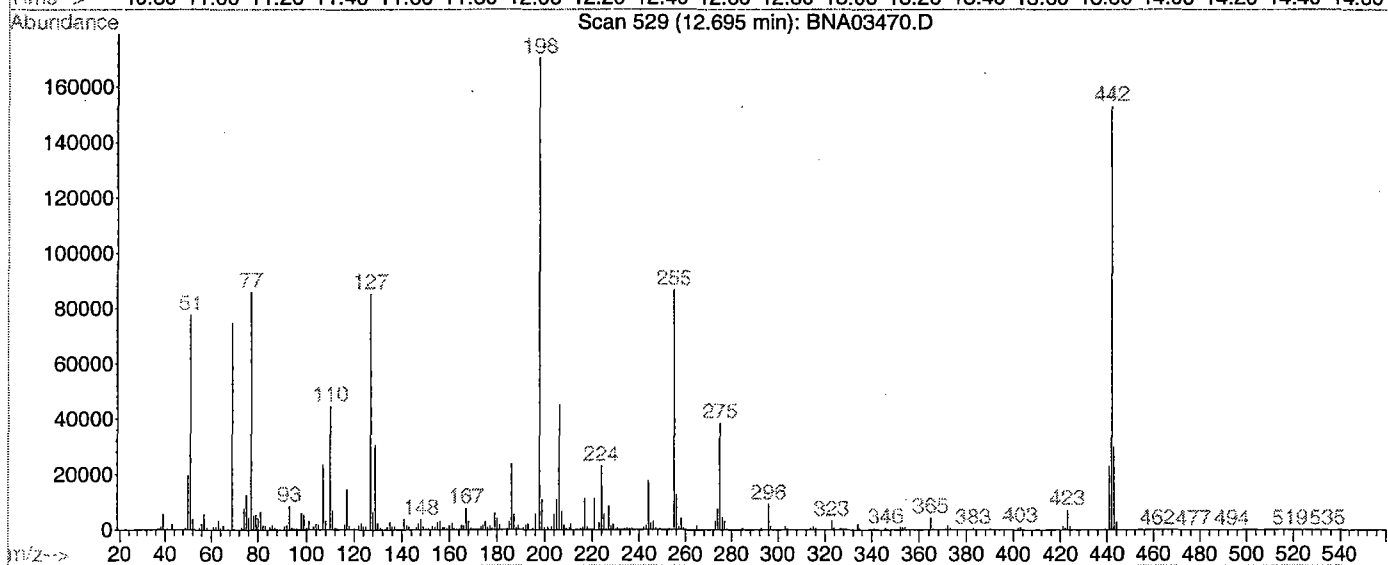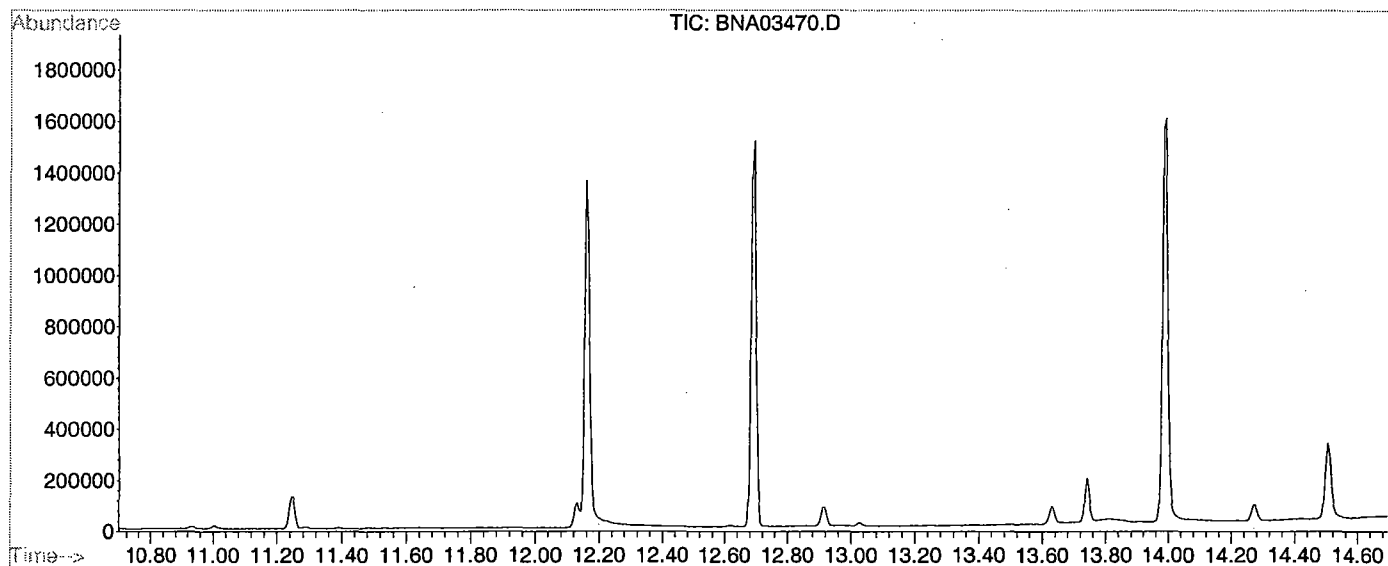

Spectrum Information: Scan 529

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
51	198	30	60	45.5	77600	PASS
68	69	0.00	2	0.0	0	PASS
69	198	0.00	100	43.9	74840	PASS
70	69	0.00	2	0.5	381	PASS
127	198	40	60	50.1	85376	PASS
197	198	0.00	1	0.0	0	PASS
198	198	100	100	100.0	170496	PASS
199	198	5	9	6.4	10917	PASS
275	198	10	30	22.5	38408	PASS
365	198	1	100	2.5	4279	PASS
441	443	1	99	77.1	23000	PASS
442	198	40	100	89.7	152896	PASS
443	442	17	23	19.5	29848	PASS

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted
2. Table of Contents submitted
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted
4. Document paginated and legible
5. Chain of Custody submitted
6. Samples submitted to lab within 48 hours of sample collection
7. Methodology Summary submitted
8. Laboratory Chronicle and Holding Time Check submitted
9. Results submitted on a dry weight basis
10. Method Detection Limits submitted
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP

✓

✓

✓

✓

✓

✓

✓

✓

NA

✓

✓

Laboratory Manager or Environmental Consultant's Signature

Date 5/8/00


Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance.

000073

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.


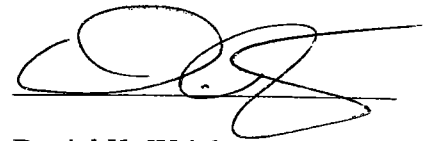


Daniel K. Wright
Laboratory Manager

000074

APPENDIX G

PHOTOGRAPHS

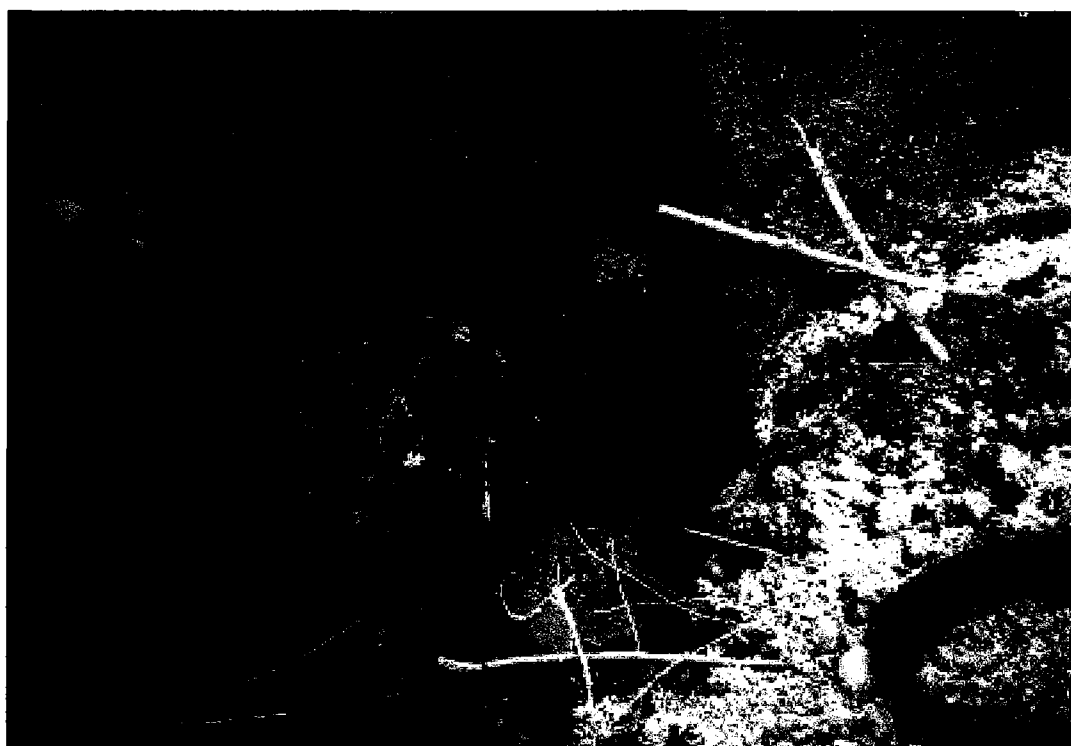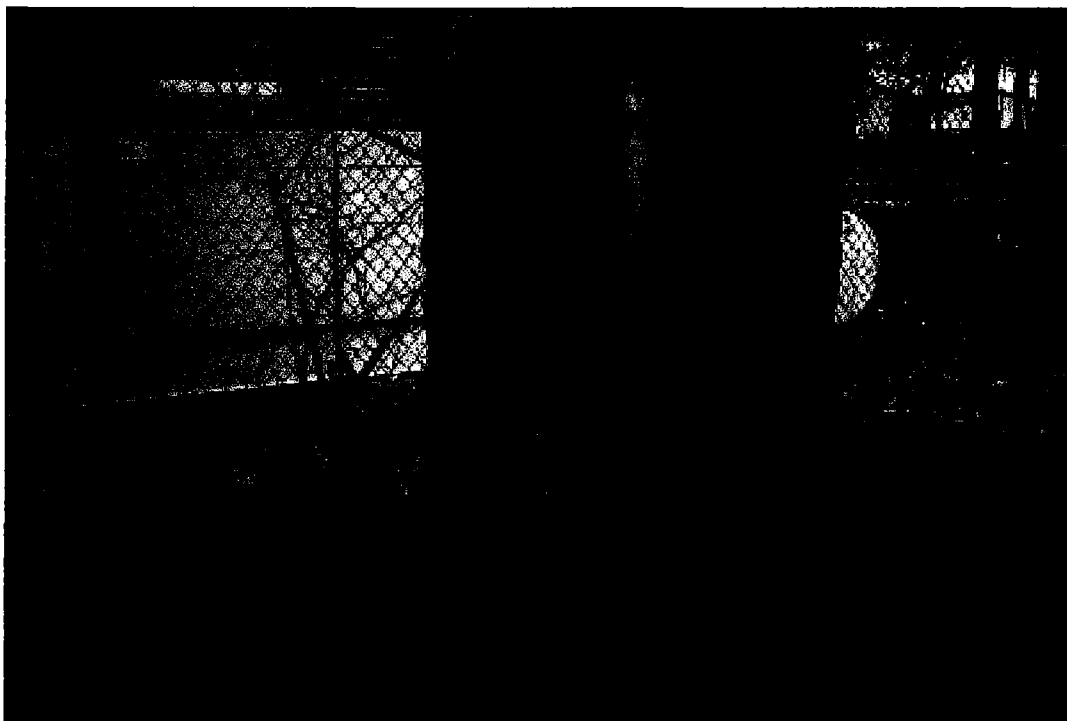

APRIL 2, 1998

PHOTOGRAPHIC LOG


UST NO. 81533-202

**Building 752
Main Post-West
Fort Monmouth**

VERSAR
Engineers, Managers, Scientists & Planners
Bristol, PA

APPENDIX H

ELECTRONIC DATA DELIVERABLES

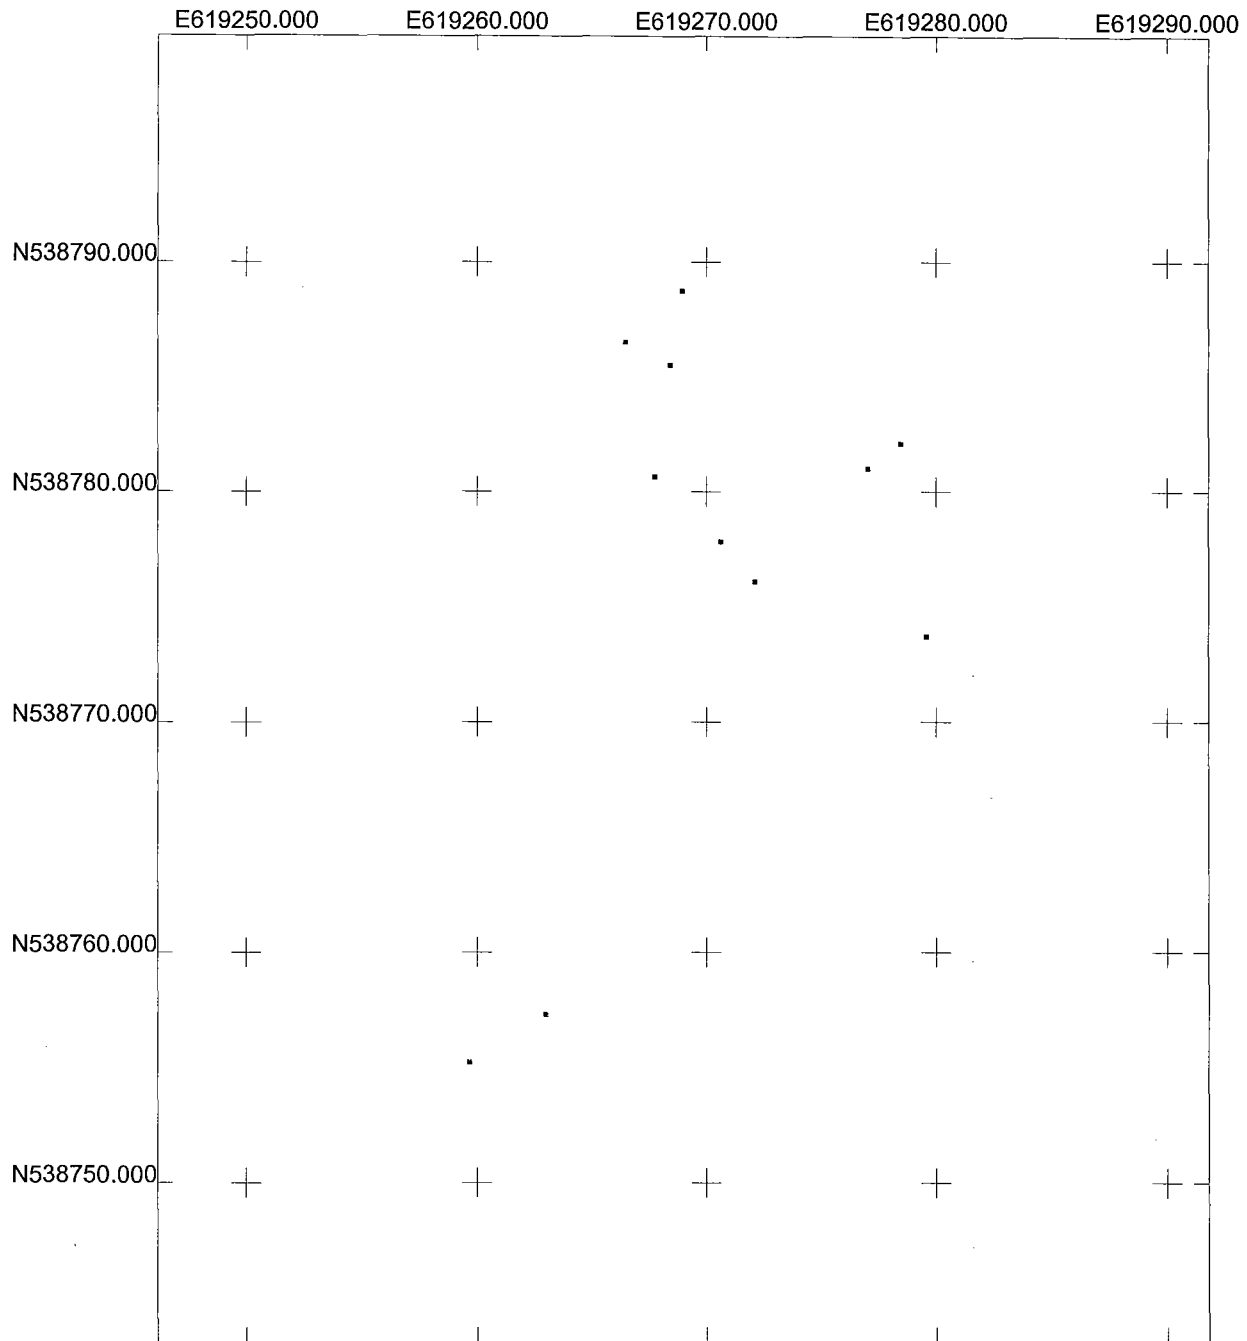

Bldg. 752 UST Site GPS Map

US State Plane 1983
New Jersey (NY East) 2900
NAD 1983 (Conus)



Scale 1:100
0 12.50

US Survey Feet

r071014d.cor
7/10/2000
Pathfinder Office
 Trimble

BLDG 753 UST SITE SAMPLE POSITIONS & COORDINATES

US STATE PLANE 1983 NJ (NY EAST) 2900 NAD 1983 (CONUS)


(IN US SURVEY FEET)

SAMPLE POINTS

<u>POSITION / DESC.</u>	<u>Y COORD. (NORTHING)</u>	<u>X COORD. (EASTING)</u>
752 E1 E2	538773.745	619279.557
752 N	538782.154	619278.409
752 B	538781.047	619277.006
752 PP	538776.14	619272.082
752 S	538777.854	619270.618
752 V	538780.687	619267.717
752 B2	538785.571	619268.397
752 W2	538788.804	619268.93
752 W3	538786.57	619266.442

REFERENCE POINTS

<u>POSITION / DESC.</u>	<u>Y COORD. (NORTHING)</u>	<u>X COORD. (EASTING)</u>
752 DOOR PAD CRNR	538755.296	619259.631
752 DOOR PAD CRNR	538757.342	619262.942

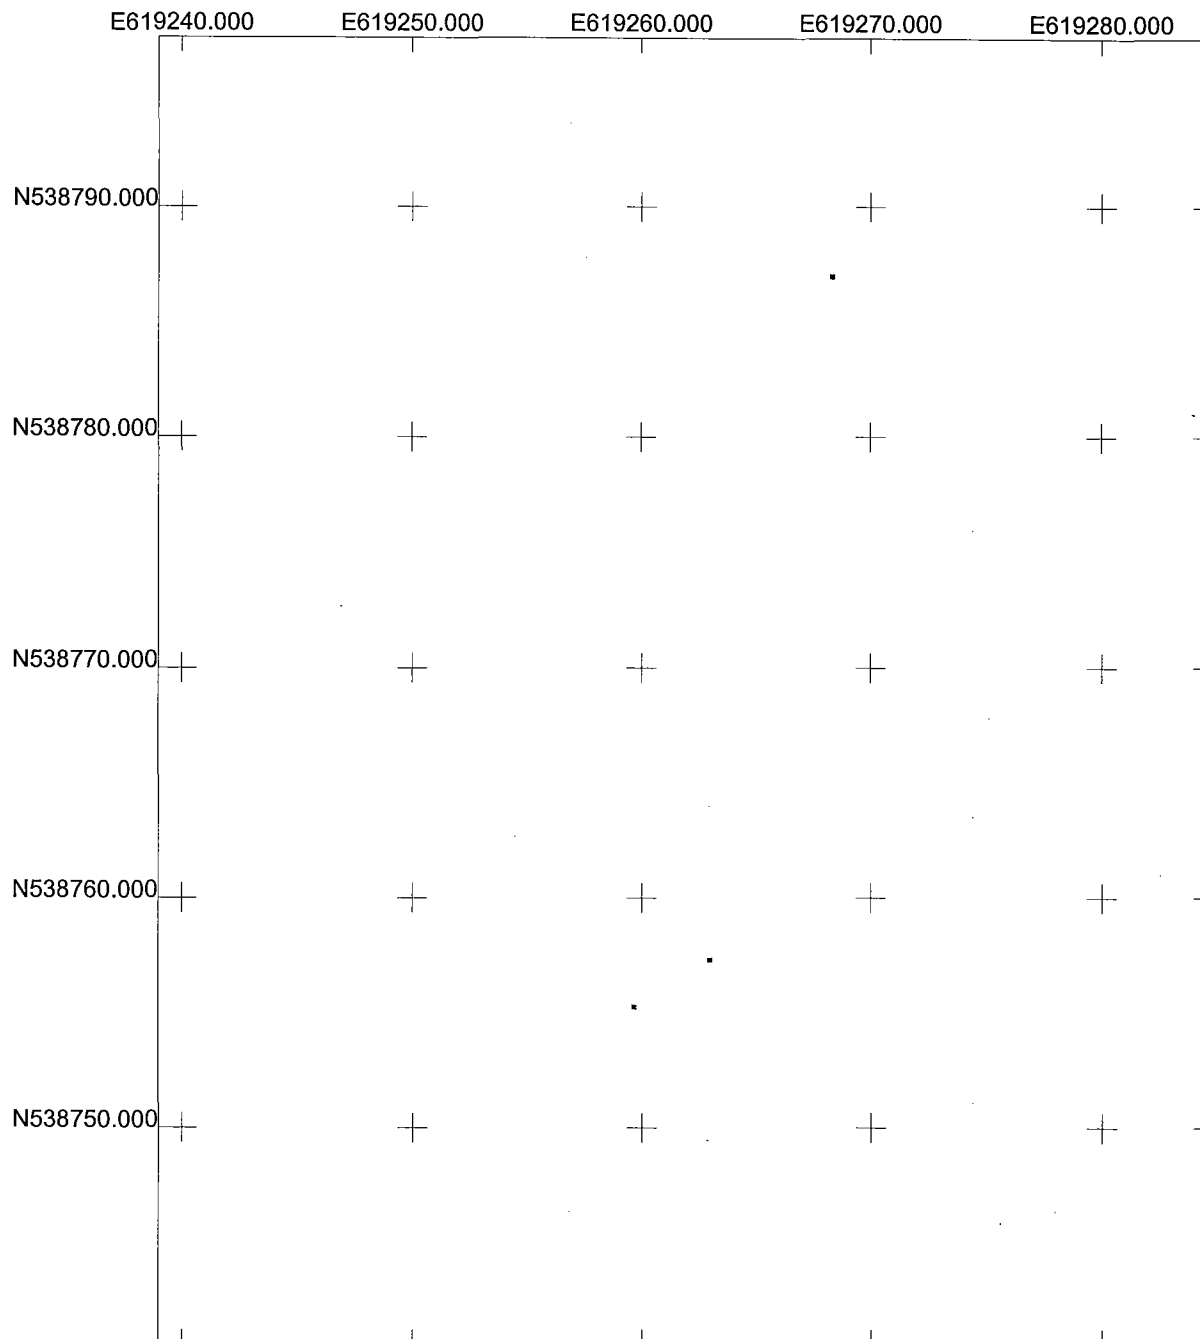

Bldg. 752 UST Ground Water Sample GPS Map

US State Plane 1983
New Jersey (NY East) 2900
NAD 1983 (Conus)



Scale 1:100
0 12.50
US Survey Feet

gw r071014d.cor
7/11/2000
Pathfinder Office
 Trimble

BLDG. 752 UST GROUND WATER SAMPLES GPS POSITION & COORDINATES

US STATE PLANE 1983 NJ (NY EAST) 2900 NAD 1983 (CONUS)

(IN US SURVEY FEET)

SAMPLE POINTS

<u>POSITION / DESC.</u>	<u>Y COORD. (NORTHING)</u>	<u>X COORD. (EASTING)</u>
752 GW	538787.011	619268.285

(GW denotes Ground Water)

REFERENCE POINTS

<u>POSITION / DESC.</u>	<u>Y COORD. (NORTHING)</u>	<u>X COORD. (EASTING)</u>
752 DOOR PAD CRNR	538755.296	619259.631
752 DOOR PAD CRNR	538757.342	619262.942