

United States Army
Fort Monmouth, New Jersey

**Underground Storage Tank
Closure and Site Investigation
Report**

***Building 949
Main Post-West Area***

**NJDEP UST Registration No. 81533-203
DICAR No. 98-06-12-1324-44**

October 2000

**UNDERGROUND STORAGE TANK
CLOSURE AND SITE INVESTIGATION REPORT**

BUILDING 949

**MAIN POST-WEST AREA
NJDEP UST REGISTRATION NO. 81533-203**

OCTOBER 2000

PREPARED FOR:

**UNITED STATES ARMY, FORT MONMOUTH, NEW JERSEY
DIRECTORATE OF PUBLIC WORKS
BUILDING 167
FORT MONMOUTH, NJ 07703**

PREPARED BY:

**VERSAR
1900 FROST ROAD
SUITE 110
BRISTOL, PA 19007**

PROJECT NO. 4435-018

TABLE OF CONTENTS

EXECUTIVE SUMMARY	iv
1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES	1
1.1 OVERVIEW	1
1.2 SITE DESCRIPTION	2
1.2.1 Geological/Hydrogeological Setting	2
1.3 HEALTH AND SAFETY	4
1.4 REMOVAL OF UNDERGROUND STORAGE TANK	4
1.4.1 General Procedures	4
1.4.2 Underground Storage Tank Excavation and Cleaning	4
1.5 UNDERGROUND STORAGE TANK TRANSPORTATION AND DISPOSAL	5
1.6 MANAGEMENT OF EXCAVATED SOILS	5
2.0 SITE INVESTIGATION ACTIVITIES	6
2.1 OVERVIEW	6
2.2 FIELD SCREENING/MONITORING	6
2.3 SOIL SAMPLING	7
2.4 GROUNDWATER SAMPLING	7
3.0 CONCLUSIONS AND RECOMMENDATIONS	8
3.1 SOIL SAMPLING RESULTS	8
3.2 GROUNDWATER SAMPLING RESULTS	
3.3 CONCLUSIONS AND RECOMMENDATIONS	9

TABLE OF CONTENTS (CONTINUED)

TABLES

Table 1	Summary of Post-Excavation Sampling Activities
Table 2	Post-Excavation Soil Sampling Results
Table 3	Groundwater Sampling Results

FIGURES

Figure 1	Site Location Map
Figure 1A	Geological Map
Figure 2	Site Map
Figure 3	Cross Sectional View
Figure 4	Soil Sampling Location Map
Figure 5	Groundwater Sampling Location Map

APPENDICES

Appendix A	NJDEP Standard Reporting Form
Appendix B	Site Assessment Summary
Appendix C	Waste Manifest
Appendix D	UST Disposal Certificate
Appendix E	Soil Analytical Data Package
Appendix F	Groundwater Analytical Data Package
Appendix G	Photographs

EXECUTIVE SUMMARY

UST Closure

On May 12, 1998, a steel underground storage tank (UST) was closed by removal in accordance with New Jersey Department of Environmental Protection (NJDEP) closure procedures at the Main Post-West area of the U.S. Army Fort Monmouth, Fort Monmouth, New Jersey. The UST, NJDEP Registration No. 0081533-203 (Fort Monmouth ID No. 949), was located east of Building 949. UST No. 0081533-203 was a 275-gallon diesel UST.

Site Assessment

The site assessment was performed by U.S. Army personnel in accordance with the NJDEP *Technical Requirements for Site Remediation* (N.J.A.C. 7:26E) and the NJDEP *Field Sampling Procedures Manual*. The sampling and laboratory analysis conducted during the site assessment were performed in accordance with Section 7:26E-2.1 of the *Technical Requirements for Site Remediation*. Soils surrounding the tank were screened visually and with air monitoring equipment for evidence of contamination. Following removal, the UST was inspected for corrosion holes. Numerous holes were noted in the UST. Soils at the location of the holes were dark in color and appeared to be contaminated. Based on the inspection of the UST, Directorate of Public Works (DPW) concluded that a discharge was associated with this UST. The NJDEP hotline was notified and the case was assigned DICAR No. 98-06-12-1324-44. Approximately 33 cubic yards of potentially contaminated soil were removed from the excavated area and stored at the Fort Monmouth petroleum contaminated soil staging area. Soil samples, which were collected after the removal of the potentially contaminated soil, contained TPHC concentrations ranging from non-detect to 875.69 mg/kg. Groundwater was encountered at 4.0 feet below ground surface and sheen was observed on groundwater.

All post excavation soil samples collected from the UST excavation at Building 949 contained TPHC concentrations below the NJDEP residential direct contact total organic contaminants soil cleanup criteria of 10,000 milligrams per kilogram (mg/kg) (N.J.A.C. 7:26D and revisions dated February 3, 1994). Following receipt of all post-excavation soil sampling results, the excavation was backfilled to grade with a combination of uncontaminated excavated soil and certified clean fill. The excavation site was then restored to its original condition.

In response to the observation of potentially contaminated soil near the water table, two (2) groundwater samples were collected at Building 949. On November 13, 1999, and December 11, 1999, Building 949 was sampled for volatile organic compounds calibrated for xylene plus 15 tentatively identified compounds (VOC's), and semivolatile organic compounds plus 15 tentatively identified compounds (SVOC's). All groundwater analytical results were either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC) with the exception of tetrachloroethene. Tetrachloroethene was detected at a concentration of 2.13 ug/L, above the GWQC of 1.00 ug/L.

Based on the analytical results of the groundwater sample collected on November 13, 1999, and December 11, 1999, groundwater quality at Building 949 exceeds the New Jersey Groundwater Quality Standard for tetrachloroethene. The installation of a monitoring well and the collection of samples on a quarterly basis is recommended. The analysis will determine if the levels of tetrachloroethene detected previously are declining. The need for any additional actions to address groundwater quality should be evaluated following receipt of the additional groundwater data.

Based on the post-excavation soil sampling results, soils with TPHC concentrations exceeding the NJDEP soil cleanup criteria for total organic contaminants of 10,000 mg/kg, do not exist in the former location of the UST or associated piping.

No further action for soil is proposed in regard to the closure and site assessment of UST No. 0081533-203 at Building 949.

1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES

1.1 OVERVIEW

One underground storage tank (UST), New Jersey Department of Environmental Protection (NJDEP) Registration No. 81533-203, was closed at Building 949 at the Main Post-West area of U.S. Army Fort Monmouth, Fort Monmouth, New Jersey on May 12, 1998. Refer to the site location map on Figure 1. This report presents the results of the Department of Public Works' (DPW) implementation of the UST Decommissioning/Closure Plan approved by the NJDEP. The UST was a steel 275-gallon tank containing diesel.

Decommissioning activities for UST No. 81533-203 complied with all applicable Federal, State, and Local laws and ordinances in effect at the date of decommissioning. These laws included but were not limited to N.J.A.C. 7:14B-1 et seq., N.J.A.C. 5:23-1 et seq., and Occupational Safety and Health Administration (OSHA) 1910.146 & 1910.120. All permits including but not limited to the NJDEP approved Decommissioning/Closure Plan were posted onsite for inspection. The decommissioning activities were conducted by SMC Environmental Services Group personnel who are registered and certified by the NJDEP for performing UST closure activities. Closure of UST No. 81533-203 proceeded under the approval of the NJDEP Bureau of Federal Case Management (NJDEP-BFCM). The Standard Reporting Form and signed Site Assessment Summary form for UST No. 81533-203 are included in Appendices A and B, respectively.

This UST Closure and Site Investigation Report has been prepared by Versar, to assist the U.S. Army DPW in complying with the NJDEP regulations. The applicable NJDEP regulations at the date of closure were the *Interim Closure Requirements for Underground Storage Tank Systems* (N.J.A.C. 7:14B-1 et seq. October 1990 and revisions dated November 1, 1991).

This report was prepared using information collected at the time of closure. Section 1 of this UST Closure and Site Investigation Report provides a summary of the UST decommissioning activities. Section 2 of this report describes the site investigation activities. Conclusions and recommendations, including the results of the soil sampling and groundwater investigation, are presented in the final section of this report.

1.2 SITE DESCRIPTION

Building 949 is located in the Main Post-West area of the Fort Monmouth Army Base. UST No. 0081533-203 was located east of Building 949 and appurtenant copper piping ran approximately five (5) feet west from the excavation to the emergency generator building. The vent line ran approximately ten (10) feet from the excavation to Building 949. A site map is provided on Figure 2.

1.2.1 Geological/Hydrogeological Setting

The following is a description of the geological/hydrogeological setting of the area surrounding Building 949. Included is a description of the regional geology of the area surrounding Fort Monmouth as well as descriptions of the local geology and hydrogeology of the Main Post area. A geological map is provided on Figure 1A.

Regional Geology

Monmouth County lies within the New Jersey Section of the Atlantic Coastal Plain physiographic province. The Main Post, Charles Wood, and the Evans areas are located in what may be referred to as the Outer Coastal Plain subprovince, or the Outer Lowlands.

In general, New Jersey Coastal Plain formations consist of a seaward-dipping wedge of unconsolidated deposits of clay, silt, and gravel. These formations typically strike northeast-southwest with a dip ranging from 10 to 60 feet per mile and were deposited on Precambrian and lower Paleozoic rocks (Zapecza, 1989). These sediments, predominantly derived from deltaic, shallow marine, and continental shelf environments, date from Cretaceous through the Quaternary Periods. The mineralogy ranges from quartz to glauconite.

The formations record several major transgressive/regressive cycles and contain units which are generally thicker to the southeast and reflect a deeper water environment. More than 20 regional geologic units are present within the sediments of the Coastal Plain. Regressive, upward coarsening deposits are usually aquifers (e.g., Englishtown and Kirkwood Formations, and the Cohansey Sand) while the transgressive deposits act as confining units (e.g., the Merchantville, Marshalltown, and Navesink Formations). The individual thicknesses for these units vary greatly (i.e., from several feet to several hundred feet). The Coastal Plain deposits thicken to the southeast from the Fall Line to greater than 6,500 feet in Cape May County (Brown and Zapecza, 1990).

Local Geology

Based on the regional geologic map (Jablonski, 1968), the Cretaceous age Red Bank and Tinton Sands outcrop at the Main Post area. The Red Bank sand conformably overlies the Navesink Formation and dips to the southeast at 35 feet per mile. The upper member (Shrewsbury) of the Red Bank sand is a yellowish-gray to reddish brown clayey, medium-to-coarse-grained sand that contains abundant rock fragments, minor mica and glauconite (Jablonski). The lower member (Sandy Hook) is a dark gray to black, medium-to-fine grained sand with abundant clay, mica, and glauconite.

The Tinton sand conformably overlies the Red Bank Sand and ranges from a clayey medium to very coarse grained feldspathic quartz and glauconite sand to a glauconitic coarse sand. The color varies from dark yellowish orange or light brown to moderate brown and from light olive to grayish olive. Glauconite may constitute 60 to 80 percent of the sand fraction in the upper part of the unit (Minard, 1969). The upper part of the Tinton is often highly oxidized and iron oxide encrusted (Minard).

Hydrogeology

The water table aquifer in the Main Post area is identified as part of the "composite confining units," or minor aquifers. The minor aquifers include the Navesink formation, Red Bank Sand, Tinton Sand, Hornerstown Sand, Vincentown Formation, Manasquan Formation, Shark River Formation, Piney Point Formation, and the basal clay of the Kirkwood Formation.

Based on records of wells drilled in the Main Post area, water is typically encountered at depths of 2 to 9 feet below ground surface (bgs). According to Jablonski, wells drilled in the Red Bank and Tinton Sands may produce 2 to 25 gallons per minute (gpm). Some well owners have reported acidic water that requires treatment to remove iron.

Due to the proximity of the Atlantic Ocean to Fort Monmouth, shallow groundwater may be tidally influenced and may flow toward creeks and brooks as the tide goes out, and away from creeks and brooks as the tide comes in. However, an abundance of clay lenses and sand deposits were noted in borings installed throughout Fort Monmouth. Therefore, the direction of shallow groundwater should be determined on a case-by-case basis.

Shallow groundwater is locally influenced within the Main Post area by the following factors:

- tidal influence (based on proximity to the Atlantic Ocean, rivers, and tributaries)
- topography
- nature of the fill material within the Main Post area
- presence of clay and silt lenses in the natural overburden deposits
- local groundwater recharge areas (i.e., streams, lakes)

Due to the fluvial nature of the overburden deposits (i.e., sand and clay lenses), shallow groundwater flow direction is best determined on a case-by-case basis. This is consistent with lithologies observed in borings installed within the Main Post area, which primarily consisted of fine-to-medium grained sands, with occasional lenses or laminations of gravel silt and/or clay.

Building 949 is located approximately 500 feet south of Husky Brook, the nearest water body. Based on the Main Post topography, the groundwater flow in the area of Building 949 is anticipated to be to the north.

1.3 HEALTH AND SAFETY

Before, during, and after all decommissioning activities, hazards at the work site which may have posed a threat to the Health and Safety of all personnel who were involved with, or were affected by, the decommissioning of the UST system were minimized. All areas, which posed, or may have been suspected to pose a vapor hazard were monitored by a qualified individual utilizing an organic vapor analyzer (OVA). The individual ascertained if the area was properly vented to render the area safe, as defined by OSHA.

1.4 REMOVAL OF UNDERGROUND STORAGE TANK

1.4.1 General Procedures

- The contractor performing the closure prior to excavation activities identified all underground obstructions (utilities, etc.).
- All activities were carried out with the greatest regard to safety and health and the safeguarding of the environment.
- All excavated soils were visually examined and screened with an OVA for evidence of contamination. Potentially contaminated soils were identified and logged during closure activities.
- Surface materials (i.e., asphalt, concrete, etc.) were excavated and staged separately from all soil and recycled in accordance with all applicable regulations and laws.
- A Sub-Surface Evaluator from the DPW was present during all site assessment activities.

1.4.2 Underground Storage Tank Excavation and Cleaning

Prior to UST decommissioning activities, surficial soil was removed to expose the UST and associated piping. All free product present in the piping was drained into the UST, and the UST was purged to remove vapors prior to cutting and removal of the piping. After removal of the associated piping, a manway was made in the UST to allow for proper cleaning. The UST was completely emptied of all liquids prior to removal from the ground. Approximately 30 gallons of liquid from the UST and its associated piping were transported by Lionetti Oil Recovery Co. Inc to the Lionetti Oil Recovery Co. Inc. facility, a NJDEP-approved petroleum recycling and disposal company located in Old Bridge, New Jersey. Refer to Appendix C for the waste manifest.

The UST was cleaned prior to removal from the excavation in accordance with the NJDEP regulations. After the UST was removed from the excavation, it was staged on polyethylene sheeting and examined for holes. Numerous holes were observed during the inspection by the Sub-Surface Evaluator. Soils surrounding the UST were screened visually and with an OVA for evidence of contamination. Soils were stained and appeared to be contaminated. Approximately 33 cubic yards of potentially contaminated soil were removed from the excavated area and transported to the Main Post petroleum contaminated soil holding area. Soil screening was also performed along the piping associated with the UST. No contamination was noted anywhere along the piping length. Soil samples, which were collected after the removal of the potentially contaminated soil, contained TPHC concentrations ranging from non-detect to 875.69 mg/kg. Groundwater was encountered at 4.0 feet below ground surface and sheen was observed on groundwater. See Figure 3 for a cross-sectional view of the excavated area.

1.5 UNDERGROUND STORAGE TANK TRANSPORTATION AND DISPOSAL

The tank was transported in compliance with all applicable regulations and laws to Red Bank Recycling Auto Wreckers, Inc. Please refer to Appendix D for the UST Disposal Certificate and Appendix G for photographs of the tank.

The UST was labeled prior to transport with the following information:

- Site of origin
- Contact person
- NJDEP UST Facility ID number
- Former contents
- Destination site
- Date

1.6 MANAGEMENT OF EXCAVATED SOILS

Based on OVA air monitoring and TPHC analysis results from the post-excavation soil samples, approximately 33 cubic yards of potentially contaminated soil were removed from the UST excavation. All potentially contaminated soils were stockpiled separately from other excavated material and were placed on and covered with polyethylene sheets. Potentially contaminated soils were transported to the soil staging area. Soils that did not exhibit signs of contamination were used as backfill following the removal of the UST. Groundwater was encountered at 4.0 feet below ground surface and sheen was observed on groundwater.

2.0 SITE INVESTIGATION ACTIVITIES

2.1 OVERVIEW

The Site Investigation was managed and carried out by U.S. Army DPW personnel. All analyses were performed and reported by U.S. Army Fort Monmouth Environmental Laboratory, a NJDEP-certified testing laboratory. All sampling was performed under the direct supervision of a NJDEP Certified Sub-Surface Evaluator according to the methods described in the NJDEP *Field Sampling Procedures Manual* (1992). Sampling frequency and parameters analyzed complied with the NJDEP document *Interim Closure Requirements for Underground Storage Tank Systems* (October 1990 and revisions dated November 1, 1991) which was the applicable regulation at the date of the closure. The Fort Monmouth DPW Environmental Office maintains all records of the Site Investigation activities.

The following Parties participated in Closure and Site Investigation Activities:

- Subsurface Evaluator: David H. Daniels
Employer: SMC Environmental Services Group
Phone Number: (215) 788-7844
NJDEP Certification No.: 10279
- Project Manager: Dinker Desai
Employer: U.S. Army, Fort Monmouth
Phone Number: (730) 532-6224
NJDEP Certification No.: 10173
- Analytical Laboratory: U.S. Army Fort Monmouth Environmental laboratory
Contact Person: Daniel K. Wright
Phone Number: (908) 532-4359
NJDEP Company Certification No.: 13461
- Hazardous Waste Hauler: Lorco Petroleum Services
Contact Person: Anibal Vazquez
Phone Number: (908) 721-0900

2.2 FIELD SCREENING/MONITORING

Field screening was performed by a NJDEP Certified Sub-Surface Evaluator using an OVA and visual observations to identify potentially contaminated material. Approximately 33 cubic yards of potentially petroleum contaminated soil were removed from the excavated area and transported to the Fort Monmouth petroleum contaminated soil holding area. Soils were removed from the excavation until no evidence of contamination remained. Groundwater was encountered at 4.0 feet below ground surface and sheen was observed on groundwater.

2.3 SOIL SAMPLING

On May 12, 1998, following the removal of the UST and associated piping, post-excavation soil samples S, E1, N, B, W, PP, V, B2, W2, and DUP E2 were collected from a total of nine (9) locations of the UST excavation. Excavation floor samples B and B2 were collected at a depth of 6.0 feet bgs and 8.5 feet bgs. Sidewall samples S, E1, N, W, and DUP E2 were collected at a depth of 5.5 feet bgs. Sidewall sample W2 was collected at a depth of 7.5 feet bgs. Piping sample PP and vent line sample V were collected at a depth of 0.5 feet bgs. All samples were analyzed for total petroleum hydrocarbons (TPHC) and total solids.

On September 1, 1998, following the removal of potentially contaminated soil from the west end of the excavated area, post-excavation soil samples N2, N3, and B3 were collected from a total of three (3) locations of the UST excavation. Excavation floor sample B3 was collected at a depth of 6.5 feet bgs. Sidewall samples N2 and N3 were collected at a depth of 6.0 feet bgs. All samples were analyzed for total petroleum hydrocarbons (TPHC) and total solids.

SMC Environmental Services Group personnel in accordance with the NJDEP Technical Requirements and the NJDEP Field Sampling Procedures Manual performed the site assessment. A summary of sampling activities including parameters analyzed is provided in Table 1. The post-excavation soil samples were collected using NJDEP *Field Sampling Procedures Manual* (1992) standard sampling procedures. Following soil sampling activities, the samples were chilled and delivered to U.S. Army Fort Monmouth Environmental Laboratory located in Fort Monmouth, New Jersey, for analysis.

2.4 GROUNDWATER SAMPLING

On November 13, 1999, and December 11, 1999, Building 949 was sampled for volatile organic compounds calibrated for xylene plus 15 tentatively identified compounds (VOC's), and semivolatile organic compounds plus 15 tentatively identified compounds (SVOC's). Sampling and analysis were performed in accordance with the NJDEP *Field Sampling Procedures Manual* and the *Technical Requirements For Site Remediation*. Refer to Appendix F for the field sampling documentation.

3.0 CONCLUSIONS AND RECOMMENDATIONS

3.1 SOIL SAMPLING RESULTS

To evaluate soil conditions following removal of the UST and associated piping, post-excavation soil samples were collected on May 12, 1998, and September 1, 1998 from a total of twelve (12) locations. All samples were analyzed for TPHC and total solids. The post-excavation sampling results were compared to the NJDEP residential direct contact total organic contaminants soil cleanup criteria of 10,000 mg/kg (N.J.A.C. 7:26D and revisions dated February 3, 1994). A summary of the analytical results and comparison to the NJDEP soil cleanup criteria is provided in Table 2 and the soil sampling locations are shown on Figure 4. The analytical data package is provided in Appendix E.

All post-excavation soil samples collected on May 12, 1998, and September 1, 1998, from the UST excavation and from below piping associated with the UST contained concentrations of TPHC below the NJDEP soil cleanup criteria. Soil samples, which were collected after the removal of the potentially contaminated soil, contained TPHC concentrations ranging from non-detect to 875.69 mg/kg.

3.2 GROUNDWATER SAMPLING RESULTS

The sample collected from Building 949 on November 13, 1999, contained cis-1, 2-dichloroethene at a concentration of 2.19 ug/l, tetrachloroethene at 2.13 ug/l, and 2-methylnaphthalene at 1.27 ug/l. No other compounds were detected.

The sample collected from Building 949 on December 11, 1999, contained cis-1, 2-dichloroethene at a concentration of 3.40 ug/l, tetrachloroethene at 2.13 ug/l, and 2-methylnaphthalene at 1.54 ug/l. No other compounds were detected.

A summary of the analytical results and comparison to the NJDEP groundwater cleanup criteria is provided in Table 3 and the groundwater sampling locations are shown on Figure 5. The analytical data package is provided in Appendix F. The full data package, including quality control, is on file at U.S. Army Fort Monmouth, Fort Monmouth, New Jersey.

Groundwater samples collected on November 13, 1999, and December 11, 1999, were either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC) with the exception of tetrachloroethene. Tetrachloroethene was detected at a concentration of 2.13 ug/L, above the GWQC of 1.00 ug/L.

3.3 CONCLUSIONS AND RECOMMENDATIONS

The analytical results for all post-excavation soil samples collected from the UST closure excavation at Building 949 were below the NJDEP soil cleanup criteria for total organic contaminants.

Based on the post-excavation sampling results, soil with TPHC concentrations exceeding the NJDEP soil cleanup criteria for total organic contaminants of 10,000 mg/kg, do not exist in the former location of the UST or associated piping.

Based on the analytical results of the groundwater sample collected on November 13, 1999, and December 11, 1999, groundwater quality at Building 949 exceeds the New Jersey Groundwater Quality Standard for tetrachloroethene. The installation of a monitoring well and the collection of samples on a quarterly basis is recommended. The analysis will determine if the levels of tetrachloroethene detected previously are declining. The need for any additional actions to address groundwater quality should be evaluated following receipt of the additional groundwater data.

No further action for soil is proposed in regard to the closure and site assessment of UST No. 0081533-203 at Building 949.

8 7

4. 2

5

١٠٠

7 1

620

2



7

۱۰۵

r 1

6. 1.4

7.

Yes, I did

5: 1

1.2

10

و: عا

5-3

6-49

TABLES

f ;

1. a

1 1

L. 23

5.

6. 10

1 2

6. 22

1 1

62 12

5

k. 27

5

1. 4

17

2. 4

2 1

4. 3

TABLE 1

SUMMARY OF POST-EXCAVATION SAMPLING ACTIVITIES
BUILDING 949, MAIN POST-WEST AREA
FORT MONMOUTH, NEW JERSEY

Page 1 of 3

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	NJDEP Method
S	5/12/98	5/13/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
E1	5/12/98	5/13/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
E2	5/12/98	5/13/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
**N	5/12/98	5/13/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
B	5/12/98	5/13/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
**W	5/12/98	5/13/98	Soil	Post-excavation	TPHC	OQA-QAM-025
PP	5/12/98	5/13/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
V	5/12/98	5/13/98	Soil	Post-excavation	TPHC	OQA-QAM-025
B2	5/12/98	5/13/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
W2	5/12/98	5/13/98	Soil	Post-excavation	TPHC	OQA-QAM-025

Note:

* TPHC Total Petroleum Hydrocarbons

** Sample further remediated and resampled

TABLE 1

SUMMARY OF POST-EXCAVATION SAMPLING ACTIVITIES
BUILDING 949, MAIN POST-WEST AREA
FORT MONMOUTH, NEW JERSEY

Page 2 of 3

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	NJDEP Method
N2	9/1/98	9/1/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
N3	9/1/98	9/1/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
B3	9/1/98	9/1/98	Soil	Post-Excavation	TPHC	OQA-QAM-025

Note:

* TPHC Total Petroleum Hydrocarbons

TABLE 1

SUMMARY OF SAMPLING ACTIVITIES
BUILDING 949, MAIN POST-WEST AREA
FORT MONMOUTH, NEW JERSEY

Page 3 of 3

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	Sampling Method**
4938.01	11/13/99	11/15/98	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
5005.01	12/11/99	12/13/99	Aqueous	Groundwater	VOCs, SVOCs	PPNDP

Note:

*VOCs: Volatile Organic Compounds plus 15 tentatively identified compounds

*SVOCs: Semivolatile organic compounds plus 15 tentatively identified compounds

**PPNDP: Passively Placed Narrow Diameter Point

TABLE 2

POST-EXCAVATION SOIL SAMPLING RESULTS
 BUILDING 949, MAIN POST-WEST AREA
 FORT MONMOUTH, NEW JERSEY

Page 1 of 2

Sample ID/ Depth	Sample Laboratory ID	Sample Date	Analysis Date	Analytical Parameters	Method Detection Limit (mg/kg)	Compound of Concern	Results (mg/kg) *	NJDEP Soil Cleanup Criteria ** (mg/kg)	Exceeds Cleanup Criteria
S/5.5' =	3562.01	5/12/98	5/13/98	Total Solid	--	--	81.05 %	--	--
				TPHC	186	yes	704.12	10,000	No
E1/5.5' =	3562.02	5/12/98	5/13/98	Total Solid	--	--	84.00 %	--	--
				TPHC	179	Yes	ND	10,000	No
E2/5.5' =	3562.03	5/12/98	5/13/98	Total Solid	--	--	84.19 %	--	--
				TPHC	178	Yes	ND	10,000	No
***N/5.5' =	3562.04	5/12/98	5/13/98	Total Solid	--	--	84.96 %	--	--
				TPHC	180	yes	1336.24	10,000	No
B/6.0' =	3562.05	5/12/98	5/13/98	Total Solid	--	--	78.17 %	--	--
				TPHC	193	yes	875.69	10,000	No
***W/5.5' =	3562.06	5/12/98	5/13/98	Total Solid	--	--	80.78 %	--	--
				TPHC	184	yes	3121.52	10,000	No
PP/0.5' =	3562.07	5/12/98	5/13/98	Total Solid	--	--	86.13 %	--	--
				TPHC	180	yes	ND	10,000	No
V/0.5' =	3562.08	5/12/98	5/13/98	Total Solid	--	--	87.83 %	--	--
				TPHC	168	yes	284.53	10,000	No
B2/8.5' =	3562.09	5/12/98	5/13/98	Total Solid	--	--	70.08 %	--	--
				TPHC	216	yes	ND	10,000	No
W2/7.5' =	3562.10	5/12/98	5/13/98	Total Solid	--	--	76.46 %	--	--
				TPHC	198	yes	580.47	10,000	No

Note:

* Total Solid results are expressed as a percentage.

** NJDEP Residential Direct Contact soil cleanup criteria for total organics

*** Sample further remediated and resampled

ND Not detected above stated method detection limit

TPHC Total Petroleum Hydrocarbons

TABLE 2

POST-EXCAVATION SOIL SAMPLING RESULTS
 BUILDING 949, MAIN POST-WEST AREA
 FORT MONMOUTH, NEW JERSEY

Page 2 of 2

Sample ID/ Depth	Sample Laboratory ID	Sample Date	Analysis Date	Analytical Parameters	Method Detection Limit (mg/kg)	Compound of Concern	Results (mg/kg) *	NJDEP Soil Cleanup Criteria ** (mg/kg)	Exceeds Cleanup Criteria
N2/6.0' =	3849.01	9/1/98	9/1/98	Total Solid	--	--	85.55 %	--	--
				TPHC	179	yes	571.87	10,000	No
N3/6.0' =	3849.02	9/1/98	9/1/98	Total Solid	--	--	84.76 %	--	--
				TPHC	177	Yes	240.03	10,000	No
B3/6.5' =	3849.03	9/1/98	9/1/98	Total Solid	--	--	92.65 %	--	--
				TPHC	164	Yes	ND	10,000	No

Note:

* Total Solid results are expressed as a percentage.

** NJDEP Residential Direct Contact soil cleanup criteria for total organics

ND Not detected above stated method detection limit

TPHC Total Petroleum Hydrocarbons

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 11/13/99Location: 949Lab Sample ID: 4938.01(Bldg 949)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	Not Detected	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	2.19 ug/L	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 11/13/99 Location: 949 Lab Sample ID: 4938.01(Bldg 949)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	—	400	no
108-88-3	Toluene	0.37	Not Detected	—	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	—	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	—	3	no
127-18-4	Tetrachloroethene	0.32	2.13 ug/L	—	1	yes
591-78-6	2-Hexanone	0.71	Not Detected	—	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	—	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	—	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	—	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	—	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	—	nle	no
100-42-5	Styrene	0.56	Not Detected	—	100	no
75-25-2	Bromoform	0.70	Not Detected	—	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	—	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	—	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	—	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	—	600	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 11/13/99Location: 949Lab Sample ID: 4938.01(Bldg 949)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	1.83	Not Detected	—	nle	no
62-75-9	N-nitroso-dimethylamine	0.91	Not Detected	—	20	no
62-53-3	Aniline	1.63	Not Detected	—	nle	no
111-44-4	bis(2-Chloroethyl)ether	1.28	Not Detected	—	10	no
541-73-1	1,3-Dichlorobenzene	1.19	Not Detected	—	600	no
106-46-7	1,4-Dichlorobenzene	1.02	Not Detected	—	75	no
100-51-6	Benzyl alcohol	1.02	Not Detected	—	nle	no
95-50-1	1,2-Dichlorobenzene	1.13	Not Detected	—	600	no
108-60-1	bis(2-chloroisopropyl)ether	1.39	Not Detected	—	300	no
621-64-7	n-Nitroso-di-n-propylamine	1.50	Not Detected	—	20	no
67-72-1	Hexachloroethane	0.97	Not Detected	—	10	no
98-95-3	Nitrobenzene	1.01	Not Detected	—	10	no
78-59-1	Isophorone	1.21	Not Detected	—	100	no
111-91-1	bis(2-Chloroethoxy)methane	1.75	Not Detected	—	nle	no
120-82-1	1,2,4-Trichlorobenzene	1.22	Not Detected	—	9	no
91-20-3	Naphthalene	1.27	Not Detected	—	nle	no
106-47-8	4-Chloroaniline	1.09	Not Detected	—	nle	no
87-68-3	Hexachlorobutadiene	0.71	Not Detected	—	1	no
91-57-6	2-Methylnaphthalene	1.08	1.27 ug/L	—	nle	no
77-47-4	Hexachlorocyclopentadiene	1.32	Not Detected	—	50	no
91-58-7	2-Chloronaphthalene	1.01	Not Detected	—	nle	no
88-74-4	2-Nitroaniline	0.79	Not Detected	—	nle	no
131-11-3	Dimethylphthalate	1.52	Not Detected	—	7000	no
208-96-8	Acenaphthylene	0.96	Not Detected	—	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 11/13/99Location: 949Lab Sample ID: 4938.01(Bldg 949)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	0.81	Not Detected	--	nle	no
99-09-2	3-Nitroaniline	0.79	Not Detected	--	nle	no
83-32-9	Acenaphthene	1.10	Not Detected	--	400	no
132-64-9	Dibenzofuran	1.00	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	0.87	Not Detected	--	10	no
84-66-2	Diethylphthalate	1.62	Not Detected	--	5000	no
86-73-7	Fluorene	0.99	Not Detected	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	1.10	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	1.05	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.01	Not Detected	--	20	no
103-33-3	Azobenzene	0.67	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	0.76	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	0.94	Not Detected	--	10	no
85-01-8	Phenanthrene	1.23	Not Detected	--	nle	no
120-12-7	Anthracene	1.12	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	1.70	Not Detected	--	900	no
206-44-0	Fluoranthene	1.64	Not Detected	--	300	no
92-87-5	Benzidine	4.18	Not Detected	--	50	no
129-00-0	Pyrene	1.25	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.05	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	1.19	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	1.75	Not Detected	--	60	no
218-01-9	Chrysene	1.38	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	1.74	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.44	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.25	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.29	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	1.05	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	0.83	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	0.64	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	0.84	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 12/11/99Location: 949Lab Sample ID: 5005.01(Bldg 949)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	Not Detected	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	3.40 ug/L	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzene	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/11/99 Location: 949 Lab Sample ID: 5005.01(Bldg 949)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	2.13 ug/L	--	1	yes
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 12/11/99Location: 949Lab Sample ID: 5005.01(Bldg 949)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	1.83	Not Detected	--	nle	no
62-75-9	N-nitroso-dimethylamine	0.91	Not Detected	--	20	no
62-53-3	Aniline	1.63	Not Detected	--	nle	no
111-44-4	bis(2-Chloroethyl)ether	1.28	Not Detected	--	10	no
541-73-1	1,3-Dichlorobenzene	1.19	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	1.02	Not Detected	--	75	no
100-51-6	Benzyl alcohol	1.02	Not Detected	--	nle	no
95-50-1	1,2-Dichlorobenzene	1.13	Not Detected	--	600	no
108-60-1	bis(2-chloroisopropyl)ether	1.39	Not Detected	--	300	no
621-64-7	n-Nitroso-di-n-propylamine	1.50	Not Detected	--	20	no
67-72-1	Hexachloroethane	0.97	Not Detected	--	10	no
98-95-3	Nitrobenzene	1.01	Not Detected	--	10	no
78-59-1	Isophorone	1.21	Not Detected	--	100	no
111-91-1	bis(2-Chloroethoxy)methane	1.75	Not Detected	--	nle	no
120-82-1	1,2,4-Trichlorobenzene	1.22	Not Detected	--	9	no
91-20-3	Naphthalene	1.27	Not Detected	--	nle	no
106-47-8	4-Chloroaniline	1.09	Not Detected	--	nle	no
87-68-3	Hexachlorobutadiene	0.71	Not Detected	--	1	no
91-57-6	2-Methylnaphthalene	1.08	1.54 ug/L	--	nle	no
77-47-4	Hexachlorocyclopentadiene	1.32	Not Detected	--	50	no
91-58-7	2-Chloronaphthalene	1.01	Not Detected	--	nle	no
88-74-4	2-Nitroaniline	0.79	Not Detected	--	nle	no
131-11-3	Dimethylphthalate	1.52	Not Detected	--	7000	no
208-96-8	Acenaphthylene	0.96	Not Detected	--	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/11/99 Location: 949 Lab Sample ID: 5005.01(Bldg 949)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	0.81	Not Detected	--	nle	no
99-09-2	3-Nitroaniline	0.79	Not Detected	--	nle	no
83-32-9	Acenaphthene	1.10	Not Detected	--	400	no
132-64-9	Dibenzofuran	1.00	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	0.87	Not Detected	--	10	no
84-66-2	Diethylphthalate	1.62	Not Detected	--	5000	no
86-73-7	Fluorene	0.99	Not Detected	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	1.10	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	1.05	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.01	Not Detected	--	20	no
103-33-3	Azobenzene	0.67	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	0.76	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	0.94	Not Detected	--	10	no
85-01-8	Phenanthrene	1.23	Not Detected	--	nle	no
120-12-7	Anthracene	1.12	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	1.70	Not Detected	--	900	no
206-44-0	Fluoranthene	1.64	Not Detected	--	300	no
92-87-5	Benzydine	4.18	Not Detected	--	50	no
129-00-0	Pyrene	1.25	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.05	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	1.19	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	1.75	Not Detected	--	60	no
218-01-9	Chrysene	1.38	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	1.74	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.44	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.25	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.29	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	1.05	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	0.83	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	0.64	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	0.84	Not Detected	--	nle	no

Page 1
Page 2
Page 3
Page 4
Page 5
Page 6
Page 7
Page 8
Page 9
Page 10
Page 11
Page 12
Page 13
Page 14
Page 15
Page 16
Page 17
Page 18
Page 19
Page 20
Page 21
Page 22
Page 23
Page 24
Page 25
Page 26
Page 27
Page 28
Page 29
Page 30
Page 31
Page 32
Page 33
Page 34
Page 35
Page 36
Page 37
Page 38
Page 39
Page 40
Page 41
Page 42
Page 43
Page 44
Page 45
Page 46
Page 47
Page 48
Page 49
Page 50
Page 51
Page 52
Page 53
Page 54
Page 55
Page 56
Page 57
Page 58
Page 59
Page 60
Page 61
Page 62
Page 63
Page 64
Page 65
Page 66
Page 67
Page 68
Page 69
Page 70
Page 71
Page 72
Page 73
Page 74
Page 75
Page 76
Page 77
Page 78
Page 79
Page 80
Page 81
Page 82
Page 83
Page 84
Page 85
Page 86
Page 87
Page 88
Page 89
Page 90
Page 91
Page 92
Page 93
Page 94
Page 95
Page 96
Page 97
Page 98
Page 99
Page 100

FIGURES

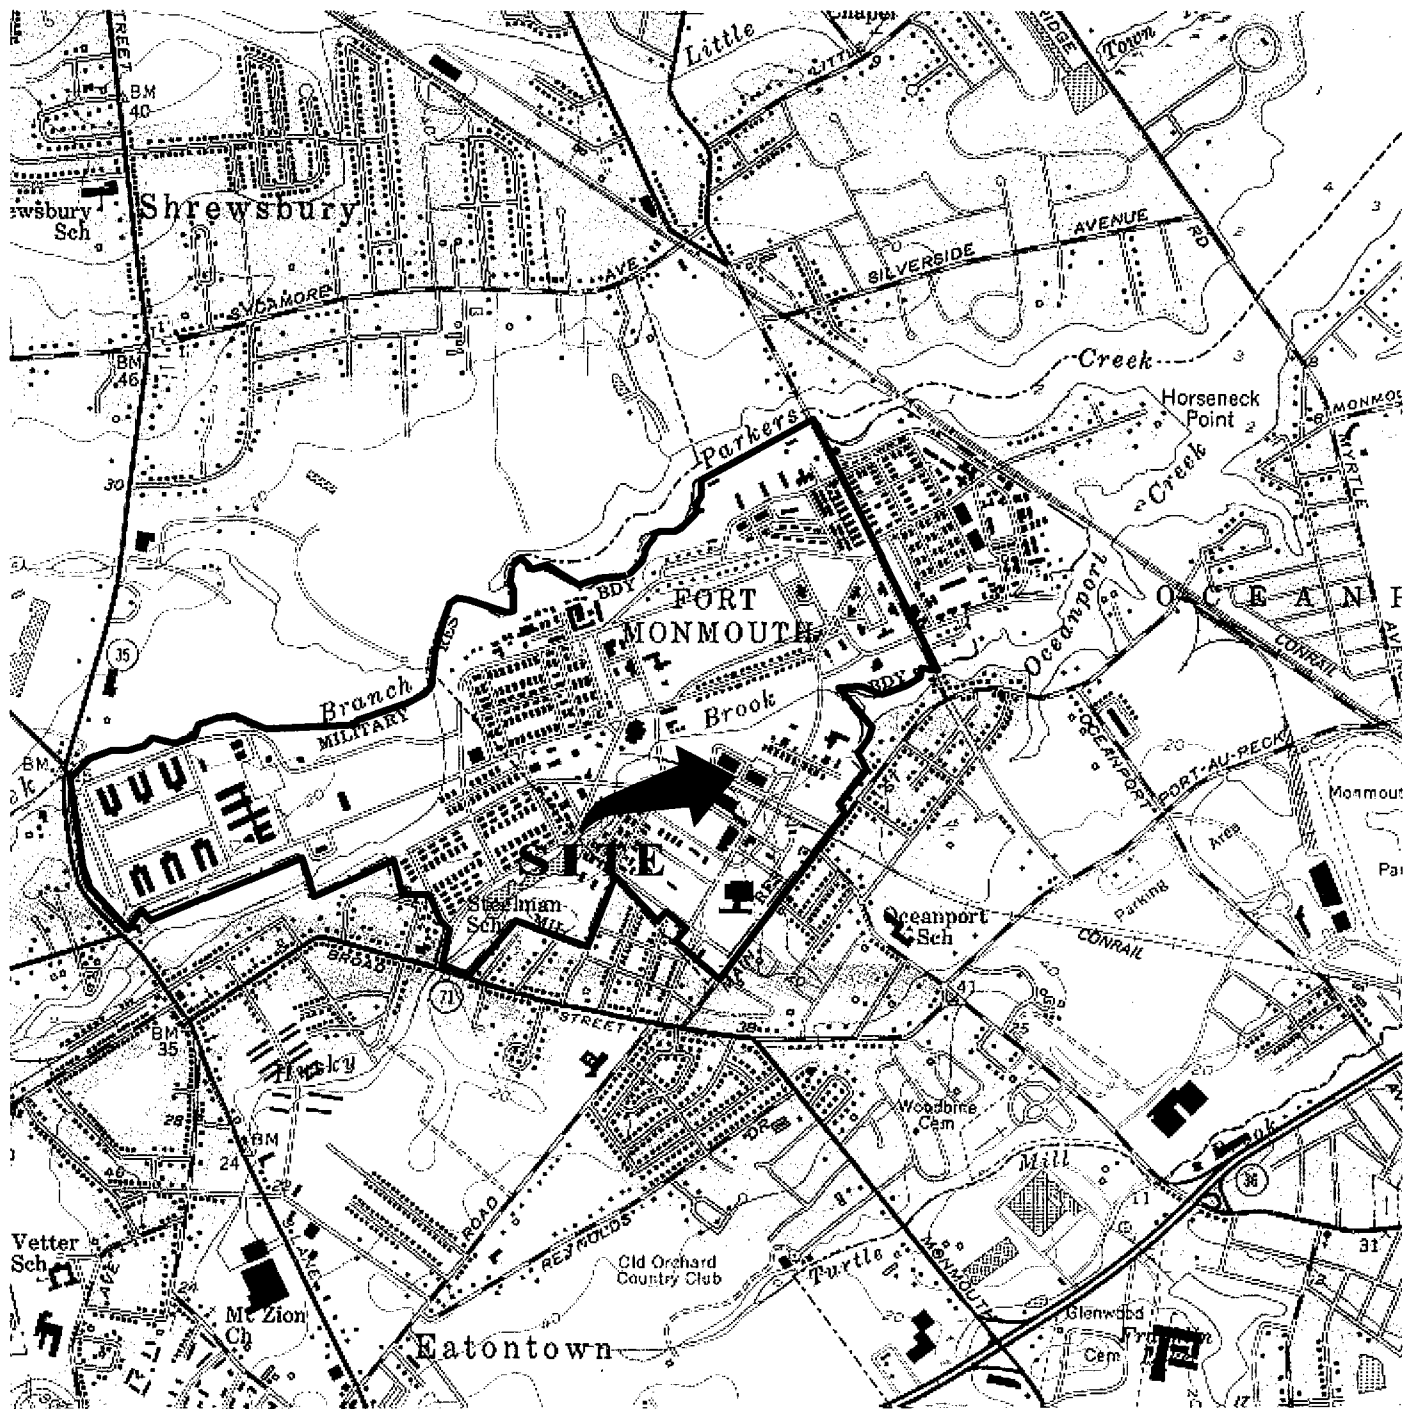


FIGURE 1

LOCATION MAP
Building 949
Main-Post West
Fort Monmouth Army Base
Monmouth County, NJ

VERSAR
Engineers, Managers, Scientists, & Planners
Bristol, PA

Scale: 1" = 2000'

Date: MAY 1998

LONG BRANCH, N. J.

40073-C8-TF-024

1954

PHOTOREVISED 1981
DMA 6164 I SE-SERIES V822



NEW
JERSEY

QUADRANGLE LOCATION



Mapped, edited and published by the Geological Survey

Geologic Map of New Jersey

SEDIMENTARY ROCKS

CENOZOIC

- Holocene: sand
- Tertiary: sand, silt, clay

MESOZOIC

- Cretaceous: sand, silt, clay
- Jurassic: siltstone, shale, sandstone
- Triassic: siltstone, shale, sandstone

PALEOZOIC

- Devonian: conglomerate, sandstone,
- Silurian: conglomerate, sandstone, shale, limestone
- Ordovician: shale, limestone
- Cambrian: limestone, sandstone

IGNEOUS AND METAMORPHIC ROCKS

MESOZOIC

- Jurassic: basalt
- Jurassic: diabase

PRECAMBRIAN

- marble
- gneiss, granite

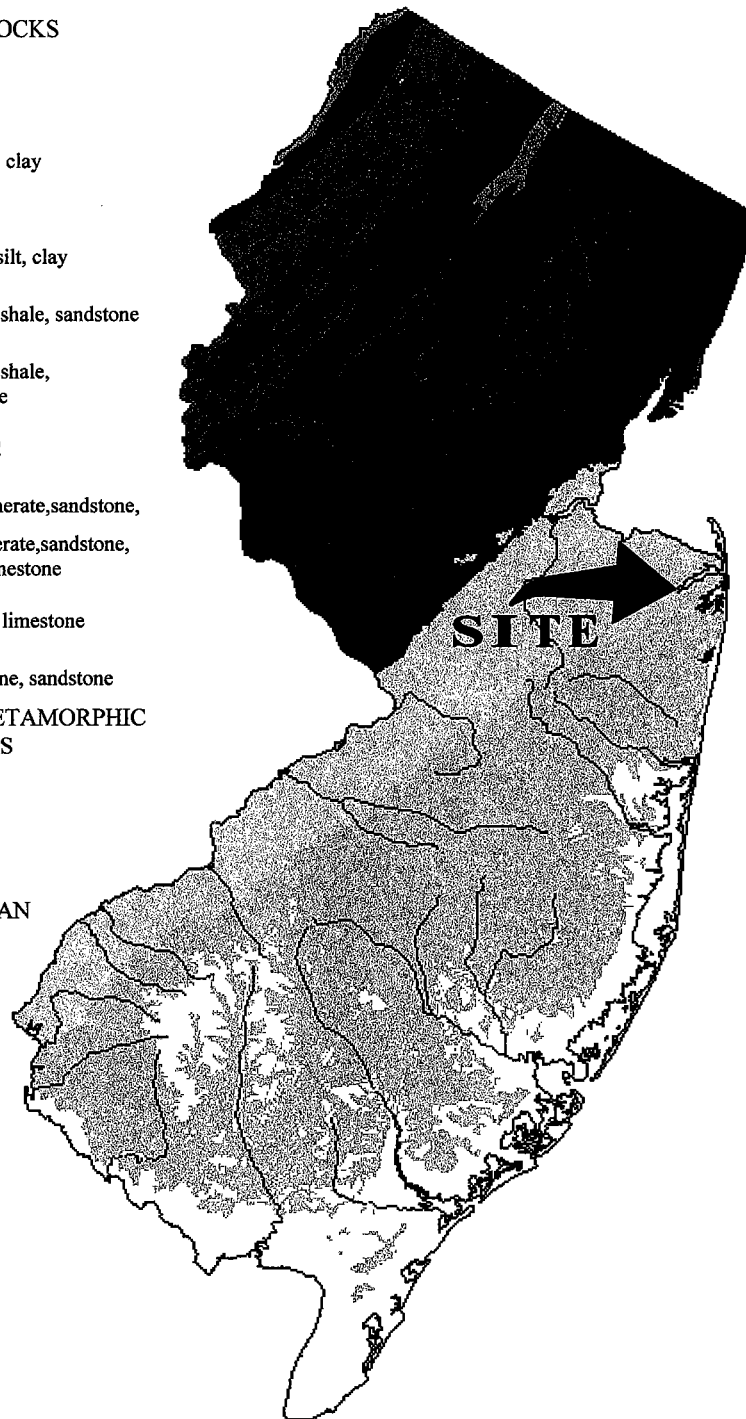


FIGURE 1A
GEOLOGICAL MAP
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
 Engineers, Managers, Scientists & Planners
 Bristol, Pennsylvania


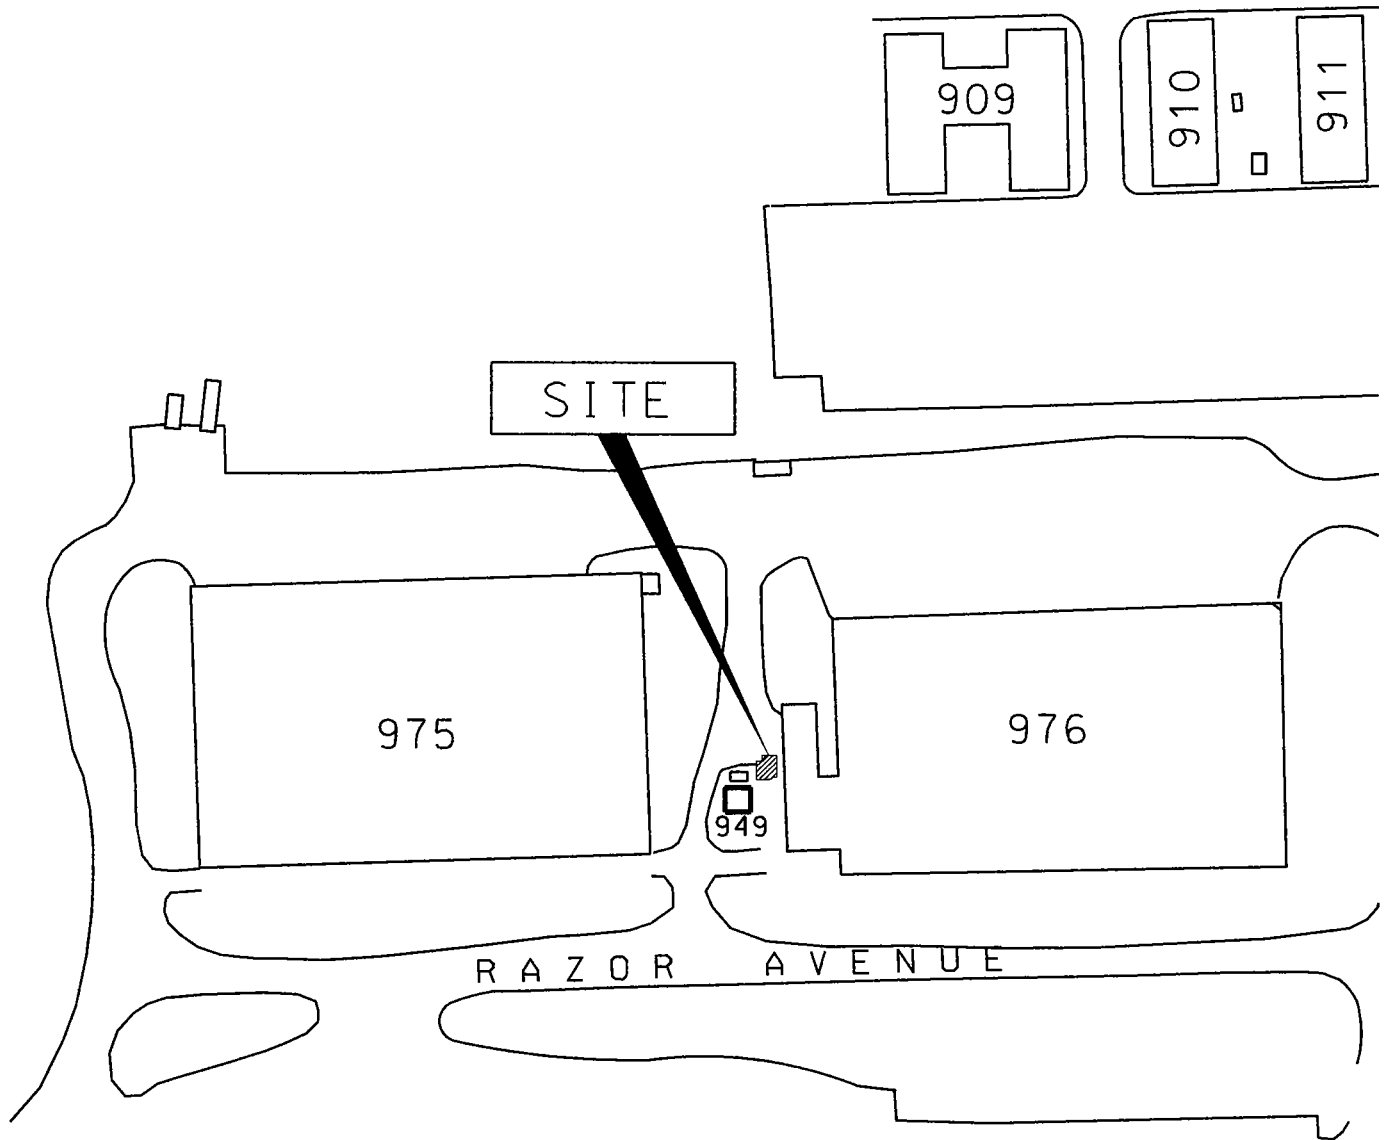



FIGURE 2
SITE MAP
BUILDING 949
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS
BRISTOL, PA.

SCALE: 1"=100'

DATE: MAY 1998

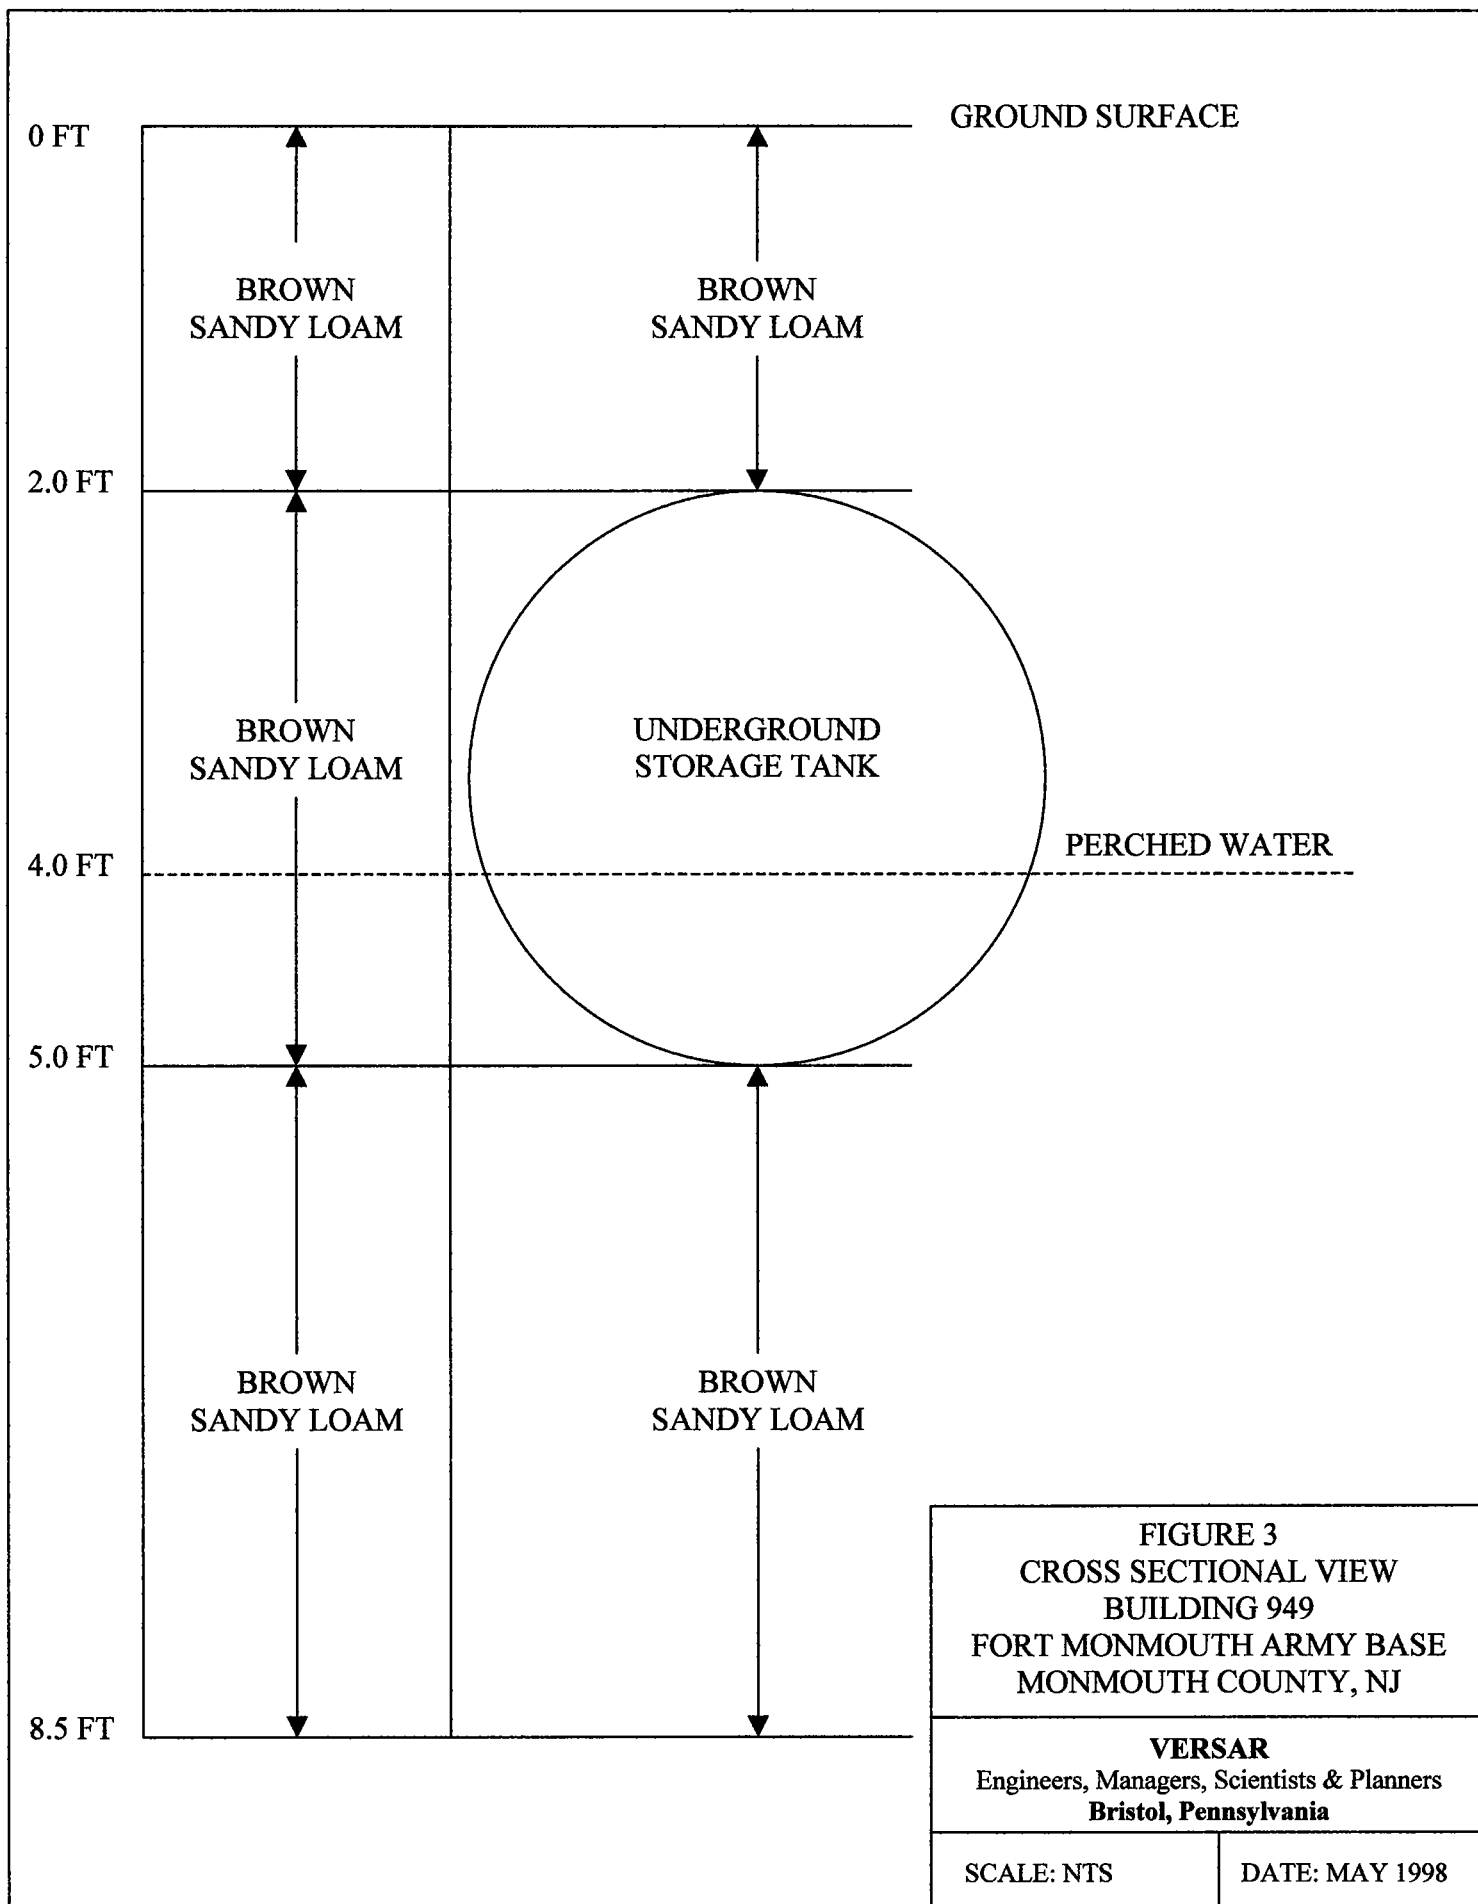

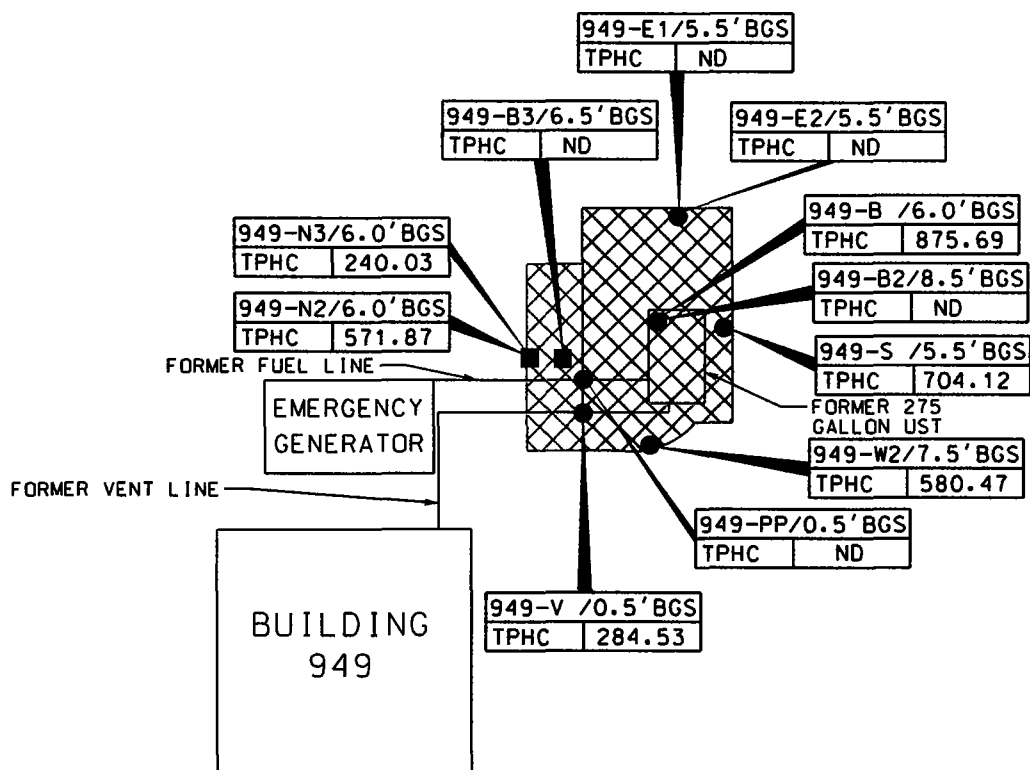

LEGEND

- SOIL SAMPLE LOCATION (MAY 12, 1998)
- SOIL SAMPLE LOCATION (SEPTEMBER 1, 1998)
- ▨ LIMIT OF EXCAVATION (MAY 12, 1998)
- ▨ LIMIT OF EXCAVATION (SEPTEMBER 1, 1998)

NOTES:


1. ALL RESULTS IN MG/KG.
2. SEE TABLE 2 FOR NJDEP SOIL CLEANUP CRITERIA
3. BGS = BELOW GROUND SURFACE

FIGURE 4
SOIL SAMPLING LOCATION MAP
BUILDING 949
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS
BRISTOL, PA.

SCALE: 1"=10'

DATE: MAY 1998

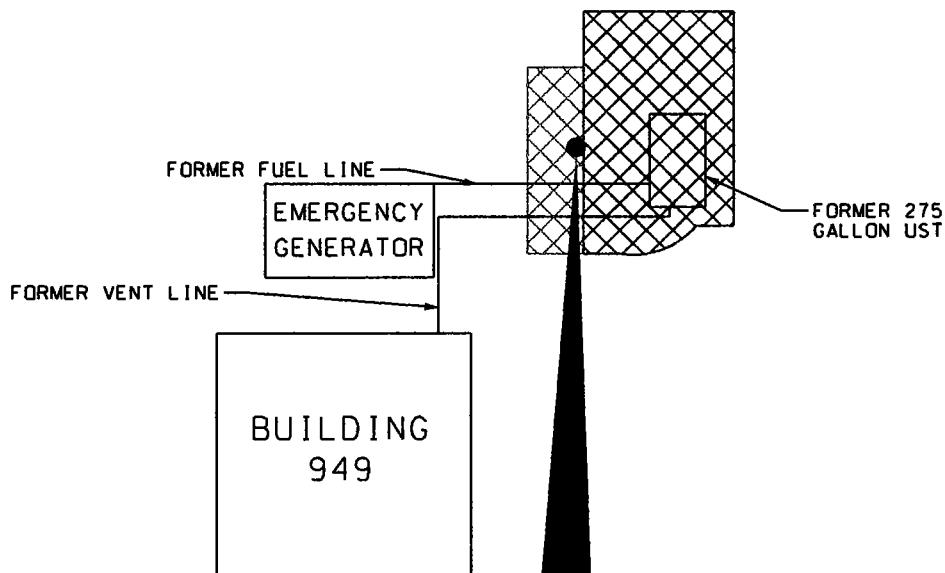

SAMPLING LOCATION: SAMPLING DEPTH: SAMPLING DATE:	HIGHER OF NJDEP GWQS AND POL	BLDG 949 6-10' BGS 11/13/99	BLDG 949 8-13' BGS 12/11/99
VOLATILE ORGANIC COMPOUNDS:			
CIS-1,2-DICHLOROETHENE:	10	2.19	3.40
TETRACHLOROETHENE:	1.0	2.13	2.13
SEMIVOLATILE ORGANIC COMPOUNDS:			
2-METHYLNAPHTHALENE:	NLE	1.27	1.54



LEGEND

- GROUNDWATER SAMPLE LOCATION
(NOVEMBER 13, 1999 AND DECEMBER 11, 1999)
- ▨ LIMIT OF EXCAVATION
(MAY 12, 1998)
- ▨ LIMIT OF EXCAVATION
(SEPTEMBER 1, 1998)

NOTES:

1. ND=INDICATES COMPOUND NOT DETECTED
2. NLE= NO LIMIT ESTABLISHED
3. ALL RESULTS IN UG/L
4. BGS = BELOW GROUND SURFACE

FIGURE 5
GROUNDWATER SAMPLING MAP
BUILDING 949
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS
BRISTOL, PA.

SCALE: 1"=10'

DATE: MAY 1998

APPENDIX A

NJDEP-STANDARD REPORTING FORM

NEW JERSEY DEPARTMENT OF ENVIRONMENTAL PROTECTION
DIVISION OF RESPONSIBLE PARTY SITE REMEDIATION
BUREAU OF APPLICABILITY AND COMPLIANCE
Registration and Billing Unit
CN 028, Trenton, N.J. 08625-0028
1-609-984-3156

UNDERGROUND STORAGE TANK
FACILITY QUESTIONNAIRE

FOR STATE USE ONLY

Check In ☐ Yes ☐ No

STATUS Active Inactive COMCODE

☐ ☐ ☐ ☐ ☐

FACILITY UST # 81533 (Tank # 203)

Building 949

Completion of this Registration Questionnaire will satisfy the registration requirements of the Underground Storage of Hazardous Substances Act, N.J.S.A. 58:10A-21, and the Registration and Billing Regulations N.J.A.C. 7:14B-2.

[Check appropriate box(es)]

- A. ☐ Is this a registration of a proposed or newly installed underground storage tank? (This form must be filed at least 30 days prior to operation)
B. ☐ Is this a registration of an existing underground storage tank not presently registered?
C. ☒ Is this a correction or amendment to an existing facility registration? UST # 81533
D. ☐ There have been no changes to the facility registration since last submittal. UST # _____ (Go to certification page for signatures)

If "C" is checked above, please check the appropriate type of change(s) below

- | | | |
|--|---|--|
| ☐ Facility Name and/or Address Change | ☐ Type of Product(s) Stored | ☐ Financial Responsibility Change |
| ☐ Owner Name and/or Address Change | ☐ Spills, Leaks, Releases | ☐ Substantial Modification(s) |
| ☐ Facility Operator and/or Address Change | ☐ Tank(s) and/or Piping Changes | ☐ Sale or Transfer (Complete Questions 4,5,6 & 13D) |
| ☐ Owner Contact Person Change | ☒ Closure (Complete Question #13) | ☐ Other (please specify) |

SECTION A - GENERAL FACILITY INFORMATION

1. Facility Name MAIN POST FORT MONMOUTH

2. Facility Location _____

NUMBER AND STREET

CITY OR MUNICIPALITY

COUNTY

STATE N.J.

ZIP CODE

BLOCK

LOT

3. Facility Operator _____

PERSON OR TITLE

Contact Tele. No. _____

(Area Code)

(Extension)

Operator Address (if different than #2) _____

NUMBER AND STREET

CITY OR MUNICIPALITY

STATE

ZIP CODE

4. Tank Owner _____

5. Tank Owner Address _____

NUMBER AND STREET

CITY OR MUNICIPALITY

STATE

ZIP CODE

Contact Person (Tank Owner) _____

Contact Tele. No. _____

(Area Code)

(Extension)

7. EPA ID # ☐

8. Total number of regulated underground storage tanks at facility ☐ ☐ ☐ ☐ (Complete Section B for each tank)

9. Total regulated underground storage tank capacity at facility (gallons)

10. Facility Type: A ☐ State C ☐ County/Municipal E ☐ Charitable / Public School G ☐ Other
 B ☐ Commercial/Industrial D ☐ Federal F ☐ Residence H ☐ Farm (as defined in N.J.S.A. 54:4-23.1 et seq.)

11. Is a copy of the facility site plan submitted with this registration pursuant to N.J.A.C. 7:14B-2? ☐ YES ☐ NO

SECTION B - SPECIFIC TANK INFORMATION

ALL underground tanks, including those taken out of operation (UNLESS THE TANK WAS REMOVED FROM THE GROUND PRIOR TO 9/3/86) must be registered. Report all tank/piping status changes unless previously submitted.

1. Tank Identification Number	TANK NO.			TANK NO.			TANK NO.			TANK NO.			TANK NO.		
2. CAS Number (hazardous substances only)															
3. Date Tank Installed (Month/Day/Year)	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year
4. Tank Size (gallons)															
5. Tank Contents (Mark one "X" for each tank)															
A. Leaded gasoline															
B. Unleaded gasoline															
C. Alcohol enriched gasoline															
D. Light diesel fuel (No. 1-D)															
E. Medium diesel fuel (No. 2-D)															
F. Waste Oil															
G. Kerosene (No. 1)															
H. Home heating oil (No. 2)															
J. Heating oil (No. 4)															
K. Heavy heating oil (No. 6)															
L. Aviation fuel															
M. Motor oil															
N. Lubricating oil															
P. Sewage															
Q. Sewage sludge															
R. Other hazardous substances (specify)															
S. Hazardous waste (specify ID number)															
T. Mixtures (please specify)															
U. Emergency spill tank (specify substance)															
V. Other petroleum products (please specify)															
W. Other (please specify)															
6. Tank & Piping Construction (Mark one each for both tank & piping)	Tank	Piping		Tank	Piping		Tank	Piping		Tank	Piping		Tank	Piping	
A. Bare Steel															
B. Cathodically protected steel															
C. Fiberglass-coated steel															
D. Fiberglass-reinforced plastic															
E. Internally lined															
F. Other (please specify)															
7. Tank & Piping Structure (Mark one each for both tank & piping)	Tank	Piping		Tank	Piping		Tank	Piping		Tank	Piping		Tank	Piping	
A. Single wall															
B. Double wall															
C. Other (please specify)															
8. Type of Monitoring/Detection System (Mark all that apply for both tank & piping)	Tank	Piping		Tank	Piping		Tank	Piping		Tank	Piping		Tank	Piping	
A. Statistical Inventory Reconciliation															
B. Manual Tank Gauging															
C. Inventory Control															
D. Interstitial															
E. Precision Test															
F. Ground water observation wells															
G. Vapor observation wells															
H. In-tank (automatic) monitoring gauge															
J. Periodic Tank Test															

Tank Identification Number	TANK NO.	TANK NO.	TANK NO.	TANK NO.	TANK NO.					
8. Type of Monitoring/Detection System	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping
K. None	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐
L. Other (please specify)										
9. Overfill Protection (tank only) (Mark one X for each tank)										
A. Yes	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐
B. No	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐
10. Spill Containment Around Fill Pipe (Mark one X for each tank)										
A. Yes	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐
B. No	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐
11. Tank Status (Mark one X for each tank)	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping
A. In-use	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐
B. Empty less than 12 months	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐
C. Empty 12 months or more	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐
D. Emergency spill tank (sump)	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐
E. Emergency backup generator tank	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐
F. Abandoned in Place	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐
G. Removed	☐	☐	☐	☐	☐	☐	☐	☐	☐	☐
H. Other (please specify)										
12. If box 11B, C, or D above has been marked, indicate the estimated date last used (month/day/year)	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year
13. Closure Information - Tank ID No.	TANK NO.	TANK NO.	TANK NO.	TANK NO.	TANK NO.	TANK NO.	TANK NO.	TANK NO.	TANK NO.	TANK NO.
	01203									
A. Date abandoned in place	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year
B. Date taken temporarily out of service										
C. Date removed	0511211918									
D. Date of Sale or Transfer										
E. TMS # (if applicable)										
F. ISRA # (if applicable)										

SECTION C - FINANCIAL RESPONSIBILITY

Does this facility have a Financial Responsibility Assurance Mechanism as required in 40 CFR 280? ☐ YES ☐ NO

Please list the appropriate financial information below:

Type	Carrier / Issuing Agency
Effective Date	Expiration Date
Policy Number	Amount

SECTION D - MONITORING SYSTEMS

Does this facility have a release detection monitoring system which is in compliance with N.J.A.C. 7:14B-6?

☐ YES ☐ NO

If "No", please be aware that the facility must meet the appropriate deadline. (See "Dates to Know" on Page 4)

SECTION E - RECORDKEEPING/COMPLIANCE

Please answer all the questions in this section on a facility basis. Any one tank not in compliance requires a "NO" answer for the entire facility.

- Does this facility have cathodic protection systems for all steel tanks and piping?
If "Yes", are the systems properly operated and maintained pursuant to N.J.A.C. 7:14B-5?
- Are the performance claims and documentation of monitoring systems maintained by the owner or operator pursuant to N.J.A.C. 7:14B-5?
- Are the proper monitoring, testing, sampling, repair and inventory records kept on-site pursuant to N.J.A.C. 7:14B-5 and 6?
- Is the proper Release Response Plan kept on-site pursuant to N.J.A.C. 7:14B-5?
- Does the facility have spill and over fill protection systems pursuant to N.J.A.C. 7:14B-4?
- Have all Fill Ports been permanently marked as per API #1637 pursuant to N.J.A.C. 7:14B-5?

☐ YES ☐ NO
☐ YES ☐ NO
☐ YES ☐ NO
☐ YES ☐ NO
☐ YES ☐ NO
☐ YES ☐ NO

IMPORTANT INFORMATION

- FEE:** Please make checks payable to: "Treasurer, State of New Jersey". Use of the enclosed return envelope will expedite processing. Registration and Billing Schedule can be found in N.J.A.C. 7:14B.
All Initial Registration fees are \$100 per facility.
- PENALTY:** Failure by owner or operator of a regulated underground storage tank to comply with any requirement of the State UST Act or regulations may result in the penalties set forth in N.J.S.A. 58:10A-10.
- EMERGENCY:** If a discharge or spill occurs, the NJDEP Hotline at (609) 292-7172 must be called IMMEDIATELY - 24 hours a day.
- UPGRADE EXEMPTION:** Residential heating oil underground storage tanks are exempt from all upgrade requirements.

DATES TO KNOW (critical deadlines)

- December 22, 1988 — All new federally regulated tank systems must have cathodic protection and spill/overfill protection.
- September 4, 1990 — All new State-only regulated tank systems must have cathodic protection and spill/overfill protection.
- December 22, 1990 — All federally regulated piping must have begun leak detection.
- February 19, 1993 — All federally regulated tank systems must maintain financial responsibility assurance.
- December 22, 1993 — All federally regulated tank systems must have begun leak detection.
- December 22, 1998 — All regulated tanks shall install cathodic protection and spill/overfill protection.

CERTIFICATIONS

NOTE: IF THE PERSON SIGNING CERTIFICATION NO. 2 IS THE SAME AS THE PERSON SIGNING CERTIFICATION NO. 1, THEN CERTIFICATION NO. 2 NEED NOT BE SIGNED. (If different persons are required to sign No. 1 and No. 2, then they must do so.)

CERTIFICATION NO. 1:

Must be signed by the highest ranking individual at the facility with overall responsibility

"I certify under penalty of law that the information provided in this document is true, accurate and complete to the best of my knowledge, information and belief. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

JAMES OTT
(Typed / Printed Name)

Director, DPW
(Title)

(Signature)

5/13/98
(Date)

CERTIFICATION NO. 2:

Must be signed as follows:

- For a corporation, by a principal executive officer of at least the level of vice president
- For a partnership or sole proprietorship, by a general partner or the proprietor, respectively
- For a municipality, State, Federal or other public agency, by either a principal executive officer or ranking elected official
- For persons other than indicated above, by the person with legal responsibility for the site

"I certify under penalty of law that I have personally examined and am familiar with the information submitted herein and all attached documents, and that based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the submitted information is true, accurate and complete. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

(Typed / Printed Name)

(Title)

(Signature)

(Date)

CERTIFICATION NO. 3:

If applicable, must be signed by the individual who is certified to perform services.

"I certify under penalty of law that the information provided in this document is true, accurate and complete to the best of my knowledge, information and belief. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

KEVIN J. PHELAN, GEOLOGIST
(Typed / Printed Name) (Title)

Tetra Tech Environmental Mgmt., Inc.
(Name of Firm, if applicable)

(Signature)

Kevin J. Phelan 5/13/98
(Date)

0018436
(NJ. Certification Number)

Site Remediation Program

UST Site/Remedial Investigation Report Certification Form

A. Facility Name : U.S. Army Fort Monmouth New JerseyFacility Street Address : Directorate of Public Works Building 173Municipality: Oceanport County : MonmouthBlock: _____ Lot(s): _____ Telephone Number : 732-532-6224**B. Owner (RP)'s Name:** _____

Street Address: _____ City : _____

State: _____ Zip: _____ Telephone Number : _____

C. (Check as appropriate)☐ Site Investigation

Report (SIR) \$500 Fee

☐ Remedial Investigation

Report (RIR) \$1000 Fee

☒ NA – Federal
Agreement**D. (Complete all that apply)**• Assigned Case Manager : Ian Curtis, Federal Case Manager• UST Registration Number : 81533-203 (7 digits)• Incident Report Number 98 – 06 – 12 – 1324 – 44 (10 or 12 digits)• Tank Closure Number : Federal Case Manager**E. Certification by the Subsurface Evaluator:**

The attached report conforms to the specific reporting requirements of N.J.A.C. 7:26EYes No

Name: Dinker Desai Signature: _____ UST Cert. No.: 10173Firm: U.S. Army Fort Monmouth Firm's UST Cert. Number: NA-U.S. ArmyFirm Address: Directorate of Public Works Building 173 City: Fort MonmouthState: NJ Zip: 07703 Telephone Number : 732-532-6224

(NOTE: Certification numbers required only if work was conducted on USTs regulated per N.J.S.A. 58:10A-21 et seq.)

F. Certification by the Responsible Party(ies) of the Facility:

The following certification shall be signed [according to the requirements of N.J.A.C. 7:14B-1.7(b)] as follows:

1. For a Corporation by a person authorized by a resolution of the board of directors to sign the document. A copy of the resolution, certified as a true copy by the secretary of the corporation, shall be submitted along with the certification; or
2. For a partnership or sole proprietorship, by a general partner or the proprietor, respectively; or
3. For a municipality, State, federal or other public agency by either a principal executive officer or ranking elected Official.

"I certify under penalty of law that I have personally examined and am familiar with the information submitted in this application and all attached documents, and that based on my inquiry of those individuals responsible for obtaining the information, I believe that the submitted information is true, accurate, and complete. I am aware that there are significant civil penalties for knowingly submitting false, inaccurate, or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

Name (Print or Type): James Ott Title: Directorate of Public Works

Signature: _____

Company Name: U.S. Army Fort Monmouth Date: _____

P. 1

U. 1

P. 1

U. 1

P. 1

U. 1

P. 1

U. 1

P. 1

U. 1

P. 1

U. 1

P. 1

U. 1

P. 1

U. 1

P. 1

U. 1

P. 1

U. 1

P. 1

U. 1

P. 1

U. 1

P. 1

U. 1

P. 1

U. 1

P. 1

U. 1

P. 1

U. 1

P. 1

U. 1

P. 1

U. 1

P. 1

U. 1

APPENDIX C

WASTE MANIFEST



RD1 Box 5A
Old Bridge, N.J. 08857
(732) 721-0900
Fax (732) 721-0231

STANDARD
COLLECTION
ORDER FORM

199329

GENERATOR/LOCATION Fort Monmouth SALES ORDER #

NAME Fort Monmouth ACCOUNT APPROVAL CODE:

INFORMATION/ATTENTION LINE

DELIVERY ADDRESS Riverside Ave Bldg 280. 281

CITY Fort Monmouth STATE NJ ZIP 07703

PHONE NUMBER PURCHASE ORDER NUMBER

USA EPA ID NO. (IF APPLICABLE) NJ3210020597 STATE ID NO.

BILL TO (IF DIFFERENT FROM LOCATION)

NAME SMC Environmental ACCOUNT APPROVAL CODE:

INFORMATION/ATTENTION LINE

DELIVERY ADDRESS

CITY STATE ZIP

PHONE NUMBER PURCHASE ORDER NUMBER

MANIFEST NUMBER 14023

SHIPPING INFORMATION

This is to certify that the below named materials are properly classified, described, packaged, marked and labeled, and are in proper condition for transportation according to the applicable regulations of the Department of Transportation.

NO.	TYPE	QTY.	UNIT	US DOT Description (Including Proper Shipping Name, Hazard Class and ID Number)	SALES REPRESENTATIVE

SERVICE SECTION

SALES CODE	DESCRIPTION	WASTE CODE	QUANTITY	UNIT PRICE	Building	Drums	gallons
40500	USED OIL REMOVAL				1221	1	20
40300	ANTI-FREEZE REMOVAL						
40600	USED OIL FILTER REMOVAL				1700	1	25
40501	OILY-WATER DISPOSAL						
40502	SLUDGE DISPOSAL				400	1	25
41001	GASOLINE/WATER						
41501	DRUM DISPOSAL				949	1	30
41504	TANK ENTRY						
40800	PARTS WASHER SERVICE				979	1	20
41500	TRUCK & OPERATOR						
41511	NEW 55 GAL DRUM /17H				286	1	30
41503	QAQC ANALYTICAL TESTING						
42001	DEXSIL TEST KIT	TAX			2018	1	25
41509	TRANSPORTATION				977	1	25
					2021A	1	20

CHARGE MY ACCOUNT FOR THIS TRANSACTION UNLESS OTHERWISE INDICATED IN THE PAYMENT SECTION.

INVOICES REFLECTING CHARGES TO CUSTOMER ARE SUBJECT TO AN INTEREST RATE OF THE LESSER OF 1 1/2% PER MONTH (18% PER ANNUM) OR THE MAXIMUM RATE ALLOWED BY LAW ON ANY INVOICES THAT ARE NOT PAID WITHIN 30 DAYS. IN THE EVENT OF DEFAULT, LORCO SHALL BE ENTITLED TO RECOVER COSTS OF COLLECTION, INCLUDING REASONABLE ATTORNEY'S FEES.

GENERATOR WARRANTS AND REPRESENTS THAT THE MATERIALS PROVIDED LORCO HEREUNDER HAVE NOT BEEN MIXED, COMBINED, OR OTHERWISE BLENDED IN ANY QUANTITY WITH MATERIALS CONTAINING POLYCHLORINATED BIPHENYLS (PCB) OR ANY OTHER MATERIAL DEFINED AS HAZARDOUS WASTE UNDER APPLICABLE LAWS, INCLUDING BUT NOT LIMITED TO 40 CFR PART 261. GENERATOR AGREES TO INDEMNIFY AND HOLD LORCO HARMLESS FOR ANY DAMAGES, COSTS, ATTORNEY'S FEES, ETC. ARISING OUT OF OR IN ANY WAY RELATED TO A BREACH OF THE ABOVE WARRANTY BY THE GENERATOR.

Generator certifies that the waste is ID72
In accordance the N.J.A.C. 7:26-12.1 et seq, LORCO has the required permits to accept the above described waste.

DEEPA M. DESAI
Print Name Title
 6.1.98
Signature Date
GENERATOR/CUSTOMER

SMALL QUANTITY TOTAL GENERATOR CERTIFICATION

I certify that this generator generates less than 100 kilograms of hazardous waste per month, as defined at 40 C.F.R. 261, and does not accumulate more than 1,000 kilograms of such waste during the month.

GENERATOR'S SIGNATURE

LARGE QUANTITY GENERATOR CERTIFICATION

DEXSIL CDT
TEST RESULTS
2.100C
TA PPM

Total → 9 → 220gall

PAYMENT RECEIVED SECTION

CASH ☐	TOTAL RECEIVED
CHECK NUMBER	

CUSTOMER SERVICED EVERY 30 DAYS ☐

In accordance with 40 CFR 266 § 43(5) LORCO has notified the US EPA of its location and used oil management activities

Anibal Vucogorac
Print Name

Signature Date
LORCO REPRESENTATIVE



RD. 1, BOX 5A - OLD BRIDGE, NJ 08857

NON-HAZARDOUS
WASTE MANIFEST

1. Generator's US EPA ID No.

NJ3210020597

Manifest
Document No.

14073

2. Page 1
of 1

NHZ 014023

3. Generator's Name and Mailing Address

U.S. Army Communications Electronics command
main Post, Bldg. 173 Joe Fallon BTR, SCLerm-PW-EV

4. Generator's Phone

(732) 532-6223 Fort Monmouth, NJ 07703

5. Transporter 1 Company Name

LIONETTI OIL RECOVERY CO INC

6. US EPA ID Number

NJ D 0 8 4 0 4 4 0 6 4

A. Transporter's Phone

908 721-0900

7. Transporter 2 Company Name

8. US EPA ID Number

B. Transporter's Phone

9. Designated Facility Name and Site Address

LIONETTI OIL RECOVERY CO INC DBA LORCO PETROLEUM SVCS
RUNYON&CHEESELAKE RDS
OLD BRIDGE, NJ 08857

10. US EPA ID Number

NJ D 0 8 4 0 4 4 0 6 4

C. Facility's Phone

908 721-0900

11. Waste Shipping Name and Description

12. Containers

No.

Type

13.
Total
Quantity14.
Unit
Wt/Vola. PETROLEUM OIL (PETROLEUM OIL)
COMBUSTIBLE LIQUID UN1270 PGII

00

T

1220

G

b.

c.

d.

D. Additional Descriptions for Materials Listed Above

T, L PETROLEUM OIL 90 %
WATER 10 %

E. Handling Codes for Wastes Listed Above

T04 FILTRATION

15. Special Handling Instructions and Additional Information

24 HR EMERGENCY RESPONSE#(908) 721-0900
DECAL 87066 ERG#128 DEXSIL TEST KIT RESULTS 4:00 PM
MANIFEST USED FOR TRACKING PURPOSES ONLY

16. GENERATOR'S CERTIFICATION: I certify the materials described above on this manifest are not subject to federal regulations for reporting proper disposal of Hazardous Waste.

Printed/Typed Name

DINKER, M. DEBAZ

Signature

[Signature]

Month Day Year

06 01 98

17. Transporter 1 Acknowledgement of Receipt of Materials

Printed/Typed Name

Anibal Vazquez

Signature

[Signature]

Month Day Year

06 01 98

18. Transporter 2 Acknowledgement of Receipt of Materials

Printed/Typed Name

Signature

Month Day Year

19. Discrepancy Indication Space

20. Facility Owner or Operator: Certification of receipt of waste materials covered by this manifest except as noted in Item 19.

Printed/Typed Name

Signature

Month Day Year

ORIGINAL RETURN TO GENERATOR

P. 1
L. 1
P. 2
L. 2
P. 3
L. 3
P. 4
L. 4
P. 5
L. 5
P. 6
L. 6
P. 7
L. 7
P. 8
L. 8
P. 9
L. 9
P. 10
L. 10
P. 11
L. 11
P. 12
L. 12
P. 13
L. 13
P. 14
L. 14
P. 15
L. 15
P. 16
L. 16
P. 17
L. 17
P. 18
L. 18
P. 19
L. 19
P. 20
L. 20
P. 21
L. 21
P. 22
L. 22
P. 23
L. 23
P. 24
L. 24
P. 25
L. 25
P. 26
L. 26
P. 27
L. 27
P. 28
L. 28
P. 29
L. 29
P. 30
L. 30
P. 31
L. 31
P. 32
L. 32
P. 33
L. 33
P. 34
L. 34
P. 35
L. 35
P. 36
L. 36
P. 37
L. 37
P. 38
L. 38
P. 39
L. 39
P. 40
L. 40
P. 41
L. 41
P. 42
L. 42
P. 43
L. 43
P. 44
L. 44
P. 45
L. 45
P. 46
L. 46
P. 47
L. 47
P. 48
L. 48
P. 49
L. 49
P. 50
L. 50
P. 51
L. 51
P. 52
L. 52
P. 53
L. 53
P. 54
L. 54
P. 55
L. 55
P. 56
L. 56
P. 57
L. 57
P. 58
L. 58
P. 59
L. 59
P. 60
L. 60
P. 61
L. 61
P. 62
L. 62
P. 63
L. 63
P. 64
L. 64
P. 65
L. 65
P. 66
L. 66
P. 67
L. 67
P. 68
L. 68
P. 69
L. 69
P. 70
L. 70
P. 71
L. 71
P. 72
L. 72
P. 73
L. 73
P. 74
L. 74
P. 75
L. 75
P. 76
L. 76
P. 77
L. 77
P. 78
L. 78
P. 79
L. 79
P. 80
L. 80
P. 81
L. 81
P. 82
L. 82
P. 83
L. 83
P. 84
L. 84
P. 85
L. 85
P. 86
L. 86
P. 87
L. 87
P. 88
L. 88
P. 89
L. 89
P. 90
L. 90
P. 91
L. 91
P. 92
L. 92
P. 93
L. 93
P. 94
L. 94
P. 95
L. 95
P. 96
L. 96
P. 97
L. 97
P. 98
L. 98
P. 99
L. 99
P. 100
L. 100

APPENDIX D
UST DISPOSAL CERTIFICATE



SMC Environmental Services Group
A Subsidiary of Science Management Corporation

BY _____ DATE _____

SHEET _____ OF _____

CHKD. BY _____ DATE _____

W. O. NO. _____

PROJECT _____

SUBJECT _____

908-747-7784

908-747-7779

Red Bank Recycling Auto Wreckers, Inc.

64 Central Avenue, Red Bank, New Jersey 07701

Date 5/14/88

M 1000 lbs

Feet 1100000000

	AMOUNT	CWT	TOTAL
LIGHT IRON			
NO. 1 STEEL	1700		1700
NO. 2 STEEL			
D. M. B.			
CAST IRON			
COPPER			
BRASS			
ALUMINUM			
RADIATORS			
BATTERIES			
CARS			

I, the owner of said vehicles, do hereby release it to Red Bank Recycling Auto Wreckers, Inc.

Signature of Owner [Signature]



The Drawing Board
P.O. Box 2044, Hartford, CT 06144-2044
Call for Price: 1-800-827-8888

NEORDER ITEM # BLN74

STRAIGHT BILL OF LADING
ORIGINAL - NOT NEGOTIABLE

Shipper No. 009

Carrier No. _____

SMC ENVIRONMENTAL SERVICES GROUP
(Name of Carrier)

Date _____

To: Red Bank Recycling	From: Fort Monmouth (U.S. Army)
Box: 164 Central Avenue	Box: Building 949
City: Red Bank, N.J. Zip Code: 07701	City: Oceanport, N.J.

No. of Pieces	Weight (Lbs.)	Kind of Packaging, Description of Articles, Special Marks and Exception	Weight (Lbs.)	Rate	Charges
①		for setup only 1 - 275 Gallon U.S. St Steel "clam"			
		TANK # : 81533-203			
		Building # : 949			

REMIT C.O.D. TO: ADDRESS:	COD Amt: \$	C.O.D. FEE: PREPAID ☐ \$ COLLECT ☐ \$ TOTAL CHARGES: \$
--	--------------------	--

RECEIVED. Subject to the classification and tariff to effect on the date of the issue of this Bill of Lading, the property described above is accepted, good order, except as noted (contents and condition of contents of packages, references, marks, numbers, and classified as indicated above which said carrier has undertaken to transport. This contract is made by the person or corporation in possession of the property hereby the carrier agrees to carry to the named place of delivery at said destination, if on its route, otherwise to deliver to another carrier on the route to said destination. It is mutually agreed upon and understood by all parties to this bill of lading that the carrier shall not be liable for any loss or damage to the property or any portion of said loss or damage to the property, but every carrier shall be responsible for the loss or damage to the property and conditions in the governing classification on the date of shipment.

By the carrier, I hereby certify that the property is in good order and condition in the governing classification and the said terms and conditions are hereby agreed to by the shipper and accepted for himself and his consignee.

SHIPPER Fort Monmouth (U.S. Army)	CARRIER SMC ENVIRONMENTAL SERVICES GROUP
PER _____	PER Mark C. Sullivan
	DATE 05/14/98

*Mark with "X" to designate Exception Marked as defined in Title 49 of the Code of Federal Regulations.

Register Item BLN74 The Drawing Board, P.O. Box 2044, Hartford, CT 06144-2044
© 1998, 1999, Printed in U.S.A.

APPENDIX E

SOIL ANALYTICAL DATA PACKAGE

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

REPORT OF ANALYSIS

Client: U.S. Army
DPW, SELFM-PW-EV
Bldg. 173
Ft. Monmouth, NJ 07703

Project: Total Petroleum Hydrocarbons
98-0779
Bldg. 949
Tetra Tech

Project # 3562
Date Rec. 05/12/98
Date Compl. 05/13/98
Released by:



Daniel K. Wright
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Cover Sheet	1
Table of Contents	2
Method Summary	3
Conformance/Non-Conformance	4
Chain of Custody	5
Results Summary	6
Initial Calibration Summary	7
Continuing Calibration Summary	8
Surrogate Results Summary	9
MS/MSD Results Summary	10
Quality Control Spike Summary	11
Raw Sample Data	12-31
Laboratory Deliverable Checklist	32

Method Summary

NJDEP Method OQA-QAM-025-10/97

Gas Chromatographic Determination of Total Petroleum Hydrocarbons in Soil

Fifteen grams (15g)(wet weight) of a soil sample is added to a 125 mL acid cleaned, solvent rinsed, capped Erlenmeyer flask. 15g anhydrous sodium sulfate is added to dry sample. Surrogate standard spiking solution is then added to the flask.

Twenty five milliliters(25mL) Methylene Chloride is added to the flask and it is secured on a gyrotory shaker table. The agitation rate is set to 400rpm and the sample is shaken for 30 minutes. The flask is removed from the table and the particulate matter is allowed to settle. The extract is transferred to a Teflon capped vial. A second 25mL of Methylene Chloride is added to the flask and shaken for an additional 30 minutes. The flask is again removed and allowed to settle. The extracts are combined in the vial then transferred to a 1mL autosampler vial.

The extract is then injected directly into a GC-FID for analysis. The sample is analyzed for petroleum hydrocarbons covering a range of C8-C42 including pristane and phytane. Total Petroleum Hydrocarbon concentration is determined by integrating between 5 minutes and 22 minutes. The baseline is established by starting the integration after the end of the solvent peak and stopping after the last peak.


The final concentration of Total Petroleum Hydrocarbons is calculated using percent solid, sample weight and concentration.

PHC Conformance/Non-conformance Summary Report

	<u>No</u>	<u>Yes</u>
1. Method Detection Limits provided.	<u>—</u>	<u>✓</u>
2. Method Blank Contamination - If yes, list the sample and the corresponding concentrations in each blank. _____ _____	<u>✓</u>	<u>—</u>
3. Matrix Spike Results Summary Meet Criteria. (If not met, list the sample and corresponding recovery which falls outside the acceptable range). _____ _____	<u>—</u>	<u>✓</u>
4. Duplicate Results Summary Meet Criteria. (If not met, list the sample and corresponding recovery which falls outside the acceptable range). _____ _____	<u>—</u>	<u>✓</u>
5. IR Spectra submitted for standards, blanks, & samples	<u>—</u>	<u>NA</u>
6. Chromatograms submitted for standards, blanks, and samples if GC fingerprinting was conducted.	<u>—</u>	<u>✓</u>
7. Analysis holding time met. (If not met, list number of days exceeded for each sample) _____ _____	<u>—</u>	<u>✓</u>
Additional Comments: _____ _____ _____		

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW 846 for Solid Waste Analysis. I have personally examined the information contained in this report, and to the best of my knowledge, I believe that the submitted information is true, accurate, complete, and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.

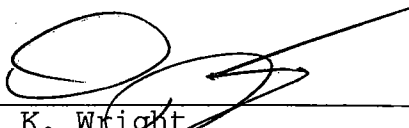

Daniel K. Wright
Laboratory Manager



Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-3484 EMail:appleby@doim6.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

[illegible]

Report of Analysis
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification # 13461

Client : U.S. Army **Lab. ID # :** 3562
DPW. SELFM-PW-EV **Date Rec'd:** 12-May-98
Bldg. 173 **Analysis Start:** 13-May-98
Ft. Monmouth, NJ 07703 **Analysis Complete:** 13-May-98

Analysis: OQA-QAM-025 **UST Reg. #:**
Matrix: Soil **Closure #:**
Analyst: D.DEINHARDT **DICAR #:**
Ext. Meth: Shake **Location #:** BLDG. 949

Sample	Field ID	Dilution Factor	Weight (g)	% Solid	MDL (mg/kg)	TPHC Result (mg/kg)
3562.01	949-S	1.00	15.59	81.05	186	704.12
3562.02	949-E1	1.00	15.64	84.00	179	ND
3562.03	949-E2	1.00	15.66	84.19	178	ND
3562.04	949-N	1.00	15.39	84.96	180	1336.24
3562.05	949-B	1.00	15.61	78.17	193	875.69
3562.06	949-W	1.00	15.81	80.78	184	3121.52
3562.07	949-PP	1.00	15.15	86.13	180	ND
3562.08	949-V	1.00	15.94	87.83	168	284.53
3562.09	949-B2	1.00	15.56	70.08	216	ND
3562.10	949-W2	1.00	15.56	76.46	198	580.47
METHOD BLANK	TBLK 98	1.00	15.00	100.00	157	ND

ND = Not Detected

MDL = Method Detection Limit


Daniel K. Wright
Laboratory Director

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted
2. Table of Contents submitted
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted
4. Document paginated and legible
5. Chain of Custody submitted
6. Samples submitted to lab within 48 hours of sample collection
7. Methodology Summary submitted
8. Laboratory Chronicle and Holding Time Check submitted
9. Results submitted on a dry weight basis
10. Method Detection Limits submitted
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP

✓
✓
✓
✓
✓
✓
✓
✓
✓
✓
✓

Laboratory Manager or Environmental Consultant's Signature

Date 7/15/97



Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance

Transmission Report

9-19-00; 9:18
732 532 6263
Ft Monmouth Envr Lab
FMETL

[illegible][illegible]
$$f' = 1$$

1. $\frac{1}{2} \times \frac{1}{2} = \frac{1}{4}$

1

E C
 B C
 G 7
 I 3

RE: Resend
MP: Multi-Poll
RM: Receive to Memory
LP: Local Print

PD: Polled by Remote
PG: Polling a Remote
DR: Document Removed
FO: Forced Output

MB: Receive to Mailbox
PI: Power Interruption
TM: Terminated by user
WT: Waiting Transfer

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

REPORT OF ANALYSIS

Client: U.S. Army
DPW, SELFM-PW-EV
Bldg. 173
Ft. Monmouth, NJ 07703

Project: Total Petroleum Hydrocarbons
98-0932
Bldg. 949
SMC

Project # 3849
Date Rec. 09/01/98
Date Compl. 09/03/98
Released by:


Daniel K. Wright **Date:** 9/15/98
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Cover Sheet	1
Table of Contents	2
Method Summary	3
Conformance/Non-Conformance	4
Chain of Custody	5
Results Summary	6
Initial Calibration Summary	7-12
Continuing Calibration Summary	13-16
Surrogate Results Summary	17
MS/MSD Results Summary	18
Quality Control Spike Summary	19
Raw Sample Data	20-26
Laboratory Deliverable Checklist	27
Laboratory Authentication Statement	28

Method Summary

NJDEP Method OQA-QAM-025-10/97

Gas Chromatographic Determination of Total Petroleum Hydrocarbons in Soil

Fifteen grams (15g)(wet weight) of a soil sample is added to a 125 mL acid cleaned, solvent rinsed, capped Erlenmeyer flask. 15g anhydrous sodium sulfate is added to dry sample. Surrogate standard spiking solution is then added to the flask.

Twenty five milliliters(25mL) Methylene Chloride is added to the flask and it is secured on a gyrotory shaker table. The agitation rate is set to 400rpm and the sample is shaken for 30 minutes. The flask is the removed from the table and the particulate matter is allowed to settle. The extract is transferred to a Teflon capped vial. A second 25mL of Methylene Chloride is added to the flask and shaken for an additional 30 minutes. The flask is again removed and allowed to settle. The extracts are combined in the vial then transferred to a 1mL autosampler vial.

The extract is then injected directly into a GC-FID for analysis. The sample is analyzed for petroleum hydrocarbons covering a range of C8-C42 including pristane and phytane. Total Petroleum Hydrocarbon concentration is determined by integrating between 5 minutes and 22 minutes. The baseline is established by starting the integration after the end of the solvent peak and stopping after the last peak.

The final concentration of Total Petroleum Hydrocarbons is calculated using percent solid, sample weight and concentration.

PHC Conformance/Non-conformance Summary Report

- | | Indicate
Yes, No, N/A |
|---|--------------------------|
| 1. Method Detection Limits provided. | <u>yes</u> |
| 2. Method Blank Contamination – If yes, list the sample and the corresponding concentrations in each blank.

_____ | <u>NO</u> |
| 3. Matrix Spike Results Summary Meet Criteria
(If not met, list the sample and corresponding recovery which falls outside the acceptable range).

_____ | <u>yes</u> |
| 4. Duplicate Results Summary Meet Criteria
(If not met, list the sample and corresponding recovery which falls outside the acceptable range).

_____ | <u>yes</u> |
| 5. IR Spectra submitted for standards, blanks and samples. | <u>NA</u> |
| 6. Chromatograms submitted for standards, blanks and samples if GC fingerprinting was conducted. | <u>yes</u> |
| 7. Analysis holding time met.
(If not met, list number of days exceeded for each sample).

_____ | <u>yes</u> |

Additional comments: _____



Laboratory Manager

9/13/95

Date



Tel (732)532-4359 Fax (732)532-3484 EMail:appleby@doim6.monmouth.army.mil

Chain of Custody Record

print legibly

Report of Analysis
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification # 13461

Client : U.S. Army **Lab. ID # :** 3849
DPW. SELFM-PW-EV **Date Rec'd:** 01-Sep-98
Bldg. 173 **Analysis Start:** 01-Sep-98
Ft. Monmouth, NJ 07703 **Analysis Complete:** 03-Sep-98

Analysis: OQA-QAM-025 **UST Reg. #:**
Matrix: Soil **Closure #:**
Analyst: D.DEINHARDT **DICAR #:**
Inst. ID. GC TPHC INST. #1 **Injection Volume** 1 ul
Column Type RTX 5 **Column ID** 0.32 um
Ext. Meth: Shake **Location #:** BLDG. 949

Sample	Field ID	Dilution Factor	Weight (g)	% Solid	MDL (mg/kg)	TPHC Result (mg/kg)
3849.01	949-N2	1.00	15.37	85.55	179	571.87
3849.02	949-N3	1.00	15.66	84.76	177	240.03
3849.03	949-B3	1.00	15.42	92.65	164	ND
METHOD BLANK	TBLK 156	1.00	15.00	100.00	157	ND

ND = Not Detected

MDL = Method Detection Limit


Daniel K. Wright
Laboratory Director

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted
2. Table of Contents submitted
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted
4. Document paginated and legible
5. Chain of Custody submitted
6. Samples submitted to lab within 48 hours of sample collection
7. Methodology Summary submitted
8. Laboratory Chronicle and Holding Time Check submitted
9. Results submitted on a dry weight basis
10. Method Detection Limits submitted
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP

✓
✓
✓
✓
✓
✓
✓
✓
✓
✓
✓

Laboratory Manager or Environmental Consultant's Signature

Date 9/15/96

Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance.

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW 846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.

A handwritten signature in dark ink, consisting of several loops and a long horizontal stroke extending to the right, positioned above a solid horizontal line.

Daniel K. Wright
Laboratory Manager

APPENDIX F

GROUNDWATER ANALYTICAL DATA PACKAGE

FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732) 532-6224 FAX: (732) 532-6263

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

CERTIFICATIONS: NJDEP #13461, NYSDOH #11699



ANALYTICAL DATA REPORT
Fort Monmouth Environmental Laboratory
ENVIRONMENTAL DIVISION
Fort Monmouth, New Jersey
PROJECT: UST Program

Bldg. 949

Field Sample Location	Laboratory Sample ID#	Matrix	Date and Time of Collection	Date Received
949-1 6-10'	4938.01	Aqueous	13-Nov-99 13:40	11/15/99

ANALYSIS:
FORT MONMOUTH ENVIRONMENTAL LAB
VOA+15, BN+15

ENCLOSURE:
CHAIN OF CUSTODY
RESULTS


 4-7-00
Daniel Wright/Date
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Chain of Custody	1-2
Methodology Summary	3-4
Conformance/Non-Conformance Summary	5-7
Laboratory Chronicle	8-9
Volatile Organics	10-11
Analytical Results Summary	12-15
Tune Results Summary	16-21
Method Blank Results Summary	22-23
Calibration Summary	24-25
Surrogate Recovery Summary	26
MS/MSD Results Summary	27-28
Internal Standard Area & RT Summary	29-30
Chromatograms	331-34
Base Neutrals	35
Analytical Results Summary	36-41
Tune Results Summary	42-45
Method Blank Results Summary	46
Calibration Summary	47-50
Surrogate Recovery Summary	51
MS/MSD Results Summary	52-55
Internal Standard Area & RT Summary	56-59
Chromatograms	60-63
Laboratory Deliverables Checklist	64
Laboratory Authentication Statement	65

CHAIN OF CUSTODY

000001

METHOD SUMMARY

000003

Method Summary

EPA Method 624

Gas Chromatographic Determination of Volatiles in Water

Surrogates and internal standards are added to a 5-ml aliquot of sample. The sample is then purged and desorbed into a GC/MS system. The organic compounds are separated by the gas chromatograph and detected using the mass spectrometer. Volatiles are identified and quantitated.

EPA Method 3510/8270

Gas Chromatographic Determination of Semi-volatiles in Water

Surrogates are added to measured volume of sample, usually 1 liter, at a specified pH. The sample is serially extracted with Methylene chloride using a separatory funnel. The extract concentrated and internal standards are added. The sample is injected into a GC/MS system. Semi-volatiles are identified and quantitated.

000004

CONFORMANCE/NON- CONFORMANCE SUMMARY

000005

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT

Indicate
Yes, No, N/A

1. Chromatograms labeled/Compounds identified
(Field samples and method blanks) yes
2. Retention times for chromatograms provided yes
3. GC/MS Tune Specifications
 - a. BFB Meet Criteria yes
 - b. DFTPP Meet Criteria yes
4. GC/MS Tuning Frequency – Performed every 24 hours for 600 series and 12 hours for 8000 series yes
5. GC/MS Calibration – Initial Calibration performed before sample analysis and continuing calibration performed within 24 hours of sample analysis for 600 series and 12 hours for 8000 series yes
6. GC/MS Calibration requirements
 - a. Calibration Check Compounds Meet Criteria yes
 - b. System Performance Check Compounds Meet Criteria yes
7. Blank Contamination – If yes, List compounds and concentrations in each blank: NO
 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction _____
8. Surrogate Recoveries Meet Criteria NO

If not met, list those compounds and their recoveries, which fall outside the acceptable range:

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction Terphenyl 14 low conc 949-1

If not met, were the calculations checked and the results qualified as "estimated"? _____
9. Matrix Spike/Matrix Spike Duplicate Recoveries Meet Criteria yes

(If not met, list those compounds and their recoveries, which fall outside the acceptable range)

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction _____

000006

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT (cont.)

Indicate
Yes, No, N/A

10. Internal Standard Area/Retention Time Shift Meet Criteria
(If not met, list those compounds, which fall outside the acceptable range)

Yes

- a. VOA Fraction _____
b. B/N Fraction _____
c. Acid Fraction _____

11. Extraction Holding Time Met

Yes

If not met, list the number of days exceeded for each sample: _____

12. Analysis Holding Time Met

Yes

If not met, list the number of days exceeded for each sample: _____

Additional Comments:

Laboratory Manager: _____

Date: 4-7-00

000007

LABORATORY CHRONICLE

000608

Laboratory Chronicle

Lab ID: 4938

Site: Bldg. 949

	Date	Hold Time
Date Sampled	11/13/99	NA
Receipt/Refrigeration	11/13/99	NA

Extractions

1. Base Neutral	11/16/99	14 days
-----------------	----------	---------

Analyses

1. Volatile Organics	11/15,16/99	14 days
2. Base Neutral	11/19/99	40 days

*Samples collected and refrigerated on 11/13/99, Laboratory received the samples Monday 11/15/99.

000009

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

Definition of Qualifiers

MDL : Method Detection Limit
J : Compound identified below detection limit
B : Compound in both sample and blank
D : Results from dilution of sample
U : Compound searched for but not detected
E : Compound exceeds calibration limit

000610

VOLATILES ORGANIC

000011

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VB004794.D**
 Operator **Skelton**
 Date Acquired **15 Nov 1999 3:31 pm**

Sample Name **Vblk147**
 Field ID **Vblk147**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

Vblk147

Lab Name: FMETL Project: 100004
NJDEP#: 13461 Case No.: 4938 Location: Bldg94 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: Vblk147
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB004794.D
Level: (low/med) LOW Date Received: 11/15/99
% Moisture: not dec. Date Analyzed: 11/15/99
GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VB004814.D**
 Operator **Skelton**
 Date Acquired **16 Nov 1999 5:01 am**

Sample Name **4938.01**
 Field ID **949-1**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene	15.96	64214	2.19 ug/L	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene	25.51	47336	2.13 ug/L	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

949-1

Lab Name: FMETL Project: 100004
NJDEP#: 13461 Case No.: 4938 Location: Bldg94 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 4938.01
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB004814.D
Level: (low/med) LOW Date Received: 11/15/99
% Moisture: not dec. _____ Date Analyzed: 11/16/99
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

5A

**VOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
BROMOFLUOROBENZENE (BFB)**

Lab Name: FMETL Project: 100004
 NJDEP#: 13461 Case No.: 4938 Location: Bldg94 SDG No.:
 Lab File ID: VB004715.D BFB Injection Date: 11/8/99
 Instrument ID: GCMS#2 BFB Injection Time: 11:22
 GC Column: RTX502.2 ID: 0.25 (mm) Heated Purge: (Y/N) N

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
50	8.0 - 40.0% of mass 95	20.0
75	30.0 - 66.0% of mass 95	50.9
95	Base peak, 100% relative abundance	100.0
96	5.0 - 9.0% of mass 95	7.7
173	Less than 2.0% of mass 174	0.0 (0.0)1
174	50.0 - 120.0% of mass 95	75.2
175	4.0 - 9.0% of mass 174	5.3 (7.0)1
176	93.0 - 101.0% of mass 174	72.3 (96.2)1
177	5.0 - 9.0% of mass 176	4.3 (6.0)2

1-Value is % mass 174

2-Value is % mass 176

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	Lab ID.	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	VSTD020	VSTD020	VB004721.D	11/8/99	16:32
02	VBLK145	VBLK145	VB004723.D	11/8/99	17:50
03	4913.01MS	4913.01MS	VB004746.D	11/9/99	9:22
04	4913.01MSD	4913.01MSD	VB004747.D	11/9/99	10:01

Data File : C:\HPCHEM\1\DATA\991108\VB004715.D

Vial: 1

Acq On : 8 Nov 1999 11:22 am

Operator: Skelton

Sample : BFB Tune

Inst : GC VOA 2


Misc : BFB Tune

Multiplr: 1.00

MS Integration Params: GAS1.P

Method : C:\HPCHEM\1\METHODS\M262439.M (RTE Integrator)

Title : Volatile Organics by GC/MS Method 624/8260/TCLP

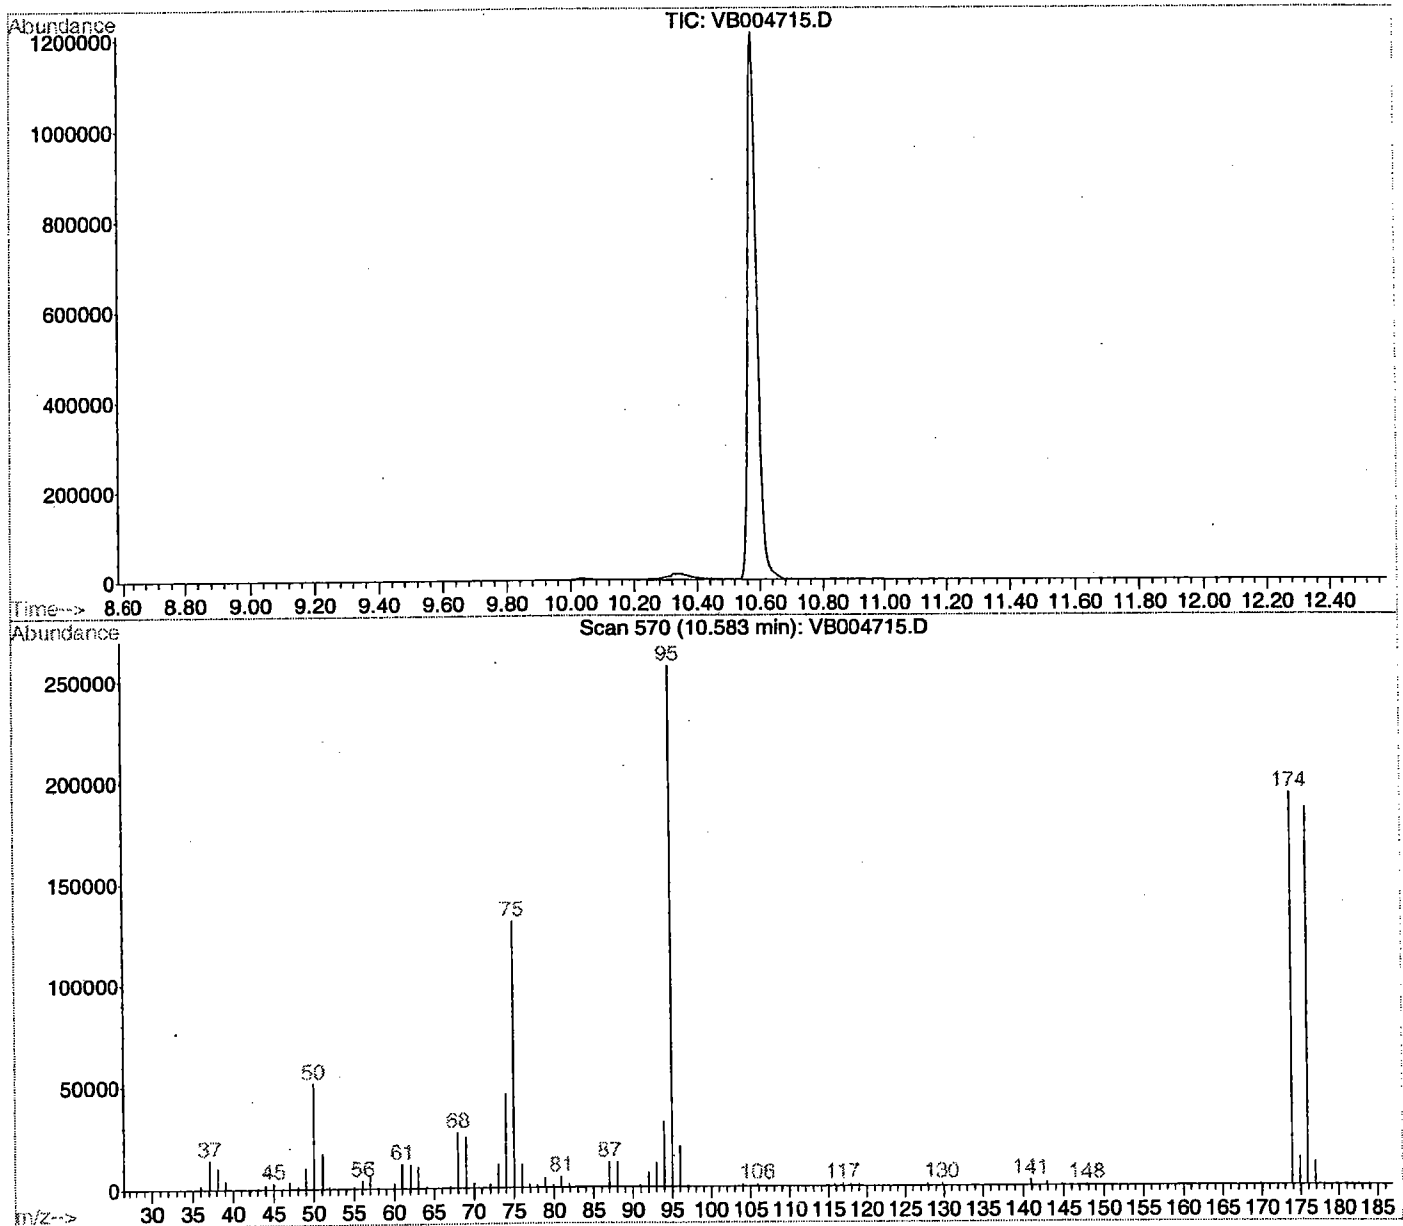

Spectrum Information: Scan 570

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
50	95	15	40	20.0	51464	PASS
75	95	30	60	50.9	130752	PASS
95	95	100	100	100.0	256896	PASS
96	95	5	9	7.7	19656	PASS
173	174	0.00	2	0.0	0	PASS
174	95	50	100	75.2	193152	PASS
175	174	5	9	7.0	13505	PASS
176	174	95	101	96.2	185728	PASS
177	176	5	9	6.0	11156	PASS

5A

**VOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
BROMOFLUOROBENZENE (BFB)**

Lab Name: FMETL Project: 100004
 NJDEP#: 13461 Case No.: 4938 Location: Bldg94 SDG No.:
 Lab File ID: VB004750.D BFB Injection Date: 11/12/99
 Instrument ID: GCMS#2 BFB Injection Time: 8:31
 GC Column: RTX502.2 ID: 0.25 (mm) Heated Purge: (Y/N) N

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
50	8.0 - 40.0% of mass 95	20.8
75	30.0 - 66.0% of mass 95	49.7
95	Base peak, 100% relative abundance	100.0
96	5.0 - 9.0% of mass 95	6.3
173	Less than 2.0% of mass 174	0.0 (0.0)1
174	50.0 - 120.0% of mass 95	73.7
175	4.0 - 9.0% of mass 174	5.5 (7.4)1
176	93.0 - 101.0% of mass 174	72.7 (98.6)1
177	5.0 - 9.0% of mass 176	4.6 (6.3)2

1-Value is % mass 174

2-Value is % mass 176

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	Lab ID.	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	VSTD020	VSTD020	VB004751.D	11/12/99	9:25
02	VSTD010	VSTD010	VB004752.D	11/12/99	10:19
03	VSTD005	VSTD005	VB004753.D	11/12/99	10:58
04	VSTD100	VSTD100	VB004754.D	11/12/99	11:37
05	VSTD050	VSTD050	VB004755.D	11/12/99	12:17

Data File : C:\HPCHEM\1\DATA\991112\VB004750.D

Vial: 1

Acq On : 12 Nov 1999 8:31 am

Operator: Skelton

Sample : BFB Tune

Inst : GC VOA 2



Misc : BFB Tune

Multiplr: 1.00

MS Integration Params: GAS1.P

Method : C:\HPCHEM\1\METHODS\M262439.M (RTE Integrator)

Title : Volatile Organics by GC/MS Method 624/8260/TCLP

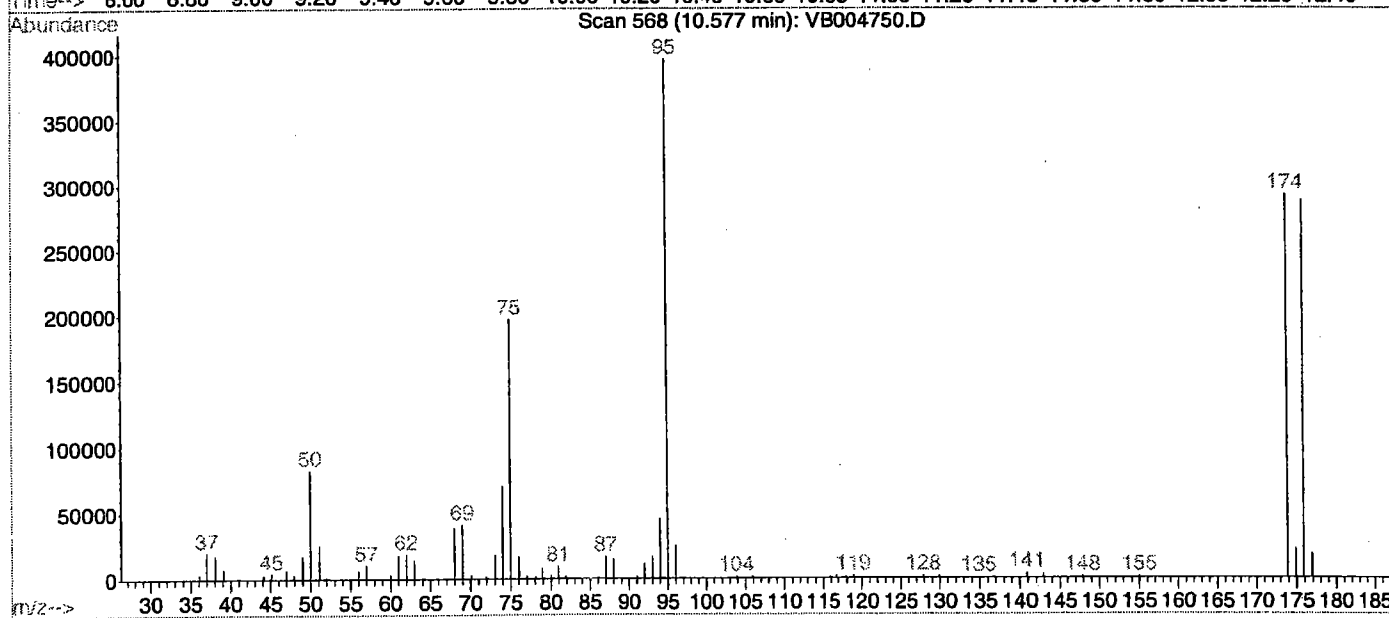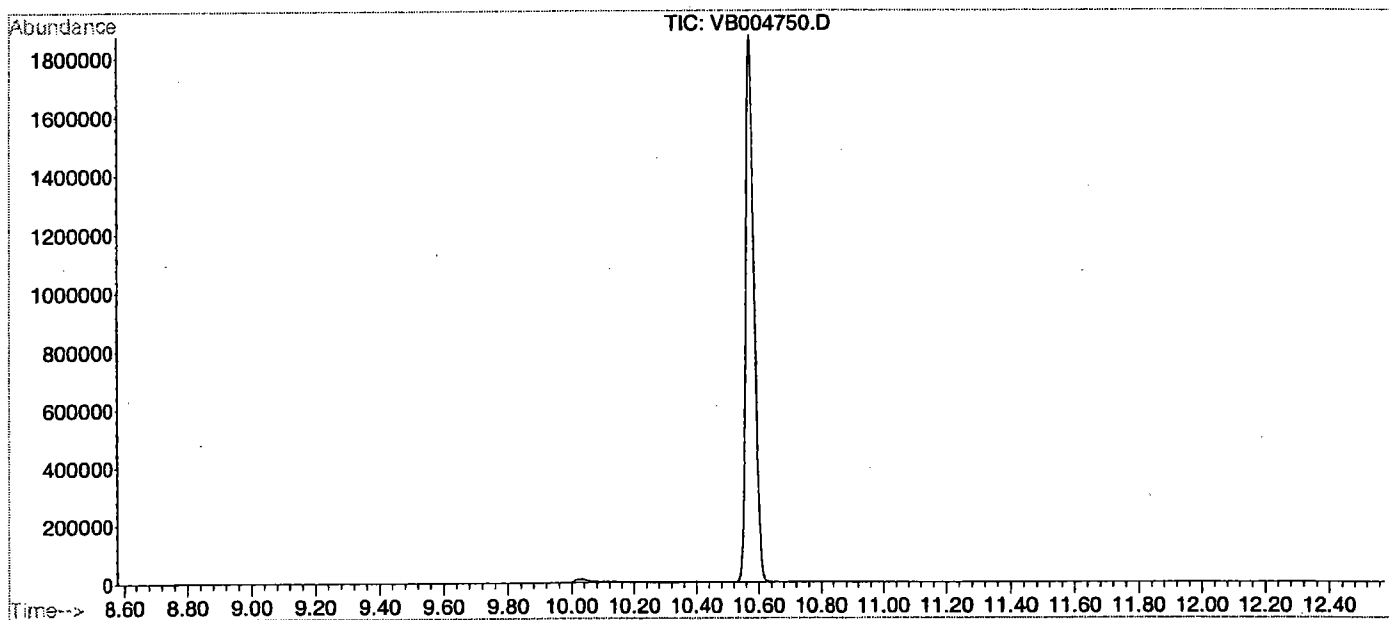

Spectrum Information: Scan 568

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
50	95	15	40	20.8	82488	PASS
75	95	30	60	49.7	197248	PASS
95	95	100	100	100.0	396992	PASS
96	95	5	9	6.3	25080	PASS
173	174	0.00	2	0.0	0	PASS
174	95	50	100	73.7	292736	PASS
175	174	5	9	7.4	21792	PASS
176	174	95	101	98.6	288640	PASS
177	176	5	9	6.3	18264	PASS

BASE NEUTRAL

000035

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name BNA03387.D

Operator Bhaskar

Date Acquired 19-Nov-99

Sample Name Sblk321

Misc Info Sblk321 A 991116

Sample Multiplier 1

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BNA03387.D**
 Operator **Bhaskar**
 Date Acquired **19-Nov-99**

Sample Name **Sblk321**
 Misc Info **Sblk321 A 991116**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

Page 2 of 2

000037

1F

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Sblk321

Lab Name: FMETL Lab Code 13461
Project UST Case No.: 4938 Location 949 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: Sblk321
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03387.D
Level: (low/med) LOW Date Received: 11/15/99
% Moisture: _____ decanted: (Y/N) N Date Extracted: 11/16/99
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 11/19/99
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name **BNA03392.D**
Operator **Bhaskar**
Date Acquired **19-Nov-99**

Sample Name **4938.01**
Misc Info **949-1**
Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene	15.29	20140	1.27 ug/L	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.57 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

000039

Semi-Volatile Analysis Report

Page 2

Data File Name **BNA03392.D**
 Operator **Bhaskar**
 Date Acquired **19-Nov-99**

Sample Name **4938.01**
 Misc Info **949-1**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

Page 2 of 2

000040

1F

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

949-1

Lab Name: FMETL Lab Code 13461
Project UST Case No.: 4938 Location 949 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 4938.01
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03392.D
Level: (low/med) LOW Date Received: 11/15/99
% Moisture: _____ decanted: (Y/N) N Date Extracted: 11/16/99
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 11/19/99
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

5B

**SEMIVOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
DECAFLUOROTRIPHENYLPHOSPHINE (DFTPP)**

Lab Name: FMETL Lab Code 13461
 Project UST Case No.: 4938 Location 949 SDG No.:
 Lab File ID: BNA03321.D DFTPP Injection Date: 10/27/99
 Instrument ID: BNA#2 DFTPP Injection Time: 9:32

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
51	30.0 - 80.0% of mass 198	60.0
68	Less than 2.0% of mass 69	0.0 (0.0)1
69	Mass 69 Relative abundance	56.4
70	Less than 2.0% of mass 69	0.3 (0.6)1
127	25.0 - 75.0% of mass 198	53.8
197	Less than 1.0% of mass 198	0.0
198	Base Peak, 100% relative abundance	100.0
199	5.0 to 9.0% of mass 198	7.1
275	10.0 - 30.0% of mass 198	19.9
365	Greater than 0.75% of mass 198	2.0
441	Present, but less than mass 443	8.7
442	40.0 - 110.0% of mass 198	59.1
443	15.0 - 24.0% of mass 442	12.0 (20.4)2

1-Value is % mass 69

2-Value is % mass 442

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	FIELD ID	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	SSTD120	120 PPM CAL	BNA03323.D	10/27/99	10:55
02	SSTD080	80 PPM CAL	BNA03324.D	10/27/99	11:50
03	SSTD050	50 PPM CAL	BNA03325.D	10/27/99	12:40
04	SSTD010	10 PPM CAL	BNA03326.D	10/27/99	13:31
05	SSTD020	20 PPM CAL	BNA03327.D	10/27/99	14:20
06	4871.04DUP	4871.04DUP	BNA03332.D	10/27/99	18:28
07	4871.04MS	4871.04MS	BNA03333.D	10/27/99	19:17

Data File : C:\HPCHEM\1\DATA\991027\BNA03321.D

Vial: 99

Acq On : 27 Oct 1999 9:32 am

Operator: Bhaskar

Sample : DFTPP TUNE

Inst : GC BNA 2



Misc : 50NG/2UL

Multiplr: 1.00

MS Integration Params: RTEINT.P

Method : C:\HPCHEM\1\METHODS\M262534.M (RTE Integrator)

Title : BNA Calibration

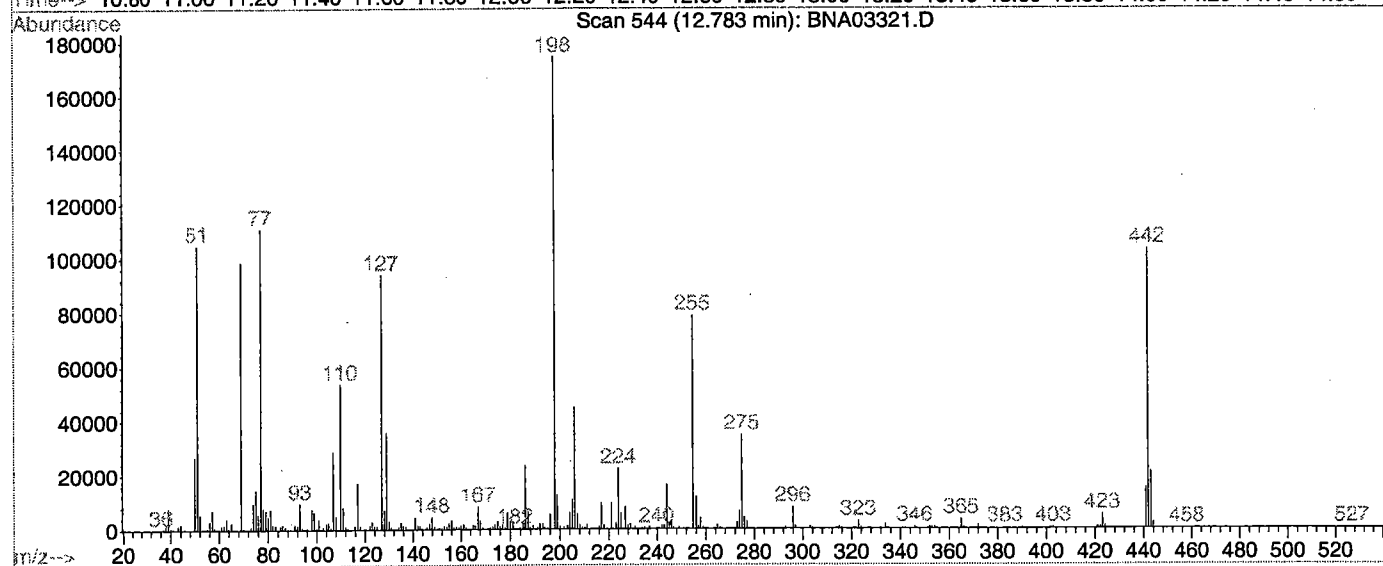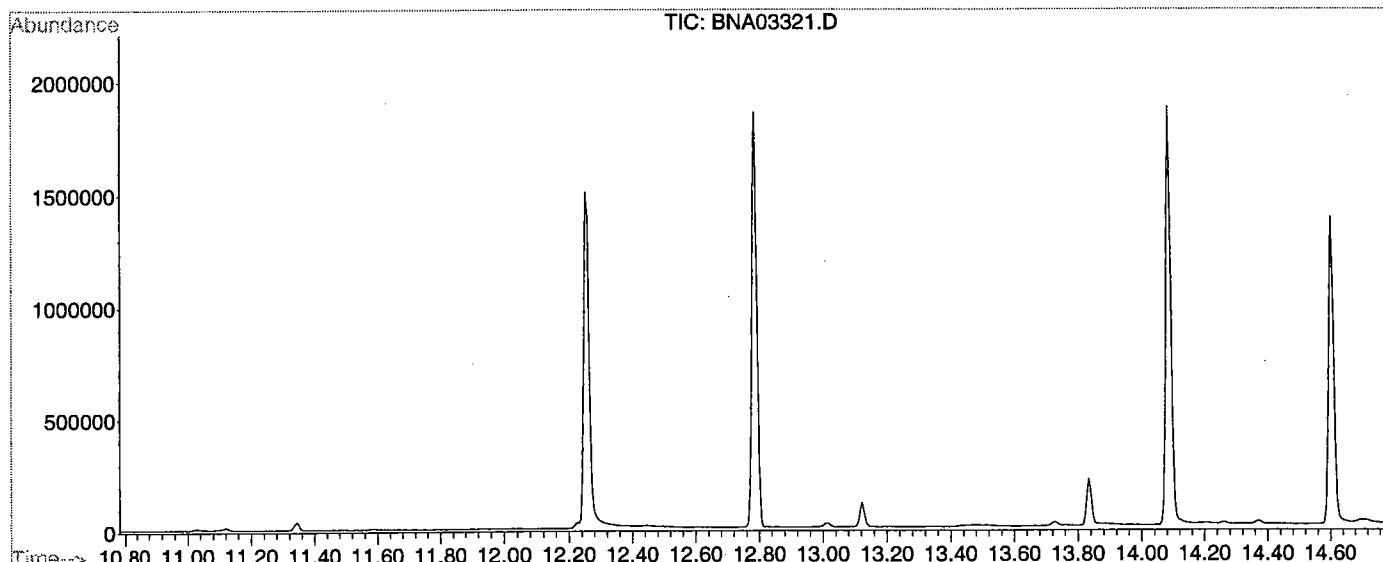

Spectrum Information: Scan 544

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
51	198	30	60	60.0	104832	PASS
68	69	0.00	2	0.0	0	PASS
69	198	0.00	100	56.4	98600	PASS
70	69	0.00	2	0.6	593	PASS
127	198	40	60	53.8	94000	PASS
197	198	0.00	1	0.0	0	PASS
198	198	100	100	100.0	174720	PASS
199	198	5	9	7.1	12479	PASS
275	198	10	30	19.9	34848	PASS
365	198	1	100	2.0	3527	PASS
441	443	1	99	72.0	15134	PASS
442	198	40	100	59.1	103184	PASS
443	442	17	23	20.4	21008	PASS

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted
2. Table of Contents submitted
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted
4. Document paginated and legible
5. Chain of Custody submitted
6. Samples submitted to lab within 48 hours of sample collection
7. Methodology Summary submitted
8. Laboratory Chronicle and Holding Time Check submitted
9. Results submitted on a dry weight basis
10. Method Detection Limits submitted
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP

Laboratory Manager or Environmental Consultant's Signature

Date 4/7/00

Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance.

000064

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.



Daniel K. Wright
Laboratory Manager

000085

FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732) 532-6224 FAX: (732) 532-6263

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

CERTIFICATIONS: NJDEP #13461, NYSDOH #11699



ANALYTICAL DATA REPORT Fort Monmouth Environmental Laboratory ENVIRONMENTAL DIVISION Fort Monmouth, New Jersey PROJECT: UST Program

Bldg. 949

Field Sample Location	Laboratory Sample ID#	Matrix	Date and Time of Collection	Date Received
949-1 8-13'	5005.01	Aqueous	11-Dec-99 11:45	12/13/99

ANALYSIS:
FORT MONMOUTH ENVIRONMENTAL LAB
VOA+15, BN+15

ENCLOSURE:
CHAIN OF CUSTODY
RESULTS

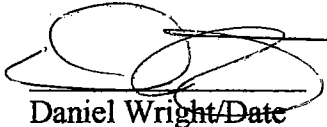
 5-4-00
Daniel Wright/Date
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Chain of Custody	1-2
Methodology Summary	3-4
Conformance/Non-Conformance Summary	5-7
Laboratory Chronicle	8-9
Volatile Organics	10-11
Analytical Results Summary	12-15
Tune Results Summary	16-19
Method Blank Results Summary	20
Calibration Summary	21-22
Surrogate Recovery Summary	23
MS/MSD Results Summary	24-25
Internal Standard Area & RT Summary	26
Chromatograms	27-30
Base Neutrals	31
Analytical Results Summary	32-37
Tune Results Summary	38-41
Method Blank Results Summary	42
Calibration Summary	43-46
Surrogate Recovery Summary	47
MS/MSD Results Summary	48-51
Internal Standard Area & RT Summary	52-55
Chromatograms	56-59
Laboratory Deliverables Checklist	60
Laboratory Authentication Statement	61

CHAIN OF CUSTODY

000001

METHODOLOGY SUMMARY

000003

Method Summary

EPA Method 624

Gas Chromatographic Determination of Volatiles in Water

Surrogates and internal standards are added to a 5-ml aliquot of sample. The sample is then purged and desorbed into a GC/MS system. The organic compounds are separated by the gas chromatograph and detected using the mass spectrometer. Volatiles are identified and quantitated.

EPA Method 3510/8270

Gas Chromatographic Determination of Semi-volatiles in Water

Surrogates are added to measured volume of sample, usually 1 liter, at a specified pH. The sample is serially extracted with Methylene chloride using a separatory funnel. The extract concentrated and internal standards are added. The sample is injected into a GC/MS system. Semi-volatiles are identified and quantitated.

000004

CONFORMANCE NON-CONFORMANC SUMMARY

000005

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT

Indicate
Yes, No, N/A

1. Chromatograms labeled/Compounds identified
(Field samples and method blanks) yes
2. Retention times for chromatograms provided yes
3. GC/MS Tune Specifications
 - a. BFB Meet Criteria yes
 - b. DFTPP Meet Criteria yes
4. GC/MS Tuning Frequency – Performed every 24 hours for 600 series and 12 hours for 8000 series yes
5. GC/MS Calibration – Initial Calibration performed before sample analysis and continuing calibration performed within 24 hours of sample analysis for 600 series and 12 hours for 8000 series yes
6. GC/MS Calibration requirements
 - a. Calibration Check Compounds Meet Criteria yes
 - b. System Performance Check Compounds Meet Criteria yes
7. Blank Contamination – If yes, List compounds and concentrations in each blank: no
 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA
8. Surrogate Recoveries Meet Criteria yes

If not met, list those compounds and their recoveries, which fall outside the acceptable range:

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA

If not met, were the calculations checked and the results qualified as “estimated”? _____
9. Matrix Spike/Matrix Spike Duplicate Recoveries Meet Criteria yes

(If not met, list those compounds and their recoveries, which fall outside the acceptable range)

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA

000006

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT (cont.)

Indicate
Yes, No, N/A

10. Internal Standard Area/Retention Time Shift Meet Criteria
(If not met, list those compounds, which fall outside the acceptable range)

yes

- a. VOA Fraction _____
b. B/N Fraction _____
c. Acid Fraction N/A _____

11. Extraction Holding Time Met

yes


If not met, list the number of days exceeded for each sample: _____

12. Analysis Holding Time Met

yes

If not met, list the number of days exceeded for each sample: _____

Additional Comments:

Laboratory Manager:  Date: 5-4-00

000007

LABORATORY CHRONICLE

000008

Laboratory Chronicle

Lab ID: 5005

Site: Bldg. 949

	Date	Hold Time
Date Sampled	12/11/99	NA
Receipt/Refrigeration	12/11/99	NA

Extractions

1. Base Neutral	12/13/99	14 days
-----------------	----------	---------

Analyses

1. Volatile Organics	12/13,14/99	14 days
2. Base Neutral	12/14/99	40 days

* Samples collected and refrigerated 12/11/99, Laboratory received the samples on Monday 12/13/99.

000003

VOLATILE ORGANICS

000010

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

Definition of Qualifiers

MDL : Method Detection Limit
J : Compound identified below detection limit
B : Compound in both sample and blank
D : Results from dilution of sample
U : Compound searched for but not detected
E : Compound exceeds calibration limit

000011

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001540.D**
 Operator **Skelton**
 Date Acquired **13 Dec 1999 5:42 pm**

Sample Name **Vblk41**
 Field ID **Vblk41**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Vblk41

Lab Name: FMETL NJDEP#: 13461

Project: 100004 Case No.: 5005 Location: Bldg94 SDG No.: _____

Matrix: (soil/water) WATER Lab Sample ID: Vblk41

Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001540.D

Level: (low/med) LOW Date Received: 12/13/99

% Moisture: not dec. _____ Date Analyzed: 12/13/99

GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0

Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001560.D**
 Operator **Skelton**
 Date Acquired **14 Dec 1999 6:58 am**

Sample Name **5005.01**
 Field ID **949-1**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene	15.75	100231	3.40 ug/L	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene	25.27	50802	2.13 ug/L	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

949-1

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 5005 Location: Bldg94 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 5005.01
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001560.D
Level: (low/med) LOW Date Received: 12/13/99
% Moisture: not dec. _____ Date Analyzed: 12/14/99
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

**VOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
BROMOFLUOROBENZENE (BFB)**

Lab Name: FMETL NJDEP#: 13461
 Project: 100004 Case No.: 5005 Location: Bldg94 SDG No.:
 Lab File ID: VC001500.D BFB Injection Date: 12/10/99
 Instrument ID: Voalnst#3 BFB Injection Time: 15:07
 GC Column: RTX502.2 ID: 0.25 (mm) Heated Purge: (Y/N) N

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
50	8.0 - 40.0% of mass 95	15.3
75	30.0 - 66.0% of mass 95	46.0
95	Base peak, 100% relative abundance	100.0
96	5.0 - 9.0% of mass 95	6.6
173	Less than 2.0% of mass 174	0.5 (1.0)1
174	50.0 - 120.0% of mass 95	55.4
175	4.0 - 9.0% of mass 174	4.7 (8.5)1
176	93.0 - 101.0% of mass 174	55.4 (99.9)1
177	5.0 - 9.0% of mass 176	4.1 (7.4)2

1-Value is % mass 174

2-Value is % mass 176

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	FIELD ID:	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	VSTD020	VSTD020	VC001501.D	12/10/99	15:43
02	VSTD100	VSTD100	VC001502.D	12/10/99	16:38
03	VSTD050	VSTD050	VC001503.D	12/10/99	17:20
04	VSTD010	VSTD010	VC001504.D	12/10/99	18:01
05	VSTD005	VSTD005	VC001505.D	12/10/99	18:43

Data File : C:\HPCHEM\1\DATA\991210\VC001500.D

Vial: 1

Acq On : 10 Dec 1999 3:07 pm

Operator: Skelton

Sample : BFB Tune

Inst : GC/MS Ins


Misc : BFB Tune

Multiplr: 1.00

MS Integration Params: RTEINT.P

Method : C:\HPCHEM\1\METHODS\M362413.M (RTE Integrator)

Title : Volatile Organics by GC/MS Method 624/8260/TCLP

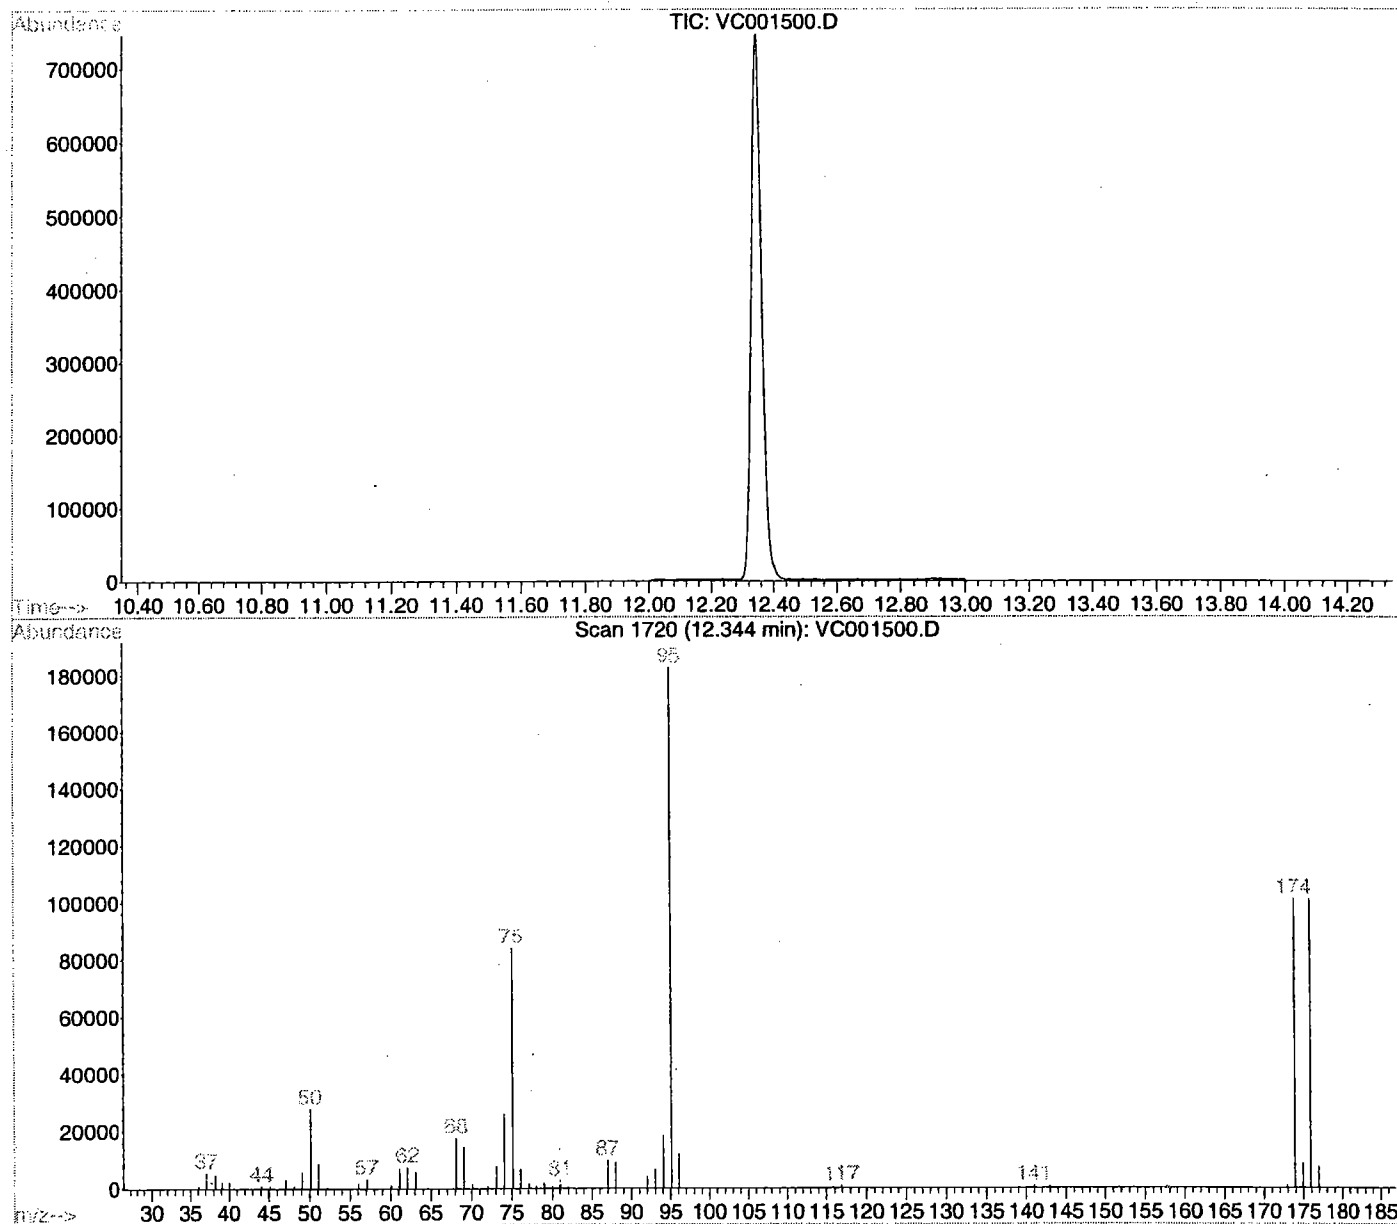

Spectrum Information: Scan 1720

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
50	95	15	40	15.3	27896	PASS
75	95	30	60	46.0	84112	PASS
95	95	100	100	100.0	182848	PASS
96	95	5	9	6.6	12052	PASS
173	174	0.00	2	1.0	970	PASS
174	95	50	100	55.4	101376	PASS
175	174	5	9	8.5	8648	PASS
176	174	95	101	99.9	101272	PASS
177	176	5	9	7.4	7448	PASS

BASE NEUTRAL

000031

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **BNA03456.D**
 Operator **Bhaskar**
 Date Acquired **14-Dec-99**

Sample Name **Sblk327**
 Misc Info **Sblk327 A 991213**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethoxy)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BNA03456.D**
 Operator **Bhaskar**
 Date Acquired **14-Dec-99**

Sample Name **Sblk327**
 Misc Info **Sblk327 A 991213**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Sblk327

Lab Name: FMETL Lab Code 13461
Project 100004 Case No.: 5005 Location Bld.949 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: Sblk327
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03456.D
Level: (low/med) LOW Date Received: 12/13/99
% Moisture: _____ decanted: (Y/N) N Date Extracted: 12/13/99
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 12/14/99
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 2 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
1.	unknown	7.18	5	J
2.	unknown	10.16	51	J

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name **BNA03461.D**
Operator **Bhaskar**
Date Acquired **14-Dec-99**

Sample Name **5005.01**
Misc Info **949-1**
Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene	15.26	22114	1.54 ug/L	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BNA03461.D**
 Operator **Bhaskar**
 Date Acquired **14-Dec-99**

Sample Name **5005.01**
 Misc Info **949-1**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

Page 2 of 2

000036

1F

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

949-1

Lab Name: FMETL Lab Code 13461
Project 100004 Case No.: 5005 Location Bld.949 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 5005.01
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03461.D
Level: (low/med) LOW Date Received: 12/13/99
% Moisture: decanted: (Y/N) N Date Extracted: 12/13/99
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 12/14/99
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted ☒
2. Table of Contents submitted ☒
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted ☒
4. Document paginated and legible ☒
5. Chain of Custody submitted ☒
6. Samples submitted to lab within 48 hours of sample collection ☒
7. Methodology Summary submitted ☒
8. Laboratory Chronicle and Holding Time Check submitted ☒
9. Results submitted on a dry weight basis ☒ NA
10. Method Detection Limits submitted ☒
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP ☒

Laboratory Manager or Environmental Consultant's Signature

Date 5/4/00


Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance.

000060

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.




Daniel K. Wright
Laboratory Manager

000061

APPENDIX G

PHOTOGRAPHS

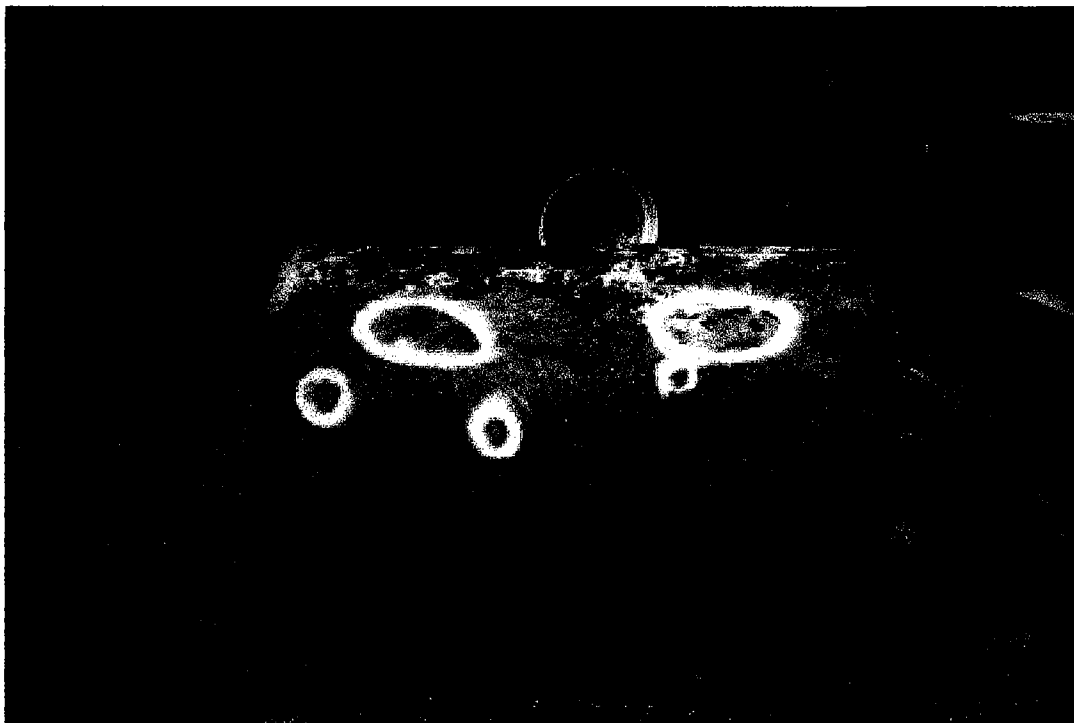

MAY 12, 1998
PHOTOGRAPHIC LOG
UST NO. 81533-203

Building 949
Main Post-West
Fort Monmouth

VERSAR
Engineers, Managers, Scientists & Planners
Bristol, PA

ELECTRONIC DATA DELIVERABLES