

United States Army
Fort Monmouth, New Jersey

**Underground Storage Tank
Closure and Site Investigation
Report**

***Building 2043
Charles Wood Area***

**NJDEP UST Registration No. 192486-36
Dicar No. 98-04-10-1408-11**

January 2000

**UNDERGROUND STORAGE TANK
CLOSURE AND SITE INVESTIGATION REPORT**

BUILDING 2043

**CHARLES WOOD AREA
NJDEP UST REGISTRATION NO. 192486-36**

JANUARY 2000

PREPARED FOR:

**UNITED STATES ARMY, FORT MONMOUTH, NEW JERSEY
DIRECTORATE OF PUBLIC WORKS
BUILDING 167
FORT MONMOUTH, NJ 07703**

PREPARED BY:

**VERSAR
1900 FROST ROAD
SUITE 110
BRISTOL, PA 19007**

PROJECT NO. 4435-018

TABLE OF CONTENTS

EXECUTIVE SUMMARY	iv
1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES	1
1.1 OVERVIEW	1
1.2 SITE DESCRIPTION	2
1.2.1 Geological/Hydrogeological Setting	2
1.3 HEALTH AND SAFETY	4
1.4 REMOVAL OF UNDERGROUND STORAGE TANK	4
1.4.1 General Procedures	4
1.4.2 Underground Storage Tank Excavation and Cleaning	4
1.5 UNDERGROUND STORAGE TANK TRANSPORTATION AND DISPOSAL	5
1.6 MANAGEMENT OF EXCAVATED SOILS	5
2.0 SITE INVESTIGATION ACTIVITIES	6
2.1 OVERVIEW	6
2.2 FIELD SCREENING/MONITORING	6
2.3 SOIL SAMPLING	7
2.4 GROUNDWATER SAMPLING	7
3.0 CONCLUSIONS AND RECOMMENDATIONS	8
3.1 SOIL SAMPLING RESULTS	8
3.2 GROUNDWATER SAMPLING RESULTS	
3.3 CONCLUSIONS AND RECOMMENDATIONS	9

TABLE OF CONTENTS (CONTINUED)

TABLES

Table 1	Summary of Post-Excavation Sampling Activities
Table 2	Post-Excavation Soil Sampling Results
Table 3	VOA Results
Table 4	Groundwater sampling Results

FIGURES

Figure 1	Site Location Map
Figure 1A	Geological Map
Figure 2	Site Map
Figure 3	Cross Sectional View
Figure 4	Soil Sampling Location Map

APPENDICES

Appendix A	NJDEP Standard Reporting Form
Appendix B	Site Assessment Summary
Appendix C	Waste Manifest
Appendix D	UST Disposal Certificate
Appendix E	Soil Analytical Data Package
Appendix F	Groundwater Analytical Data Package
Appendix G	Photographs
Appendix H	Electronic Data Deliverables

EXECUTIVE SUMMARY

UST Closure

On April 10, 1998, a steel underground storage tank (UST) was closed by removal in accordance with New Jersey Department of Environmental Protection (NJDEP) closure procedures at the Charles Wood area of the U.S. Army Fort Monmouth, Fort Monmouth, New Jersey. The UST, NJDEP Registration No. 00192486-36 (Fort Monmouth ID No. 2043), was located west of Building 2043. UST No. 00192486-36 was a 275-gallon diesel UST.

Site Assessment

The site assessment was performed by U.S. Army personnel in accordance with the NJDEP *Technical Requirements for Site Remediation* (N.J.A.C. 7:26E) and the NJDEP *Field Sampling Procedures Manual*. The sampling and laboratory analysis conducted during the site assessment were performed in accordance with Section 7:26E-2.1 of the *Technical Requirements for Site Remediation*. Soils surrounding the tank were screened visually and with air monitoring equipment for evidence of contamination. Following removal, the UST was inspected for corrosion holes or punctures. No holes or punctures were noted in the UST. Stained soil was observed and appeared to be contaminated. Based on the inspection of the excavation, Directorate of Public Works (DPW) concluded that a discharge was associated with this UST. The NJDEP hotline was notified and the case was assigned DICAR No. 98-04-10-1408-11.

Soil samples, which were collected after the removal of the potentially contaminated soil, contained non-detectable levels of TPHC, except for sample 3 that had a TPHC concentration of 2,680.63 mg/kg. The sample location could not be further remediated due to the location of a netting pole. A VOA analysis was completed on sample 3 and all known compounds searched for in the analysis were not detected. Groundwater was encountered at 4.0 feet below ground surface and sheen was observed on groundwater.

All post excavation soil samples collected from the UST excavation at Building 2043 contained TPHC concentrations below the NJDEP residential direct contact total organic contaminants soil cleanup criteria of 10,000 milligrams per kilogram (mg/kg) (N.J.A.C. 7:26D and revisions dated February 3, 1994). Following receipt of all post-excavation soil sampling results, the excavation was backfilled to grade with a combination of uncontaminated excavated soil and certified clean fill. The excavation site was then restored to its original condition.

In response to the observation of sheen on groundwater, two (2) groundwater samples were collected at Building 2043. On February 15, 2000, and March 18, 2000, Building 2043 was sampled for volatile organic compounds calibrated for xylene plus 15 tentatively identified compounds (VOC's), and semivolatile organic compounds plus 15 tentatively identified compounds (SVOC's).

All groundwater analytical results were either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

No further action is proposed in regard to the closure and site assessment of UST No. 192486-36 at Building 2043.

1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES

1.1 OVERVIEW

One underground storage tank (UST), New Jersey Department of Environmental Protection (NJDEP) Registration No. 192486-36, was closed at Building 2043 at the Charles Wood area of U.S. Army Fort Monmouth, Fort Monmouth, New Jersey on April 10, 1998. Refer to the site location map on Figure 1. This report presents the results of the Department of Public Works' (DPW) implementation of the UST Decommissioning/Closure Plan approved by the NJDEP. The UST was a steel 275-gallon tank-containing diesel.

Decommissioning activities for UST No. 192486-36 complied with all applicable Federal, State, and Local laws and ordinances in effect at the date of decommissioning. These laws included but were not limited to N.J.A.C. 7:14B-1 et seq., N.J.A.C. 5:23-1 et seq., and Occupational Safety and Health Administration (OSHA) 1910.146 & 1910.120. All permits including but not limited to the NJDEP approved Decommissioning/Closure Plan were posted onsite for inspection. The decommissioning activities were conducted by DPW personnel who are registered and certified by the NJDEP for performing UST closure activities. Closure of UST No. 192486-36 proceeded under the approval of the NJDEP Bureau of Federal Case Management (NJDEP-BFCM). The Standard Reporting Form and signed Site Assessment Summary form for UST No. 192486-36 are included in Appendices A and B, respectively.

After removal of the potentially contaminated soil, the site was assessed. Based on inspecting the UST, field screening of remaining subsurface soils, and reviewing analytical results of soil samples and groundwater samples, the DPW has concluded that no significant historical discharges are associated with the UST or associated piping.

This UST Closure and Site Investigation Report has been prepared by Versar, to assist the U.S. Army DPW in complying with the NJDEP regulations. The applicable NJDEP regulations at the date of closure were the *Interim Closure Requirements for Underground Storage Tank Systems* (N.J.A.C. 7:14B-1 et seq. October 1990 and revisions dated November 1, 1991).

This report was prepared using information collected at the time of closure. Section 1 of this UST Closure and Site Investigation Report provides a summary of the UST decommissioning activities. Section 2 of this report describes the site investigation activities. Conclusions and recommendations, including the results of the soil sampling and groundwater investigation, are presented in the final section of this report.

1.2 SITE DESCRIPTION

Building 2043 is located in the Charles Wood area of the Fort Monmouth Army Base. UST No. 00192486-36 was located northeast of Building 2043 and appurtenant copper piping ran approximately eight (8) feet east from the excavation to a generator. A site map is provided on Figure 2.

1.2.1 Geological/Hydrogeological Setting

The following is a description of the geological/hydrogeological setting of the area surrounding Building 2043. Included is a description of the regional geology of the area surrounding Fort Monmouth as well as descriptions of the local geology and hydrogeology of the Charles Wood area. A geological map is provided on Figure 1A.

Regional Geology

Monmouth County lies within the New Jersey Section of the Atlantic Coastal Plain physiographic province. The Main Post, Charles Wood, and the Evans areas are located in what may be referred to as the Outer Coastal Plain subprovince, or the Outer Lowlands.

In general, New Jersey Coastal Plain formations consist of a seaward-dipping wedge of unconsolidated deposits of clay, silt, and gravel. These formations typically strike northeast-southwest with a dip ranging from 10 to 60 feet per mile and were deposited on Precambrian and lower Paleozoic rocks (Zapeczka, 1989). These sediments, predominantly derived from deltaic, shallow marine, and continental shelf environments, date from Cretaceous through the Quaternary Periods. The mineralogy ranges from quartz to glauconite.

The formations record several major transgressive/regressive cycles and contain units which are generally thicker to the southeast and reflect a deeper water environment. More than 20 regional geologic units are present within the sediments of the Coastal Plain. Regressive, upward coarsening deposits are usually aquifers (e.g., Englishtown and Kirkwood Formations, and the Cohansey Sand) while the transgressive deposits act as confining units (e.g., the Merchantville, Marshalltown, and Navesink Formations). The individual thicknesses for these units vary greatly (i.e., from several feet to several hundred feet). The Coastal Plain deposits thicken to the southeast from the Fall Line to greater than 6,500 feet in Cape May County (Brown and Zapeczka, 1990).

Local Geology

Based on the regional geologic map (Jablonski, 1968), the Cretaceous age Red Bank and Tinton Sands outcrop at the Charles Wood area. The Red Bank sand conformably overlies the Navesink Formation and dips to the southeast at 35 feet per mile. The upper member (Shrewsbury) of the Red Bank sand is a yellowish-gray to reddish brown clayey, medium-to-coarse-grained sand that contains abundant rock fragments, minor mica and glauconite (Jablonski). The lower member (Sandy Hook) is a dark gray to black, medium-to-fine grained sand with abundant clay, mica, and glauconite.

The Tinton sand conformably overlies the Red Bank Sand and ranges from a clayey medium to very coarse grained feldspathic quartz and glauconite sand to a glauconitic coarse sand. The color varies from dark yellowish orange or light brown to moderate brown and from light olive to grayish olive. Glauconite may constitute 60 to 80 percent of the sand fraction in the upper part of the unit (Minard, 1969). The upper part of the Tinton is often highly oxidized and ironoxide encrusted (Minard).

Over the last 80 years, the natural topography of Fort Monmouth has been altered by excavation and filling activities by the military. Topographic elevations for the Charles Wood area range from 20 feet above mean seal level (MSL) to 71 feet above MSL.

Hydrogeology

The water table aquifer in the Charles Wood area is identified as part of the "composite confining units", or minor aquifers. The minor aquifers include the Navesink formation, Red Bank Sand, Tinton Sand, Hornerstown Sand, Vincentown Formation, Manasquan Formation, Shark River Formation, Piney Point Formation, and the basal clay of the Kirkwood Formation.

Six well records for monitor wells installed at locations within the Charles Wood area in February 1981 were used for reference. The wells were completed to total depths ranging from 20 to 25 feet below ground surface (bgs). Water was encountered at depths ranging from 5 to 12 feet bgs.

The lithologic descriptions for these borings described deposits that were primarily fine to coarse, glauconitic sands, with traces of gravel, silt, and clay. These sediments are part of the Hornerstown Marl, from the Tertiary Period (Paleocene Series, approximately 58 to 66 Ma). According to Jablonski, wells drilled in the Red Bank and Tinton Sands may produce from 2 to 25 gallons per minute (gpm). Some well owners have reported acidic water that requires treatment to remove iron.

Shallow groundwater is locally influenced within the Charles Wood area by the following factors:

- tidal influence (based on proximity to the Atlantic Ocean, rivers, and tributaries)
- topography
- nature of the fill material within the Charles Wood area
- presence of clay and silt lenses in the natural overburden deposits
- local groundwater recharge areas (i.e., streams, lakes)

Due to the fluvial nature of the overburden deposits (i.e., sand and clay lenses), shallow groundwater flow direction is best determined on a case-by-case basis. Building 2021A is located approximately 400 feet south of an unnamed stream that runs from east to west through the Charles Wood area. Based on the Charles Wood area topography, the groundwater flow in the area of Building 2021A is anticipated to be to the north.

1.3 HEALTH AND SAFETY

Before, during, and after all decommissioning activities, hazards at the work site which may have posed a threat to the Health and Safety of all personnel who were involved with, or were affected by, the decommissioning of the UST system were minimized. All areas, which posed, or may have been suspected to pose a vapor hazard were monitored by a qualified individual utilizing an organic vapor analyzer (OVA). The individual ascertained if the area was properly vented to render the area safe, as defined by OSHA.

1.4 REMOVAL OF UNDERGROUND STORAGE TANK

1.4.1 General Procedures

- The contractor performing the closure prior to excavation activities identified all underground obstructions (utilities, etc.).
- All activities were carried out with the greatest regard to safety and health and the safeguarding of the environment.
- All excavated soils were visually examined and screened with an OVA for evidence of contamination. Potentially contaminated soils were identified and logged during closure activities.
- Surface materials (i.e., asphalt, concrete, etc.) were excavated and staged separately from all soil and recycled in accordance with all applicable regulations and laws.
- A Sub-Surface Evaluator from the DPW was present during all site assessment activities.

1.4.2 Underground Storage Tank Excavation and Cleaning

Prior to UST decommissioning activities, surficial soil was removed to expose the UST and associated piping. All free product present in the piping was drained into the UST, and the UST was purged to remove vapors prior to cutting and removal of the piping. After removal of the associated piping, a manway was made in the UST to allow for proper cleaning. The UST was completely emptied of all liquids prior to removal from the ground. Approximately 70 gallons of liquid from the UST and its associated piping were transported by Lionetti Oil Recovery Company to Lionetti Oil Recovery Company, Inc. facility, a NJDEP-approved petroleum recycling and disposal company located in Old Bridge, New Jersey. Refer to Appendix C for the waste manifest.

The UST was cleaned prior to removal from the excavation in accordance with the NJDEP regulations. After the UST was removed from the excavation, it was staged on polyethylene sheeting and examined for holes. No holes were observed during the inspection by the Sub-Surface Evaluator. Soils surrounding the UST were screened visually and with an OVA for evidence of contamination. Soils were stained and appeared to be contaminated. Soil samples, which were collected after the removal of the potentially contaminated soil, contained non-detectable levels of TPHC, except for sample 3 that had a TPHC concentration of 2,680.63 mg/kg. The sample location could not be further remediated due to the location of a netting pole. A VOA analysis was completed on sample 3 and all known compounds searched for in the analysis were not detected. Groundwater was encountered at 4.0 feet below ground surface and sheen was observed on groundwater.

1.5 UNDERGROUND STORAGE TANK TRANSPORTATION AND DISPOSAL

The tank was transported in compliance with all applicable regulations and laws to Red Bank Recycling Auto Wreckers, Inc. Refer to Appendix D for the UST disposal certificate and Appendix G for photographs of the UST.

The UST was labeled prior to transport with the following information:

- Site of origin
- Contact person
- NJDEP UST Facility ID number
- Former contents
- Destination site
- Date

1.6 MANAGEMENT OF EXCAVATED SOILS

All potentially contaminated soils were stockpiled separately from other excavated material and were placed on and covered with polyethylene sheets. Potentially contaminated soils were transported to the soil staging area. Soils that did not exhibit signs of contamination were used as backfill following the removal of the UST. Groundwater was encountered at 4.0 feet below ground surface and sheen was observed on groundwater.

2.0 SITE INVESTIGATION ACTIVITIES

2.1 OVERVIEW

The Site Investigation was managed and carried out by U.S. Army DPW personnel. All analyses were performed and reported by U.S. Army Fort Monmouth Environmental Laboratory, a NJDEP-certified testing laboratory. All sampling was performed under the direct supervision of a NJDEP Certified Sub-Surface Evaluator according to the methods described in the NJDEP *Field Sampling Procedures Manual* (1992). Sampling frequency and parameters analyzed complied with the NJDEP document *Interim Closure Requirements for Underground Storage Tank Systems* (October 1990 and revisions dated November 1, 1991) which was the applicable regulation at the date of the closure. The Fort Monmouth DPW Environmental Office maintains all records of the Site Investigation activities.

The following Parties participated in Closure and Site Investigation Activities:

- Subsurface Evaluator: David H. Daniels
Employer: SMC Environmental Services Group
Phone Number: (215) 788-7844
NJDEP Certification No.: 10279
- Project Manager: Dinker Desai
Employer: U.S. Army, Fort Monmouth
Phone Number: (730) 532-6224
NJDEP Certification No.: 10173
- Analytical Laboratory: U.S. Army Fort Monmouth Environmental Laboratory
Contact Person: Daniel K. Wright
Phone Number: (908) 532-4359
NJDEP Company Certification No.: 13461
- Hazardous Waste Hauler: Lionetti Oil Recovery Co. Inc
Contact Person: Gary LoBella
Phone Number: (908) 721-0900

2.2 FIELD SCREENING/MONITORING

Field screening was performed by a NJDEP Certified Sub-Surface Evaluator using an OVA and visual observations to identify potentially contaminated material. Groundwater was encountered at 4.0 feet below ground surface and sheen was observed on groundwater

2.3 SOIL SAMPLING

On April 29, 1998, following the removal of the UST and associated piping, post-excavation soil samples 1, 2, 3, and 4 (DUP 2) were collected from a total of three (3) locations of the UST excavation. Samples 1, 2, 3, and 4 (DUP 2) were collected along the excavation floor at a depth of 6.0 feet bgs. No piping samples were taken from the excavation since the piping run was only two (2) feet from the excavation to the generator. All samples were analyzed for total petroleum hydrocarbons (TPHC) and total solids.

On February 19, 1999, following the removal of the potentially petroleum contaminated soil from the excavated area, post-excavation soil samples 1, 2 (DUP 1), 3, 4, 5, and 6 were collected from a total of five (5) locations of the UST excavation. Sample 6 was collected along the excavation floor at a depth of 7.0 feet bgs. Sidewall samples 1, 2 (DUP 1), 3, 4, and 5 were collected at a depth of 4.0-5.0 feet bgs. No piping samples were taken from the excavation since the piping run was only two (2) feet from the excavation to the generator. All samples were analyzed for total petroleum hydrocarbons (TPHC) and total solids. Based on preliminary TPHC results, a VOA analysis was completed on sample 3.

U.S. Army personnel in accordance with the NJDEP Technical Requirements and the NJDEP Field Sampling Procedures Manual performed the site assessment. A summary of sampling activities including parameters analyzed is provided in Table 1. The post-excavation soil samples were collected using NJDEP *Field Sampling Procedures Manual* (1992) standard sampling procedures. Following soil sampling activities, the samples were chilled and delivered to U.S. Army Fort Monmouth Environmental Laboratory located in Fort Monmouth, New Jersey, for analysis.

2.4 GROUNDWATER SAMPLING

On February 15, 2000, and March 18, 2000, Building 2043 was sampled for volatile organic compounds calibrated for xylene plus 15 tentatively identified compounds (VOC's), and semivolatile organic compounds plus 15 tentatively identified compounds (SVOC's). Sampling and analysis were performed in accordance with the NJDEP *Field Sampling Procedures Manual* and the *Technical Requirements For Site Remediation*. Refer to Appendix F for the field sampling documentation.

3.0 CONCLUSIONS AND RECOMMENDATIONS

3.1 SOIL SAMPLING RESULTS

To evaluate soil conditions following removal of the UST and associated piping, post-excavation soil samples were collected on April 29, 1998, and February 19, 1999 from a total of eight (8) locations. All samples were analyzed for TPHC and total solids. In addition, sample 3 was analyzed for VOA. The post-excavation sampling results were compared to the NJDEP residential direct contact total organic contaminants soil cleanup criteria of 10,000 mg/kg (N.J.A.C. 7:26D and revisions dated February 3, 1994). A summary of the analytical results and comparison to the NJDEP soil cleanup criteria is provided in Table 2 and the soil sampling locations are shown on Figure 4. The VOA analysis for sample 3 as compared to the NJDEP residential direct contact soil cleanup criteria and is included as Table 3. The analytical data package is provided in Appendix E.

All post-excavation soil samples collected on February 19, 1999, from the UST excavation and from below piping associated with the UST contained concentrations of TPHC below the NJDEP soil cleanup criteria.

3.2 GROUNDWATER SAMPLING RESULTS

The sample collected from Building 2043 on February 15, 2000, contained chloroform at a concentration of 1.67 ug/l. No other compounds were detected.

No compounds were detected in the sample collected from Building 2043 on March 18, 2000.

A summary of the analytical results and comparison to the NJDEP groundwater cleanup criteria is provided in Table 4. The analytical data package is provided in Appendix F. The full data package, including quality control, is on file at U.S. Army Fort Monmouth, Fort Monmouth, New Jersey.

Groundwater samples collected on February 15, 2000, and March 18, 2000, were either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

3.3 CONCLUSIONS AND RECOMMENDATIONS

The analytical results for all post-excavation soil samples collected from the UST closure excavation at Building 2043 were below the NJDEP soil cleanup criteria for total organic contaminants.

Based on the post-excavation sampling results, soil with TPHC concentrations exceeding the NJDEP soil cleanup criteria for total organic contaminants of 10,000 mg/kg, do not exist in the former location of the UST or associated piping.

Based on the analytical results of the groundwater samples collected at Building 2043 on February 15, 2000, and March 18, 2000, groundwater quality at Building 2043 was either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

No further action is proposed in regard to the closure and site assessment of UST No. 192486-36 at Building 2043.

()

و. ب.

f 1

6. 2

472

٥ ٦

8 3

6. 2

8

1

13

4.

F 3

60

6 7

602

7

L. J.

63

TABLES

424

51

4. 4

10

١٠٠

()

1

14

...

6-1

1.

62

14

10

424

F 3

1. 2

103

10

TABLE 1

SUMMARY OF POST-EXCAVATION SAMPLING ACTIVITIES
BUILDING 2043, CHARLES WOOD AREA
FORT MONMOUTH, NEW JERSEY

Page 1 of 3

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	NJDEP Method
**1	4/29/98	4/29/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
**2	4/29/98	4/29/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
**3	4/29/98	4/29/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
**4	4/29/98	4/29/98	Soil	Post-Excavation	TPHC	OQA-QAM-025

Note:

* TPHC Total Petroleum Hydrocarbons

** Sample location was further remediated and resampled

TABLE 1

SUMMARY OF POST-EXCAVATION SAMPLING ACTIVITIES
BUILDING 2043, CHARLES WOOD AREA
FORT MONMOUTH, NEW JERSEY

Page 2 of 3

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	NJDEP Method
1	2/19/99	2/19/99	Soil	Post-Excavation	TPHC	OQA-QAM-025
2	2/19/99	2/19/99	Soil	Post-Excavation	TPHC	OQA-QAM-025
3	2/19/99	2/19/99	Soil	Post-Excavation	TPHC	OQA-QAM-025
4	2/19/99	2/19/99	Soil	Post-Excavation	TPHC	OQA-QAM-025
5	2/19/99	2/19/99	Soil	Post-Excavation	TPHC	OQA-QAM-025
6	2/19/99	2/19/99	Soil	Post-Excavation	TPHC	OQA-QAM-025

Note:

* TPHC Total Petroleum Hydrocarbons

TABLE 1

SUMMARY OF SAMPLING ACTIVITIES
BUILDING 2043, CHARLES WOOD AREA
FORT MONMOUTH, NEW JERSEY

Page 3 of 3

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	Sampling Method**
5169.03	2/15/00	2/16/00	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
5259.03	3/18/00	3/23/00	Aqueous	Groundwater	VOCs, SVOCs	PPNDP

Note:

*VOCs: Volatile Organic Compounds plus 15 tentatively identified compounds

*SVOCs: Semivolatile organic compounds plus 15 tentatively identified compounds

**PPNDP: Passively Placed Narrow Diameter Point

TABLE 2

POST-EXCAVATION SOIL SAMPLING RESULTS
 BUILDING 2043, CHARLES WOOD AREA
 FORT MONMOUTH, NEW JERSEY

Page 1 of 2

Sample ID/ Depth	Sample Laboratory ID	Sample Date	Analysis Date	Analytical Parameters	Method Detection Limit (mg/kg)	Compound of Concern	Results (mg/kg) *	NJDEP Soil Cleanup Criteria ** (mg/kg)	Exceeds Cleanup Criteria
***1/6.0' =	3518.01	4/29/98	4/29/98	Total Solid	--	--	79.94 %	--	--
				TPHC	193	yes	8435.51	10,000	No
***2/6.0' =	3518.02	4/29/98	4/29/98	Total Solid	--	--	81.29 %	--	--
				TPHC	191	Yes	11657.82	10,000	Yes
***3/6.0' =	3518.03	4/29/98	4/29/98	Total Solid	--	--	78.16 %	--	--
				TPHC	198	Yes	775.92	10,000	No
***4/6.0' =	3518.04	4/29/98	4/29/98	Total Solid	--	--	81.74 %	--	--
				TPHC	188	yes	9840.31	10,000	No

Note:

- * Total Solid results are expressed as a percentage.
- ** NJDEP Residential Direct Contact soil cleanup criteria for total organics
- *** Sample location was further remediated and resampled
- ND Not detected above stated method detection limit
- TPHC Total Petroleum Hydrocarbons

TABLE 2

POST-EXCAVATION SOIL SAMPLING RESULTS
 BUILDING 2043, CHARLES WOOD AREA
 FORT MONMOUTH, NEW JERSEY

Page 1 of 2

Sample ID/ Depth	Sample Laboratory ID	Sample Date	Analysis Date	Analytical Parameters	Method Detection Limit (mg/kg)	Compound of Concern	Results (mg/kg) *	NJDEP Soil Cleanup Criteria ** (mg/kg)	Exceeds Cleanup Criteria
1/5.0' =	4283.01	2/19/99	2/19/99	Total Solid	--	--	82.94 %	--	--
				TPHC	188	yes	ND	10,000	No
2/5.0' =	4283.02	2/19/99	2/19/99	Total Solid	--	--	82.15 %	--	--
				TPHC	191	Yes	ND	10,000	No
3/4.0' =	4283.03	2/19/99	2/19/99	Total Solid	--	--	65.27 %	--	--
				TPHC	228	Yes	2680.63	10,000	No
4/4.0' =	4283.04	2/19/99	2/19/99	Total Solid	--	--	70.18 %	--	--
				TPHC	220	yes	ND	10,000	No
5/4.0' =	4283.05	2/19/99	2/19/99	Total Solid	--	--	79.17 %	--	--
				TPHC	196	Yes	ND	10,000	No
6/7.0' =	4283.06	2/19/99	2/19/99	Total Solid	--	--	69.69 %	--	--
				TPHC	222	yes	ND	10,000	No

Note:

* Total Solid results are expressed as a percentage.

** NJDEP Residential Direct Contact soil cleanup criteria for total organics

ND Not detected above stated method detection limit

TPHC Total Petroleum Hydrocarbons

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) SOIL
 Date Sampled: 2/19/99 Location: 2043 Lab Sample ID: 4283.03(SAMPLE 3)

CONCENTRATION UNITS:
(ug/L or ug/Kg)

CAS NO.	PARAMETER	MDL	QUALIFIER	RESIDENTIAL	NON-RESIDENTIAL
107028	Acrolein	13000	U	NA	NA
107131	Acrylonitrile	13000	U	1000	5000
75650	tert-Butyl alcohol	24000	U	NA	NA
1634044	Methyl-tert-Butyl ether	5500	U	NA	NA
108203	Di-isopropyl ether	3700	U	NA	NA
	Dichlorodifluoromethane	7300	U	NA	NA
74-87-3	Chloromethane	1800	U	520000	1000000(d)
75-01-4	Vinyl Chloride	5500	U	2000	7000
74-83-9	Bromomethane	3700	U	79000	1000000(d)
75-00-3	Chloroethane	5500	U	NA	NA
75-69-4	Trichlorofluoromethane	3700	U	NA	NA
75-35-4	1, 1-Dichloroethene	1800	U	8000	150000
67-64-1	Acetone	3700	U	1000000(d)	1000000(d)
75-15-0	Carbon Disulfide	1800	U	NA	NA
75-09-2	Methylene Chloride	3700	U	49000	210000
156-60-5	trans-1,2-Dichloroethene	3700	U	1000000(d)	1000000(d)
75-35-3	1,1-Dichloroethane	1800	U	570000	1000000(d)
108-05-4	Vinyl Acetate	5500	U	NA	NA
78-93-3	2-Butanone	5500	U	1000000(d)	1000000(d)
156-59-2	cis-1,2-Dichloroethene	1800	U	79000	1000000(d)
67-66-3	Chloroform	1800	U	19000(k)	28000(k)
75-55-6	1,1,1-Trichloroethane	1800	U	NA	NA
56-23-5	Carbon Tetrachloride	3700	U	2000(k)	4000(k)
71-43-2	Benzeze	1800	U	3000	13000
107-06-2	1,2-Dichloroethane	3700	U	6000	24000

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) SOILDate Sampled: 2/19/99Location: 2043Lab Sample ID: 4283.03(SAMPLE 3)

CONCENTRATION UNITS:
(ug/L or ug/Kg)

CAS NO.	PARAMETER	MDL	QUALIFIER	RESIDENTIAL	NON-RESIDENTIAL
79-01-6	Trichloroethene	1800	U	23000	54000(k)
78-87-5	1, 2-Dichloropropane	1800	U	10000	43000
75-27-4	Bromodichloromethane	1800	U	11000(g)	46000(g)
110-75-8	2-Chloroethyl vinyl ether	3700	U	NA	NA
10061-01-5	cis-1,3-Dichloropropene	1800	U	NA	NA
108-10-1	4-Methyl-2-Pentanone	3700	U	1000000(d)	1000000(d)
108-88-3	Toluene	1800	U	1000000(d)	1000000(d)
10061-02-6	trans-1,3-Dichloropropene	3700	U	NA	NA
79-00-5	1,1,2-Trichloroethane	3700	U	22000	420000
127-18-4	Tetrachloroethene	1800	U	4000(k)	6000(k)
591-78-6	2-Hexanone	3700	U	NA	NA
126-48-1	Dibromochloromethane	3700	U	NA	NA
108-90-7	Chlorobenzene	1800	U	37000	680000
100-41-4	Ethylbenzene	3700	U	1000000(d)	1000000(d)
1330-20-7	m+p-Xylenes	5500	U	NA	NA
1330-20-7	o-Xylene	3700	U	NA	NA
100-42-5	Styrene	3700	U	23000	97000
75-25-2	Bromoform	3700	U	86000	370000
79-34-5	1,1,2,2-Tetrachloroethane	3700	U	34000	70000(k)

Definition of Qualifiers

MDL : Method Detection Limit

J : Compound identified below detection limit

B : Compound in both sample and blank

D : Results from dilution of sample

U : Compound searched for but not detected

SOIL CLEANUP CRITERIA (MG/KG)

(LAST REVISED-7/11/96)

- (A) CRITERIA ARE HEALTH BASED USING AN INCIDENTAL INGESTION EXPOSURE PATHWAY EXCEPT WHERE NOTED BELOW.**
- (B) CRITERIA ARE SUBJECT TO CHANGE BASED ON SITE SPECIFIC FACTORS (E.G., AQUIFER CLASSIFICATION, SOIL TYPE, NATURAL BACKGROUND, ENVIRONMENTAL IMPACTS, ETC.)**
- (C) HEALTH BASED CRITERION EXCEEDS THE 10,000 MG/KG MAXIMUM FOR TOTAL ORGANIC CONTAMINANTS.**
- (D) HEALTH BASED CRITERION EXCEEDS THE 1000 MG/KG MAXIMUM FOR TOTAL VOLATILE ORGANIC CONTAMINANTS**
- (E) CLEANUP STANDARD PROPOSAL WAS BASED ON NATURAL BACKGROUND.**
- (F) HEALTH BASED CRITERION IS LOWER THAN ANALYTICAL LIMITS; CLEANUP CRITERION BASED ON PRACTICAL QUANTITATION LEVEL.**
- (G) CRITERION HAS BEEN RECALCULATED BASED ON NEW TOXICOLOGICAL DATA.**
- (H) THE IMPACT TO GROUND WATER VALUES FOR INORGANIC CONSTITUENTS WILL BE DEVELOPED BASED UPON SITE SPECIFIC CHEMICAL AND PHYSICAL PARAMETERS.**
- (I) ORIGINAL CRITERION WAS INCORRECTLY CALCULATED AND HAS BEEN RECALCULATED.**
- (J) TYPOGRAPHICAL ERROR.**
- (K) CRITERIA BASED ON INHALATION EXPOSURE PATHWAY, WHICH YIELDED A MORE STRINGENT CRITERION THAN THE INCIDENTAL INGESTION EXPOSURE PATHWAY.**
- (L) NEW CRITERION DERIVED USING METHODOLOGY IN THE BASIS AND BACKGROUND DOCUMENT.**
- (M) CRITERION BASED ON ECOLOGICAL (PHYTOTOXICITY) EFFECTS.**
- (N) LEVEL OF THE HUMAN HEALTH BASED CRITERION IS SUCH THAT EVALUATION FOR POTENTIAL ENVIRONMENTAL IMPACTS ON A SITE BY SITE BASIS IS RECOMMENDED.**

- (O) LEVEL OF THE CRITERION IS SUCH THAT EVALUATION FOR POTENTIAL ACUTE EXPOSURE HAZARD IS RECOMMENDED.**
- (P) CRITERION BASED ON THE USEPA INTEGRATED EXPOSURE UPTAKE BIOKINETIC (IEUBK) MODEL UTILIZING THE DEFAULT PARAMETERS. THE CONCENTRATION IS CONSIDERED TO PROTECT 95% OF TARGET POPULATION (CHILDREN) AT A BLOOD LEVEL OF 10 UG/DL.**
- (Q) CRITERIA WAS DERIVED FROM A MODEL DEVELOPED BY THE SOCIETY FOR ENVIRONMENTAL GEOCHEMISTRY AND HEALTH (SEGH) AND WAS DESIGNED TO BE PROTECTIVE FOR ADULTS IN THE WORKPLACE.**
- (R) INSUFFICIENT INFORMATION AVAILABLE TO CALCULATE IMPACT TO GROUND WATER CRITERIA.**

Table 4
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 2/15/00Location: 2043Lab Sample ID: 5169.03(2043-1)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	Not Detected	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	1.67 ug/L	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 4
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 2/15/00Location: 2043Lab Sample ID: 5169.03(2043-1)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 4
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 2/15/00Location: 2043Lab Sample ID: 5169.03(2043-1)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	1.83	Not Detected	--	nle	no
62-75-9	N-nitroso-dimethylamine	0.91	Not Detected	--	20	no
62-53-3	Aniline	1.63	Not Detected	--	nle	no
111-44-4	bis(2-Chloroethyl)ether	1.28	Not Detected	--	10	no
541-73-1	1,3-Dichlorobenzene	1.19	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	1.02	Not Detected	--	75	no
100-51-6	Benzyl alcohol	1.02	Not Detected	--	nle	no
95-50-1	1,2-Dichlorobenzene	1.13	Not Detected	--	600	no
108-60-1	bis(2-chloroisopropyl)ether	1.39	Not Detected	--	300	no
621-64-7	n-Nitroso-di-n-propylamine	1.50	Not Detected	--	20	no
67-72-1	Hexachloroethane	0.97	Not Detected	--	10	no
98-95-3	Nitrobenzene	1.01	Not Detected	--	10	no
78-59-1	Isophorone	1.21	Not Detected	--	100	no
111-91-1	bis(2-Chloroethoxy)methane	1.75	Not Detected	--	nle	no
120-82-1	1,2,4-Trichlorobenzene	1.22	Not Detected	--	9	no
91-20-3	Naphthalene	1.27	Not Detected	--	nle	no
106-47-8	4-Chloroaniline	1.09	Not Detected	--	nle	no
87-68-3	Hexachlorobutadiene	0.71	Not Detected	--	1	no
91-57-6	2-Methylnaphthalene	1.08	Not Detected	--	nle	no
77-47-4	Hexachlorocyclopentadiene	1.32	Not Detected	--	50	no
91-58-7	2-Chloronaphthalene	1.01	Not Detected	--	nle	no
88-74-4	2-Nitroaniline	0.79	Not Detected	--	nle	no
131-11-3	Dimethylphthalate	1.52	Not Detected	--	7000	no
208-96-8	Acenaphthylene	0.96	Not Detected	--	nle	no

Table 4

SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 2/15/00Location: 2043Lab Sample ID: 5169.03(2043-1)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	0.81	Not Detected	--	nle	no
99-09-2	3-Nitroaniline	0.79	Not Detected	--	nle	no
83-32-9	Acenaphthene	1.10	Not Detected	--	400	no
132-64-9	Dibenzofuran	1.00	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	0.87	Not Detected	--	10	no
84-66-2	Diethylphthalate	1.62	Not Detected	--	5000	no
86-73-7	Fluorene	0.99	Not Detected	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	1.10	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	1.05	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.01	Not Detected	--	20	no
103-33-3	Azobenzene	0.67	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	0.76	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	0.94	Not Detected	--	10	no
85-01-8	Phenanthrene	1.23	Not Detected	--	nle	no
120-12-7	Anthracene	1.12	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	1.70	Not Detected	--	900	no
206-44-0	Fluoranthene	1.64	Not Detected	--	300	no
92-87-5	Benzidine	4.18	Not Detected	--	50	no
129-00-0	Pyrene	1.25	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.05	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	1.19	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	1.75	Not Detected	--	60	no
218-01-9	Chrysene	1.38	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	1.74	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.44	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.25	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.29	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	1.05	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	0.83	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	0.64	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	0.84	Not Detected	--	nle	no

Table 4
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 3/18/00Location: 2043Lab Sample ID: 5259.03(2043-1)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	Not Detected	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 4
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 3/18/00Location: 2043Lab Sample ID: 5259.03(2043-1)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 4
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 3/18/00Location: 2043Lab Sample ID: 5259.03(2043-1)


CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	1.83	Not Detected	--	nle	no
62-75-9	N-nitroso-dimethylamine	0.91	Not Detected	--	20	no
62-53-3	Aniline	1.63	Not Detected	--	nle	no
111-44-4	bis(2-Chloroethyl)ether	1.28	Not Detected	--	10	no
541-73-1	1,3-Dichlorobenzene	1.19	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	1.02	Not Detected	--	75	no
100-51-6	Benzyl alcohol	1.02	Not Detected	--	nle	no
95-50-1	1,2-Dichlorobenzene	1.13	Not Detected	--	600	no
108-60-1	bis(2-chloroisopropyl)ether	1.39	Not Detected	--	300	no
621-64-7	n-Nitroso-di-n-propylamine	1.50	Not Detected	--	20	no
67-72-1	Hexachloroethane	0.97	Not Detected	--	10	no
98-95-3	Nitrobenzene	1.01	Not Detected	--	10	no
78-59-1	Isophorone	1.21	Not Detected	--	100	no
111-91-1	bis(2-Chloroethoxy)methane	1.75	Not Detected	--	nle	no
120-82-1	1,2,4-Trichlorobenzene	1.22	Not Detected	--	9	no
91-20-3	Naphthalene	1.27	Not Detected	--	nle	no
106-47-8	4-Chloroaniline	1.09	Not Detected	--	nle	no
87-68-3	Hexachlorobutadiene	0.71	Not Detected	--	1	no
91-57-6	2-Methylnaphthalene	1.08	Not Detected	--	nle	no
77-47-4	Hexachlorocyclopentadiene	1.32	Not Detected	--	50	no
91-58-7	2-Chloronaphthalene	1.01	Not Detected	--	nle	no
88-74-4	2-Nitroaniline	0.79	Not Detected	--	nle	no
131-11-3	Dimethylphthalate	1.52	Not Detected	--	7000	no
208-96-8	Acenaphthylene	0.96	Not Detected	--	nle	no

Table 4
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 3/18/00 Location: 2043 Lab Sample ID: 5259.03(2043-1)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	0.81	Not Detected	--	nle	no
99-09-2	3-Nitroaniline	0.79	Not Detected	--	nle	no
83-32-9	Acenaphthene	1.10	Not Detected	--	400	no
132-64-9	Dibenzofuran	1.00	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	0.87	Not Detected	--	10	no
84-66-2	Diethylphthalate	1.62	Not Detected	--	5000	no
86-73-7	Fluorene	0.99	Not Detected	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	1.10	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	1.05	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.01	Not Detected	--	20	no
103-33-3	Azobenzene	0.67	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	0.76	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	0.94	Not Detected	--	10	no
85-01-8	Phenanthrene	1.23	Not Detected	--	nle	no
120-12-7	Anthracene	1.12	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	1.70	Not Detected	--	900	no
206-44-0	Fluoranthene	1.64	Not Detected	--	300	no
92-87-5	Benzidine	4.18	Not Detected	--	50	no
129-00-0	Pyrene	1.25	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.05	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	1.19	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	1.75	Not Detected	--	60	no
218-01-9	Chrysene	1.38	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	1.74	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.44	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.25	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.29	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	1.05	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	0.83	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	0.64	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	0.84	Not Detected	--	nle	no

FIGURES

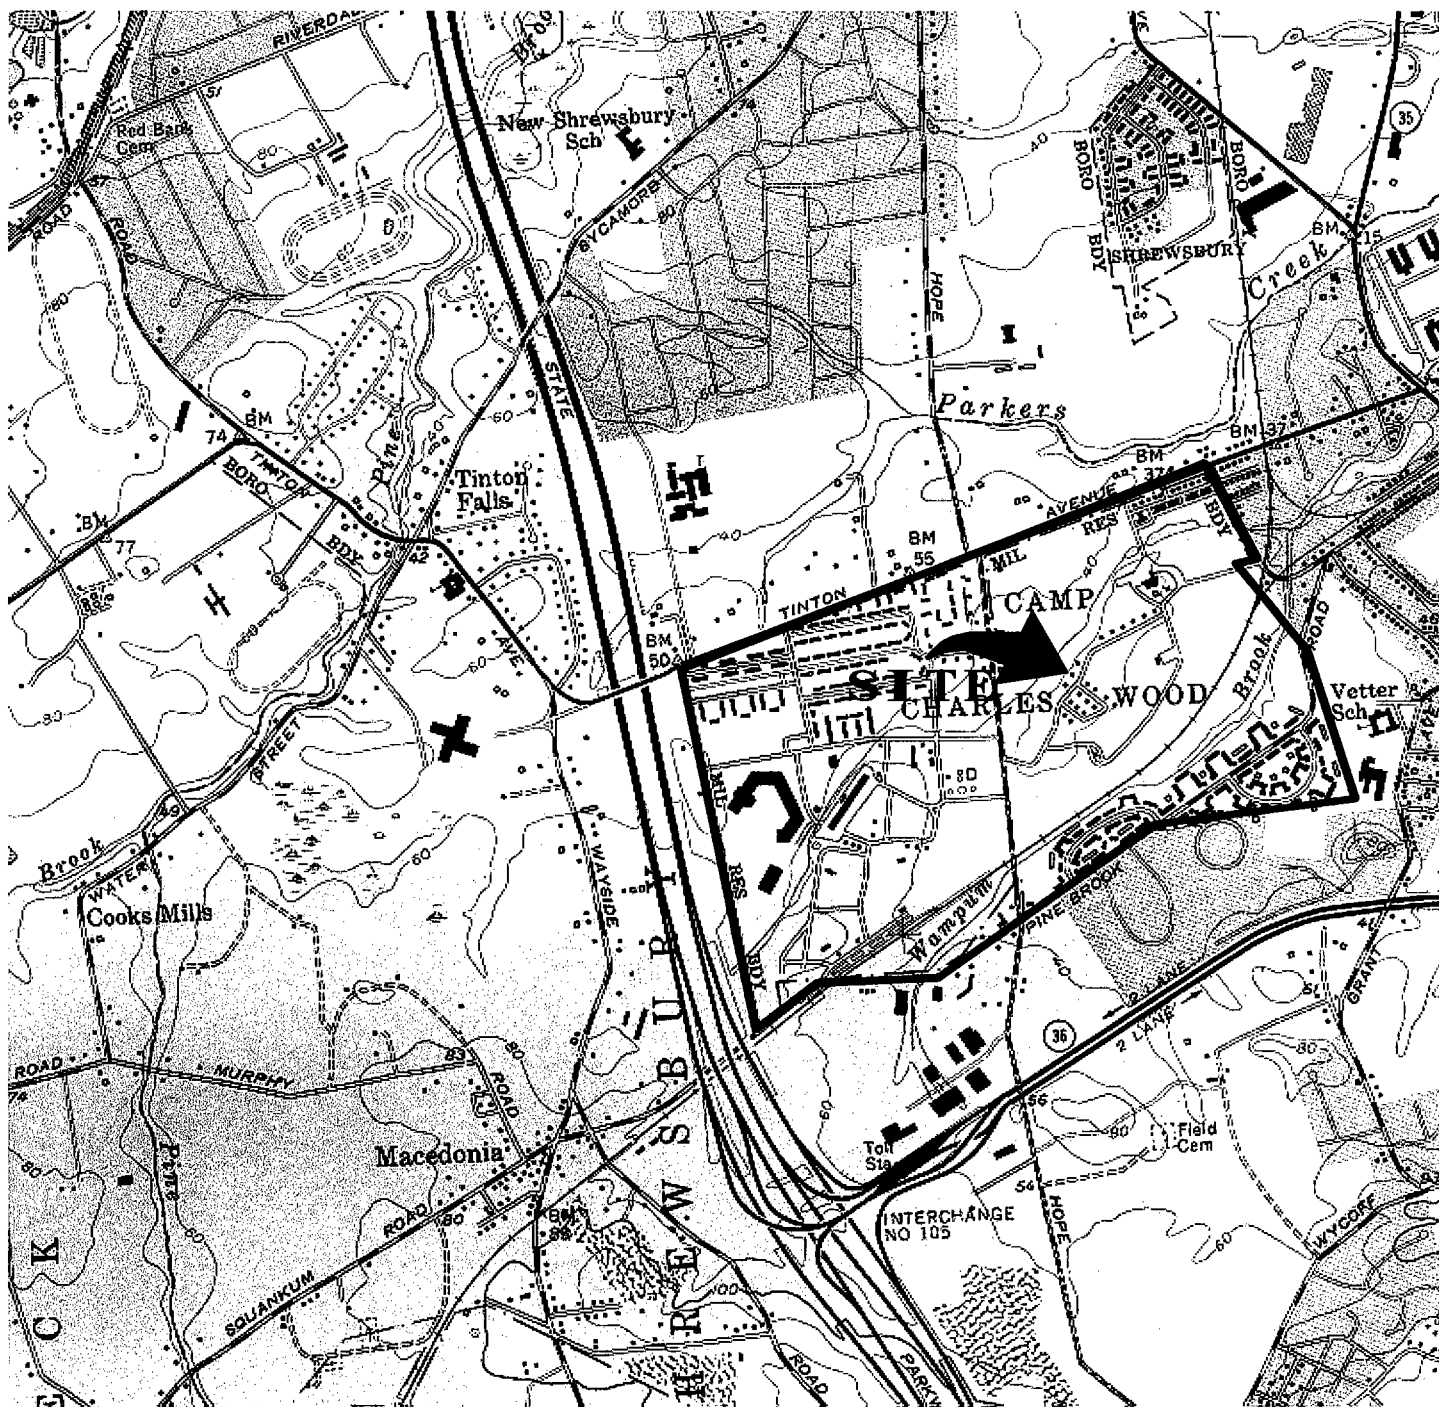

LONG BRANCH, N. J.

40073-C8-TF-024

1954

PHOTOREVISED 1981

DMA 6164 I SE-SERIES V822

NEW
JERSEY

QUADRANGLE LOCATION

FIGURE 1

LOCATION MAP

Building 2043

Charles Wood

Fort Monmouth Army Base

Monmouth County, NJ

VERSAR

Engineers, Managers, Scientists, & Planners
Bristol, PA

Mapped, edited and published by the Geological Survey

Scale: 1" = 2000'

Date: APRIL 1998

Geologic Map of New Jersey

SEDIMENTARY ROCKS

CENOZOIC

Holocene: sand

Tertiary: sand, silt, clay

MESOZOIC

Cretaceous: sand, silt, clay

Jurassic: siltstone, shale, sandstone

Triassic: siltstone, shale,
sandstone

PALEOZOIC

Devonian: conglomerate, sandstone,

Silurian: conglomerate, sandstone,
shale, limestone

Ordovician: shale, limestone

Cambrian: limestone, sandstone

IGNEOUS AND METAMORPHIC ROCKS

MESOZOIC

Jurassic: basalt

Jurassic: diabase

PRECAMBRIAN

marble

gneiss, granite

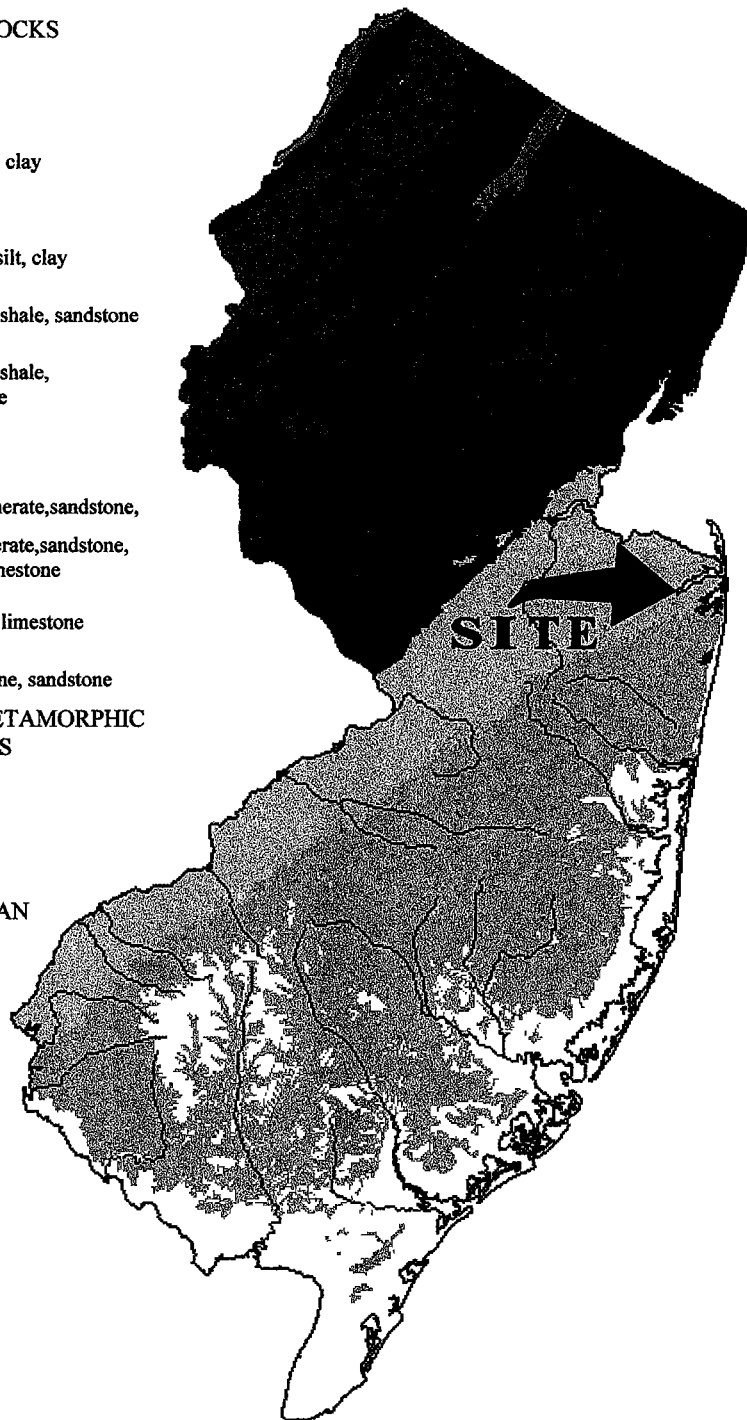


FIGURE 1A
GEOLOGICAL MAP
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
Engineers, Managers, Scientists & Planners
Bristol, Pennsylvania


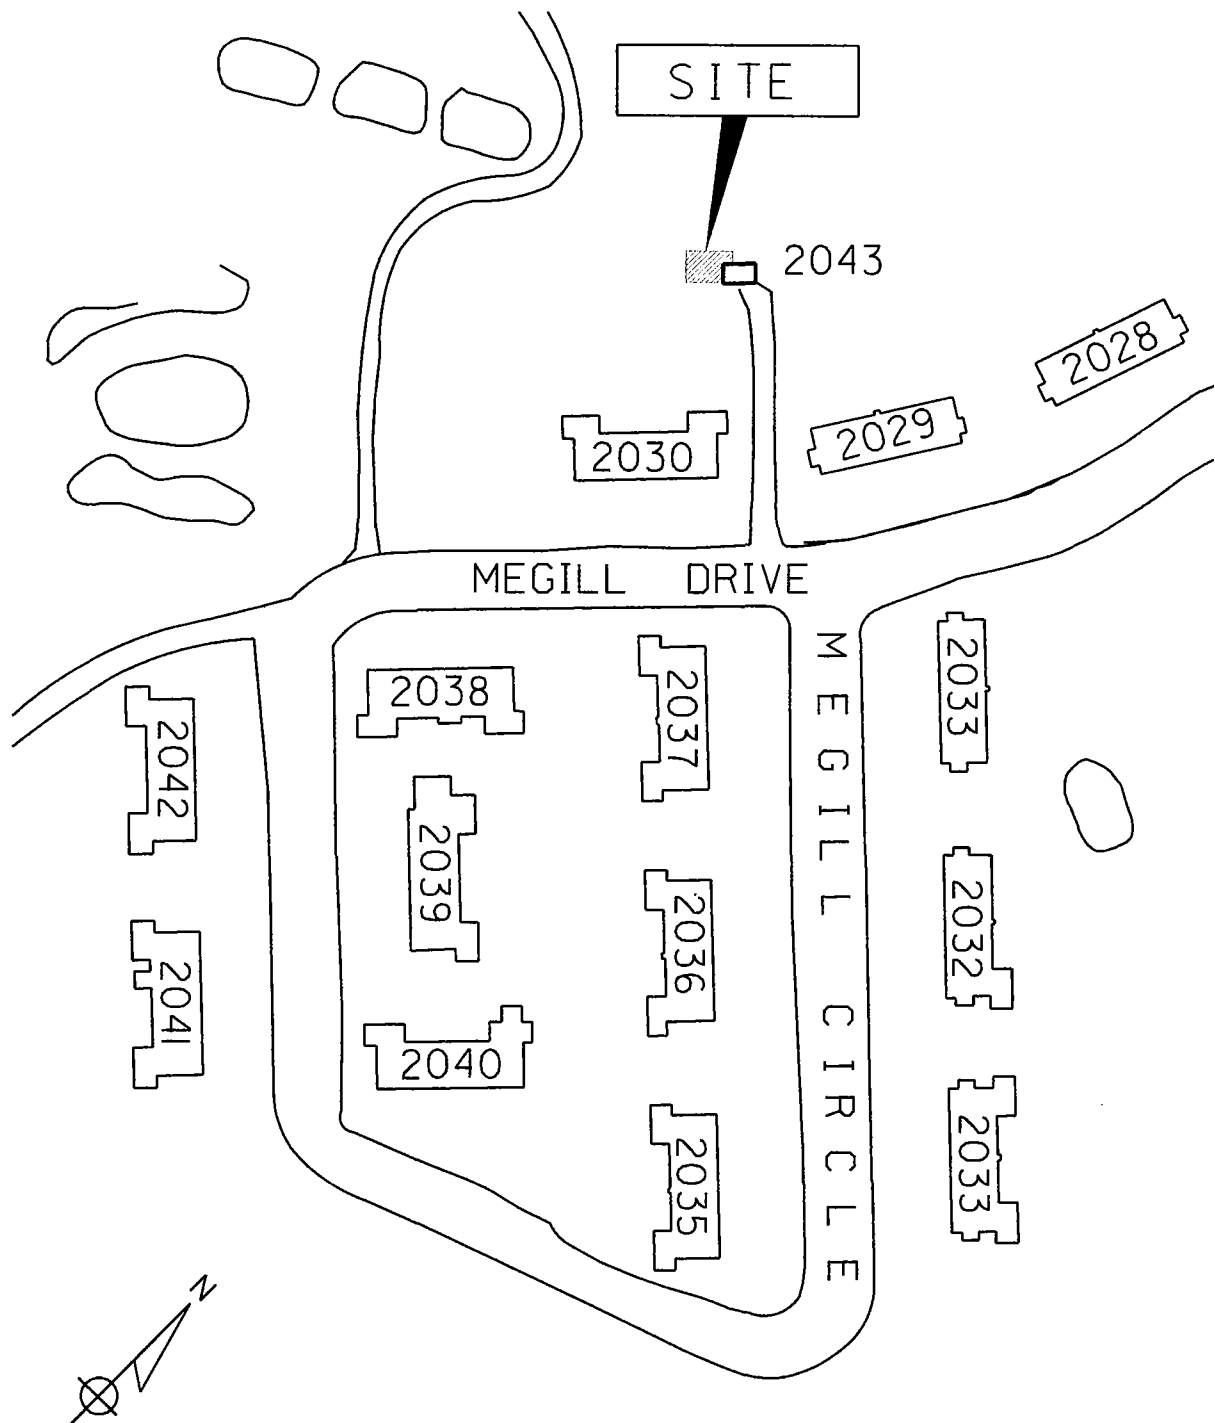




FIGURE 2
SITE MAP
BUILDING 2043
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS
BRISTOL, PA.

SCALE: 1"=100'

DATE: APRIL 1998

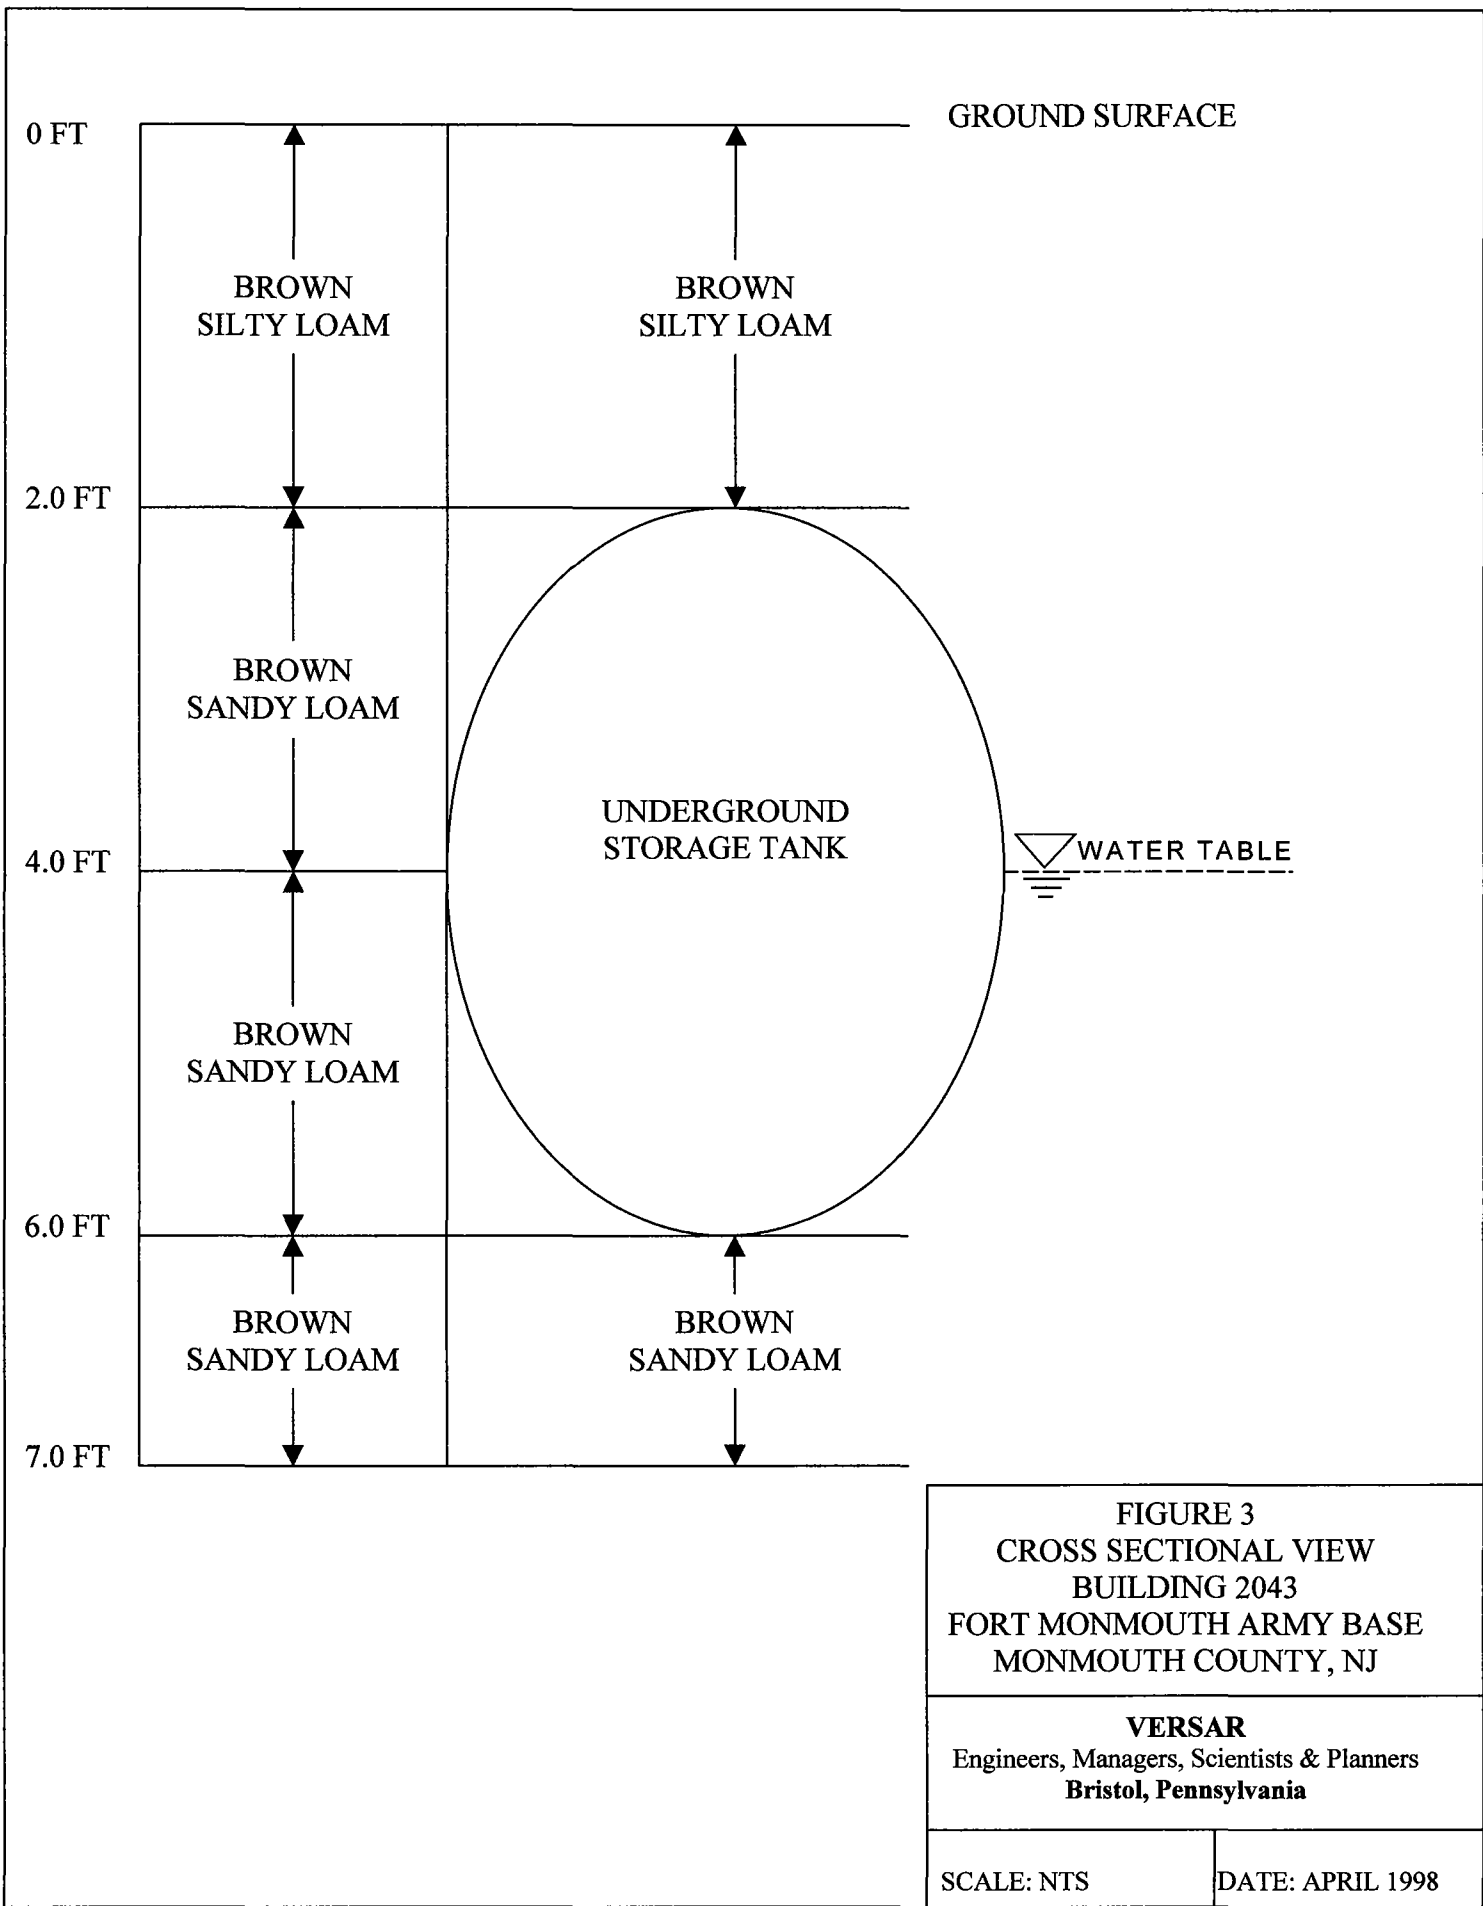

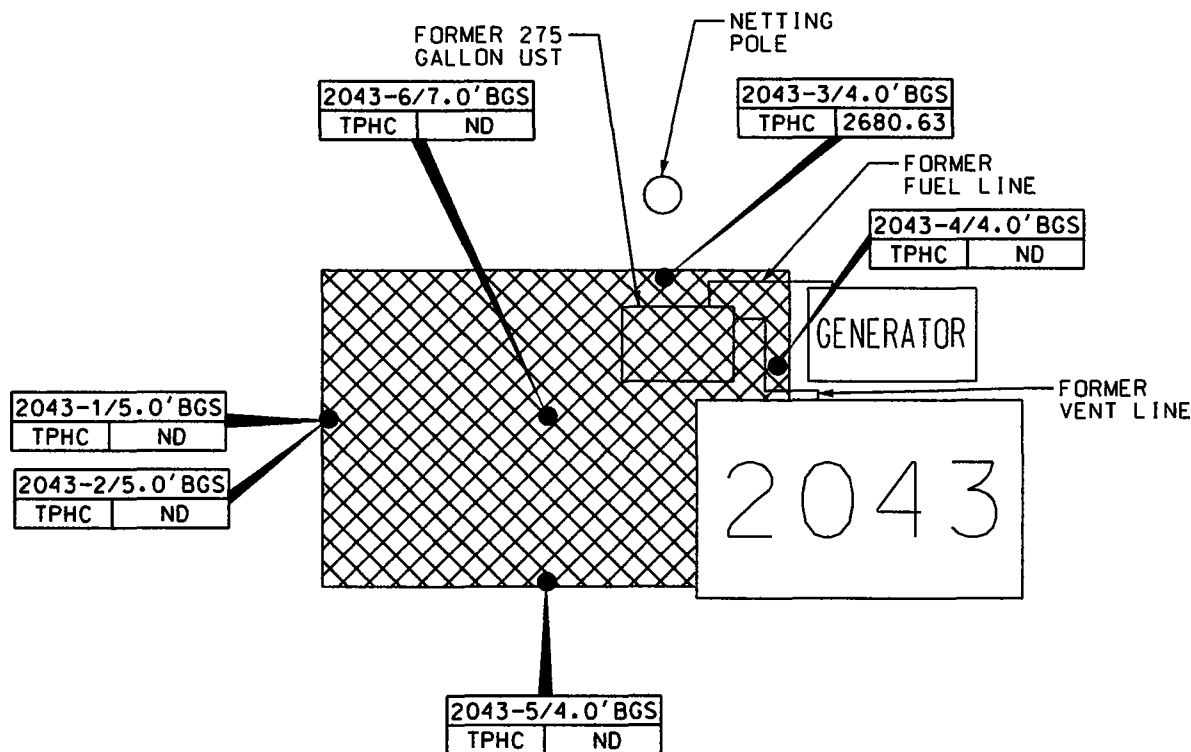

LEGEND



SOIL SAMPLE LOCATION
(FEBRUARY 19, 1999)



LIMIT OF EXCAVATION
(FEBRUARY 19, 1999)

NOTES:

1. ALL RESULTS IN MG/KG.
2. SEE TABLE 2 FOR NJDEP SOIL CLEANUP CRITERIA
3. BGS = BELOW GROUND SURFACE

FIGURE 4
SOIL SAMPLING LOCATION MAP
BUILDING 2043
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS
BRISTOL, PA.

SCALE: 1"=10'

DATE: APRIL 1998

APPENDIX A

NJDEP-STANDARD REPORTING FORM

NEW JERSEY DEPARTMENT OF ENVIRONMENTAL PROTECTION

DIVISION OF RESPONSIBLE PARTY SITE REMEDIATION

BUREAU OF APPLICABILITY AND COMPLIANCE

Registration and Billing Unit

CN 028, Trenton, N.J. 08625-0028

1-809-984-3156

FOR STATE USE ONLY

Check In ☐ Yes ☐ NoSTATUS Active Inactive COMCODE

☐	☐	☐	☐	☐
--------------------------	--------------------------	--------------------------	--------------------------	--------------------------

EMERGENCY

UNDERGROUND STORAGE TANK
FACILITY QUESTIONNAIREFACILITY UST # 192486Building 2043

Completion of this Registration Questionnaire will satisfy the registration requirements of the Underground Storage of Hazardous Substances Act, N.J.S.A. 58:10A-21, and the Registration and Billing Regulations N.J.A.C. 7:14B-2.

[Check appropriate box(es)]

- A. ☐ Is this a registration of a proposed or newly installed underground storage tank? (This form must be filed at least 30 days prior to operation)
- B. ☐ Is this a registration of an existing underground storage tank not presently registered?
- C. ☒ Is this a correction or amendment to an existing facility registration? UST # 192486
- D. ☐ There have been no changes to the facility registration since last submittal. UST # _____ (Go to certification page for signatures)

If "C" is checked above, please check the appropriate type of change(s) below

- | | | |
|--|---|--|
| ☐ Facility Name and/or Address Change | ☐ Type of Product(s) Stored | ☐ Financial Responsibility Change |
| ☐ Owner Name and/or Address Change | ☐ Spills, Leaks, Releases | ☐ Substantial Modification(s) |
| ☐ Facility Operator and/or Address Change | ☐ Tank(s) and/or Piping Changes | ☐ Sale or Transfer (Complete Questions 4,5,6 & 13D) |
| ☐ Owner Contact Person Change | ☒ Closure (Complete Question #13) | ☐ Other (please specify) |

SECTION A - GENERAL FACILITY INFORMATION

1. Facility Name Main Plot 10101 Mount Pleasant

2. Facility Location _____

NUMBER AND STREET

CITY OR MUNICIPALITY

COUNTY

STATE N.J.

ZIP CODE

BLOCK

LOT

3. Facility Operator _____

PERSON OR TITLE

Contact _____

Tele. No. _____

(Area Code)

(Extension)

Operator Address _____

(if different than #2) _____

NUMBER AND STREET

CITY OR MUNICIPALITY

STATE

ZIP CODE

4. Tank Owner _____

5. Tank Owner Address _____

NUMBER AND STREET

CITY OR MUNICIPALITY

STATE

ZIP CODE

Contact Person _____

(Tank Owner) _____

Contact _____

Tele. No. _____

(Area Code)

(Extension)

7. EPA ID # ☐8. Total number of regulated underground storage tanks at facility ☐ (Complete Section B for each tank)

9. Total regulated underground storage tank capacity at facility (gallons)

10. Facility Type: A ☐ State C ☐ County/Municipal E ☐ Charitable / Public School G ☐ Other
 B ☐ Commercial/Industrial D ☐ Federal F ☐ Residence H ☐ Farm (as defined in N.J.S.A. 54:4-23.1 et seq.)

11. Is a copy of the facility site plan submitted with this registration pursuant to N.J.A.C. 7:14B-2? ☐ YES ☐ NO

SECTION B - SPECIFIC TANK INFORMATION

ALL underground tanks, including those taken out of operation (UNLESS THE TANK WAS REMOVED FROM THE GROUND PRIOR TO 9/3/86) must be registered. Report all tank/piping status changes unless previously submitted.

1. Tank Identification Number	TANK NO. 	TANK NO. 	TANK NO. 	TANK NO. 	TANK NO.
2. CAS Number (hazardous substances only)					
3. Date Tank Installed (Month/Day/Year)	Mo. Day Year 	Mo. Day Year 	Mo. Day Year 	Mo. Day Year 	Mo. Day Year
4. Tank Size (gallons)					
5. Tank Contents (Mark one "X" for each tank)					
A. Lead gasoline					
B. Unleaded gasoline					
C. Alcohol enriched gasoline					
D. Light diesel fuel (No. 1-D)					
E. Medium diesel fuel (No. 2-D)					
F. Waste Oil					
G. Kerosene (No. 1)					
H. Home heating oil (No. 2)					
J. Heating oil (No. 4)					
K. Heavy heating oil (No. 6)					
L. Aviation fuel					
M. Motor oil					
N. Lubricating oil					
P. Sewage					
Q. Sewage sludge					
R. Other hazardous substances (specify)					
S. Hazardous waste (specify ID number)					
T. Mixtures (please specify)					
U. Emergency spill tank (specify substance)					
V. Other petroleum products (please specify)					
W. Other (please specify)					
6. Tank & Piping Construction (Mark one each for both tank & piping)	Tank Piping	Tank Piping	Tank Piping	Tank Piping	Tank Piping
A. Bare Steel					
B. Cathodically protected steel					
C. Fiberglass-coated steel					
D. Fiberglass-reinforced plastic					
E. Internally lined					
F. Other (please specify)					
7. Tank & Piping Structure (Mark one each for both tank & piping)	Tank Piping	Tank Piping	Tank Piping	Tank Piping	Tank Piping
A. Single wall					
B. Double wall					
C. Other (please specify)					
8. Type of Monitoring/Detection System (Mark all that apply for both tank & piping)	Tank Piping	Tank Piping	Tank Piping	Tank Piping	Tank Piping
A. Statistical Inventory Reconciliation					
B. Manual Tank Gauging					
C. Inventory Control					
D. Interstitial					
E. Precision Test					
F. Ground water observation wells					
G. Vapor observation wells					
H. In-tank (automatic) monitoring gauge					
J. Periodic Tank Test					

Tank Identification Number	TANK NO.	TANK NO.	TANK NO.	TANK NO.	TANK NO.
8. Type of Monitoring/Detection System	Tank Piping	Tank Piping	Tank Piping	Tank Piping	Tank Piping
K. None	☐	☐	☐	☐	☐
L. Other (please specify)					
9. Overfill Protection (tank only) (Mark one X for each tank)					
A. Yes	☐	☐	☐	☐	☐
B. No	☐	☐	☐	☐	☐
10. Spill Containment Around Fill Pipe (Mark one X for each tank)					
A. Yes	☐	☐	☐	☐	☐
B. No	☐	☐	☐	☐	☐
11. Tank Status (Mark one X for each tank)	Tank Piping	Tank Piping	Tank Piping	Tank Piping	Tank Piping
A. In-use	☐	☐	☐	☐	☐
B. Empty less than 12 months	☐	☐	☐	☐	☐
C. Empty 12 months or more	☐	☐	☐	☐	☐
D. Emergency spill tank (sump)	☐	☐	☐	☐	☐
E. Emergency backup generator tank	☐	☐	☐	☐	☐
F. Abandoned in Place	☐	☐	☐	☐	☐
G. Removed	☐	☐	☐	☐	☐
H. Other (please specify)					
12. If box 11B, C, or D above has been marked, indicate the estimated date last used (month/day/year)	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year
13. Closure Information - Tank ID No.	TANK NO.	TANK NO.	TANK NO.	TANK NO.	TANK NO.
	0036				
A. Date abandoned in place	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year
B. Date taken temporarily out of service					
C. Date removed	04/10/99				
D. Date of Sale or Transfer					
E. TMS # (if applicable)					
F. ISRA # (if applicable)	DIAR #	98-04-10	1408-11		

SECTION C - FINANCIAL RESPONSIBILITY

Does this facility have a Financial Responsibility Assurance Mechanism as required in 40 CFR 280? ☐ YES ☐ NO
Please list the appropriate financial information below:

Type	Carrier / Issuing Agency
Effective Date	Expiration Date
Policy Number	\$ Amount

SECTION D - MONITORING SYSTEMS

Does this facility have a release detection monitoring system which is in compliance with N.J.A.C. 7:14B-6? ☐ YES ☐ NO
If "No", please be aware that the facility must meet the appropriate deadline. (See "Dates to Know" on Page 4)

SECTION E - RECORDKEEPING/COMPLIANCE

Please answer all the questions in this section on a facility basis. Any one tank not in compliance requires a "NO" answer for the entire facility.

- Does this facility have cathodic protection systems for all steel tanks and piping?
If "Yes", are the systems properly operated and maintained pursuant to N.J.A.C. 7:14B-5? ☐ YES ☐ NO
- Are the performance claims and documentation of monitoring systems maintained by the owner or operator pursuant to N.J.A.C. 7:14B-5? ☐ YES ☐ NO
- Are the proper monitoring, testing, sampling, repair and inventory records kept on-site pursuant to N.J.A.C. 7:14B-5 and 6? ☐ YES ☐ NO
- Is the proper Release Response Plan kept on-site pursuant to N.J.A.C. 7:14B-5? ☐ YES ☐ NO
- Does the facility have spill and over fill protection systems pursuant to N.J.A.C. 7:14B-4? ☐ YES ☐ NO
- Have all Fill Ports been permanently marked as per API #1637 pursuant to N.J.A.C. 7:14B-5? ☐ YES ☐ NO

IMPORTANT INFORMATION

- FEE:** Please make checks payable to: "Treasurer, State of New Jersey". Use of the enclosed return envelope will expedite processing. Registration and Billing Schedule can be found in N.J.A.C. 7:14B.
All Initial Registration fees are \$100 per facility.
- PENALTY:** Failure by owner or operator of a regulated underground storage tank to comply with any requirement of the State UST Act or regulations may result in the penalties set forth in N.J.S.A. 58:10A-10.
- EMERGENCY:** If a discharge or spill occurs, the NJDEP Hotline at (609) 292-7172 must be called IMMEDIATELY - 24 hours a day.
- UPGRADE EXEMPTION:** Residential heating oil underground storage tanks are exempt from all upgrade requirements.

DATES TO KNOW (critical deadlines)

- December 22, 1988 — All new federally regulated tank systems must have cathodic protection and spill/overfill protection.
- September 4, 1990 — All new State-only regulated tank systems must have cathodic protection and spill/overfill protection.
- December 22, 1990 — All federally regulated piping must have begun leak detection.
- February 19, 1993 — All federally regulated tank systems must maintain financial responsibility assurance.
- December 22, 1993 — All federally regulated tank systems must have begun leak detection.
- December 22, 1998 — All regulated tanks shall install cathodic protection and spill/overfill protection.

CERTIFICATIONS

NOTE: IF THE PERSON SIGNING CERTIFICATION NO. 2 IS THE SAME AS THE PERSON SIGNING CERTIFICATION NO. 1, THEN CERTIFICATION NO. 2 NEED NOT BE SIGNED. (If different persons are required to sign No. 1 and No. 2, then they must do so.)

CERTIFICATION NO. 1:

Must be signed by the highest ranking individual at the facility with overall responsibility

"I certify under penalty of law that the information provided in this document is true, accurate and complete to the best of my knowledge, information and belief. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

James Ott
(Typed / Printed Name)

Director
(Title) OR, PUBLIC WORKS

[Signature]
(Signature)
4/15/98
(Date)

CERTIFICATION NO. 2:

Must be signed as follows:

- For a corporation, by a principal executive officer of at least the level of vice president
- For a partnership or sole proprietorship, by a general partner or the proprietor, respectively
- For a municipality, State, Federal or other public agency, by either a principal executive officer or ranking elected official
- For persons other than indicated above, by the person with legal responsibility for the site

"I certify under penalty of law that I have personally examined and am familiar with the information submitted herein and all attached documents, and that based on my inquiry of those individuals immediately responsible for obtaining the information. I believe that the submitted information is true, accurate and complete. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

(Typed / Printed Name)

(Title)

(Signature)

(Date)

CERTIFICATION NO. 3:

If applicable, must be signed by the individual who is certified to perform services.

"I certify under penalty of law that the information provided in this document is true, accurate and complete to the best of my knowledge, information and belief. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

David H. Daniels
(Typed / Printed Name) (Title)

SNC Environmental Services Group
(Name of Firm, if applicable)

[Signature] 4.10.98
(Signature) (Date)

10279
(N.J. Certification Number)

APPENDIX B

SITE ASSESSMENT SUMMARY

Site Remediation Program

UST Site/Remedial Investigation Report Certification Form

A. Facility Name : U.S. Army Fort Monmouth New JerseyFacility Street Address : Directorate of Public Works Building 173Municipality: Oceanport County : MonmouthBlock: _____ Lot(s): _____ Telephone Number : 732-532-6224**B. Owner (RP)'s Name:** _____

Street Address: _____ City : _____

State: _____ Zip: _____ Telephone Number : _____

C. (Check as appropriate)☐ Site Investigation

Report (SIR) \$500 Fee

☐ Remedial Investigation

Report (RIR) \$1000 Fee

☒ NA – Federal Agreement**D. (Complete all that apply)**• Assigned Case Manager : Ian Curtis, Federal Case Manager• UST Registration Number : 192486-36 (7 digits)• Incident Report Number 98 - 04 - 10 - 1408 - 11 (10 or 12 digits)• Tank Closure Number : Federal Case Manager**E. Certification by the Subsurface Evaluator:**

The attached report conforms to the specific reporting requirements of N.J.A.C. 7:26EYes No

Name: Dinker Desai Signature: [Signature] UST Cert. No.: 10173Firm: U.S. Army Fort Monmouth Firm's UST Cert. Number: NA-U.S. ArmyFirm Address: Directorate of Public Works Building 173 City: Fort MonmouthState: NJ Zip: 07703 Telephone Number : 732-532-6224

(NOTE: Certification numbers required only if work was conducted on USTs regulated per N.J.S.A. 58:10A-21 et seq.)

F. Certification by the Responsible Party(ies) of the Facility:

The following certification shall be signed [according to the requirements of N.J.A.C. 7:14B-1.7(b)] as follows:

1. For a Corporation by a person authorized by a resolution of the board of directors to sign the document. A copy of the resolution, certified as a true copy by the secretary of the corporation, shall be submitted along with the certification; or
2. For a partnership or sole proprietorship, by a general partner or the proprietor, respectively; or
3. For a municipality, State, federal or other public agency by either a principal executive officer or ranking elected Official.

"I certify under penalty of law that I have personally examined and am familiar with the information submitted in this application and all attached documents, and that based on my inquiry of those individuals responsible for obtaining the information, I believe that the submitted information is true, accurate, and complete. I am aware that there are significant civil penalties for knowingly submitting false, inaccurate, or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

Name (Print or Type): James Ott Title: Directorate of Public WorksSignature: [Signature]Company Name: U.S. Army Fort MonmouthDate: 9/4/00

APPENDIX C

WASTE MANIFEST



RD1 Box 5A
Old Bridge, N.J. 08857
(732) 721-0900
Fax (732) 721-0231

Building # Drums Volume (gallons)
257 3 130
752 2 70
1213 1 30
2043 2 70
2603 1 30
192205

STANDARD
COLLECTION
ORDER FORM

GENERATOR/LOCATION

SALES ORDER #

BILL TO (IF DIFFERENT FROM LOCATION)

NAME: U.S. Army Communications Electronics Group
INFORMATION/ATTENTION LINE: MAIN Post
DELIVERY ADDRESS: C/O J. FALLON BLDG 173 ATTN: SELF-MANAGED
CITY: FT. Monmouth STATE: NJ ZIP: 07703
PHONE NUMBER: 732-532-6223
USA EPA ID NO. (IF APPLICABLE): NJ 3210020324
PURCHASE ORDER NUMBER: 07703
STATE ID NO.

NAME: SMC Environmental
INFORMATION/ATTENTION LINE: SMC Environmental
DELIVERY ADDRESS: SMC Environmental
CITY: SMC Environmental STATE: SMC Environmental ZIP: SMC Environmental
PHONE NUMBER: SMC Environmental PURCHASE ORDER NUMBER: SMC Environmental
MANIFEST NUMBER: D09956

SHIPPING INFORMATION

This is to certify that the below named materials are properly classified, described, packaged, marked and labeled, and are in proper condition for transportation according to the applicable regulations of the Department of Transportation.

NO.	TYPE	QTY.	UNIT	US DOT Description (Including Proper Shipping Name, Hazard Class and ID Number)	SALES REPRESENTATIVE

SERVICE SECTION

SALES CODE	DESCRIPTION	WASTE CODE	QUANTITY	UNIT PRICE	PRICE	TAX	LINE TOTAL
40500	USED OIL REMOVAL						
40300	ANTI-FREEZE REMOVAL						
40600	USED OIL FILTER REMOVAL						
40501	OILY WATER DISPOSAL						
40502	SLUDGE DISPOSAL	ID72	330	GALS			
41001	GASOLINE/WATER						
41501	DRUM DISPOSAL						
41504	TANK ENTRY						
40800	PARTS WASHER SERVICE						
41500	TRUCK & OPERATOR	10:30-2:30	(4 hours)				
41511	NEW 55 GAL DRUM /17H						
41503	QAQC ANALYTICAL TESTING						
42001	DEXSIL TEST KIT	TAX					
41509	TRANSPORTATION						

CHARGE MY ACCOUNT FOR THIS TRANSACTION
UNLESS OTHERWISE INDICATED IN THE
PAYMENT SECTION.

INVOICES REFLECTING CHARGES TO CUSTOMER
ARE SUBJECT TO AN INTEREST RATE OF THE LESSER OF 1½% PER MONTH (18%
PER ANNUM) OR THE MAXIMUM RATE ALLOWED BY LAW ON ANY INVOICES THAT
ARE NOT PAID WITHIN 30 DAYS. IN THE EVENT OF DEFAULT, LORCO SHALL BE
ENTITLED TO RECOVER COSTS OF COLLECTION, INCLUDING REASONABLE
ATTORNEY'S FEES.

GENERATOR WARRANTS AND REPRESENTS THAT THE MATERIALS PROVIDED
LORCO HEREUNDER HAVE NOT BEEN MIXED, COMBINED, OR OTHERWISE
BLENDED IN ANY QUANTITY WITH MATERIALS CONTAINING POLYCHLORINATED
BIPHENYLS (PCB) OR ANY OTHER MATERIAL DEFINED AS HAZARDOUS WASTE
UNDER APPLICABLE LAWS, INCLUDING BUT NOT LIMITED TO 40 CFR PART 261.
GENERATOR AGREES TO INDEMNIFY AND HOLD LORCO HARMLESS FOR ANY
DAMAGES, COSTS, ATTORNEY'S FEES, ETC. ARISING OUT OF OR IN ANY WAY
RELATED TO A BREACH OF THE ABOVE WARRANTY BY THE GENERATOR.

Generator certifies that the waste is ID72
In accordance the N.J.A.C. 7:26-12.1 et seq, LORCO has the required
permits to accept the above described waste.

Print Name

Title

Signature

Date

GENERATOR/CUSTOMER

SMALL QUANTITY TOTAL GENERATOR CERTIFICATION

I certify that this generator
generates less than 100
kilograms of hazardous
waste per month, as
defined at 40 C.F.R. 261,
and does not accumulate
more than 1,000 kilograms
of such waste during the
month.

GENERATOR'S SIGNATURE

LARGE QUANTITY GENERATOR CERTIFICATION

DEXSIL CDT
TEST RESULTS

PPM

PAYMENT RECEIVED SECTION

CASH ☐

TOTAL RECEIVED

CHECK NUMBER

CUSTOMER SERVICED
EVERY 30 DAYS

In accordance with 40 CFR 266 § 43(5) LORCO has notified
the US EPA of its location and used oil management activities.

Signature: Cary L. Bell
Date: 4-22-98
LORCO REPRESENTATIVE

CUSTOMER

APPENDIX D

UST DISPOSAL CERTIFICATE



Reorder From:
The Drawing Board
P.O. Box 2044 • Hartford, CT 06104-2044
Call Toll Free: 1-800-427-6530

REORDER ITEM # BLN74

STRAIGHT BILL OF LADING
ORIGINAL - NOT NEGOTIABLE

Shipper No. 004

SMC ENVIRONMENTAL SERVICES GROUP

Carrier No. _____

Date _____

Consignee Red Bank Recycling	From Shipper Fort Monmouth (U.S. Army)
Street 64 Central Ave	Street Building 2043
Postoffice Red Bank, NJ	Origin Oceanport, N.J.
Zip Code 07701	

No. Shipping Units	Kind of Packaging, Description of Articles, Special Marks and Symbols	Weight (Subject to Correction)	RATE	CHARGES
①	For Setup Only 1 - 275 Gallon U.S.T. Skid "Clamp"			
	TANK # 192486-36 Building # 2043			

REMIT C.O.D. TO: ADDRESS	COD Amt: \$	C.O.D. FEE: PREPAID ☐ \$ COLLECT ☐ \$
NOTE - Where the rate is dependent on value, shippers are required to state specifically in writing the agreed or declared value of the property.	Subject to Section 7 of the statute, the value of property to be delivered in the freight car without receipt on the bill of lading, the carrier shall observe the following statement: For carrier's use only: delivery of the shipment without payment of freight and all other lawful charges.	TOTAL CHARGES: \$
The agreed or declared value of the property is hereby voluntarily stated by the shipper to be not exceeding	Signature _____ (Signature of Consignor)	Signature of Carrier _____

RECEIVED, subject to the conditions and terms in effect on the date of the issue of this Bill of Lading, the property described above in apparent good order, except as noted (contents and condition of contents of packages unknown, packed, consigned, and delivered as indicated above and carrier's word being understood throughout this contract as meaning any person or corporation in possession of the property under the contract) agree to carry to its usual place of delivery at the destination, if on its route, otherwise to deliver to another carrier on the route to said destination. It is mutually agreed as to each carrier of all or any of said property over all or any portion of said route to destination and as to each party at any time interested in all or any of said property, that every service to be performed hereunder shall be subject to all the bill of lading terms and conditions in the governing classification and the said terms and conditions are hereby agreed to by the shipper and accepted for himself and his assigns.

SHIPPER Fort Monmouth (U.S. Army)	CARRIER SMC ENVIRONMENTAL SERVICES GROUP
PER _____	PER Mark C. Lyman
	DATE 5/1/98

*Mark with "X" to designate Hazardous Material as defined in Title 49 of the Code of Federal Regulations.

Reorder Item #BLN74 The Drawing Board, P.O. Box 2044, Hartford, CT 06104-2044
©EGI, 1992, Printed in U.S.A.

FROM JMT ENVIRON. TECH. 610 759 6149

1995 8:52PM

908-747-7784

908-747-7779

Red Bank Recycling Auto Wreckers, Inc.

64 Central Avenue, Red Bank, New Jersey 07701

Date 5/1 1988

M

Yellow Dump Truck

	AMOUNT	CWT	TOTAL
☒ LIGHT IRON	<u>420</u>		<u>4.50</u>
NO. 1 STEEL			
NO. 2 STEEL			
D. M. B.			
CAST IRON			
COPPER			
BRASS			
ALUMINUM			
RADIATORS			
BATTERIES			
<u>2.300</u> <u>644</u> <u>Truck</u> <u>5.00</u>			
CARS			

I am the owner of said vehicle(s) and release it to Red Bank Recycling Auto Wreckers, Inc.

Signature of Owner

[Signature]

APPENDIX E

SOIL ANALYTICAL DATA PACKAGE

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

REPORT OF ANALYSIS

Client: U.S. Army
DPW, SELFM-PW-EV
Bldg. 173
Ft. Monmouth, NJ 07703

Project: Total Petroleum Hydrocarbons
98-0779
Bldg. 2043
TETRA-TECH

Project # 3518
Date Rec. 04/29/98
Date Compl. 05/01/98
Released by:



Daniel K. Wright
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Cover Sheet	1
Table of Contents	2
Method Summary	3
Conformance/Non-Conformance	4
Chain of Custody	5
Results Summary	6
Initial Calibration Summary	7
Continuing Calibration Summary	8
Surrogate Results Summary	9
MS/MSD Results Summary	10
Quality Control Spike Summary	11
Raw Sample Data	12-19
Laboratory Deliverable Checklist	20

Method Summary

NJDEP Method OQA-QAM-025-10/97

Gas Chromatographic Determination of Total Petroleum Hydrocarbons in Soil

Fifteen grams (15g)(wet weight) of a soil sample is added to a 125 mL acid cleaned, solvent rinsed, capped Erlenmeyer flask. 15g anhydrous sodium sulfate is added to dry sample. Surrogate standard spiking solution is then added to the flask.

Twenty five milliliters(25mL) Methylene Chloride is added to the flask and it is secured on a gyrotory shaker table. The agitation rate is set to 400rpm and the sample is shaken for 30 minutes. The flask is the removed from the table and the particulate matter is allowed to settle. The extract is transferred to a Teflon capped vial. A second 25mL of Methylene Chloride is added to the flask and shaken for an additional 30 minutes. The flask is again removed and allowed to settle. The extracts are combined in the vial then transferred to a 1mL autosampler vial.

The extract is then injected directly into a GC-FID for analysis. The sample is analyzed for petroleum hydrocarbons covering a range of C8-C42 including pristane and phytane. Total Petroleum Hydrocarbon concentration is determined by integrating between 5 minutes and 22 minutes. The baseline is established by starting the integration after the end of the solvent peak and stopping after the last peak.


The final concentration of Total Petroleum Hydrocarbons is calculated using percent solid, sample weight and concentration.

PHC Conformance/Non-conformance Summary Report


	<u>No</u>	<u>Yes</u>
1. Method Detection Limits provided.	—	☒
2. Method Blank Contamination - If yes, list the sample and the corresponding concentrations in each blank.	☒	—
3. Matrix Spike Results Summary Meet Criteria. (If not met, list the sample and corresponding recovery which falls outside the acceptable range).	—	☒
4. Duplicate Results Summary Meet Criteria. (If not met, list the sample and corresponding recovery which falls outside the acceptable range).	—	☒
5. IR Spectra submitted for standards, blanks, & samples	☒	NA
6. Chromatograms submitted for standards, blanks, and samples if GC fingerprinting was conducted.	—	☒
7. Analysis holding time met.	—	☒
(If not met, list number of days exceeded for each sample)		
Additional Comments:		

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW 846 for Solid Waste Analysis. I have personally examined the information contained in this report, and to the best of my knowledge, I believe that the submitted information is true, accurate, complete, and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.

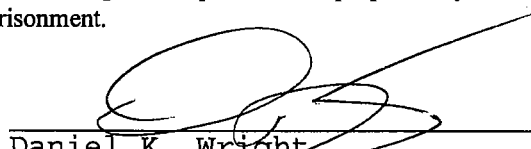

Daniel K. Wright
Laboratory Manager

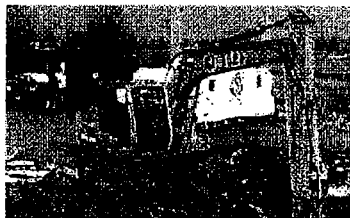

Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-3484 EMail:appleby@doim6.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

[illegible]

Report of Analysis
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification # 13461

Client :	U.S. Army	Lab. ID # :	3518
	DPW. SELFM-PW-EV	Date Rec'd:	29-Apr-98
	Bldg. 173	Analysis Start:	29-Apr-98
	Ft. Monmouth, NJ 07703	Analysis Complete:	01-May-98

Analysis:	OQA-QAM-025	UST Reg. #:	
Matrix:	Soil	Closure #:	
Analyst:	D.DEINHARDT	DICAR #:	
Ext. Meth:	Shake	Location #:	BLDG. 2043

Sample	Field ID	Dilution Factor	Weight (g)	% Solid	MDL (mg/kg)	TPHC Result (mg/kg)
3518.01	2043-1	1.00	15.27	79.94	193	8435.51
3518.02	2043-2	1.00	15.10	81.29	191	11657.82
3518.03	2043-3	1.00	15.21	78.16	198	775.92
3518.04	2043-4	1.00	15.26	81.74	188	9840.31
METHOD BLANK	TBLK 92	1.00	15.00	100.00	157	ND

ND = Not Detected

MDL = Method Detection Limit


 Daniel K. Wright
 Laboratory Director

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted
2. Table of Contents submitted
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted
4. Document paginated and legible
5. Chain of Custody submitted
6. Samples submitted to lab within 48 hours of sample collection
7. Methodology Summary submitted
8. Laboratory Chronicle and Holding Time Check submitted
9. Results submitted on a dry weight basis
10. Method Detection Limits submitted
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP

✓
✓
✓
✓
✓
✓
✓
✓
✓
✓
✓

Laboratory Manager or Environmental Consultant's Signature
Date 5/15/98



Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance

FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732)532-6224 FAX: (732)532-6263

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

NJDEP LABORATORY CERTIFICATION # 13461



ANALYTICAL DATA REPORT Fort Monmouth Environmental Laboratory ENVIRONMENTAL DIVISION Fort Monmouth, New Jersey PROJECT: #99-0078 UST

Bldg. 2043

Field Location No. & Location	Laboratory Sample ID#	Matrix	Date and Time Of Collection	Date Received
2043-1 (5')	4283.01	Soils	19-Feb-99 08:30	02/19/99
2043-2 (5')	4283.02	Soils	19-Feb-99 08:35	02/19/99
2043-3 (4')	4283.03	Soils	19-Feb-99 08:40	02/19/99
2043-4 (4')	4283.04	Soils	19-Feb-99 08:45	02/19/99
2043-5 (4')	4283.05	Soils	19-Feb-99 08:50	02/19/99
2043-6 (7')	4283.06	Soils	19-Feb-99 08:55	02/19/99
2043-SP1	4283.07	Soils	19-Feb-99 09:00	02/19/99

ANALYSIS:
FORT MONMOUTH ENVIRONMENTAL LAB
VOA+15, TPHC, %SO₂DIS


3/4/99
Daniel Wright/Date
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Chain of Custody	1-3
Methodology Review	4-6
Laboratory Chronicle	7-8
Conformance/Non-Conformance Summary	9-12
Volatile Organics	13-13A
Results Summary	14-19
Tuning Results Summary	20-23
Method Blank Summary	24
Calibration Summary	25-28
Surrogate Results Summary	29
MS/MSD Results Summary	30
Internal Standard Summary	31-32
Chromatograms	33-36
Total Petroleum Hydrocarbons	37
Results Summary	38
Method Blank Summary	38
Standards Summary	39-46
Surrogate Results Summary	47
MS/MSD Results Summary	48-49
Chromatograms	50-65
Laboratory Deliverable Checklist	66
Laboratory Authentication Statement	67

CHAIN OF CUSTODY

000001



Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-3484 EMail:appleby@doim6.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

Customer: Charles Appleby				Project No: IJO 99-0078 UST (REM.)		Analysis Parameters						Comments: 3-5 th RUSH RUN VO+IO ON ANY TPHC ABOVE 1,000PPM	
Phone #: X26224				Location: BUILDING 2043 UST # 192486-36		TPHC	% SOLIDS	VO+IO	VOC JAR#	H-NU READING			
(X) OMA FM0097F147 UST Remediation				CASE # 9804101408-11									
Samplers Name / Company : Tim Walker (SMC/VERSAR)						Sample #	TPHC	% SOLIDS	VO+IO	VOC JAR#	H-NU READING	Remarks / Preservation Method	
Lab Sample I.D.	Sample Location	Date	Time	Type	bottles								
4283	1 2043-1 (5')	2-19-99	0830	SOIL	1	K	K				0	ICE	
	2 2043-2 (5')		0835		1	K	K				0		
	3 2043-3 (4')		0840		2	K	K			791	17		
	4 2043-4 (4')		0845		2	K	K			792	2		
	5 2043-5 (4')		0850		2	K	K			793	14		
	6 2043-6 (7')		0855		1	K	K				0		
	7 2043-SP1		0900		1	K	K				0		
Relinquished by (signature):						Date/Time:		Received by (signature):		Date/Time:		Received by (signature):	
Relinquished by (signature):						Date/Time:		Received by (signature):		Date/Time:		Received by (signature):	
Report Type: () Full, (X) Reduced, () Standard, () Screen / non-certified						Remarks: H-NU CALIBRATION - ZERO GAS = 0.0 PPM 100 PPM 150 BUTYLENE; 58 PPM @ 9.8 SPAN SHC H-NU #1; 5/N 901463							
Turnaround time: () Standard 4 wks, (X) Rush Days, (X) ASAP Verbal Hrs.													

0000002

Change of Chain of Custody

Lab Project ID#: 4283 Site/Project Name: Bldg 2043

Date Received: 2/19/99 Date of Change: 2/22/99

Requested by: print Dave Daniels Sign: _____

Turnaround Time: Standard

1. Were the correct containers and/or preservatives used for the tests indicated? Yes No
2. Was a sufficient amount of sample sent for the tests indicated? Yes No
3. Are samples Within Holding time for new analysis? Yes No
4. Was the change documented in the sample receipt log book? Yes No

Received by: print

Sign:

[illegible]

Comments:

METHOD SUMMARY

000004

Method Summary

NJDEP Method 8260

Gas Chromatographic Determination of Volatiles in Soil

A 50uL volume of Methanol Samples soil is added to 5mL aliquot of water. Surrogates and internal standards are added and the sample is placed on a purge and trap concentrator. The sample as purged and desorbed into a GC/MS system.

Volatiles are identified and quantitated. The final concentration is calculated using soil weight, percent solid, methanol volume and concentration.

000005

Method Summary

NJDEP Method OOA-QAM-025-10/97

Gas Chromatographic Determination of Total Petroleum Hydrocarbons in Soil

Fifteen grams (15g)(wet weight) of a soil sample is added to a 125 mL acid cleaned, solvent rinsed, capped Erlenmeyer flask. 15g anhydrous sodium sulfate is added to dry sample. Surrogate standard spiking solution is then added to the flask.

Twenty five milliliters(25mL) Methylene Chloride is added to the flask and it is secured on a gyrotory shaker table. The agitation rate is set to 400rpm and the sample is shaken for 30 minutes. The flask is the removed from the table and the particulate matter is allowed to settle. The extract is transferred to a Teflon capped vial. A second 25mL of Methylene Chloride is added to the flask and shaken for an additional 30 minutes. The flask is again removed and allowed to settle. The extracts are combined in the vial then transferred to a 1mL autosampler vial.

The extract is then injected directly into a GC-FID for analysis. The sample is analyzed for petroleum hydrocarbons covering a range of C8-C42 including pristane and phytane. Total Petroleum Hydrocarbon concentration is determined by integrating between 5 minutes and 22 minutes. The baseline is established by starting the integration after the end of the solvent peak and stopping after the last peak.

The final concentration of Total Petroleum Hydrocarbons is calculated using percent solid, sample weight and concentration.

000006

LABORATORY CHRONICLE

000007

Laboratory Chronicle

Lab ID: 4283

Site: Bldg. 2043

	Date	Hold Time
Date Sampled	02/19/99	NA
Receipt/Refrigeration	02/19/99	NA
Extractions		
1. TPHC	02/19/99	14 days
Analyses		
1. Volatile Organics	02/25/99	14 Days
2. TPHC	02/22/99	14 days

000008

**CONFORMANCE
NON
CONFORMANCE**

000009

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT

Indicate
Yes, No, N/A

1. Chromatograms labeled/Compounds identified
(Field samples and method blanks) yes
2. Retention times for chromatograms provided yes
3. GC/MS Tune Specifications
 - a. BFB Meet Criteria yes
 - b. DFTPP Meet Criteria NA
4. GC/MS Tuning Frequency – Performed every 24 hours for 600 series and 12 hours for 8000 series yes
5. GC/MS Calibration – Initial Calibration performed before sample analysis and continuing calibration performed within 24 hours of sample analysis for 600 series and 12 hours for 8000 series yes
6. GC/MS Calibration requirements
 - a. Calibration Check Compounds Meet Criteria yes
 - b. System Performance Check Compounds Meet Criteria yes
7. Blank Contamination – If yes, List compounds and concentrations in each blank: NO
 - a. VOA Fraction _____
 - b. B/N Fraction NA
 - c. Acid Fraction NA
8. Surrogate Recoveries Meet Criteria yes

If not met, list those compounds and their recoveries, which fall outside the acceptable range:

 - a. VOA Fraction _____
 - b. B/N Fraction NA
 - c. Acid Fraction NA

If not met, were the calculations checked and the results qualified as "estimated"? _____
9. Matrix Spike/Matrix Spike Duplicate Recoveries Meet Criteria yes

(If not met, list those compounds and their recoveries, which fall outside the acceptable range)

 - a. VOA Fraction _____
 - b. B/N Fraction NA
 - c. Acid Fraction NA

000010

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT (cont.)

Indicate
Yes, No, N/A

10. Internal Standard Area/Retention Time Shift Meet Criteria
(If not met, list those compounds, which fall outside the acceptable range)

yes

- a. VOA Fraction _____
b. B/N Fraction NA _____
c. Acid Fraction NA _____

11. Extraction Holding Time Met

yes

If not met, list the number of days exceeded for each sample: _____

12. Analysis Holding Time Met

yes

If not met, list the number of days exceeded for each sample: _____

Additional Comments: _____

Laboratory Manager: 

Date: 3-4-99

000011

PHC Conformance/Non-conformance Summary Report

Indicate
Yes, No, N/A

1. Method Detection Limits provided.
2. Method Blank Contamination – If yes, list the sample and the corresponding concentrations in each blank.

3. Matrix Spike Results Summary Meet Criteria
(If not met, list the sample and corresponding recovery which falls outside the acceptable range).

4. Duplicate Results Summary Meet Criteria
(If not met, list the sample and corresponding recovery which falls outside the acceptable range).

5. IR Spectra submitted for standards, blanks and samples.
6. Chromatograms submitted for standards, blanks and samples if GC fingerprinting was conducted.
7. Analysis holding time met.
(If not met, list number of days exceeded for each sample).

Yes

NO

Yes


Yes

NA

yes

yes

Additional comments: _____

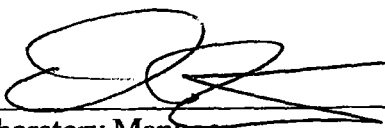

Laboratory Manager

3-4-99

Date

000012

TPHC

000037


Report of Analysis
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification # 13461

Client :	U.S. Army	Lab. ID # :	4283
	DPW. SELFM-PW-EV	Date Rec'd:	19-Feb-99
	Bldg. 173	Analysis Start:	19-Feb-99
	Ft. Monmouth, NJ 07703	Analysis Complete:	22-Feb-99
Analysis:	OQA-QAM-025	UST Reg. #:	
Matrix:	Soil	Closure #:	
Analyst:	D.DEINHARDT	DICAR #:	
Inst. ID.	GC TPHC INST. #1	Injection Volume	1 ul
Column Type	RTX 5	Column ID	0.32 um
Ext. Meth:	Shake	Location #:	Bldg. 2043

Sample	Field ID	Dilution Factor	Weight (g)	% Solid	MDL (mg/kg)	TPHC Result (mg/kg)
4283.01	2043-1(5')	1.00	15.10	82.94	188	ND
4283.02	2043-2(5')	1.00	14.96	82.15	191	ND
4283.03	2043-3(4')	1.00	15.76	65.27	228	2680.63
4283.04	2043-4(4')	1.00	15.20	70.18	220	ND
4283.05	2043-5(4')	1.00	15.14	79.17	196	ND
4283.06	2043-6(7')	1.00	15.18	69.69	222	ND
4283.07	2043-SP1	1.00	15.34	84.78	181	ND
METHOD BLANK	TBLK 219	1.00	15.00	100.00	157	ND

ND = Not Detected

MDL = Method Detection Limit


Daniel K. Wright
Laboratory Director

000038

VOLATILE ORGANIC

000013

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

Definition of Qualifiers

MDL : Method Detection Limit

J : Compound identified below detection limit

B : Compound in both sample and blank

D : Results from dilution of sample

U : Compound searched for but not detected

000013A

1A
VOLATILE ORGANICS ANALYSIS DATA SHEET

FIELD ID.

Vblk85

Lab Name: FMETL NJDEP # 13561

Project: 990078 Case No.: 4283 SDG No: Location: 2043

Matrix: (soil/water) SOIL Lab Sample ID: Vblk85

Sample wt/vol: 10.0 (g/ml) G Lab File ID: VB02782.D

Level: (low/med) MED Date Received: 2/19/99

% Moisture: not dec. 0 Date Analyzed: 2/25/99

GC Column: RTX-502 ID: 0.25 (mm) Dilution Factor: 1.0

Soil Extract Volume: 25000 (uL) Soil Aliquot Volume: 50 (uL)

CONCENTRATION UNITS:

CAS NO. COMPOUND (ug/L or ug/Kg) UG/KG Q

107028	Acrolein	1800	U
107131	Acrylonitrile	1800	U
75650	tert-Butyl alcohol	3200	U
1634044	Methyl-tert-Butyl ether	750	U
108203	Di-isopropyl ether	500	U
	Dichlorodifluoromethane	1000	U
74-87-3	Chloromethane	250	U
75-01-4	Vinyl Chloride	750	U
74-83-9	Bromomethane	500	U
75-00-3	Chloroethane	750	U
75-69-4	Trichlorofluoromethane	500	U
75-35-4	1,1-Dichloroethene	250	U
67-64-1	Acetone	500	U
75-15-0	Carbon Disulfide	250	U
75-09-2	Methylene Chloride	500	U
156-60-5	trans-1,2-Dichloroethene	500	U
75-35-3	1,1-Dichloroethane	250	U
108-05-4	Vinyl Acetate	750	U
78-93-3	2-Butanone	750	U
	cis-1,2-Dichloroethene	250	U
67-66-3	Chloroform	250	U
75-55-6	1,1,1-Trichloroethane	250	U
56-23-5	Carbon Tetrachloride	500	U
71-43-2	Benzene	250	U
107-06-2	1,2-Dichloroethane	500	U
79-01-6	Trichloroethene	250	U
78-87-5	1,2-Dichloropropane	250	U
75-27-4	Bromodichloromethane	250	U
110-75-8	2-Chloroethyl vinyl ether	500	U
10061-01-5	cis-1,3-Dichloropropene	250	U
108-10-1	4-Methyl-2-Pentanone	500	U
108-88-3	Toluene	250	U
10061-02-6	trans-1,3-Dichloropropene	500	U
79-00-5	1,1,2-Trichloroethane	500	U
127-18-4	Tetrachloroethene	250	U
591-78-6	2-Hexanone	500	U
126-48-1	Dibromochloromethane	500	U
108-90-7	Chlorobenzene	250	U

1A
VOLATILE ORGANICS ANALYSIS DATA SHEET

FIELD ID.

Vblk85

Lab Name: FMETL NJDEP # 13561
Project: 990078 Case No.: 4283 SDG No: Location: 2043
Matrix: (soil/water) SOIL Lab Sample ID: Vblk85
Sample wt/vol: 10.0 (g/ml) G Lab File ID: VB02782.D
Level: (low/med) MED Date Received: 2/19/99
% Moisture: not dec. 0 Date Analyzed: 2/25/99
GC Column: RTX-502 ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: 25000 (uL) Soil Aliquot Volume: 50 (uL)

CONCENTRATION UNITS:

CAS NO. COMPOUND (ug/L or ug/Kg) UG/KG Q

100-41-4	Ethylbenzene	500	U
1330-20-7	m+p-Xylenes	750	U
1330-20-7	o-Xylene	500	U
100-42-5	Styrene	500	U
75-25-2	Bromoform	500	U
79-34-5	1,1,2,2-Tetrachloroethane	500	U

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID.

Vblk85

Lab Name: FMETL NJDEP # 13561
Project: 990078 Case No.: 4283 SDG No: Location: 2043
Matrix: (soil/water) SOIL Lab Sample ID: Vblk85
Sample wt/vol: 10.0 (g/ml) G Lab File ID: VB02782.D
Level: (low/med) MED Date Received: 2/19/99
% Moisture: not dec. 0 Date Analyzed: 2/25/99
GC Column: RTX-502 ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: 25000 (uL) Soil Aliquot Volume: 50 (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/KGNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

1A
VOLATILE ORGANICS ANALYSIS DATA SHEET

FIELD ID.

2043-3(4')

Lab Name: FMETL NJDEP # 13561

Project: 990078 Case No.: 4283 SDG No: Location: 2043

Matrix: (soil/water) SOIL Lab Sample ID: 4283.03

Sample wt/vol: 10.5 (g/ml) G Lab File ID: VB02788.D

Level: (low/med) MED Date Received: 2/19/99

% Moisture: not dec. 34.73 Date Analyzed: 2/25/99

GC Column: RTX-502 ID: 0.25 (mm) Dilution Factor: 5.0

Soil Extract Volume: 25000 (uL) Soil Aliquot Volume: 50 (uL)

CONCENTRATION UNITS:

CAS NO. COMPOUND (ug/L or ug/Kg) UG/KG Q

107028	Acrolein	13000	U
107131	Acrylonitrile	13000	U
75650	tert-Butyl alcohol	24000	U
1634044	Methyl-tert-Butyl ether	5500	U
108203	Di-isopropyl ether	3700	U
	Dichlorodifluoromethane	7300	U
74-87-3	Chloromethane	1800	U
75-01-4	Vinyl Chloride	5500	U
74-83-9	Bromomethane	3700	U
75-00-3	Chloroethane	5500	U
75-69-4	Trichlorofluoromethane	3700	U
75-35-4	1,1-Dichloroethene	1800	U
67-64-1	Acetone	3700	U
75-15-0	Carbon Disulfide	1800	U
75-09-2	Methylene Chloride	3700	U
156-60-5	trans-1,2-Dichloroethene	3700	U
75-35-3	1,1-Dichloroethane	1800	U
108-05-4	Vinyl Acetate	5500	U
78-93-3	2-Butanone	5500	U
	cis-1,2-Dichloroethene	1800	U
67-66-3	Chloroform	1800	U
75-55-6	1,1,1-Trichloroethane	1800	U
56-23-5	Carbon Tetrachloride	3700	U
71-43-2	Benzene	1800	U
107-06-2	1,2-Dichloroethane	3700	U
79-01-6	Trichloroethene	1800	U
78-87-5	1,2-Dichloropropane	1800	U
75-27-4	Bromodichloromethane	1800	U
110-75-8	2-Chloroethyl vinyl ether	3700	U
10061-01-5	cis-1,3-Dichloropropene	1800	U
108-10-1	4-Methyl-2-Pentanone	3700	U
108-88-3	Toluene	1800	U
10061-02-6	trans-1,3-Dichloropropene	3700	U
79-00-5	1,1,2-Trichloroethane	3700	U
127-18-4	Tetrachloroethene	1800	U
591-78-6	2-Hexanone	3700	U
126-48-1	Dibromochloromethane	3700	U
108-90-7	Chlorobenzene	1800	U

1A

FIELD ID.

VOLATILE ORGANICS ANALYSIS DATA SHEET

2043-3(4')

Lab Name: FMETLNJDEP # 13561Project: 990078Case No.: 4283

SDG No: _____

Location: 2043Matrix: (soil/water) SOILLab Sample ID: 4283.03Sample wt/vol: 10.5 (g/ml) GLab File ID: VB02788.DLevel: (low/med) MEDDate Received: 2/19/99% Moisture: not dec. 34.73Date Analyzed: 2/25/99GC Column: RTX-502 ID: 0.25 (mm)Dilution Factor: 5.0Soil Extract Volume: 25000 (uL)Soil Aliquot Volume: 50 (uL)

CONCENTRATION UNITS:

CAS NO. COMPOUND (ug/L or ug/Kg) UG/KG Q

100-41-4	Ethylbenzene	3700	U
1330-20-7	m+p-Xylenes	5500	U
1330-20-7	o-Xylene	3700	U
100-42-5	Styrene	3700	U
75-25-2	Bromoform	3700	U
79-34-5	1,1,2,2-Tetrachloroethane	3700	U

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID.

2043-3(4')

Lab Name: FMETL NJDEP # 13561
Project: 990078 Case No.: 4283 SDG No: Location: 2043
Matrix: (soil/water) SOIL Lab Sample ID: 4283.03
Sample wt/vol: 10.5 (g/ml) G Lab File ID: VB02788.D
Level: (low/med) MED Date Received: 2/19/99
% Moisture: not dec. 34.73 Date Analyzed: 2/25/99
GC Column: RTX-502 ID: 0.25 (mm) Dilution Factor: 5.0
Soil Extract Volume: 25000 (uL) Soil Aliquot Volume: 50 (uL)

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/KG

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted ☒
2. Table of Contents submitted ☒
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted ☒
4. Document paginated and legible ☒
5. Chain of Custody submitted ☒
6. Samples submitted to lab within 48 hours of sample collection ☒
7. Methodology Summary submitted ☒
8. Laboratory Chronicle and Holding Time Check submitted ☒
9. Results submitted on a dry weight basis ☒
10. Method Detection Limits submitted ☒
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP ☒

Laboratory Manager or Environmental Consultant's Signature

Date 3/4/99

Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance.

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.

A handwritten signature in black ink, appearing to read "Daniel K. Wright", is written over a horizontal line. To the right of the signature, the number "3-4" is handwritten.

**Daniel K. Wright
Laboratory Manager**

000067

APPENDIX F

GROUNDWATER ANALYTICAL DATA PACKAGE

FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732) 532-6224 FAX: (732) 532-6263

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

CERTIFICATIONS: NJDEP #13461, NYSDOH #11699



ANALYTICAL DATA REPORT Fort Monmouth Environmental Laboratory ENVIRONMENTAL DIVISION Fort Monmouth, New Jersey PROJECT: UST Program

Bldg. 2043

Field Sample Location	Laboratory Sample ID#	Matrix	Date and Time of Collection	Date Received
Trip Blank	5169.01	Aqueous	15-Feb-00	02/15/00
Field Blank	5169.02	Aqueous	15-Feb-00 08:45	02/15/00
2043-1 6-11'	5169.03	Aqueous	15-Feb-00 09:15	02/15/00
Field Dup. 6-11'	5169.04	Aqueous	15-Feb-00	02/15/00

ANALYSIS:
FORT MONMOUTH ENVIRONMENTAL LAB
VOA+15, BN+15

ENCLOSURE:
CHAIN OF CUSTODY
RESULTS


Daniel Wright ~~Date~~ 5-8-00
Laboratory Director

Table of Contents

Section	Pages
Chain of Custody	1-2
Methodology Summary	3-4
Conformance/Non-Conformance Summary	5-7
Laboratory Chronicle	8-9
Volatile Organics	10-11
Analytical Results Summary	12-21
Tune Results Summary	22-25
Method Blank Results Summary	26
Calibration Summary	27-28
Surrogate Recovery Summary	29
MS/MSD Results Summary	30-31
Internal Standard Area & RT Summary	32
Chromatograms	33-66
Base Neutrals	67
Analytical Results Summary	68-79
Tune Results Summary	80-85
Method Blank Results Summary	86
Calibration Summary	87-92
Surrogate Recovery Summary	93-94
MS/MSD Results Summary	95-98
Internal Standard Area & RT Summary	99-102
Chromatograms	103-115
Laboratory Deliverables Checklist	116
Laboratory Authentication Statement	117

CHAIN OF CUSTODY

000001

METHODOLOGY SUMMARY

000003

Methodology Summary

EPA Method 624

Gas Chromatographic Determination of Volatiles in Water

Surrogates and internal standards are added to a 5-ml aliquot of sample. The sample is then purged and desorbed into a GC/MS system. The organic compounds are separated by the gas chromatograph and detected using the mass spectrometer. Volatiles are identified and quantitated.

EPA Method 3510/8270

Gas Chromatographic Determination of Semi-volatiles in Water

Surrogates are added to a measured volume of sample, usually 1 liter, at a specified pH. The sample is serially extracted with Methylene Chloride using a separatory funnel. The extract concentrated and internal standards are added. The sample is injected into a GC/MS system. Semi-volatiles are identified and quantitated.

LABORATORY CHRONICLE

000005

Laboratory Chronicle

Lab ID: 5169

Site: Bldg. 2043

	Date	Hold Time
Date Sampled	02/15/00	NA
Receipt/Refrigeration	02/15/00	NA
Extractions		
1. Base Neutral	02/16/00	14 days
Analyses		
1. Volatile Organics	2/16/00	14 days
2. Base Neutral	02/18/00	40 days

000006

CONFORMANCE NON-CONFORMANCE SUMMARY

000007

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT

Indicate
Yes, No, N/A

1. Chromatograms Labeled/Compounds Identified
(Field Samples and Method Blanks) yes
2. Retention times for chromatograms provided yes
3. GC/MS Tune Specifications
 - a. BFB Meet Criteria yes
 - b. DFTPP Meet Criteria yes
4. GC/MS Tuning Frequency - Performed every 24 hours for 600 series and 12 hours for 8000 series yes
5. GC/MS Calibration - Initial Calibration performed before sample analysis and continuing calibration performed within 24 hours of sample analysis for 600 series and 12 hours for 8000 series yes
6. GC/MS Calibration Requirements
 - a. Calibration Check Compounds Meet Criteria yes
 - b. System Performance Check Compounds Meet Criteria yes
7. Blank Contamination - If yes, List compounds and concentrations in each blank: no
 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA
8. Surrogate Recoveries Meet Criteria yes

If not met, list those compounds and their recoveries, which fall outside the acceptable range:

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA

If not met, were the calculations checked and the results qualified as "estimated"? _____
9. Matrix Spike/Matrix Spike Duplicate Recoveries Meet Criteria yes

(If not met, list those compounds and their recoveries, which fall outside the acceptable range)

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA

GC/MS Analysis Conformance/Non-Conformance Summary (cont.)

Indicate
Yes,
No,
N/A

10. Internal Standard Area/Retention Time Shift Meet Criteria
(If not met, list those compounds, which fall outside the acceptable range)

yes

- a. VOA Fraction _____
b. B/N Fraction _____
c. Acid Fraction N/A

11. Extraction Holding Time Met

yes

If not met, list number of days exceeded for each sample: _____

12. Analysis Holding Time Met

yes

If not met, list number of days exceeded for each sample: _____

Additional Comments:

Laboratory Manager :  Date: 5-8-00

VOLATILES ORGANICS

000010

**US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEP CERTIFICATION # 13461**

Definition of Qualifiers

MDL : Method Detection Limit
J : Compound Identified Below Detection Limit
B : Compound is in Both Sample and Blank
D : Results are from a Dilution of the Sample
U : Compound Searched for but not Detected
E : Compound Exceeds Calibration Limit

000011

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC002129.D**
 Operator **Skelton**
 Date Acquired **16 Feb 2000 1:34 pm**

Sample Name **Vblk58**
 Field ID **Vblk58**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75343	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156594	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Vblk58

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 5169 Location: 2043 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: Vblk58
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC002129.D
Level: (low/med) LOW Date Received: 2/15/00
% Moisture: not dec. _____ Date Analyzed: 2/16/00
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC002138.D**
 Operator **Skelton**
 Date Acquired **16 Feb 2000 8:33 pm**

Sample Name **5169.01**
 Field ID **Trip Blank**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75343	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156594	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform	16.22	108605	2.68 ug/L	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Trip Blank

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 5169 Location: 2043 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 5169.01
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC002138.D
Level: (low/med) LOW Date Received: 2/15/00
% Moisture: not dec. Date Analyzed: 2/16/00
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC002139.D**
 Operator **Skelton**
 Date Acquired **16 Feb 2000 9:14 pm**

Sample Name **5169.02**
 Field ID **Field Blank**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75343	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156594	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform	16.22	133590	3.24 ug/L	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Field Blank

Lab Name: FMETL NJDEP#: 13461

Project: 100004 Case No.: 5169 Location: 2043 SDG No.: _____

Matrix: (soil/water) WATER Lab Sample ID: 5169.02

Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC002139.D

Level: (low/med) LOW Date Received: 2/15/00

% Moisture: not dec. _____ Date Analyzed: 2/16/00

GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0

Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC002140.D**
 Operator **Skelton**
 Date Acquired **16 Feb 2000 9:55 pm**

Sample Name **5169.03**
 Field ID **2043-1**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75343	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156594	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform	16.23	68000	1.67 ug/L	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

2043-1

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 5169 Location: 2043 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 5169.03
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC002140.D
Level: (low/med) LOW Date Received: 2/15/00
% Moisture: not dec. Date Analyzed: 2/16/00
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC002141.D**
 Operator **Skelton**
 Date Acquired **16 Feb 2000 10:36 pm**

Sample Name **5169.04**
 Field ID **Field Dup**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75343	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156594	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform	16.22	68633	1.69 ug/L	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Field Dup

Lab Name: FMETL NJDEP#: 13461

Project: 100004 Case No.: 5169 Location: 2043 SDG No.: _____

Matrix: (soil/water) WATER Lab Sample ID: 5169.04

Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC002141.D

Level: (low/med) LOW Date Received: 2/15/00

% Moisture: not dec. _____ Date Analyzed: 2/16/00

GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0

Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

**VOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
BROMOFLUOROBENZENE (BFB)**

Lab Name: FMETL NJDEP#: 13461
 Project: 100004 Case No.: 5169 Location: 2043 SDG No.: _____
 Lab File ID: VC002070.D BFB Injection Date: 2/10/00
 Instrument ID: Voalnst#3 BFB Injection Time: 11:01
 GC Column: RTX502.2 ID: 0.25 (mm) Heated Purge: (Y/N) N

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
50	8.0 - 40.0% of mass 95	18.8
75	30.0 - 66.0% of mass 95	51.6
95	Base peak, 100% relative abundance	100.0
96	5.0 - 9.0% of mass 95	7.1
173	Less than 2.0% of mass 174	0.0 (0.0)1
174	50.0 - 120.0% of mass 95	64.3
175	4.0 - 9.0% of mass 174	4.3 (6.7)1
176	93.0 - 101.0% of mass 174	62.7 (97.6)1
177	5.0 - 9.0% of mass 176	3.6 (5.8)2

1-Value is % mass 174

2-Value is % mass 176

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	FIELD ID:	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	VSTD100	VSTD100	VC002071.D	2/10/00	11:33
02	VSTD050	VSTD050	VC002072.D	2/10/00	12:14
03	VSTD020	VSTD020	VC002073.D	2/10/00	12:55
04	VSTD010	VSTD010	VC002074.D	2/10/00	13:36
05	VSTD005	VSTD005	VC002075.D	2/10/00	14:17

Data File : C:\HPCHEM\1\DATA\000210\VC002070.D

Vial: 1

Acq On : 10 Feb 2000 11:01 am

Operator: Skelton

Sample : BFB Tune

Inst : GC/MS Ins



Misc : BFB Tune

Multiplr: 1.00

MS Integration Params: RTEINT.P

Method : C:\HPCHEM\1\METHODS\M362420.M (RTE Integrator)

Title : Volatile Organics by GC/MS Method 624/8260/TCLP

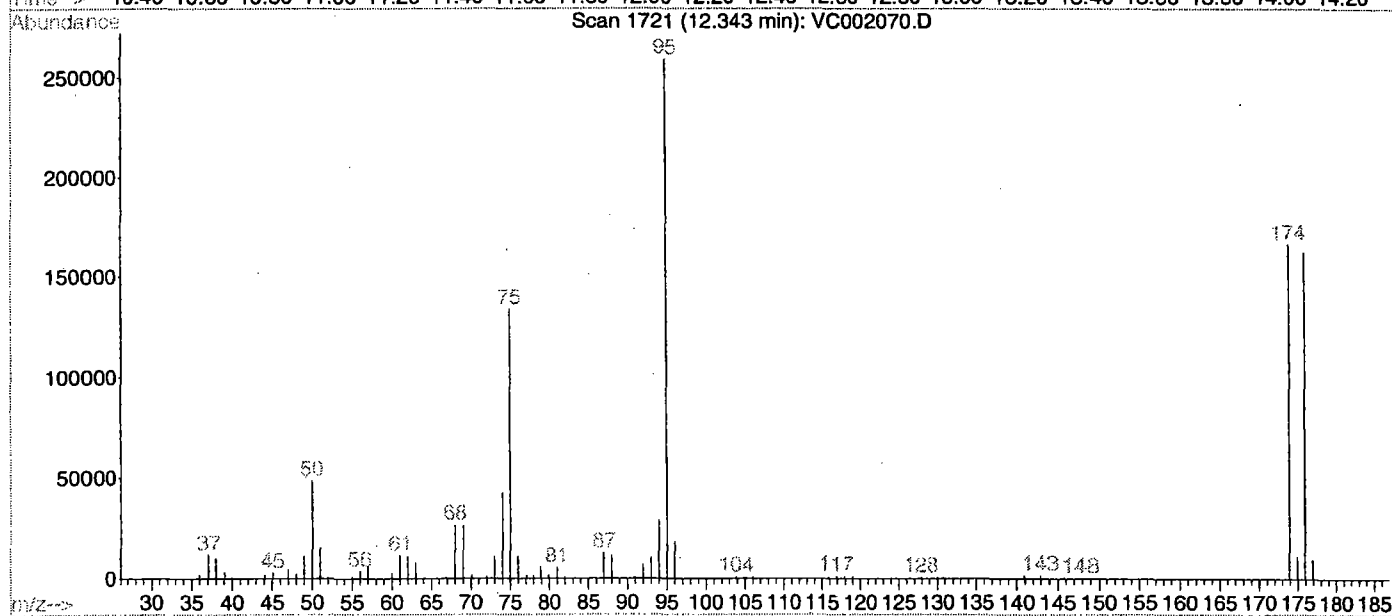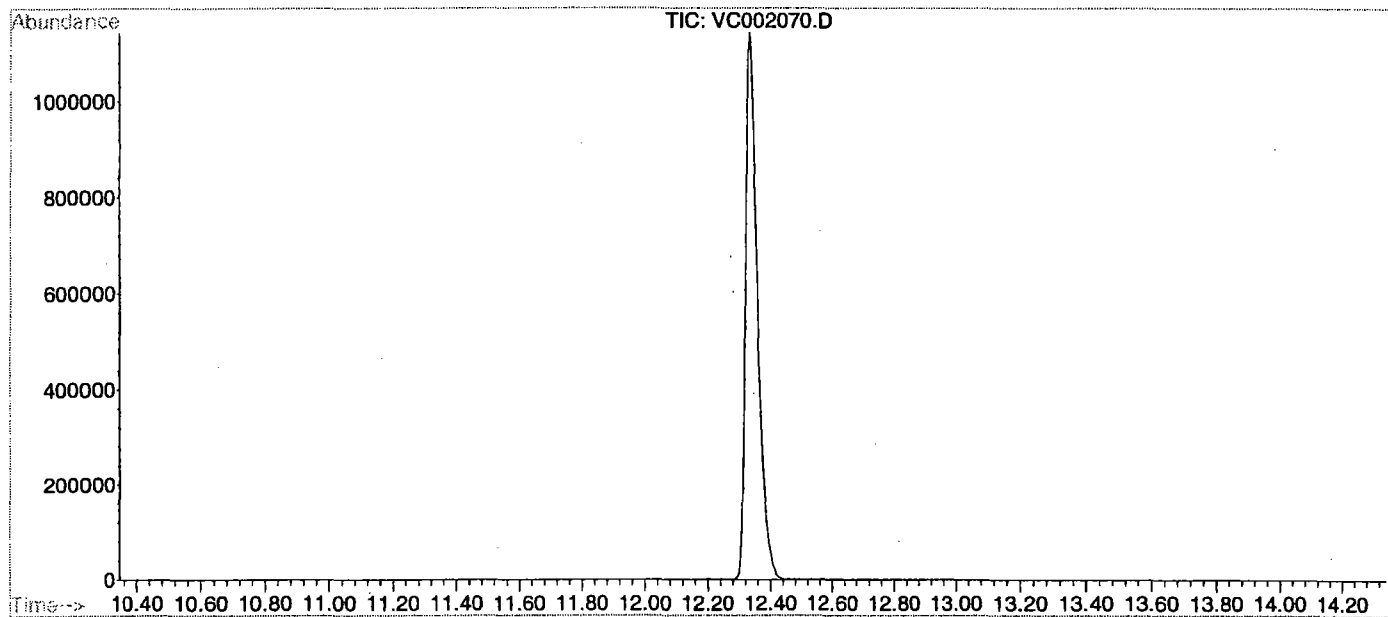

Spectrum Information: Scan 1721

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
50	95	15	40	18.8	48640	PASS
75	95	30	60	51.6	133888	PASS
95	95	100	100	100.0	259392	PASS
96	95	5	9	7.1	18288	PASS
173	174	0.00	2	0.0	0	PASS
174	95	50	100	64.3	166784	PASS
175	174	5	9	6.7	11241	PASS
176	174	95	101	97.6	162752	PASS
177	176	5	9	5.8	9451	PASS

BASE NEUTRAL

000067

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name BNA03627.D

Sample Name Sblk343

Operator Bhaskar

Misc Info Sblk343

Date Acquired 18-Feb-00

Sample Multiplier 1

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BNA03627.D**
 Operator **Bhaskar**
 Date Acquired **18-Feb-00**

Sample Name **Sblk343**
 Misc Info **Sblk343**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Sblk343

Lab Name: FMETL Lab Code 13461
Project 100004 Case No.: 5169 Location Bl.2043 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: Sblk343
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03627.D
Level: (low/med) LOW Date Received: 2/15/00
% Moisture: _____ decanted: (Y/N) N Date Extracted: 2/16/00
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 2/18/00
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 1 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
1. 000123-42-2	2-Pentanone, 4-hydroxy-4-methyl	7.07	5	JN

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name BN04197.D

Sample Name 5169.02

Operator Bhaskar

Misc Info Field Blank

Date Acquired 18-Feb-00

Sample Multiplier 1

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
39638-32-9	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.79 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BN04197.D**
 Operator **Bhaskar**
 Date Acquired **18-Feb-00**

Sample Name **5169.02**
 Misc Info **Field Blank**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

Page 2 of 2

000072

1F

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Field ID:

Field Blank

Lab Name: FMETL Lab Code 13461
Project: 100004 Case No.: 5169 Location: Bl.2043 SDG No: _____
Matrix: (soil/water) WATER Lab Sample ID: 5169.02
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BN04197.D
Level: (low/med) LOW Date Received: 2/15/00
% Moisture: _____ decanted: (Y/N) N Date Extracted: 2/16/00
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 2/18/00
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: _____

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name **BN04198.D**
Operator **Bhaskar**
Date Acquired **18-Feb-00**

Sample Name **5169.03**
Misc Info **2043-1**
Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
39638-32-9	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.79 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BN04198.D**
 Operator **Bhaskar**
 Date Acquired **18-Feb-00**

Sample Name **5169.03**
 Misc Info **2043-1**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benizidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

Page 2 of 2

000075

1F

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Field ID:

2043-1

Lab Name: FMETL Lab Code 13461
Project: 100004 Case No.: 5169 Location: Bl.2043 SDG No: _____
Matrix: (soil/water) WATER Lab Sample ID: 5169.03
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BN04198.D
Level: (low/med) LOW Date Received: 2/15/00
% Moisture: _____ decanted: (Y/N) N Date Extracted: 2/16/00
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 2/18/00
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: _____

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name **BN04199.D**
Operator **Bhaskar**
Date Acquired **18-Feb-00**

Sample Name **5169.04**
Misc Info **Field Dup.**
Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
39638-32-9	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.79 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BN04199.D**
 Operator **Bhaskar**
 Date Acquired **18-Feb-00**

Sample Name **5169.04**
 Misc Info **Field Dup.**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benizidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indenof[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

1F

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Field ID:

Field Dup.

Lab Name: FMETL Lab Code 13461
Project: 100004 Case No.: 5169 Location: Bl.2043 SDG No: _____
Matrix: (soil/water) WATER Lab Sample ID: 5169.04
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BN04199.D
Level: (low/med) LOW Date Received: 2/15/00
% Moisture: _____ decanted: (Y/N) N Date Extracted: 2/16/00
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 2/18/00
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: _____

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

5B

SEMIVOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
DECAFLUOROTRIPHENYLPHOSPHINE (DFTPP)

Lab Name: FMETL Lab Code 13461
 Project: 100004 Case No.: 5169 Location: Bl.2043 SDG No: _____
 Lab File ID: BN04190.D DFTPP Injection Date: 2/18/00
 Instrument ID: SVoa#1 DFTPP Injection Time: 8:31

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
51	30.0 - 80.0% of mass 198	52.0
68	Less than 2.0% of mass 69	0.0 (0.0)1
69	Mass 69 Relative abundance	65.1
70	Less than 2.0% of mass 69	0.2 (0.4)1
127	25.0 - 75.0% of mass 198	45.8
197	Less than 1.0% of mass 198	0.0
198	Base Peak, 100% relative abundance	100.0
199	5.0 to 9.0% of mass 198	6.4
275	10.0 - 30.0% of mass 198	15.3
365	Greater than 0.75% of mass 198	1.5
441	Present, but less than mass 443	6.6
442	40.0 - 110.0% of mass 198	41.8
443	15.0 - 24.0% of mass 442	8.2 (19.7)2

1-Value is % mass 69

2-Value is % mass 442

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	Field ID:	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	SSTD120	120 PPM CAL	BN04191.D	2/18/00	9:01
02	SSTD080	80 PPM CAL	BN04192.D	2/18/00	9:46
03	SSTD050	50 PPM CAL	BN04193.D	2/18/00	10:31
04	SSTD020	20 PPM CAL	BN04194.D	2/18/00	11:17
05	SSTD010	10 PPM CAL	BN04195.D	2/18/00	12:05
06	FIELD BLANK	5169.02	BN04197.D	2/18/00	14:39
07	2043-1	5169.03	BN04198.D	2/18/00	15:22
08	FIELD DUP.	5169.04	BN04199.D	2/18/00	16:04

Data File : C:\HPCHEM\1\DATA\000218\BN04190.D

Vial: 99

Acq On : 18 Feb 2000 8:31 am

Operator: Bhaskar

Sample : DFTPP TUNE

Inst : GC/MS Ins

Misc :


Multiplr: 1.00

MS Integration Params: RTEINT.P

GC Integration Params: rteint2.p

Method : C:\HPCHEM\1\METHODS\M62539.M (RTE Integrator)

Title : BNA Calibration

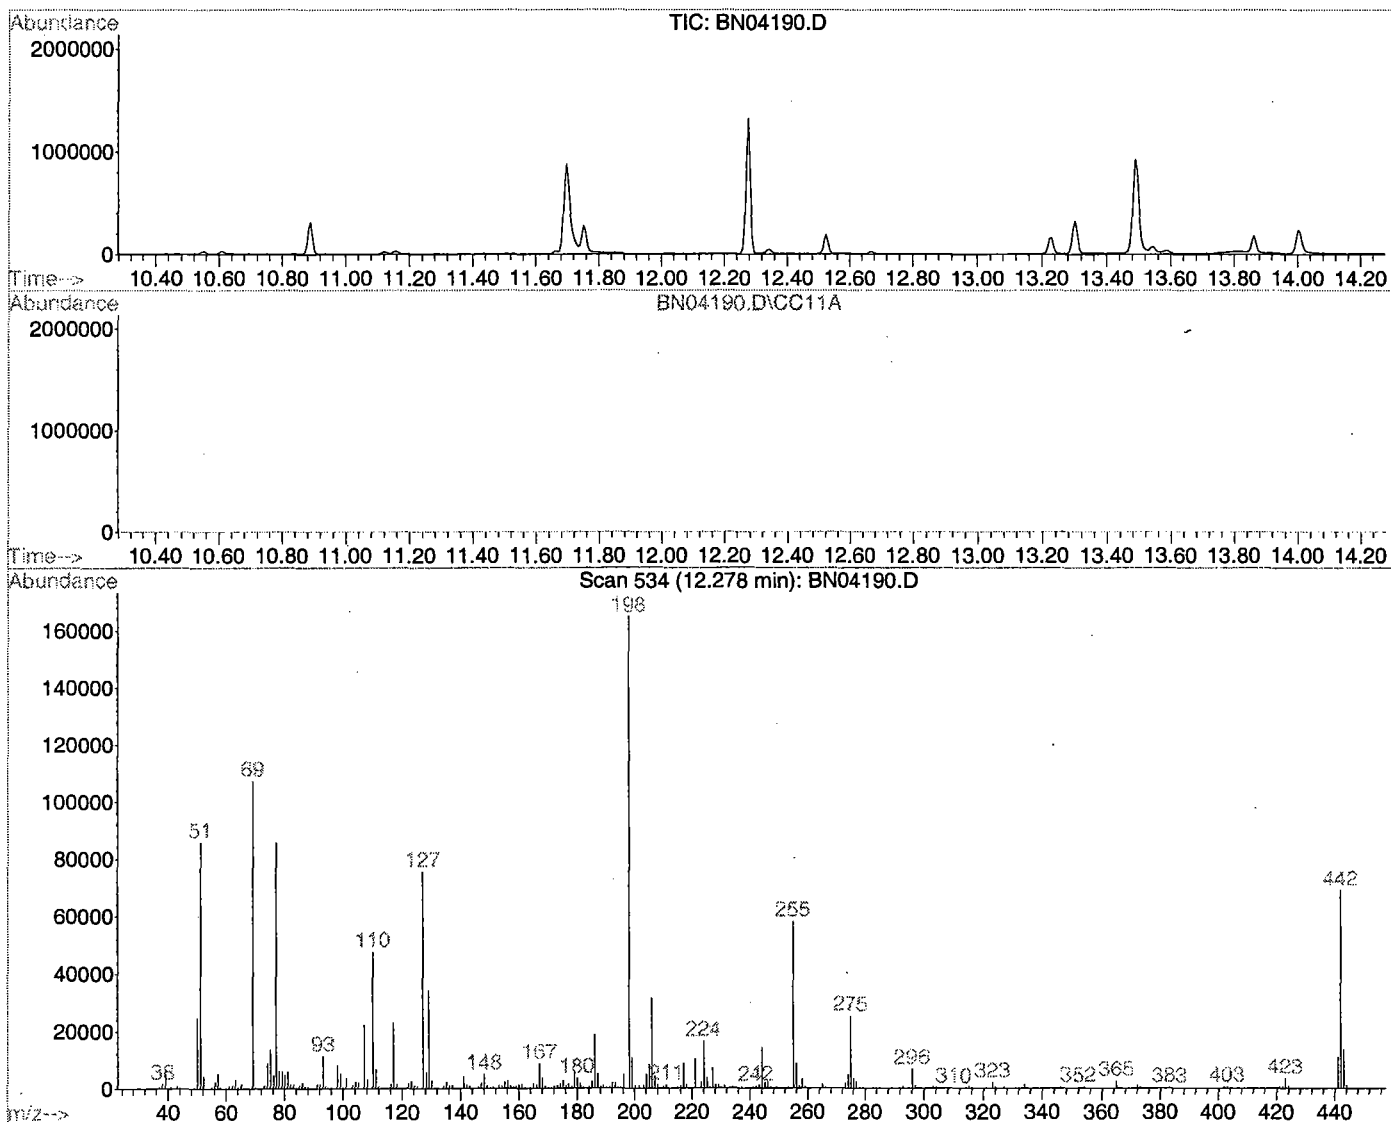

Spectrum Information: Scan 534

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
51	198	30	60	52.0	85792	PASS
68	69	0.00	2	0.0	0	PASS
69	198	0.00	100	65.1	107360	PASS
70	69	0.00	2	0.4	393	PASS
127	198	40	60	45.8	75576	PASS
197	198	0.00	1	0.0	0	PASS
198	198	100	100	100.0	164992	PASS
199	198	5	9	6.4	10630	PASS
275	198	10	30	15.3	25232	PASS
365	198	1	100	1.5	2506	PASS
441	443	1	99	80.4	10922	PASS
442	198	40	100	41.8	68976	PASS
443	442	17	23	19.7	13577	PASS

5B

**SEMIVOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
DECAFLUOROTRIPHENYLPHOSPHINE (DFTPP)**

Lab Name: FMETL Lab Code 13461
 Project 100004 Case No.: 5169 Location Bl.2043 SDG No.: _____
 Lab File ID: BNA03608.D DFTPP Injection Date: 2/8/00
 Instrument ID: BNA#2 DFTPP Injection Time: 9:39

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
51	30.0 - 80.0% of mass 198	55.2
68	Less than 2.0% of mass 69	0.0 (0.0)1
69	Mass 69 Relative abundance	50.0
70	Less than 2.0% of mass 69	0.3 (0.5)1
127	25.0 - 75.0% of mass 198	52.5
197	Less than 1.0% of mass 198	0.0
198	Base Peak, 100% relative abundance	100.0
199	5.0 to 9.0% of mass 198	7.0
275	10.0 - 30.0% of mass 198	20.5
365	Greater than 0.75% of mass 198	2.3
441	Present, but less than mass 443	11.5
442	40.0 - 110.0% of mass 198	78.7
443	15.0 - 24.0% of mass 442	14.7 (18.7)2

1-Value is % mass 69

2-Value is % mass 442

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	FIELD ID	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	SSTD120	120 PPM CAL	BNA03609.D	2/8/00	10:07
02	SSTD080	80 PPM CAL	BNA03610.D	2/8/00	10:55
03	SSTD050	50 PPM CAL	BNA03611.D	2/8/00	11:42
04	SSTD020	20 PPM CAL	BNA03612.D	2/8/00	12:28
05	SSTD010	10 PPM CAL	BNA03613.D	2/8/00	13:16

Data File : C:\HPCHEM\1\DATA\000208\BNA03608.D

Vial: 99

Acq On : 8 Feb 2000 9:39 am

Operator: Bhaskar

Sample : DFTPP TUNE

Inst : GC BNA 2



Misc : 50 NG/2UL

Multiplr: 1.00

MS Integration Params: RTEINT.P

Method : C:\HPCHEM\1\METHODS\M262537.M (RTE Integrator)

Title : BNA Calibration

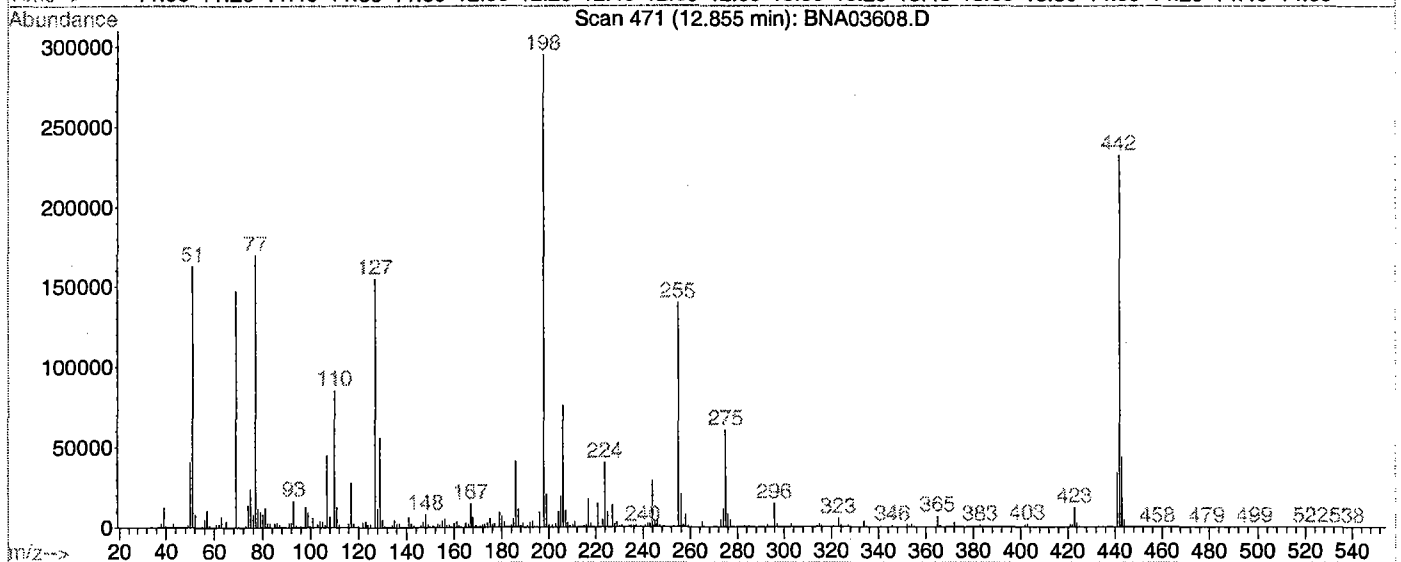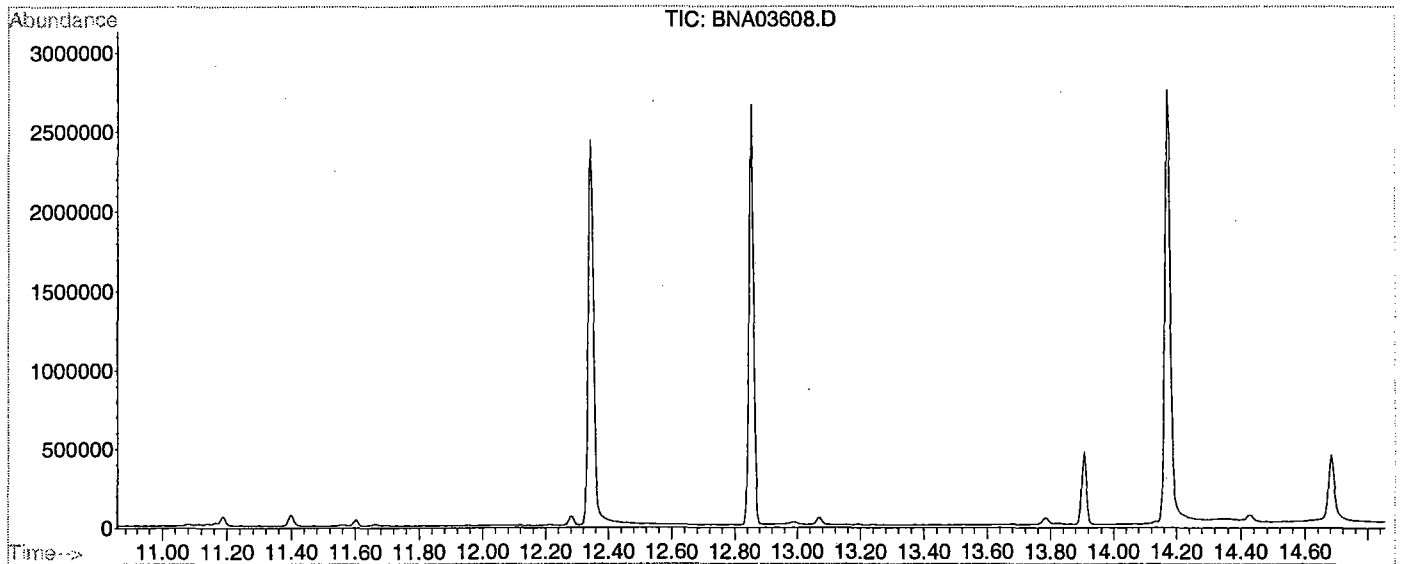

Spectrum Information: Scan 471

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
51	198	30	60	55.2	162816	PASS
68	69	0.00	2	0.0	0	PASS
69	198	0.00	100	50.0	147456	PASS
70	69	0.00	2	0.5	746	PASS
127	198	40	60	52.5	155008	PASS
197	198	0.00	1	0.0	0	PASS
198	198	100	100	100.0	295168	PASS
199	198	5	9	7.0	20808	PASS
275	198	10	30	20.5	60536	PASS
365	198	1	100	2.3	6786	PASS
441	443	1	99	78.0	33888	PASS
442	198	40	100	78.7	232384	PASS
443	442	17	23	18.7	43456	PASS

Quantitation Report

Data File : C:\HPCHEM\1\DATA\000218\BNA03645.D

Vial: 18

Acq On : 18 Feb 2000 11:42 pm

Operator: Bhaskar

Sample : 5175.04Dup

Inst : GC BNA 2

Misc : 0CW2MW30Dup

Multiplr: 1.00

MS Integration Params: RTEINT.P

GC Integration Params: rteint2.p

Quant Time: Feb 25 10:41 2000



Quant Results File: M262537.RES

Method : C:\HPCHEM\1\METHODS\M262537.M (RTE Integrator)

Title : BNA Calibration

Last Update : Tue Feb 08 14:16:08 2000

Response via : Initial Calibration

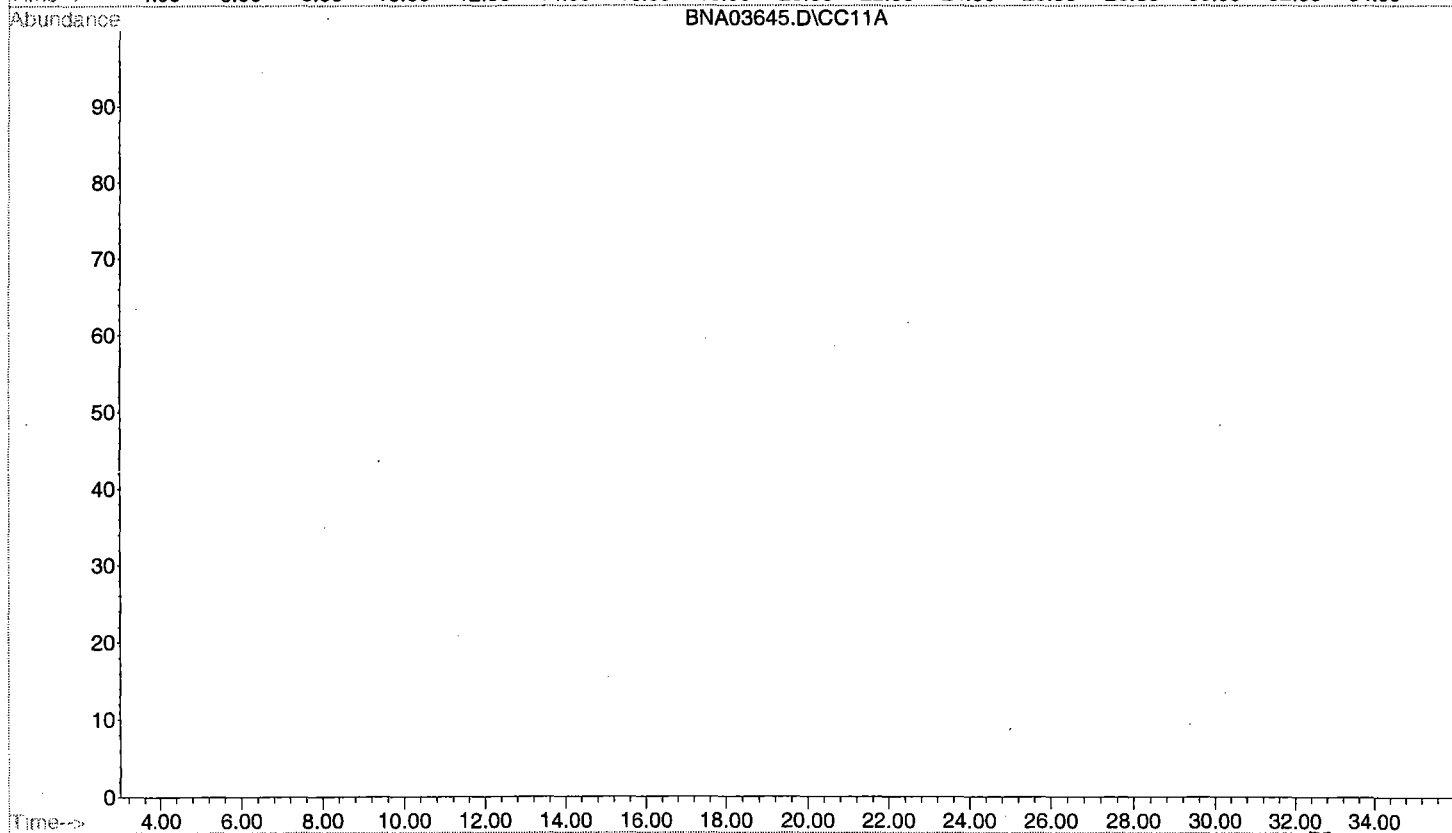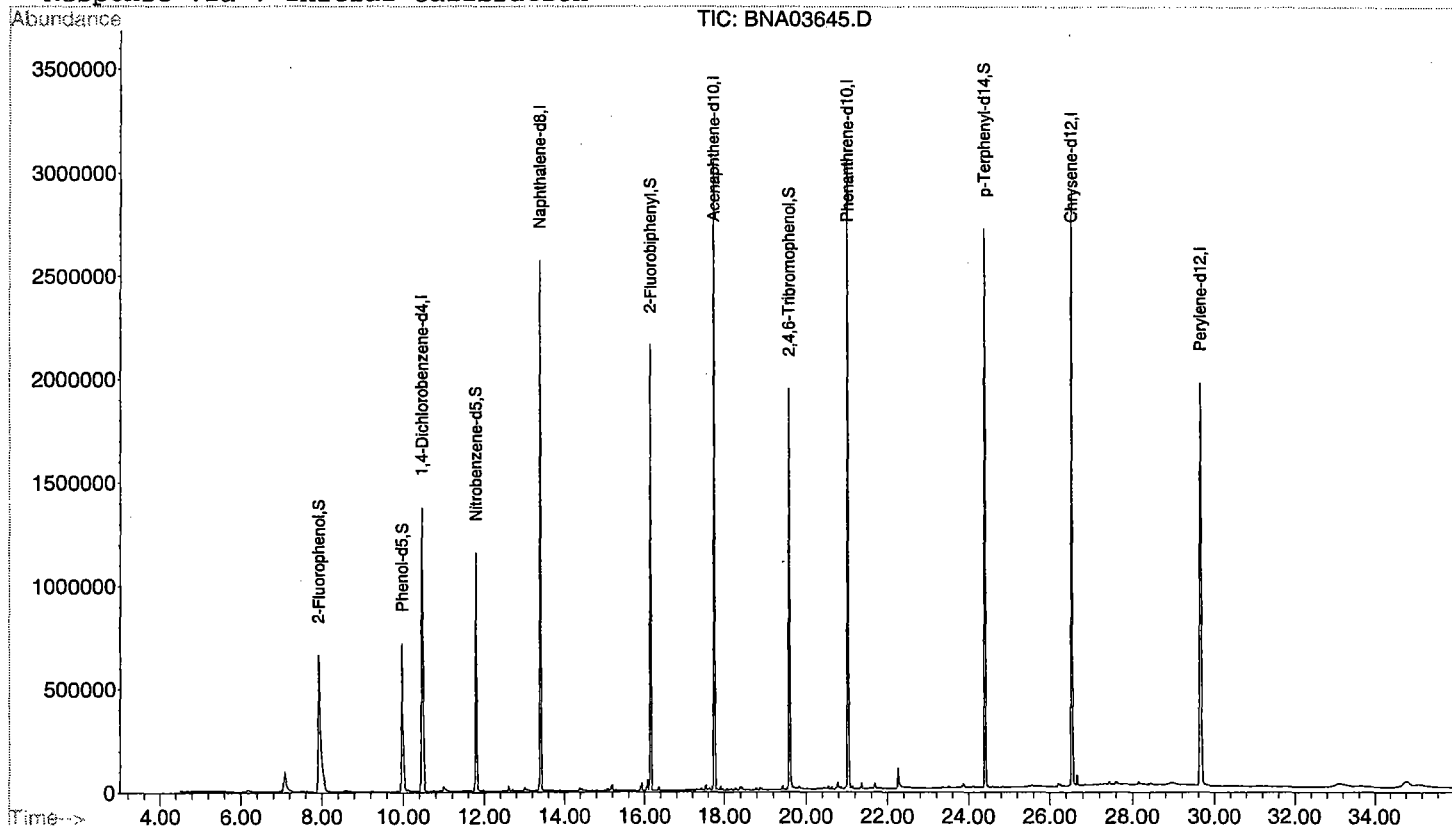

BNA03645.D M262537.M

Fri Feb 25 10:42:06 2000

000115

Page 2

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

- | | |
|--|-------------------------------------|
| 1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted | ☒ |
| 2. Table of Contents submitted | ☒ |
| 3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted | ☒ |
| 4. Document paginated and legible | ☒ |
| 5. Chain of Custody submitted | ☒ |
| 6. Samples submitted to lab within 48 hours of sample collection | ☒ |
| 7. Methodology Summary submitted | ☒ |
| 8. Laboratory Chronicle and Holding Time Check submitted | ☒ |
| 9. Results submitted on a dry weight basis | ☒ |
| 10. Method Detection Limits submitted | ☒ |
| 11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP | ☒ |

Laboratory Manager or Environmental Consultant's Signature _____
Date 5/6/00


Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance.

000116

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.



Daniel K. Wright
Laboratory Manager

000117

FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732) 532-6224 FAX: (732) 532-6263

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

CERTIFICATIONS: NJDEP #13461, NYSDOH #11699



ANALYTICAL DATA REPORT Fort Monmouth Environmental Laboratory ENVIRONMENTAL DIVISION Fort Monmouth, New Jersey PROJECT: UST Program

Bldg. 2043

Field Sample Location	Laboratory Sample ID#	Matrix	Date and Time of Collection	Date Received
Trip Blank	5259.01	Aqueous	18-Mar-00	03/20/00
Field Blank	5259.02	Aqueous	18-Mar-00 08:30	03/20/00
2043-1 6-11'	5259.03	Aqueous	18-Mar-00 09:00	03/20/00
Field Dup. 6-11'	5259.04	Aqueous	18-Mar-00	03/20/00

ANALYSIS:
FORT MONMOUTH ENVIRONMENTAL LAB
VOA+15, BN+15

ENCLOSURE:
CHAIN OF CUSTODY
RESULTS



Daniel Wright/Date
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Chain of Custody	1-2
Methodology Summary	3-4
Conformance/Non-Conformance Summary	5-7
Laboratory Chronicle	8-9
Volatile Organics	10-11
Analytical Results Summary	12-21
Tune Results Summary	22-25
Method Blank Results Summary	26-27
Calibration Summary	28
Surrogate Recovery Summary	29
MS/MSD Results Summary	30-31
Internal Standard Area & RT Summary	32-33
Chromatograms	85-94
Base Neutrals	34
Analytical Results Summary	35-46
Tune Results Summary	47-52
Method Blank Results Summary	53
Calibration Summary	54-57
Surrogate Recovery Summary	58
MS/MSD Results Summary	59-62
Internal Standard Area & RT Summary	63-66
Chromatograms	67-82
Laboratory Deliverables Checklist	83
Laboratory Authentication Statement	84

CHAIN OF CUSTODY

000001



Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

NJDEP Certification #13461

[illegible]

METHODOLOGY SUMMARY

000003

Methodology Summary

EPA Method 624

Gas Chromatographic Determination of Volatiles in Water

Surrogates and internal standards are added to a 5-ml aliquot of sample. The sample is then purged and desorbed into a GC/MS system. The organic compounds are separated by the gas chromatograph and detected using the mass spectrometer. Volatiles are identified and quantitated.

EPA Method 3510/8270

Gas Chromatographic Determination of Semi-volatiles in Water

Surrogates are added to a measured volume of sample, usually 1 liter, at a specified pH. The sample is serially extracted with Methylene Chloride using a separatory funnel. The extract concentrated and internal standards are added. The sample is injected into a GC/MS system. Semi-volatiles are identified and quantitated.

LABORATORY CHRONICLE

000003

Laboratory Chronicle

Lab ID: 5259

Site: Bldg. 2043

	Date	Hold Time
Date Sampled	03/18/00	NA
Receipt/Refrigeration	03/18,20/00*	NA

Extractions

1. Base Neutrals	03/23/00	7 Days
------------------	----------	--------

Analyses

1. Volatile Organics	03/27/00	14 Days
2. Base Neutrals	03/24/00	40 DDays

* Samples taken on Saturday 03/18/00, and refrigerated.
Received by laboratory on Monday 03/20/00.

000006

CONFORMANCE NON-CONFORMANCE SUMMARY

000007

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT

Indicate
Yes, No, N/A

- | | |
|---|----------|
| 1. Chromatograms Labeled/Compounds Identified
(Field Samples and Method Blanks) | <u>Y</u> |
| 2. Retention times for chromatograms provided | <u>Y</u> |
| 3. GC/MS Tune Specifications | |
| a. BFB Meet Criteria | <u>Y</u> |
| b. DFTPP Meet Criteria | <u>Y</u> |
| 4. GC/MS Tuning Frequency - Performed every 24 hours for 600 series and 12 hours for 8000 series | <u>Y</u> |
| 5. GC/MS Calibration - Initial Calibration performed before sample analysis and continuing calibration performed within 24 hours of sample analysis for 600 series and 12 hours for 8000 series | <u>Y</u> |
| 6. GC/MS Calibration Requirements | |
| a. Calibration Check Compounds Meet Criteria | <u>Y</u> |
| b. System Performance Check Compounds Meet Criteria | <u>Y</u> |
| 7. Blank Contamination - If yes, List compounds and concentrations in each blank: | <u>N</u> |
| a. VOA Fraction _____ | |
| b. B/N Fraction _____ | |
| c. Acid Fraction _____ | |
| 8. Surrogate Recoveries Meet Criteria | <u>Y</u> |
| If not met, list those compounds and their recoveries, which fall outside the acceptable range: | |
| a. VOA Fraction _____ | |
| b. B/N Fraction _____ | |
| c. Acid Fraction _____ | |
| If not met, were the calculations checked and the results qualified as "estimated"? | |
| 9. Matrix Spike/Matrix Spike Duplicate Recoveries Meet Criteria
(If not met, list those compounds and their recoveries, which fall outside the acceptable range) | <u>Y</u> |
| a. VOA Fraction _____ | |
| b. B/N Fraction _____ | |
| c. Acid Fraction _____ | |

GC/MS Analysis Conformance/Non-Conformance Summary (cont.)

Indicate
Yes,
No,
N/A

10. Internal Standard Area/Retention Time Shift Meet Criteria
(If not met, list those compounds, which fall outside the acceptable range)

a. VOA Fraction _____
b. B/N Fraction _____
c. Acid Fraction _____

Y

11. Extraction Holding Time Met

If not met, list number of days exceeded for each sample: _____

Y


12. Analysis Holding Time Met

If not met, list number of days exceeded for each sample: _____

Y

Additional Comments:

Laboratory Manager

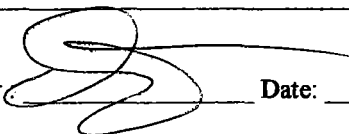

Date: 4-25-00

VOLATILES ORGANICS

000010

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEP CERTIFICATION # 13461

Definition of Qualifiers

MDL : Method Detection Limit
J : Compound Identified Below Detection Limit
B : Compound is in Both Sample and Blank
D : Results are from a Dilution of the Sample
U : Compound Searched for but not Detected
E : Compound Exceeds Calibration Limit

000011

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VB006406.D**
 Operator **Skelton**
 Date Acquired **27 Mar 2000 12:17 pm**

Sample Name **Vblk194**
 Field ID **Vblk194**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-34-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
156-59-4	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

Vblk194

Lab Name: FMETL Project: UST
NJDEP#: 13461 Case No.: 5259 Location: 2043 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: Vblk194
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB006406.D
Level: (low/med) LOW Date Received: 3/20/00
% Moisture: not dec. Date Analyzed: 3/27/00
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VB006410.D**
 Operator **Skelton**
 Date Acquired **27 Mar 2000 3:18 pm**

Sample Name **5259.01**
 Field ID **Trip Blank**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-34-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
156-59-4	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

Trip Blank

Lab Name: FMETL Project: UST
NJDEP#: 13461 Case No.: 5259 Location: 2043 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 5259.01
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB006410.D
Level: (low/med) LOW Date Received: 3/20/00
% Moisture: not dec. Date Analyzed: 3/27/00
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VB006411.D**
 Operator **Skelton**
 Date Acquired **27 Mar 2000 3:59 pm**

Sample Name **5259.02**
 Field ID **Field Blank**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride	11.45	218235	7.80 ug/L	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-34-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
156-59-4	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6.2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

Field Blank

Lab Name: FMETL Project: UST
NJDEP#: 13461 Case No.: 5259 Location: 2043 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 5259.02
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB006411.D
Level: (low/med) LOW Date Received: 3/20/00
% Moisture: not dec. Date Analyzed: 3/27/00
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VB006412.D**
 Operator **Skelton**
 Date Acquired **27 Mar 2000 4:39 pm**

Sample Name **5259.03**
 Field ID **2043-1**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-34-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
156-59-4	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

2043-1

Lab Name: FMETL Project: UST
NJDEP#: 13461 Case No.: 5259 Location: 2043 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 5259.03
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB006412.D
Level: (low/med) LOW Date Received: 3/20/00
% Moisture: not dec. Date Analyzed: 3/27/00
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VB006413.D**
 Operator **Skelton**
 Date Acquired **27 Mar 2000 5:19 pm**

Sample Name **5259.04**
 Field ID **Field Dup**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-34-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
156-59-4	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

Field Dup

Lab Name: FMETL Project: UST
NJDEP#: 13461 Case No.: 5259 Location: 2043 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 5259.04
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB006413.D
Level: (low/med) LOW Date Received: 3/20/00
% Moisture: not dec. Date Analyzed: 3/27/00
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: (uL) Soil Aliquot Volume: (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/LNumber TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

BASE NEUTRAL

000034

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name BNA03761.D

Sample Name Sblk357

Operator Bhaskar

Misc Info Sblk357

Date Acquired 24-Mar-00

Sample Multiplier 1

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BNA03761.D**
 Operator **Bhaskar**
 Date Acquired **24-Mar-00**

Sample Name **Sblk357**
 Misc Info **Sblk357**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Sblk357

Lab Name: FMETL Lab Code 13461
Project 100004 Case No.: 5259 Location Bl.2043 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: Sblk357
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03761.D
Level: (low/med) LOW Date Received: 3/20/00
% Moisture: decanted: (Y/N) N Date Extracted: 3/23/00
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 3/24/00
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 1 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
1.	unknown	7.03	5	J

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name BNA03763.D

Sample Name 5259.02

Operator Bhaskar

Misc Info Field Blank

Date Acquired 24-Mar-00

Sample Multiplier 1

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BNA03763.D**
 Operator **Bhaskar**
 Date Acquired **24-Mar-00**

Sample Name **5259.02**
 Misc Info **Field Blank**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate	26.60	435549	11.77 ug/L	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

1F

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Field Blank

Lab Name: FMETL Lab Code 13461
Project 100004 Case No.: 5259 Location Bl.2043 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 5259.02
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03763.D
Level: (low/med) LOW Date Received: 3/20/00
% Moisture: decanted: (Y/N) N Date Extracted: 3/23/00
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 3/24/00
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 1 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
1.	unknown	7.03	4	J

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name BNA03764.D

Sample Name 5259.03

Operator Bhaskar

Misc Info 2043-1

Date Acquired 24-Mar-00

Sample Multiplier 1

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BNA03764.D**
 Operator **Bhaskar**
 Date Acquired **24-Mar-00**

Sample Name **5259.03**
 Misc Info **2043-1**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

2043-1

Lab Name: FMETL Lab Code 13461
Project 100004 Case No.: 5259 Location Bl.2043 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 5259.03
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03764.D
Level: (low/med) LOW Date Received: 3/20/00
% Moisture: _____ decanted: (Y/N) N Date Extracted: 3/23/00
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 3/24/00
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 1 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
1.	unknown	7.03	4	J

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name BNA03765.D

Sample Name 5259.04

Operator Bhaskar

Misc Info Field Dup

Date Acquired 24-Mar-00

Sample Multiplier 1

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BNA03765.D**
 Operator **Bhaskar**
 Date Acquired **24-Mar-00**

Sample Name **5259.04**
 Misc Info **Field Dup**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

Page 2 of 2

000045

1F

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Field Dup

Lab Name: FMETL Lab Code 13461
Project 100004 Case No.: 5259 Location Bl.2043 SDG No.:
Matrix: (soil/water) WATER Lab Sample ID: 5259.04
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03765.D
Level: (low/med) LOW Date Received: 3/20/00
% Moisture: decanted: (Y/N) N Date Extracted: 3/23/00
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 3/24/00
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 1 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
1.	unknown	7.03	4	J

5B

**SEMIVOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
DECAFLUOROTRIPHENYLPHOSPHINE (DFTPP)**

Lab Name: FMETL Lab Code 13461
 Project 100004 Case No.: 5259 Location Bl.2043 SDG No.: _____
 Lab File ID: BNA03649.D DFTPP Injection Date: 2/29/00
 Instrument ID: BNA#2 DFTPP Injection Time: 8:54

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
51	30.0 - 80.0% of mass 198	49.9
68	Less than 2.0% of mass 69	0.0 (0.0)1
69	Mass 69 Relative abundance	43.9
70	Less than 2.0% of mass 69	0.3 (0.6)1
127	25.0 - 75.0% of mass 198	48.6
197	Less than 1.0% of mass 198	0.0
198	Base Peak, 100% relative abundance	100.0
199	5.0 to 9.0% of mass 198	6.4
275	10.0 - 30.0% of mass 198	22.5
365	Greater than 0.75% of mass 198	2.8
441	Present, but less than mass 443	13.6
442	40.0 - 110.0% of mass 198	91.5
443	15.0 - 24.0% of mass 442	17.5 (19.1)2

1-Value is % mass 69

2-Value is % mass 442

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	FIELD ID	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	SSTD120	SSTD120	BNA03650.D	2/29/00	9:23
02	SSTD080	SSTD080	BNA03651.D	2/29/00	10:13
03	SSTD050	SSTD050	BNA03652.D	2/29/00	11:04
04	SSTD020	SSTD020	BNA03653.D	2/29/00	11:53
05	SSTD010	SSTD010	BNA03654.D	2/29/00	12:40

Data File : C:\HPCHEM\1\DATA\000229\BNA03649.D

Vial: 99

Acq On : 29 Feb 2000 8:54 am

Operator: Bhaskar

Sample : DFTPP TUNE

Inst : GC BNA 2



Misc : 50 NG/2UL

Multiplr: 1.00

MS Integration Params: RTEINT.P

Method : C:\HPCHEM\1\METHODS\M262538.M (RTE Integrator)

Title : BNA Calibration

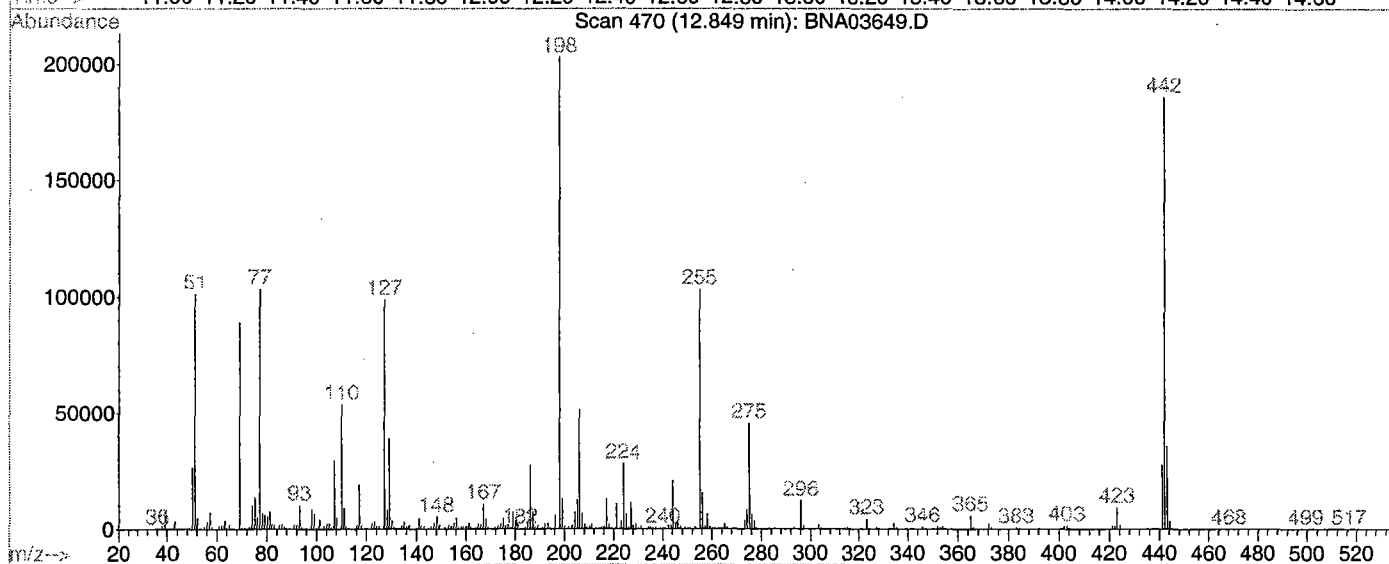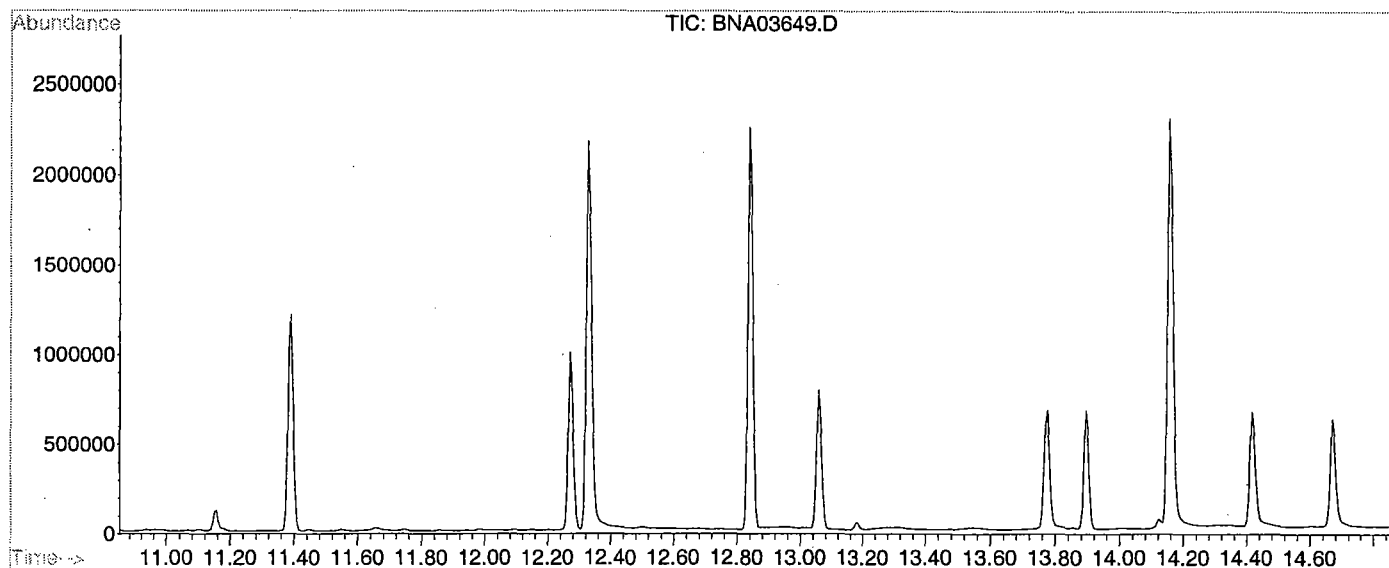

Spectrum Information: Scan 470

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
51	198	30	60	49.9	101312	PASS
68	69	0.00	2	0.0	0	PASS
69	198	0.00	100	43.9	89144	PASS
70	69	0.00	2	0.6	567	PASS
127	198	40	60	48.6	98688	PASS
197	198	0.00	1	0.0	0	PASS
198	198	100	100	100.0	203136	PASS
199	198	5	9	6.4	12977	PASS
275	198	10	30	22.5	45712	PASS
365	198	1	100	2.8	5680	PASS
441	443	1	99	77.8	27624	PASS
442	198	40	100	91.5	185856	PASS
443	442	17	23	19.1	35520	PASS

5B

**SEMIVOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
DECAFLUOROTRIPHENYLPHOSPHINE (DFTPP)**

Lab Name: FMETL Lab Code 13461
 Project 100004 Case No.: 5259 Location BI.2043 SDG No.:
 Lab File ID: BNA03721.D DFTPP Injection Date: 3/23/00
 Instrument ID: BNA#2 DFTPP Injection Time: 8:06

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
51	30.0 - 80.0% of mass 198	54.4
68	Less than 2.0% of mass 69	0.0 (0.0)1
69	Mass 69 Relative abundance	49.4
70	Less than 2.0% of mass 69	0.4 (0.7)1
127	25.0 - 75.0% of mass 198	52.4
197	Less than 1.0% of mass 198	0.0
198	Base Peak, 100% relative abundance	100.0
199	5.0 to 9.0% of mass 198	6.8
275	10.0 - 30.0% of mass 198	22.5
365	Greater than 0.75% of mass 198	2.8
441	Present, but less than mass 443	13.0
442	40.0 - 110.0% of mass 198	88.1
443	15.0 - 24.0% of mass 442	17.1 (19.4)2

1-Value is % mass 69

2-Value is % mass 442

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	FIELD ID	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	SSTD050	DAILY CAL	BNA03722.D	3/23/00	8:33
02	5244.09MS	5244.09MS	BNA03733.D	3/23/00	17:31
03	5244.09DUP	5244.09DUP	BNA03734.D	3/23/00	18:19

Data File : C:\HPCHEM\1\DATA\000323\BNA03721.D

Vial: 99

Acq On : 23 Mar 2000 8:06 am

Operator: Bhaskar

Sample : DFTPP TUNE

Inst : GC BNA 2



Misc : 50 NG/2UL

Multiplr: 1.00

MS Integration Params: RTEINT.P

Method : C:\HPCHEM\1\METHODS\M262538.M (RTE Integrator)

Title : BNA Calibration

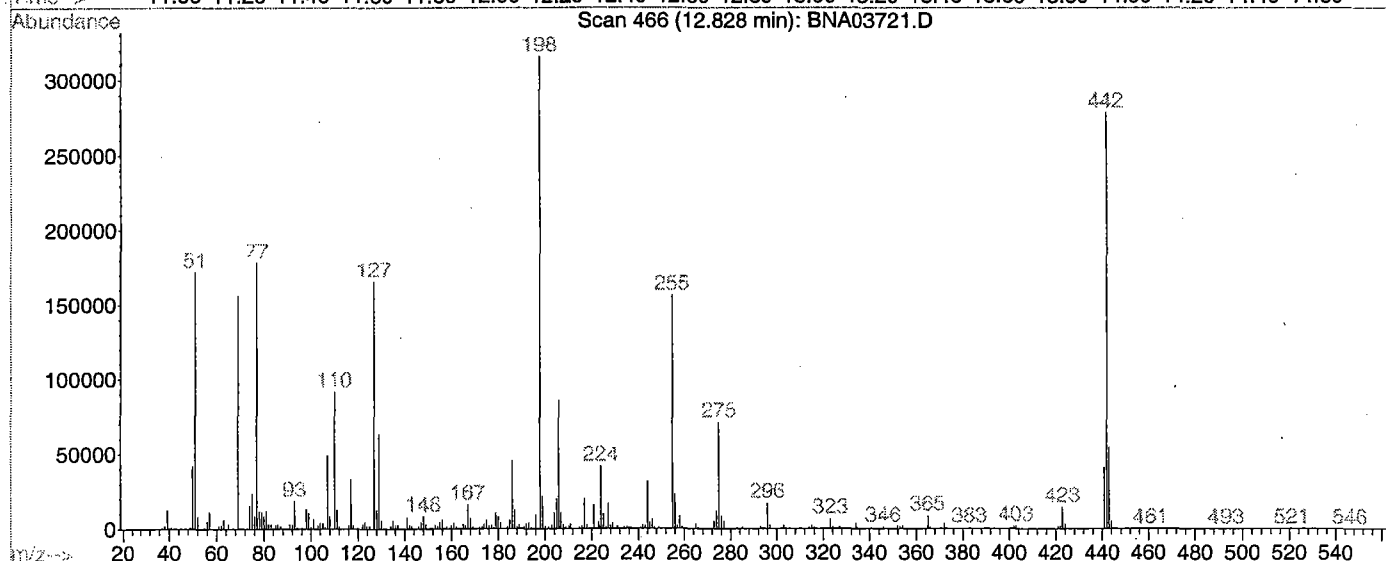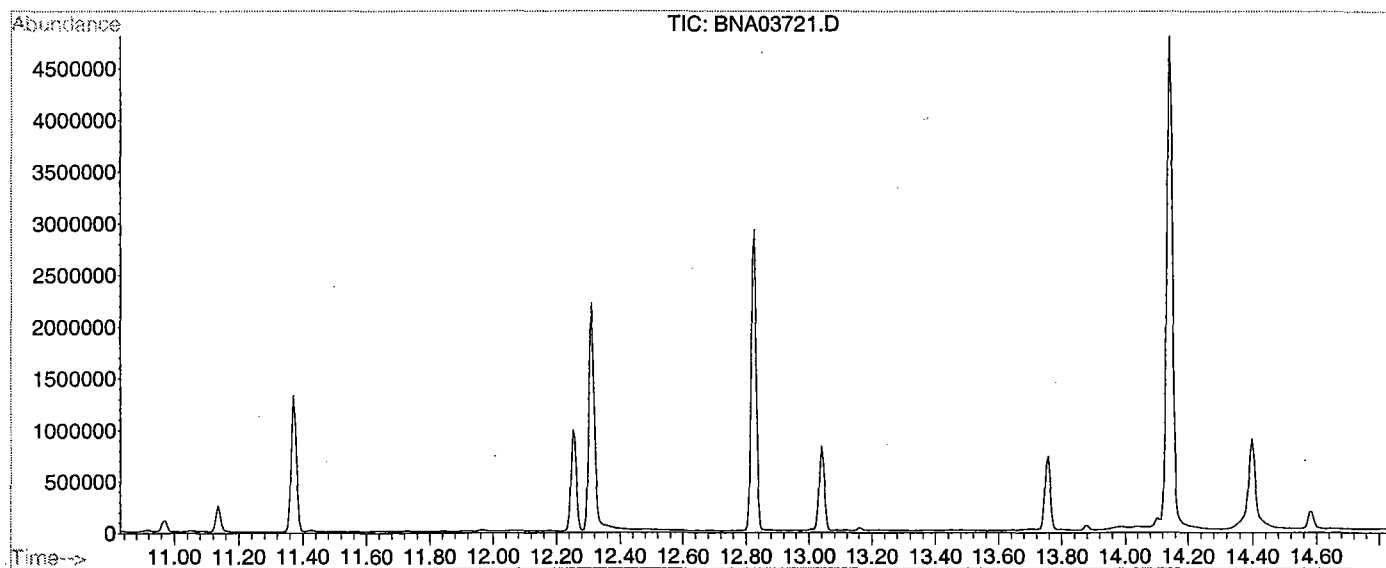

Spectrum Information: Scan 466

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
51	198	30	60	54.4	171904	PASS
68	69	0.00	2	0.0	0	PASS
69	198	0.00	100	49.4	156224	PASS
70	69	0.00	2	0.7	1158	PASS
127	198	40	60	52.4	165504	PASS
197	198	0.00	1	0.0	0	PASS
198	198	100	100	100.0	316096	PASS
199	198	5	9	6.8	21496	PASS
275	198	10	30	22.5	71024	PASS
365	198	1	100	2.8	8828	PASS
441	443	1	99	75.9	41040	PASS
442	198	40	100	88.1	278400	PASS
443	442	17	23	19.4	54096	PASS

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT
AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted
2. Table of Contents submitted
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted
4. Document paginated and legible
5. Chain of Custody submitted
6. Samples submitted to lab within 48 hours of sample collection
7. Methodology Summary submitted
8. Laboratory Chronicle and Holding Time Check submitted
9. Results submitted on a dry weight basis
10. Method Detection Limits submitted
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP

✓

✓

✓

✓

✓

✓

✓

✓

JA ✓

✓

✓

Laboratory Manager or Environmental Consultant's Signature

Date 8/25/92

Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP
Methods for further guidance.

000083

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.



Daniel K. Wright
Laboratory Manager

000084

7 8

6. 10

7 15

Le 20

7 38

6. 10

15

6. 10

633

6-11

1

1


•

1

L

APPENDIX G

PHOTOGRAPHS

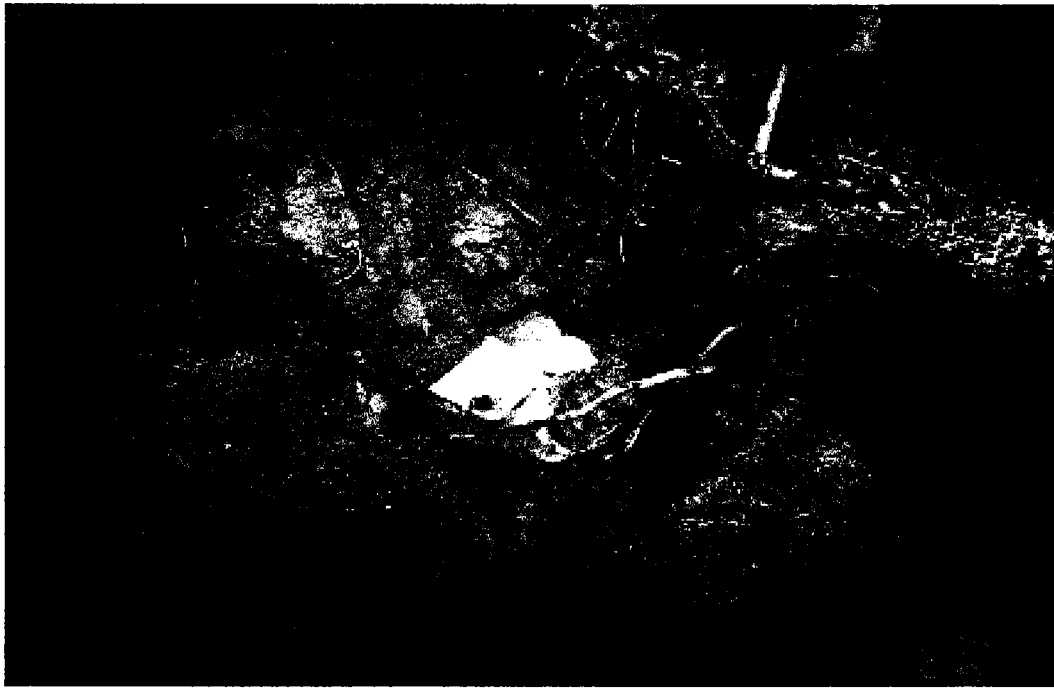


APRIL 10, 1998
PHOTOGRAPHIC LOG
UST NO. 192486-36

Building 2043
Charles Wood
Fort Monmouth

VERSAR
Engineers, Managers, Scientists & Planners
Bristol, PA

APPENDIX H

ELECTRONIC DATA DELIVERABLES

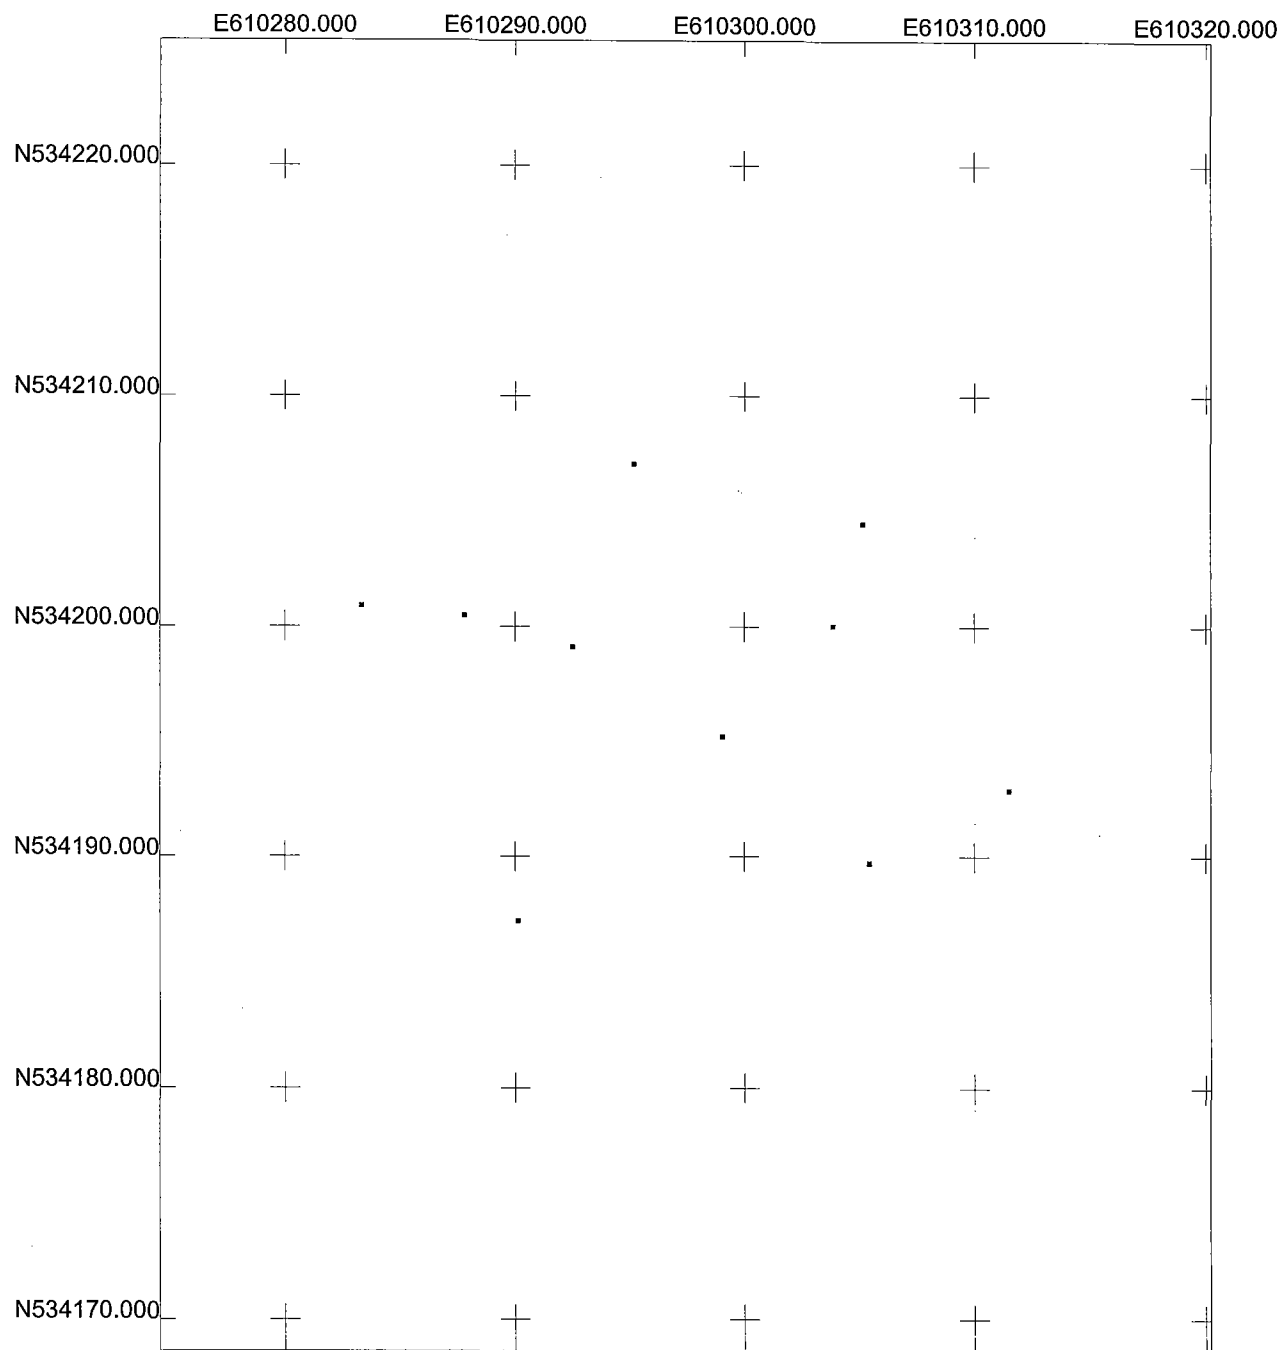

Bldg. 2043 UST Site Samples GPS Map

US State Plane 1983
New Jersey (NY East) 2900
NAD 1983 (Conus)



Scale 1:100
0 12.50
US Survey Feet

r020316a2043.cor
7/13/2000
Pathfinder Office
 **Trimble**

BLDG. 2043 UST SITE SAMPLES GPS POSITIONS & COORDINATES

US STATE PLANE 1983 NJ (NY EAST) 2900 NAD 1983 (CONUS)


(IN US SURVEY FEET)

SAMPLE POINTS

<u>POSITION / DESC</u>	<u>Y COORD. (NORTHING)</u>	<u>X COORD. (EASTING)</u>
2043 1 (4/28/98)	534200.491	610287.759
2043 2, 4 (4/28/98)	534199.158	610292.467
2043 3 (4/28/98)	534200.938	610283.298
2043 1, 2 (2/19/99)	534187.273	610290.088
2043 3 (2/19/99)	534207.103	610295.166
2043 4 (2/19/99)	534204.516	610305.129
2043 5 (2/19/99)	534189.763	610305.416
2043 6 (2/19/99)	534195.224	610298.998


REFERENCE POINTS

<u>POSITION / DESC</u>	<u>Y COORD. (NORTHING)</u>	<u>X COORD. (EASTING)</u>
2043 CORNER	534192.922	610311.476
2043 CORNER	534200.072	610303.825

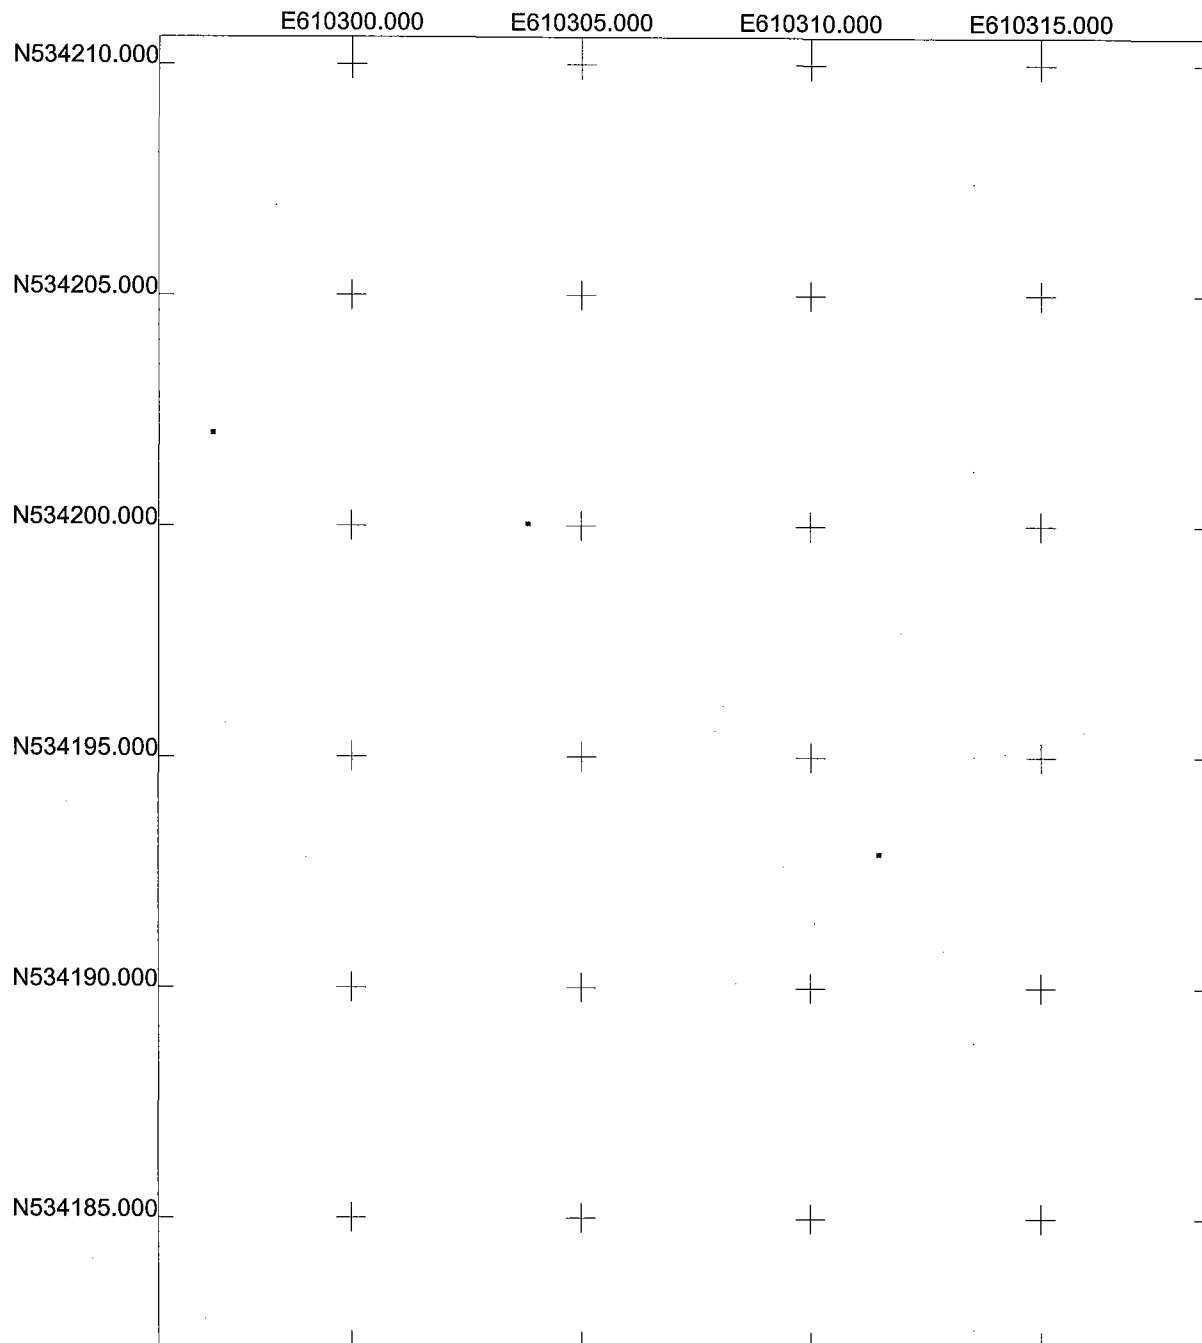

Bldg. 2043 UST Ground Water Sample GPS Map

US State Plane 1983
New Jersey (NY East) 2900
NAD 1983 (Conus)



gw r020316a2043.cor
7/13/2000
Pathfinder Office
 Trimble

BLDG. 2043 UST GROUND WATER SAMPLE GPS POSITION & COORDINATES

US STATE PLANE 1983 NJ (NY EAST) 2900 NAD 1983 (CONUS)

(IN US SURVEY FEET)

SAMPLE POINTS

<u>POSITION / DESC.</u>	<u>Y COORD. (NORTHING)</u>	<u>X COORD. (EASTING)</u>
2043 GW	534202.037	610296.986

(GW denotes Ground Water)

REFERENCE POINTS

<u>POSITION / DESC.</u>	<u>Y COORD. (NORTHING)</u>	<u>X COORD. (EASTING)</u>
2043 CORNER	534192.922	610311.476
2043 CORNER	534200.072	610303.825